



Addendum No.: 3

Date Of Addendum: July 05, 2017

CT DAS • Construction Services • Process Management and Procurement Unit

State Veterans' Cemetery Phase II Expansion
317 Bow Lane, Middletown, CT 06457
BI - C - 293 / FAI CT-16-03

Original Bid Due Date / Time:

July 12, 2017

1:00 PM

Previous Addendums: Addendum #2 dated June 30, 2017, Addendum #1 dated June 22, 2017

TO: Prospective Bid Proposers:

This Addendum forms part of the "Contract Documents" and modifies or clarifies the original "Contract Documents" for this Project dated 05/24/2017. Prospective Bid Proposers shall acknowledge receipt of the total number the Addenda issued for this Project on the space provided on Section 00 41 00 Bid Proposal Form.

Failure to acknowledge receipt of the total number the Addenda issued for this Project on the space provided on Section 00 41 00 Bid Proposal Form shall subject Bid Proposers to disqualification.

The following clarifications are applicable to drawings and specifications for the project referenced above.

Item 1:

Question: "Drawing C.03A shows Supplemental Bid Item #1 to Add Pre-Placed Concrete Crypts. Spec Section 01.23 00 SUPPLEMENTAL BIDS says to add 1040 double depth cypts within the boundary. Please clarify the quantity. Also please provide location map or section numbers. It wasnt clear if this supplemental bid is in addition to what is already shown on the drawing."

Answer: Supplemental Bid Item #1 contains 1,040 double depth crypts. The boundary of this area is identified on the plans with the line labeled "SBI #1" on Sheet C.03A containing section numbers 96 through 105.

Item 2:


ADD drawing sketches SKC.01 and SKC.02 (attached) to clarify details of the water meter pit identified on Sheet C.04B of the Contract Documents.

All questions must be in writing (not phone or e-mail) and must be forwarded to the consulting Architect/Engineer (Diversified Technology Consultants, Inc. Attn: Michael Errickson, PE, Fax: 203-234-7376) with copies sent to the DAS Project Manager (Sarah Tierney, Fax (860) 622-2965).

End of Addendum 3

Mellanee Walton, Associate Fiscal Administrative Officer
State of Connecticut

Department of Administrative Services, Construction Services
Process Management and Procurement Unit
450 Columbus Boulevard, Suite 1302
Hartford, CT 06103

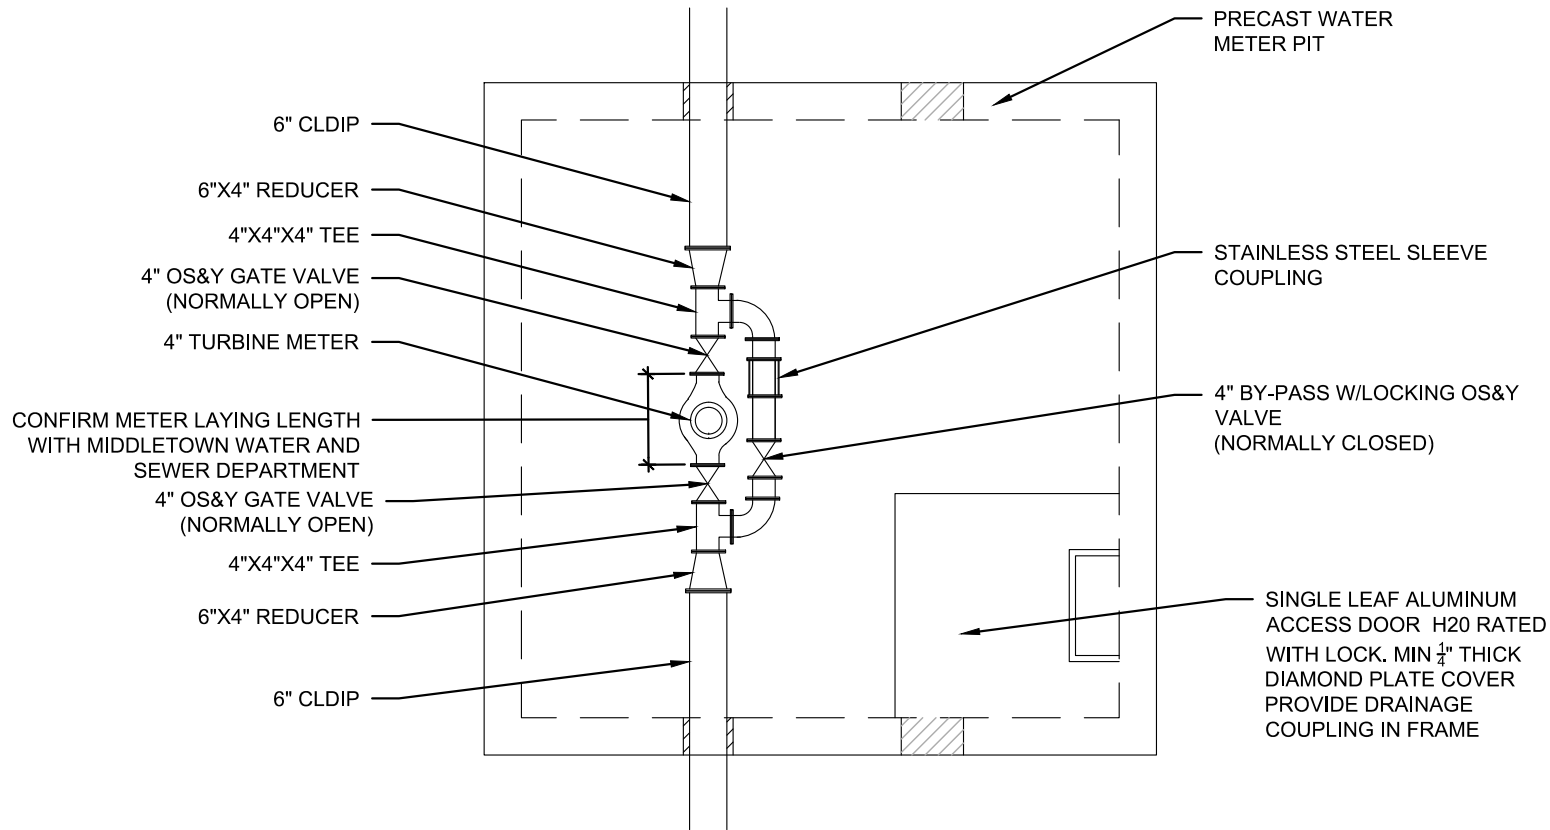

1 WATER METER PIT DETAIL

NTS


NOTES:

1. ALL FITTINGS INSIDE VAULT ARE FLANGED UNLESS OTHERWISE NOTED.
2. LOCATION, SIZE, CONTENTS SUBJECT TO FINAL APPROVAL BY CITY OF MIDDLETOWN WATER AND SEWER DEPARTMENT
3. IT IS THE CONTRACTORS RESPONSIBILITY TO COORDINATE WITH THE CITY OF MIDDLETOWN WATER AND SEWER DEPARTMENT.

SHEET ADDED PER ADDENDUM 3 JULY 05 2017

STATE OF CONNECTICUT DEPARTMENT OF ADMINISTRATIVE SERVICES

drawing prepared by		DTC, INC.		date	07/05/2017
		2321 WHITNEY AVENUE, SUITE 301 HAMDEN, CT		scale	NTS
project		STATE VETERAN'S CEMETERY PHASE II EXPANSION		drawn by	CJS
		MIDDLETOWN, CT		approved by	MDE
CAD no.		project no.		drawing no.	SKC.01
		BI-C-293 / FAI CT-16-03			

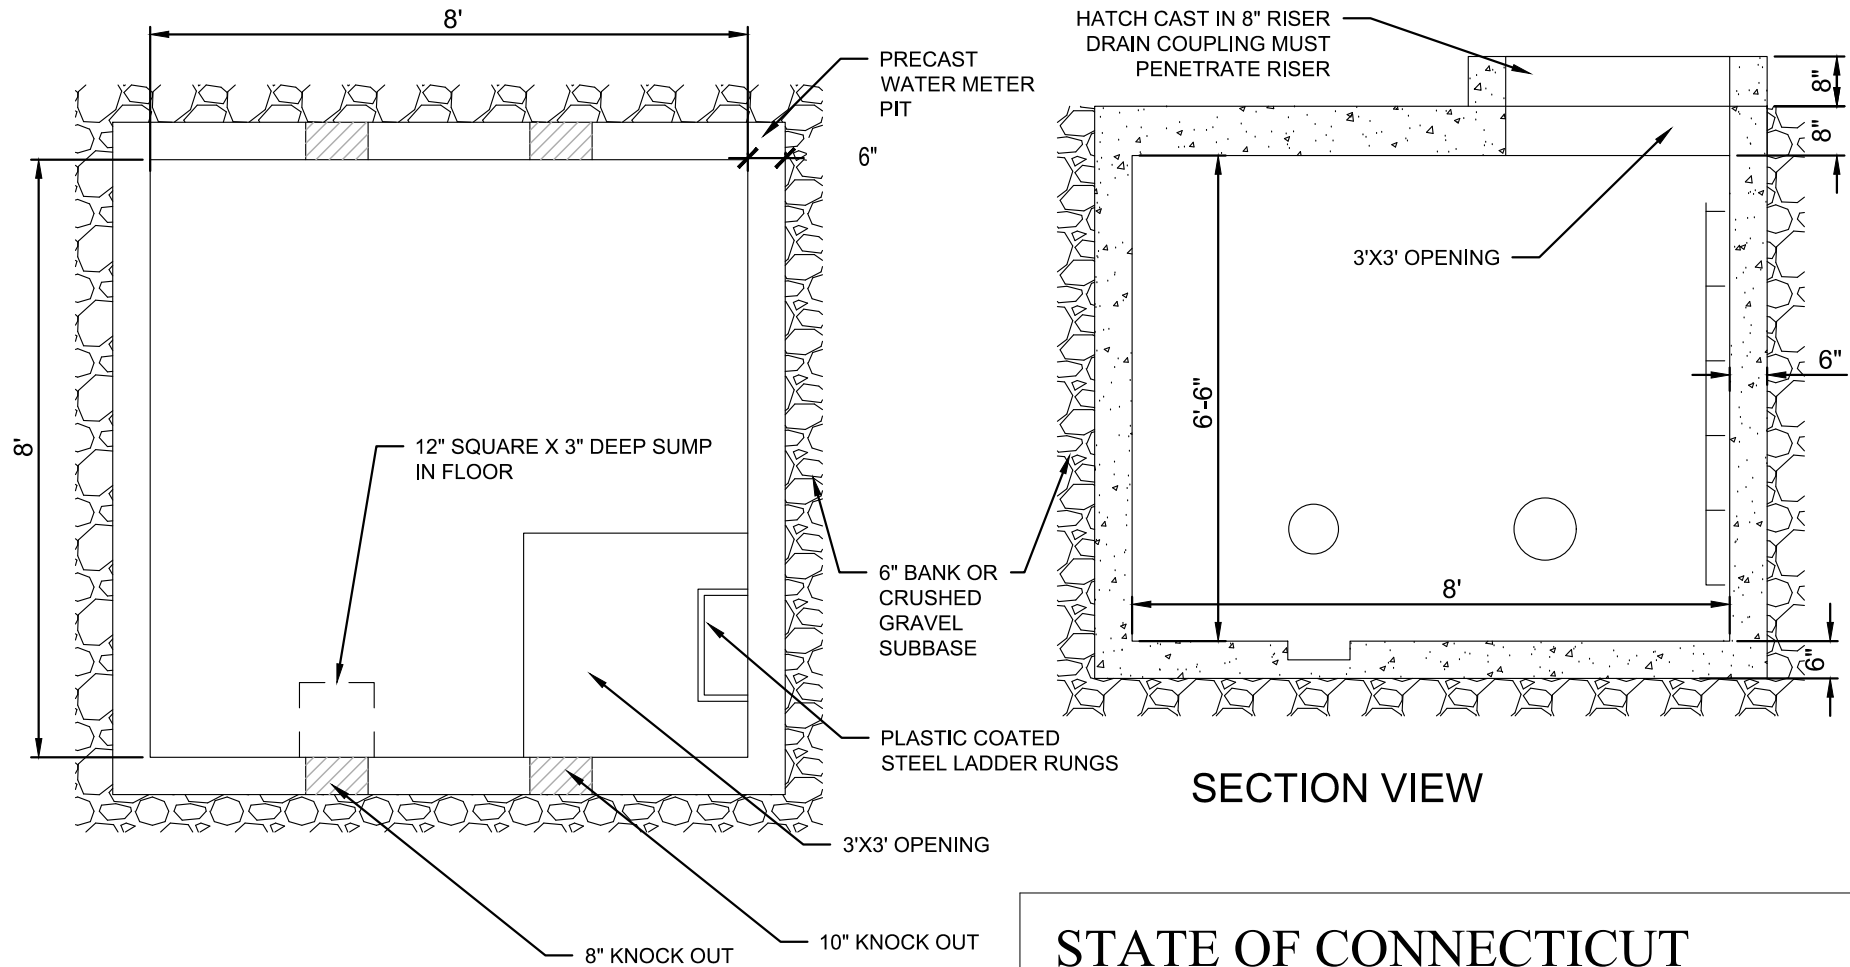

SECTION VIEW

1 WATER METER PIT DETAIL
NTS

- NOTES:
1. JOINT SEALANT IS BUTYL RUBBER MASTIC TYPE SEAL THAT CONFORMS TO LATEST AASHTO SPECIFICATION M-198 MEETS FEDERAL SEPECIFICATION SS-S-0021 (210-A)
 2. BASE SECTION IS MONOLITHIC
 3. THE CHAMBER SHOULD CONFORM WITH AASHTO H-20

STATE OF CONNECTICUT DEPARTMENT OF ADMINISTRATIVE SERVICES	
drawing prepared by	DTC, INC. 2321 WHITNEY AVENUE, SUITE 301 HAMDEN, CT
date	07/05/2017
scale	NTS
project	STATE VETERAN'S CEMETERY PHASE II EXPANSION MIDDLETOWN, CT
drawn by	CJS
approved by	MDE
drawing no.	SKC.02
CAD no. NTS	project no. BI-C-293 / FAI CT-16-03

SHEET ADDED PER ADDENDUM 3 JULY 05 2017