

TABLE OF CONTENTS OF SPECIAL PROVISIONS

Note: This Table of Contents has been prepared for the convenience of those using this contract with the sole express purpose of locating quickly the information contained herein; and no claims shall arise due to omissions, additions, deletions, etc., as this Table of Contents shall not be considered part of the contract.

Table of Contents

COMBINED PROJECTS.....	5
CONTRACT TIME AND LIQUIDATED DAMAGES.....	5
NOTICE TO CONTRACTOR – RECENT REVISIONS.....	6
NOTICE TO CONTRACTOR – SITE NO. ASSOCIATIONS.....	8
NOTICE TO CONTRACTOR – PRE-BID QUESTIONS AND ANSWERS.....	9
NOTICE TO CONTRACTOR – INSTALLATION QUALIFICATIONS FOR.....	10
COMPUTERIZED TRAFFIC SIGNAL SYSTEM (CTSS) EQUIPMENT.....	10
NOTICE TO CONTRACTOR – CONSTRUCTION CONTRACTOR.....	12
DIGITAL SUBMISSIONS.....	12
NOTICE TO CONTRACTOR – GLOBAL POSITIONING SYSTEM (GPS).....	13
COORDINATES FOR SIGNS.....	13
NOTICE TO CONTRACTOR – FEDERAL WAGE DETERMINATIONS (Davis Bacon Act).....	14
NOTICE TO CONTRACTOR – ALL-INCLUSIVE DRAINAGE.....	15
NOTICE TO CONTRACTOR – PORTLAND CEMENT CONCRETE (PCC).....	16
MIX CLASSIFICATIONS.....	16
NOTICE TO CONTRACTOR – ARCHITECTURAL AND INDUSTRIAL.....	17
MAINTENANCE COATINGS.....	17
NOTICE TO CONTRACTOR – HAZARDOUS MATERIALS INVESTIGATIONS.....	20
NOTICE TO CONTRACTOR – ASBESTOS CONTAMINATED SOIL AND.....	21
ENVIRONMENTAL INVESTIGATIONS.....	21
NOTICE TO CONTRACTOR – RAYMARK SUPERFUND SITE.....	23
NOTICE TO CONTRACTOR – ELECTRONIC ENGINEERING DATA (EED).....	24
NOTICE TO CONTRACTOR – 1.05 CONTROL OF THE WORK.....	25
NOTICE TO CONTRACTOR – SPAN WIRES, SPAN POLES AND SPAN.....	26
POLE FOUNDATIONS.....	26
NOTICE TO CONTRACTOR – TRAFFIC SIGNALS.....	27
SECTION 1.02 – PROPOSAL REQUIREMENTS AND CONDITIONS.....	29
SECTION 1.03 – AWARD AND EXECUTION OF CONTRACT.....	30
SECTION 1.05 – CONTROL OF THE WORK.....	31
SECTION 1.06 – CONTROL OF MATERIALS.....	36
SECTION 1.07 – LEGAL RELATIONS AND RESPONSIBILITIES.....	38
SECTION 1.08 – PROSECUTION AND PROGRESS.....	41
SECTION 2.86 - DRAINAGE TRENCH EXCAVATION, ROCK IN.....	44
DRAINAGE TRENCH EXCAVATION.....	44
SECTION 4.06 BITUMINOUS CONCRETE.....	48
SECTION 5.86 - CATCH BASINS, MANHOLES AND DROP INLETS.....	71
SECTION 6.03 – STRUCTURAL STEEL.....	75
SECTION 6.86 - DRAINAGE PIPES, DRAINAGE PIPE ENDS.....	76
SECTION 10.00 – GENERAL CLAUSES FOR HIGHWAY.....	80
ILLUMINATION AND TRAFFIC SIGNAL PROJECTS.....	80
SECTION 12.00 – GENERAL CLAUSES FOR HIGHWAY SIGNING.....	82
SECTION M.03 PORTLAND CEMENT CONCRETE.....	84
SECTION M.04 BITUMINOUS CONCRETE MATERIALS.....	92
SECTION M.06 – METALS.....	112
ON THE JOB TRAINING (OJT) WORKFORCE DEVELOPMENT PILOT.....	115
D.B.E. SUBCONTRACTORS AND MATERIAL SUPPLIERS OR MANUFACTURERS.....	119
ITEM #0020806A – DISPOSAL OF ASBESTOS CONTAMINATED SOIL.....	131
ITEM #0020808A – DUST AND ASBESTOS FIBER CONTROL.....	137
ITEM #0097773A – SPARE PARTS.....	140
ITEM #0101021A – ENVIRONMENTAL HEALTH AND SAFETY –.....	142
ASBESTOS CONTAMINATED SOIL.....	142
ITEM #0101124A – DECONTAMINATION.....	154

ITEM #0202451A – TEST PIT EXCAVATION	158
ITEM #0202513A – REMOVAL OF CONCRETE SIDEWALK.....	159
ITEM #0202530A – REMOVAL OF BITUMINOUS SIDEWALK.....	159
ITEM #0406125A – BITUMINOUS CONCRETE SURFACE PATCH	160
ITEM #0601020A – STAMPED CONCRETE.....	163
ITEM #0755017A – GEOTEXTILE - HAZARDOUS WASTE	168
ITEM #0905019A – REMOVE AND REBUILD EXISTING STONE WALL.....	170
ITEM #0921007A – SPECIAL CONCRETE SIDEWALK	171
ITEM #0925101A – RELAY BRICK WALK	173
ITEM #0952001A – SELECTIVE CLEARING AND THINNING	174
ITEM #0969062A – CONSTRUCTION FIELD OFFICE, MEDIUM	175
ITEM #0971001A – MAINTENANCE AND PROTECTION OF TRAFFIC.....	183
ITEM #0992090A – BENCH.....	217
ITEM #1001001A – TRENCHING AND BACKFILLING	218
ITEM #1002201A – TRAFFIC CONTROL FOUNDATION - SPAN POLE	219
ITEM #1002202A – TRAFFIC CONTROL FOUNDATION - MAST ARM.....	230
ITEM #1002291A – MODIFICATION OF TRAFFIC CONTROL FOUNDATION.....	241
ITEM #1008015A – 2” RIGID METAL CONDUIT – SURFACE.....	242
ITEM #1008115A – 2” RIGID METAL CONDUIT IN TRENCH	242
ITEM #1008215A – 2” RIGID METAL CONDUIT UNDER ROADWAY	242
ITEM #1008908A – CLEAN EXISTING CONDUIT	244
ITEM #1010060A – CLEAN EXISTING CONCRETE HANDHOLE	245
ITEM #1015034A – GROUNDING AND BONDING.....	246
ITEM #1017032A – SERVICE (METERED)	248
ITEM #1102002A – 8’ ALUMINUM PEDESTAL.....	250
ITEM #1102048A – 8’ ORNAMENTAL ALUMINUM PEDESTAL.....	251
ITEM #1103022A – 30’ STEEL SPAN POLE.....	252
ITEM #1103023A – 32’ STEEL SPAN POLE.....	252
ITEM #1103024A – 34’ STEEL SPAN POLE.....	252
ITEM #1103002A – STEEL COMBINATION SPAN POLE	252
ITEM #1114102A – SPAN WIRE	252
ITEM #1104026A – 25’ STEEL MAST ARM ASSEMBLY.....	268
ITEM #1104028A – 30’ STEEL MAST ARM ASSEMBLY.....	268
ITEM #1104033A – 40’ STEEL MAST ARM ASSEMBLY.....	268
ITEM #1104038A – 50’ STEEL MAST ARM ASSEMBLY.....	268
ITEM #1104039A – 55’ STEEL MAST ARM ASSEMBLY.....	268
ITEM #1105001A – 1 WAY, 1 SECTION SPAN WIRE TRAFFIC SIGNAL.....	285
ITEM #1105003A – 1 WAY, 3 SECTION SPAN WIRE TRAFFIC SIGNAL.....	285
ITEM #1105101A – 1 WAY, 1 SECTION MAST ARM TRAFFIC SIGNAL.....	285
ITEM #1105103A – 1 WAY, 3 SECTION MAST ARM TRAFFIC SIGNAL.....	285
ITEM #1105180A – 1 WAY, 1 SECTION BI-COLORED ARROW	285
ITEM #1105203A – 1 WAY, 3 SECTION POLE MOUNTED TRAFFIC SIGNAL	285
ITEM #1105303A – 1 WAY, 3 SECTION PEDESTAL MOUNTED TRAFFIC	285
SIGNAL.....	285
ITEM #1106001A – 1 WAY PEDESTRIAN SIGNAL POLE MOUNTED	291
ITEM #1106003A – 1 WAY PEDESTRIAN SIGNAL PEDESTAL MOUNTED	291
ITEM #1106004A – 2 WAY PEDESTRIAN SIGNAL PEDESTAL MOUNTED	291
ITEM #1107011A – ACCESSIBLE PEDESTRIAN SIGNAL AND	294
DETECTOR (TYPE A)	294
ITEM #1108115A – FULL ACTUATED CONTROLLER 8 PHASE	299
ITEM #1108163A – MODIFY EXISTING CONTROLLER.....	313
ITEM #1108207A – INSTALL STATE FURNISHED TRAFFIC	314
CONTROLLER AND CABINET.....	314

ITEM #1108665A – 10/100/1000BASE - T ETHERNET SWITCH.....	316
ITEM #1108725A – PHASE SELECTOR (MODIFIED)	321
ITEM #1112413A – DETECTOR (TYPE A) (MODIFIED)	321
ITEM #1112471A – PRE-EMPTION SYSTEM CHASSIS (MODIFIED)	321
ITEM #1113552A – DETECTOR CABLE (OPTICAL) (MODIFIED)	321
ITEM #1108808A – TRAINING	326
ITEM #1108826A – OPTICAL FIBER TERMINATION PATCH PANELS	327
ITEM #1111201A – TEMPORARY DETECTION (SITE NO. 1)	332
ITEM #1111202A – TEMPORARY DETECTION (SITE NO. 2)	332
ITEM #1111203A – TEMPORARY DETECTION (SITE NO. 3)	332
ITEM #1111204A – TEMPORARY DETECTION (SITE NO. 4)	332
ITEM #1111205A – TEMPORARY DETECTION (SITE NO. 5)	332
ITEM #1111206A – TEMPORARY DETECTION (SITE NO. 6)	332
ITEM #1111207A – TEMPORARY DETECTION (SITE NO. 7)	332
ITEM #1111208A – TEMPORARY DETECTION (SITE NO. 8)	332
ITEM #1111209A – TEMPORARY DETECTION (SITE NO. 9)	332
ITEM #1111210A – TEMPORARY DETECTION (SITE NO. 10)	332
ITEM #1111211A – TEMPORARY DETECTION (SITE NO. 11)	332
ITEM #1111212A – TEMPORARY DETECTION (SITE NO. 12)	332
ITEM #1111213A – TEMPORARY DETECTION (SITE NO. 13)	332
ITEM #1111214A – TEMPORARY DETECTION (SITE NO. 14)	332
ITEM #1111215A – TEMPORARY DETECTION (SITE NO. 15)	332
ITEM #1111216A – TEMPORARY DETECTION (SITE NO. 16)	332
ITEM #1111217A – TEMPORARY DETECTION (SITE NO. 17)	332
ITEM #1111470A – TIME CLOCK	337
ITEM #1112242A – FIBER OPTIC SPLICE ENCLOSURE (SIGNAL)	338
ITEM #1112284A – VEHICLE DETECTION MONITOR	344
ITEM #1112285A – THERMAL VIDEO DETECTOR ASSEMBLY	346
ITEM #1113901A – CAMERA CABLE	346
ITEM #1111600A – EXTENSION BRACKET.....	350
ITEM #1112286A – 360-DEGREE CAMERA ASSEMBLY	350
ITEM #1112287A – 360-DEGREE VIDEO DETECTION PROCESSOR.....	350
ITEM #1113725A – 23 AWG 4 TWISTED PAIR CATEGORY 6 CABLE	350
ITEM #1112288A – IP VIDEO DETECTION CAMERA ASSEMBLY	366
ITEM #1113398A – CABLE CLOSURE (TYPE A)	371
ITEM #1113431A – #16 AWG, 6 TWISTED PAIR COMMUNICATION CABLE	372
ITEM #1113550A – DETECTOR CABLE (OPTICAL)	374
ITEM #1113604A – OPTICAL FIBER CABLE, SINGLE MODE, LOOSE	379
BUFFER TUBE CABLE, 6 FIBER.....	379
ITEM #1113618A – OPTICAL FIBER CABLE, SINGLE MODE, LOOSE	379
BUFFER TUBE CABLE, 36 FIBER.....	379
ITEM #1114201A – AUXILIARY EQUIPMENT CABINET.....	396
ITEM #1116110A – BLANK-OUT SIGN.....	397
ITEM #1118012A – REMOVAL AND/OR RELOCATION OF TRAFFIC	399
SIGNAL EQUIPMENT.....	399
ITEM #1118051A – TEMPORARY SIGNALIZATION (SITE NO. 1)	403
ITEM #1118052A – TEMPORARY SIGNALIZATION (SITE NO. 2)	403
ITEM #1118053A – TEMPORARY SIGNALIZATION (SITE NO. 3)	403
ITEM #1118054A – TEMPORARY SIGNALIZATION (SITE NO. 4)	403
ITEM #1118055A – TEMPORARY SIGNALIZATION (SITE NO. 5)	403
ITEM #1118056A – TEMPORARY SIGNALIZATION (SITE NO. 6)	403
ITEM #1118057A – TEMPORARY SIGNALIZATION (SITE NO. 7)	403
ITEM #1118058A – TEMPORARY SIGNALIZATION (SITE NO. 8)	403

ITEM #1118059A – TEMPORARY SIGNALIZATION (SITE NO. 9)403

ITEM #1118060A – TEMPORARY SIGNALIZATION (SITE NO. 10)403

ITEM #1118071A – TEMPORARY SIGNALIZATION (SITE NO. 11)403

ITEM #1118072A – TEMPORARY SIGNALIZATION (SITE NO. 12)403

ITEM #1118073A – TEMPORARY SIGNALIZATION (SITE NO. 13)403

ITEM #1118074A – TEMPORARY SIGNALIZATION (SITE NO. 14)403

ITEM #1118075A – TEMPORARY SIGNALIZATION (SITE NO. 15)403

ITEM #1118076A – TEMPORARY SIGNALIZATION (SITE NO. 16)403

ITEM #1118077A – TEMPORARY SIGNALIZATION (SITE NO. 17)403

ITEM #1118303A – RELOCATE PRE-EMPTION SYSTEM (SITE NO. 3)410

ITEM #1118304A – RELOCATE PRE-EMPTION SYSTEM (SITE NO. 4)410

ITEM #1118305A – RELOCATE PRE-EMPTION SYSTEM (SITE NO. 5)410

ITEM #1118306A – RELOCATE PRE-EMPTION SYSTEM (SITE NO. 6)410

ITEM #1118310A – RELOCATE PRE-EMPTION SYSTEM (SITE NO. 10)410

ITEM #1118311A – RELOCATE PRE-EMPTION SYSTEM (SITE NO. 11)410

ITEM #1118312A – RELOCATE PRE-EMPTION SYSTEM (SITE NO. 12)410

ITEM #1118313A – RELOCATE PRE-EMPTION SYSTEM (SITE NO. 13)410

ITEM #1118316A – RELOCATE PRE-EMPTION SYSTEM (SITE NO. 16)410

ITEM #1206023A – REMOVAL AND RELOCATION OF EXISTING SIGNS.....414

ITEM #1208931A – SIGN FACE - SHEET ALUMINUM (TYPE IX
RETROREFLECTIVE SHEETING)415

PERMITS AND/OR REQUIRED PROVISIONS417

October 9, 2019
FEDERAL AID PROJECT NOS. 000T(147) and 0001(357)
STATE PROJECT NOS. 173-468 and 138-250

Revision and Replacement of Traffic Control Signals with APS Upgrades in District 3

Cities of Bridgeport, Milford, New Haven and West Haven
Towns of East Haven, Fairfield, Madison, North Haven, Stratford, and Westport
Federal Aid Project Nos. 000T(147) and 0001(357)

The State of Connecticut, Department of Transportation, Standard Specifications for Roads, Bridges, Facilities and Incidental Construction, Form 817, 2016, as revised by the Supplemental Specifications dated January 2019 (otherwise referred to collectively as "ConnDOT Form 817") is hereby made part of this contract, as modified by the Special Provisions contained herein. Form 817 is available at the following DOT website link <http://www.ct.gov/dot/cwp/view.asp?a=3609&q=430362>. The current edition of the State of Connecticut Department of Transportation's "Construction Contract Bidding and Award Manual" ("Manual"), is hereby made part of this contract. If the provisions of this Manual conflict with provisions of other Department documents (not including statutes or regulations), the provisions of the Manual will govern. The Manual is available at the following DOT website link <http://www.ct.gov/dot/cwp/view.asp?a=2288&q=259258>. The Special Provisions relate in particular to the Revision and Replacement of Traffic Control Signals with APS Upgrades in District 3 in the Cities of Bridgeport, Milford, New Haven and West Haven; and in the Towns of East Haven, Fairfield, Madison, North Haven, Stratford, and Westport.

COMBINED PROJECTS

There will be but one Contract for Federal Aid Project No. 000T(147) (State Project No. 0173-0468) and Federal Aid Project No. 0001(357) (State Project No. 0138-0250). The two projects will be considered as a single contract in all respects.

CONTRACT TIME AND LIQUIDATED DAMAGES

For Federal Aid Project No. 000T(147) (State Project No. 0173-0468) and Federal Aid Project No. 0001(357) (State Project No. 0138-0250), Five Hundred Twenty-Six (526) calendar days will be allowed for completion of the work and the liquidated damages charge to apply will be Two Thousand Dollars (\$ 2,000.00) per calendar day.

NOTICE TO CONTRACTOR – RECENT REVISIONS

The Contractor is hereby notified that the following Traffic Engineering Special Provisions have been revised:

Section 10.00 – General Clauses for Highway Illumination and Traffic Signal Projects

- Updated as-built plan requirements

1105xxxA – X_Way_X_Section Traffic Signal:

- Changed the color of housing, brackets, and hardware
- Clarified color of housing door and visor.
- Backplates:
 - changed to louvered
 - changed retroreflective strip sheeting type
 - changed aluminum alloy to 5052-H32
 - provided range for acceptable thickness

1106xxxA – X_Way_Pedestrian Signal:

- Changed the color of housing, brackets, and hardware
- Clarified color of housing door and visor

1107007A – Pedestrian Pushbutton and Sign (Piezo)

- Changed the color of housing, brackets, and hardware

1107011A – Accessible Pedestrian Signal and Detector (Type A)

- Changed the color of housing, brackets, and hardware
- Changed the sign size to 9” x 15”
- Changed to include confirmation light

1112286A – 360 Degree Camera Assembly

1112288A – IP Video Detection Camera Assembly

- Added installation best practices guide

The Contractor is hereby notified that Traffic Engineering’s following Standard Sheets have been revised:

TR-1105_01 – Traffic Signals and Cable Assignments

- Revised grounding note for span and other minor revisions

TR-1107_01 – Pedestrian Push Buttons

- Updated pedestrian sign legends and notes.

TR-1114_01 – Bonding and Utility Pole Attachment Details, Sign Hanger, “Y” Clamp Detail

- Revised wood pole grounding details, added ground rod.

The Contractor is hereby notified that Traffic Engineering's following guide sheets are included:

GS_Light Standard and Foundation

- Added J-Hook Mounting Detail.
- Added Aluminum Light Standard Base showing Grounding Lug Detail.

GS_Trenching and Backfilling

- Revised Pavement – Bituminous Concrete or Overlaid Portland Cement Concrete
- Revised granular fill and overlay requirements.

NOTICE TO CONTRACTOR – SITE NO. ASSOCIATIONS

The Contractor is hereby notified that the below table shows the Site No. and corresponding Intersections pertaining to the installation of new signals and maintenance of traffic signal operations are required when relevant, as part of this contract.

Site No.	Intersection No.	Description
1	015-267	Bridgeport - Route 730 (Huntington Turnpike) at Broadbridge Road
2	043-221	East Haven - Route 100 (Main Street) at Thompson Avenue and High Street
3	050-201	Fairfield - U.S. Route 1 (Boston Post Road) at Route 135 (North Benson Road) and South Benson Road
4	050-207	Fairfield - U.S. Route 1 (Boston Post Road) at Ruane Street and Heritage Square Driveway
5	075-204	Madison - U.S. Route 1 (Boston Post Road) at East Wharf Road and Scotland Avenue
6	075-220	Madison - U.S. Route 1 (Boston Post Road) at Samson Rock Road and Wall Street
7	083-237 083-244	Milford - Route 162 (New Haven Avenue & South Broad Street) at North Broad Street, River Street, and Factory Lane & Route 162 (New Haven Avenue) at Prospect Street and Shipyard Lane
8	092-241	New Haven - Route 80 (Foxon Boulevard) at Route 103 (Quinnipiac Avenue) and Quinnipiac Avenue
9	092-242	North Haven - U.S. Route 5 & 22 (Washington Street) at U.S. Route 5 & 22 (Bishop Street), Rt 22 (Clintonville road), & Rt 103 (Washington Avenue)
10	100-205	North Haven - U.S. Route 5 & 22 (Washington Street) at U.S. Route 5 & 22 (Bishop Street), Rt 22 (Clintonville road), & Rt 103 (Washington Avenue)
11	138-201	Stratford - U.S. Route 1 (Boston Avenue) at Bruce Avenue
12	138-250	Stratford - Route 110 (East Main Street) at Drive to Dock Shopping Center and Stratford Crossing
13	138-276	Stratford - U.S. Route 1 (Barnum Avenue) at Soundview Avenue & Mary Avenue
14	156-212	West Haven - Route 162 (Saw Mill Road/Wagner Place) at Elm Street
15	156-218	West Haven - Route 162 (Jones Hill Road) at Colonial Boulevard and Morgan Lane
16	158-213	Westport - U.S. Route 1 (Post Road East) at Taylor Place and Main Street
17	138-240 138-241 138-242	Stratford - U.S. Route 1 NB (Ferry Blvd) at Cutoff to East Main St & U.S. Route 1 (Barnum Avenue Cutoff) at East Drive Dock Shopping Center & Humphrey's Driveway & U.S. Route 1 SB (Barnum Avenue Cutoff) at Cutoff from U.S. Route 1 NB

NOTICE TO CONTRACTOR – PRE-BID QUESTIONS AND ANSWERS

Questions pertaining to DOT advertised construction projects must be presented through the CTDOT Pre-Bid Q and A Website. The Department cannot guarantee that all questions will be answered prior to the bid date. **PLEASE NOTE - at 9:00 am Monday (i.e. typical Wednesday Bid Opening) the project(s) being bid will be closed for questions, at which time questions can no longer be submitted through the Q and A Website.**

Answers may be provided by the Department up to 12:00 noon, the day before the bid. At this time, the Q and A for those projects will be considered final, unless otherwise stated and/or the bid is postponed to a future date and time to allow for further questions and answers to be posted.

If a question needs to be asked the day before the bid date, please contact the Contracts Unit staff and email your question to dotcontracts@ct.gov immediately.

Contractors must identify their company name, contact person, contact email address and phone number when asking a question. The email address and phone number will not be made public.

The questions and answers (if any) located on the Q and A Website are hereby made part of the bid/contract solicitation documents (located on the State Contracting Portal), and resulting contract for the subject project(s). It is the bidder's responsibility to monitor, review, and become familiar with the questions and answers, as with all bid requirements and contract documents, prior to bidding. By signing the bid proposal and resulting contract, the bidder acknowledges receipt of, and agrees to the incorporation of the final list of Q and A, into the contract document.

Contractors will not be permitted to file a future claim based on lack of receipt, or knowledge of the questions and answers associated with a project. All bidding requirements and project information, including but not limited to contract plans, specifications, addenda, Q and A, Notice to Contractors, etc., are made public on the State Contracting Portal and/or the CTDOT website.

NOTICE TO CONTRACTOR – INSTALLATION QUALIFICATIONS FOR COMPUTERIZED TRAFFIC SIGNAL SYSTEM (CTSS) EQUIPMENT

All management, construction, installation, and inspection services shall be performed by individuals who have performed the same job function on at least two (2) previously completed construction and installation communication projects of comparable size and complexity.

Approval of Fiber-Optic Cable Installation, Splicing and Testing:

Each Contractor or Subcontractor performing the work involved with installing, splicing and testing of cable and electronic communication systems shall provide references and resumes of staff that shall meet the following requirements:

Satisfactory completion of at least three (3) fiber-optic based communication projects in the last five (5) years. Experience shall be in related fiber optic systems for installers involving single-mode cables in excess of three (3) miles (4.8 kilometers).

The Contractor shall provide a list of each fiber-optic based communications project and/or intelligent transportation system project which the Contractor has performed, including a description of each project, the location of each project, inclusive dates of when the work was performed on each project, and a contact reference for each project listed. Each of the referenced projects shall include completing a minimum of three (3) single-mode, optical fiber cable fusion splices, and installation of at least twenty-five (25) optical connectors on single-mode optical fibers. As a minimum, the contact reference shall include an individual's name, training certificates (including updated licenses), title, and current telephone number.

All Contractor personnel involved in the placing, splice preparation and splicing of fiber optic cable shall meet or exceed the above referenced installation qualifications and shall be approved by the Office of Highway Operations. Under no circumstance will unqualified, unapproved Contractor personnel be allowed to work on the CTSS Equipment.

Approval of ITS Systems Integrator:

The proposed ITS Systems Integrator performing the work described in these Special Provisions which are involved with supplying, installing, configuring and testing of electronic communication systems for the Traffic signal cabinet, shall provide a printed document (nine copies) that contains the proposed ITS Systems Integrator's experience in the areas noted below, as well as references and resumes for staff proposed to perform the project work. The document should clearly indicate how the proposed ITS Systems Integrator meets the following requirements:

- Experience involving at least seven (7) ITS system integration projects with overall system responsibility and accountability, each employing at least 8 traffic signal sites or ITS camera sites.
- Knowledge and experience with video encoder compression equipment involving at least ten sites, comprising video compression algorithms including but not limited to: H.264, MPEG2, MPEG4, and MJPEG used for traffic signal or highway transportation purposes.
- Experience using various communication test equipment including: Fiber Optic Spectrum Analyzer, OTDR, BERT, Protocol Analyzer, and Oscilloscope.
- Demonstrate a general working knowledge of serial communications interfaces such as RS-232, RS-422, RS-485, RS-530, and RS-449.
- Demonstrate extensive experience configuring Ethernet layer 2 and layer 3 managed Ethernet switches including but not limited to: TCP/IP routing schemes, Rapid Spanning Tree Protocol, link aggregation protocols, VLAN configurations, and Quality of Service.

The document for the CTSS Equipment Fiber-Optic Cable Installation, Splicing and Testing Qualifications and ITS Systems Integrator shall be submitted for approval within ten (10) days of the Contract Award to:

Mr. John F. Korte
Connecticut Department of Transportation
Bureau of Highway Operations
2800 Berlin Turnpike P.O. Box 317456
Newington, Connecticut 06131-7546

These requirements shall apply to the following contract item installations:

- Optical Fiber Cable, Single Mode, Loose Buffered Tube Cable, 6-Fiber, 36-Fiber
- Fiber Optic Cable Splice Enclosures (Signal)
- Optical Fiber Termination Patch Panel
- Video detection encoding equipment
- 10/100/1000 Base – T Ethernet Switch

The Contractor shall not start work on the CTSS Equipment until the Contractor receives approval from the Department. This document shall be submitted to the department for review and approval before any CTSS Equipment project work may proceed.

NOTICE TO CONTRACTOR – CONSTRUCTION CONTRACTOR
DIGITAL SUBMISSIONS

Upon execution of the Contract, the Contractor acknowledges and agrees that contractual submittals for this Project shall be submitted and handled through a system of paperless electronic means as outlined in the special provision for Section 1.05 herein.

Shop drawings, working drawings, and product data shall be created, digitally signed and delivered by the Contractor in accordance with the Department's [Contractor Digital Submission Manual](#) (CDSM). Other deliverables that are required by other special provisions shall be similarly submitted.

Access credentials will be provided to the Contractor by the Department.

The Department will provide the Contractor with a list of email addresses that are to be used for each submittal type.

The Department shall not be held responsible for delays, lack of processing or response to submittals that do not follow the specified guidelines in the CDSM.

**NOTICE TO CONTRACTOR – GLOBAL POSITIONING SYSTEM (GPS)
COORDINATES FOR SIGNS**

The Contractor shall obtain and provide to the Engineer sign installation data, including Global Positioning System (GPS) latitude and longitude coordinates, for all new State owned and maintained signs. The Engineer shall forward the sign data to the Division of Traffic Engineering for upload into the Highway Sign Inventory and Maintenance Management Program (SIMS). Sign data submissions or questions relating to SIMS or GPS shall be sent to DOT-SignInventory@ct.gov. Refer to the special provision for Section 12.00 General Clauses For Highway Signing.

NOTICE TO CONTRACTOR – FEDERAL WAGE DETERMINATIONS (Davis Bacon Act)

The following Federal Wage Determinations are applicable to this Federal- Aid contract and are hereby incorporated by reference. During the bid advertisement period, it is the bidder’s responsibility to obtain the latest Federal wage rates from the US Department of Labor website, as may be revised 10 days prior to bid opening. Any revisions posted 10 days prior to the bid opening shall be the wage determinations assigned to this contract.

Check Applicable WD# (DOT Use Only)	WD#	Construction Type	Counties
X	CT1	Highway	Fairfield, Litchfield, Middlesex, New Haven, Tolland, Windham
	CT2	Highway	New London
	CT3	Highway	Hartford
	CT5	Heavy Dredging (Hopper Dredging)	Fairfield, Middlesex, New Haven, New London
	CT6	Heavy Dredging	Statewide
	CT13	Heavy	Fairfield
	CT14	Heavy	Hartford
	CT15	Heavy	Middlesex, Tolland
	CT16	Heavy	New Haven
	CT17	Heavy	New London
	CT26	Heavy	Litchfield, Windham
	CT18	Building	Litchfield
	CT19	Building	Windham
	CT20	Building	Fairfield
	CT21	Building	Hartford
	CT22	Building	Middlesex
	CT23	Building	New Haven
	CT24	Building	New London
	CT25	Building	Tolland
	CT4	Residential	Litchfield, Windham
	CT7	Residential	Fairfield
	CT8	Residential	Hartford
	CT9	Residential	Middlesex
	CT10	Residential	New Haven
	CT11	Residential	New London
	CT12	Residential	Tolland

The Federal wage rates (Davis-Bacon Act) applicable to this Contract shall be the Federal wage rates that are current on the US Department of Labor website (<http://www.wdol.gov/dba.aspx>) as may be revised 10 days prior to bid opening. The Department will no longer physically include revised Federal wage rates in the bid documents or as part of addenda documents. These applicable Federal wage rates will be incorporated in the final contract document executed by both parties. If a conflict exists between the Federal and State wage rates, the higher rate shall govern.

To obtain the latest Federal wage rates, go to the US Department of Labor website (link above). Under Davis-Bacon Act, choose “Selecting DBA WDs” and follow the instruction to search the latest wage rates for the State, County and Construction Type.

NOTICE TO CONTRACTOR – ALL-INCLUSIVE DRAINAGE

ADDED SECTIONS:

2.86 – DRAINAGE TRENCH EXCAVATION

ROCK IN DRAINAGE TRENCH EXCAVATION

5.86 – CATCH BASINS, MANHOLES AND DROP INLETS

6.86 – DRAINAGE PIPES

DRAINAGE PIPE ENDS

This Contract contains the above-noted Special Provisions for all-inclusive drainage, developed to replace the following Sections in their entireties:

- Section 5.07 – *Catch Basins, Manholes and Drop Inlets*
- Section 6.51 – *Culverts*
- Section 6.52 – *Culvert Ends*

The Section 5.86 and 6.86 items include excavation and bedding material in the drainage structure, pipe and pipe end unit prices.

Section 2.05 *Trench Excavation* may be included for miscellaneous trenching, where necessary, but will not be used with all-inclusive drainage items.

Other Standard Specifications, Supplemental Specifications or Special Provisions may contain references to Articles or Subarticles from previous versions of Sections 5.07, 6.51 and 6.52 which are no longer valid.

The following Standard Specifications Sections or Supplements contain references to Articles or Subarticles from Section 2.05 which shall remain in effect:

- Section 2.06 – *Ditch Excavation*
- Section 5.06 – *Retaining Walls, Endwalls and Steps*
- Section 7.51 – *Underdrains and Outlets*
- Section 10.01 – *Trenching and Backfilling*

‘Rock in Drainage Trench Excavation’ is now defined in Section 2.86. ‘Rock in Trench Excavation’ will remain in Section 2.05 and may be used with trenching not associated with all-inclusive drainage items.

Any references to Articles beginning with “5.07,” “6.51,” or “6.52” shall refer to the pertinent topic or materials in the new Special Provisions contained herein.

NOTICE TO CONTRACTOR – PORTLAND CEMENT CONCRETE (PCC) MIX CLASSIFICATIONS

SECTIONS 6.01 and M.03 MIX CLASSIFICATION EQUIVALENCY

Sections 6.01 *Concrete for Structures* and M.03 *Portland Cement Concrete* are herein revised to reflect changes to item names and nomenclature for standard Portland Cement Concrete (PCC) mix classifications. Other Special Provisions, standard specifications, plan sheets and select pay items in this Contract may not reflect this change. Refer to the Concrete Mix Classification Equivalency Table below to associate the Concrete Mix Classifications with Former Mix Classifications that may be present elsewhere in the Contract.

Concrete Mix Classification Equivalency Table

New Mix Classification (Class PCCXXYZ ¹)	Former Mix Classification
Class PCC03340	Class “A”
Class PCC03360	Class “C”
Class PCC04460 ²	Class “F”
Class PCC04462 ²	High Performance Concrete
Class PCC04481, PCC05581	Class “S”

Table Notes:

1. See Table M.03.02-1, Standard Portland Cement Concrete Mixes, for the new Mix Classification naming convention.
2. Class PCC04462 (low permeability concrete) is to be used for the following cast-in-place bridge components: decks, bridge sidewalks, and bridge parapets.

Where called for in the Contract, **Low Permeability Concrete** shall be used, as specified in Sections 6.01 and M.03. Please pay special attention to the requirements for Class PCC04462, including:

- Submittal of a mix design developed by the Contractor and a concrete supplier **at least 90 days prior to placing the concrete**
- Testing and trial placement of the concrete mix to be developed and discussed with the Department

The Department will not consider any requests for change to eliminate the use of Low Permeability Concrete on this Project.

NOTICE TO CONTRACTOR – ARCHITECTURAL AND INDUSTRIAL MAINTENANCE COATINGS

This Contract includes the application of materials subject to the Volatile Organic Compounds (VOC) content limits stated in the Regulations of Connecticut State Agencies (RCSA) Sections 22a-174-41 and -41a. All architectural and industrial maintenance (AIM) coatings and applications of such coatings must comply with these regulations.

The Contractor shall submit a Material Safety Data Sheet/Safety Data Sheet or Product Technical Data Sheet developed by the manufacturer of each material that may be subject to the Regulations. The submittal must verify both the type of AIM and its VOC Content. VOC content shall be determined based on the formulation data supplied by the materials manufacturer.

The Contractor may only use AIM coatings that contain VOCs below the respective coating category Phase II limits specified in Table 1 if either:

- a) the coating was manufactured on or after May 1, 2018, **or**
- b) the coating is being applied after April 30, 2021.

The Contractor may use AIM coatings that contain VOCs exceeding the respective coating category Phase II limits specified in Table 1 only if all of the following four conditions are met:

- a) the coating is being applied on or before April 30, 2021,
- b) the coating contains VOCs below the applicable Phase I limits specified in Table 1,
- c) the coating was manufactured prior to May 1, 2018, **and**
- d) the coating container(s) are dated (or date coded) as such.

For any coating that is not categorized within Table 1, the Contractor shall classify the coating as follows and apply corresponding limits in Table 1.

- Registers gloss <15 on an 85-degree meter or <5 on a 60-degree meter) – Flat Coating,
- Registers gloss of ≥ 15 on an 85-degree meter and ≥ 5 on a 60-degree meter) - Nonflat Coating,
- Registers gloss of ≥ 70 on a 60-degree meter - Nonflat-High Gloss Coating.

The Contractor must close all containers of coating and solvent when not in use.

Coating container labels must display the date the coating was manufactured, the manufacturer's recommendation regarding thinning with solvent, and the coating's VOC content in grams per liter (g/L) of coating. Certain coating categories as noted in Table 1 have additional labeling requirements.

The Contractor may add additional solvent to a coating only if such addition does not cause the coating to exceed the applicable VOC limit specified Table 1. The Contractor must adhere to type(s) of solvent and maximum amount of solvent recommended by coating manufacturer. VOC content of a thinned coating shall be the VOC content as listed by the manufacturer after thinning in accordance with its recommendation.

TABLE 1		
Coating Category	Phase I	Phase II
	manufactured prior to May 1, 2018 VOC content limit (g/L)	manufactured on or after May 1, 2018 VOC content limit (g/L)
Aluminum roof coating	--- ¹	450
Antenna coating	530	--- ¹
Antifouling coating	400	--- ¹
Basement specialty coating	--- ¹	400
Bituminous roof coating	300	270
Bituminous roof primer	350	350
Bond breaker	350	350
Calcimine recoater	475	475
Clear wood coating - Clear brushing lacquer ²	680	275
Clear wood coating - Lacquer ^{2,3}	550	275
Clear wood coating - Sanding sealer ^{2,4}	350	275
Clear wood coating - Varnish ²	350	275
Concrete curing compound	350	350
Concrete or masonry sealer/ Waterproofing concrete or masonry sealer	400	100
Concrete surface retarder	780	780
Conjugated oil varnish	--- ¹	450
Conversion varnish	725	725
Driveway sealer	--- ¹	50
Dry fog coating	400	150
Faux finishing coating ²	350	350
Fire resistive coating	350	350
Fire retardant coating - Clear	650	--- ¹
Fire retardant coating - Opaque	350	--- ¹
Flat coating	100	50
Floor coating	250	100
Flow coating	420	--- ¹
Form-release compound	250	250
Graphic arts coating (sign paint)	500	500
High temperature coating	420	420
Impacted immersion coating	780	780
Industrial maintenance coating ²	340	250
Industrial maintenance coating	340	250
Low solids coating	120	120
Magnesite cement coating	450	450
Mastic texture coating	300	100
Metallic pigmented coating	500	500

TABLE 1		
Coating Category	Phase I	Phase II
	manufactured prior to May 1, 2018 VOC content limit (g/L)	manufactured on or after May 1, 2018 VOC content limit (g/L)
Multi-color coating	250	250
Nonflat coating	150	100
Nonflat high gloss coating²	250	150
Nuclear coating	450	450
Pre-treatment wash primer	420	420
Primer, sealer and undercoater	200	100
Quick-dry enamel	250	--- ¹
Quick-dry primer, sealer and undercoater	200	--- ¹
Reactive penetrating carbonate stone sealer²	--- ¹	500
Reactive penetrating sealer²	--- ¹	350
Recycled coating	250	250
Roof coating	250	250
Rust preventive coating²	400	250
Shellac Clear	730	730
Shellac Opaque	550	550
Specialty primer, sealer and undercoater²	350	100
Stain	250	250
Stone consolidant²	--- ¹	450
Swimming pool coating	340	340
Thermoplastic rubber coating and mastic	550	550
Traffic marking coating	150	100
Traffic marking coating	150	100
Tub and tile refinish	--- ¹	420
Waterproofing membrane	--- ¹	250
Waterproofing sealer	250	--- ¹
Wood coating²	--- ¹	275
Wood preservative	350	350
Zinc-rich primer²	--- ¹	340

1 Classify as follows and apply corresponding limits in Table 1.

- Registers gloss <15 on an 85-degree meter or <5 on a 60-degree meter) – Flat Coating,
- Registers gloss of ≥15 on an 85-degree meter and ≥5 on a 60-degree meter) – Nonflat Coating
- Registers gloss of ≥70 on a 60-degree meter – Nonflat-High Gloss Coating

2 Container must be appropriately labeled. See RCSA 22a-174-41a

3 “Clear Wood Coating – Lacquer” includes lacquer sanding sealer

4 “Clear Wood Coating - Sanding Sealer” does not include lacquer sanding sealer

-END-

NOTICE TO CONTRACTOR – HAZARDOUS MATERIALS INVESTIGATIONS

Limited hazardous materials site investigations have been conducted at twenty (20) Traffic Signal Intersection Sites in District 3, Connecticut. The inspections were limited to the representative components projected for impact.

Lead paint is **presently presumed** or has been identified on various metal traffic components (i.e. span poles, pedestrian crosswalk push button & hoods, traffic lights themselves and control cabinets).

Traffic lights, crosswalk signal lamp hoods/connectors, crosswalk push buttons, controller cabinets, etc. with identified or presumed lead painted surfaces shall be removed in a manner as to not impact the lead paint (unbolt, cut non-painted surfaces, etc.) and to not generate lead paint waste. Any paint waste generated from the lead painted metal traffic components at the Intersection Sites listed above, the metal traffic lights themselves or the controller cabinets should be tested for TCLP lead to determine proper waste disposal (hazardous vs. non-hazardous).

All steel and metal generated from work tasks (painted or not) shall be segregated and recycled as scrap metal at a scrap metal recycling facility. The recycling of scrap metal (regardless of lead paint concentration) is exempt from USEPA RCRA and CTDEEP Hazardous Waste Regulation.

No suspect asbestos containing materials to be impacted were identified at any of the Intersection Sites. USEPA/CTDPH/OSHA define an asbestos containing material (ACM) as any material greater than one percent (> 1%) by weight. Asbestos contaminated soil (ACS) (soil/sediment contaminated with asbestos fibers) was identified within the project limits and additional information can be found in the **Notice to Contractor – Asbestos Contaminated Soil & Environmental Investigations**.

Potential universal waste (UW) and Connecticut Regulated Waste (CRW) items associated with the traffic lights themselves, crosswalk signal hoods/buttons and controller cabinets (i.e. Hg lamps/PCB ballasts and/or printed circuit boards) are also likely present at the Intersection Sites.

The Contractor is hereby notified that these hazardous materials requiring special management or disposal procedures will be encountered during various construction activities conducted within the project limits. The Contractor will be required to implement appropriate health and safety measures for all construction activities impacting these materials.

The Contractor shall review any lead paint requirements within the Contract documents.

The Contractor is alerted to the fact that a Department environmental consultant may be on site for abatement and related activities, to collect environmental samples (if necessary), and to observe site conditions for the State.

Information pertaining to the results of the limited hazardous materials investigation discussed can be found in the document listed below. This document shall be available for review electronically.

- HazMat Inspection – Seventeen (17) District 3 Traffic Signal Intersections, Various Cities/Towns, CT, August 7, 2019
- HazMat Inspection – Eleven (11) Traffic Signal Intersection Sites, District 3, CT, August 16, 2017

NOTICE TO CONTRACTOR – ASBESTOS CONTAMINATED SOIL AND ENVIRONMENTAL INVESTIGATIONS

Environmental site investigations have been conducted that involved the sampling and laboratory analysis of soil collected from within the Project Limits. The results of the investigations indicate the presence of **asbestos contaminated soil (ACS)** at some locations. ACS consists of soil contaminated with asbestos fibers, which is separate and distinct from soil contaminated with asbestos containing material (ACM) from a regulatory perspective.

ACS was found at Intersection numbers 138-240, 138-241 and 138-242 (Rte. 1/Ferry Blvd/Barnum Ave. Cutoff at the Dock Shopping Center) and Intersection 138-275 (Rte. 1 at Rte. 110). While not confirmed through the most recent in-situ testing, ACS is also presumed present in soils at Intersection 138-250 Rte. 110 at the Dock Shopping Center and the Stratford Crossing Shopping Center except for soils directly above the impermeable membrane cap associated with the Raymark Superfund Site. Please refer to the Notice to Contractor – Raymark Superfund Site for more information related to Superfund Site work restrictions.

In addition, VOCs, extractable total petroleum hydrocarbons (ETPH), polynuclear aromatic hydrocarbons (PAHs), and RCRA metals (arsenic, lead and chromium) are present in the soil within this area. Based on the recent investigation results, as well as other investigations conducted adjacent to and in close vicinity of the Project, the intersections named above have been collectively identified as an ACS AOEC.

The Contractor is hereby notified of the following and shall refer to the Project Specifications for additional details:

- For the purposes of health and safety, ACS is considered present at Intersections 138-240, 138-241, 138-242, 138-250 (except as noted above) and 138-275. Decontamination, dewatering, HASP implementation and soil management shall be planned accordingly. **WORKER HEALTH AND SAFETY PROTOCOLS WHICH ADDRESS POTENTIAL AND/OR ACTUAL RISK OF EXPOSURE TO SITE SPECIFIC HAZARDS ARE SOLELY THE RESPONSIBILITY OF THE CONTRACTOR.**
- The Contractor will be responsible for establishing asbestos Regulated Areas in accordance with 29 CFR 1926.1101. Entry into said area(s) must be strictly controlled and work performed such that people outside the area are protected from exposure.
- Equipment and materials exposed to ACS and any ACS-impacted items shall not be removed from a Regulated Area until properly decontaminated.
- The Contractor will design and implement a rigorous Air Monitoring Plan to address the risk of exposure to asbestos for both on-site workers and that of individuals beyond the regulated area throughout the duration of the Project.

- If asbestos containing materials (ACM) are discovered during construction activities, work shall cease immediately until proper procedures complying with OSHA, EPA and CT Department of Public Health (DPH) regulations can be implemented.
- All excavated trenches within the ACS AOECs shall be lined with a demarcation layer prior to backfilling with clean backfill to facilitate future maintenance work.
- The Contractor is alerted to the fact that a Department environmental consultant will be on-site for excavation activities involving ACS to collect soil and dewatering/decontamination wastewater samples (if necessary), and to observe site conditions for the State.

The Sections which shall be reviewed by the Contractor include, but are not limited to, the following:

- Item No. 0020806A – Disposal of Asbestos Contaminated Soil
- Item No. 0020808A – Dust and Asbestos Fiber Control
- Item No. 0101021A – Environmental Health and Safety – Asbestos Contaminated Soil
- Item No. 0101124A – Decontamination
- Item No. 0755017A – Geotextile – Hazardous Waste

Information pertaining to the results of the environmental investigations discussed above can be found in the documents listed below. These documents shall be available for review on the Project portal in ProjectWise.

- Task 210 – Subsurface Site Investigation Report, Stratford Signalization Project – ConnDOT Project Number 0173-0461, Stratford, Connecticut. TRC, February 2018.
- Task 210 – Subsurface Site Investigation Report, Stratford Signalization Project – ConnDOT Project Number 0173-0468, Stratford, Connecticut. TRC, August 2019.
- Task 210 – Subsurface Site Investigation Report, I-95 Interchange 33, Stratford, Connecticut. TRC, September 2017.

NOTICE TO CONTRACTOR – RAYMARK SUPERFUND SITE

The Contractor shall note that a portion of the Project is located within the limits of the Raymark Industries, Inc. Superfund Site (Raymark). The Raymark Industries facility was located at what is now 150-350 Barnum Ave. Cutoff, Stratford. This is the site of the present-day Stratford Crossing Shopping Center, located on the western side of Intersection 138-250.

Work on this site will necessitate coordination with regulatory authorities and restrictions of work methods. Details regarding work on this site can be found in article 1.07.13.

Additional information pertaining to the results of the environmental investigations can be found in the Notice to Contractor – Asbestos Contaminated Soil and Environmental Investigations.

NOTICE TO CONTRACTOR – ELECTRONIC ENGINEERING DATA (EED)

The EED is an assembly of engineering data files that were used to produce the Contract plans.

Electronic Engineering Data (EED) is provided for information purposes only. In case of conflict between the EED and the Contract plans and specifications, the contract plans and specifications shall govern. The EED has been reviewed by the Department for quality control purposes, but it is the Contractor's responsibility to build the Project per the contract plans and specifications.

The EED is being provided to the Engineer for GPS/RTS inspection. The Contractor may use the EED to assist in bidding, layout and Automated Machine Control/Guidance.

The EED includes geospatially-correct 2D CAD files and may include horizontal and vertical alignment data files, 3D surface model files (break-line features and triangles) and a preference file. The data is being provided in two formats:

- Native Format
 - Bentley MicroStation CAD files (dgn)
 - Bentley SS2 InRoads Alignment Files (alg)
 - Bentley SS2 InRoads Digital Terrain Models (dtm)
 - Bentley SS2 InRoads Preference File (xin)
- Converted Format (for use in GPS/RTS Site equipment)
 - AutoCAD CAD files (dxf)
 - Alignment files (xml)
 - Surface Models (xml)

For a complete list of EED files, see the EED file manifest (PDF) located in the EED_0173-0468.zip file which is posted with the contract PS&E's on the State Contracting portal.

NOTICE TO CONTRACTOR – 1.05 CONTROL OF THE WORK

1.05.03 - CONFORMITY WITH PLANS AND SPECIFICATIONS (INCLUDING QUALITY CONTROL)

The Contractor is hereby notified that a Quality Management Plan will be required for this Project in conformance with Standard Specifications (Supplemented July 2017) Article 1.05.03 – “Conformity with Plans and Specifications (including Quality Control).”

NOTICE TO CONTRACTOR – SPAN WIRES, SPAN POLES AND SPAN POLE FOUNDATIONS

The Contractor is notified that the Contract includes special provisions for the span wire, steel span pole, and span pole foundation items that require the submittal of working drawings and calculations for each span wire structure configuration.

NOTICE TO CONTRACTOR – TRAFFIC SIGNALS

The Contractor is hereby notified that certain conditions pertaining to the installation of new signals and maintenance of traffic signal operations are required when relevant, as part of this contract.

Qualified/Unqualified Workers

U.S. Department of Labor

Occupational Safety & Health Administration (OSHA) www.osha.gov

Part Number 1910

Part Title Occupational Safety & Health Administration

Subpart S

Subpart Title Electrical

Standard Number 1910.333

Title Selection and use of work practices

Completion of this project will require Contractor employees to be near overhead utility lines. All workers and their activities when near utility lines shall comply with the above OSHA regulations. In general, unqualified workers are not allowed within 10 feet of overhead, energized lines. It is the contractor's responsibility to ensure that workers in this area are qualified in accordance with OSHA regulations.

The electric distribution company is responsible to provide and install all necessary anchors and guy strands on utility poles. It is the Contractors responsibility to coordinate with the utility company to ensure proper placement of the anchor.

For utility poles owned and maintained by Frontier Communications:

Frontier will be responsible to provide and install the pole anchor. The installation of the guy wire will be the responsibility of the Contractor and should follow Frontier specifications.

The Controller Unit (CU) shall conform to the current edition of the Functional Specifications for Traffic Control Equipment. The Functional Specifications require the CU meet NEMA Standard Publication No. TS2-1992 Type 2. The Functional Specifications are available on the Departments' web site <http://www.ct.gov/dot/site/default.asp>, click on "Doing Business with CONNDOT", under Engineering Resources click on "Traffic Engineering", Scroll down to Traffic Documents click on "Functional_Specifications_for_Traffic_Control_Equip.pdf".

Utility poles cannot be double loaded without proper guying.

The contractor will be held liable for all damage to existing equipment resulting from his or his subcontractor's actions. A credit will be deducted from monies due the Contractor for all maintenance calls responded to by Department of Transportation personnel.

The Contractor must install permanent or temporary spans in conjunction with utility company relocations. He then must either install the new signal equipment and controller or relocate the existing equipment.

The 30 Day Test on traffic control equipment, as specified in Section 10.00, Article 10.00.10 - TESTS, will not begin until the items listed below are delivered to the Department of Transportation, Traffic Signal Lab in Rocky Hill.

Five (5) sets of cabinet wiring diagrams. Leave one set in the controller cabinet.
All spare load switches and flash relays.

SECTION 1.02 – PROPOSAL REQUIREMENTS AND CONDITIONS

Article 1.02.01 – Contract Bidding and Award:

After the first sentence of the third paragraph, add the Following:

In accordance with the provisions of the Construction Contract Bidding and Award Manual, bidders must be prequalified for Group No. 13, to be eligible to bid on this project. Bidders that are not prequalified for this work classification will not be approved to bid on this project.

Article 1.02.04 – Examination of Plans, Specifications, Special Provisions and Site of Work:

Replace the third sentence of the last paragraph with:

The Department cannot ensure a response to inquiries received later than ten (10) days prior to the original scheduled opening of the related bid.

SECTION 1.03 – AWARD AND EXECUTION OF CONTRACT

Article 1.03.07 – Insurance:

After 18. Compensation: add:

19. **Contractor's Pollution Liability Insurance:** In addition to all other insurance requirements, the Contractor shall procure and maintain coverage for the duration of this Contract, for pollution legal liability (Contractor's Pollution Liability) including investigation and legal defense, for bodily injury and property damage. Such insurance shall provide coverage for both on Site and off Site cleanup costs. Coverage shall be for minimum limits of \$1,000,000 per occurrence and \$1,000,000 annual aggregate.

Article 1.03.08 - Notice to Proceed and Commencement of Work:

Change the first paragraph to read as follows:

"The Contractor shall commence and proceed with the Contract work on the date specified in a written notice to proceed issued by the Engineer to the Contractor. The date specified will be no later than 45 calendar days after the date of the execution of the Contract by the Department".

SECTION 1.05 – CONTROL OF THE WORK

Replace Article 1.05.02 with the following:

1.05.02—Contractor Submittals, Working Drawings, Shop Drawings, Product Data, Submittal Preparation and Processing - Review Timeframes, Department’s Action:

1. Contractor Submittals: The plans provided by the Department show the details necessary to give a comprehensive idea of the construction contemplated under the Contract. The plans will generally show the location, character, dimensions, and details necessary to complete the Project. If the plans do not show complete details, they will show the necessary dimensions and details, which when used along with the other Contract documents, will enable the Contractor to prepare working drawings, shop drawings or product data necessary to complete the Project.

The Contractor shall prepare submittals as Portable Document Format (PDF) files. The Contractor is also required to acquire, maintain access and use the Department’s document management system for delivery of submittals. The format, digital signing requirements, delivery processes and document tracking procedures shall be performed in accordance with this specification and the [Contractor’s Digital Submission Manual](#) (CDSM).

The submittals shall be sent to the Department’s reviewer(s), sufficiently in advance of the work detailed, to allow for their review in accordance with the review periods as specified herein (including any necessary revisions, resubmittal, and final review), and acquisition of materials, without causing a delay of the Project.

2. Working Drawings: When required by the Contract or when ordered to do so by the Engineer, the Contractor shall prepare and submit the working drawings, signed, sealed and dated by a qualified Professional Engineer licensed to practice in the State of Connecticut, for review. The drawings shall be delivered sufficiently in advance of the work detailed, to allow for their review in accordance with the review periods specified herein (including any necessary revisions, resubmittal, and final review).

There will be no direct payment for furnishing any working drawings, procedures or supporting calculations, but the cost thereof shall be considered as included in the general cost of the work.

a. Working Drawings for Permanent Construction: The Contractor shall supply to the Assistant District Engineer a certificate of insurance in accordance with 1.03.07 at the time that the working drawings for the Project are submitted.

The Contractor’s designer, who prepares the working drawings, shall secure and maintain at no direct cost to the State a Professional Liability Insurance Policy for errors and omissions in the minimum amount of \$2,000,000 per error or omission. The Contractor’s designer may elect to obtain a policy containing a maximum \$250,000 deductible clause, but if the Contractor’s designer should obtain a policy containing such a clause, they shall be liable to the extent of at

least the deductible amount. The Contractor's designer shall obtain the appropriate and proper endorsement of its Professional Liability Policy to cover the indemnification clause in this Contract, as the same relates to negligent acts, errors or omissions in the Project work performed by them. The Contractor's designer shall continue this liability insurance coverage for a period of

- (i) 3 years from the date of acceptance of the work by the Engineer, as evidenced by a State of Connecticut, Department of Transportation form entitled "Certificate of Acceptance of Work," issued to the Contractor; or
- (ii) 3 years after the termination of the Contract, whichever is earlier, subject to the continued commercial availability of such insurance.

b. Working Drawings for Temporary Construction: The Contractor shall submit drawings, calculations, procedures and other supporting data to the Assistant District Engineer.

3. Shop Drawings: When required by the Contract, or when ordered to do so by the Engineer, the Contractor shall prepare and deliver shop drawings to the Designer for review. Review timeframes and submission locations are as specified herein.

There will be no direct payment for furnishing any shop drawings, but the cost thereof shall be considered as included in the general cost of the work.

4. Product Data: When required by the Contract, or when ordered to do so by the Engineer, the Contractor shall prepare and deliver product data.

The Contractor shall submit the product data in a single submittal for each element or group of elements of construction.

The Contractor shall mark each copy of the product data submittal to show applicable choices and options. Where product data includes information on several products that are not required, copies shall be marked to indicate the applicable information. Product data shall include the following information and confirmation of conformance with the Contract to the extent applicable: manufacturer's printed recommendations, compliance with recognized trade association standards, compliance with recognized testing agency standards, application of testing agency labels and seals, notation of coordination requirements, Contract item number, and any other information required by the individual Contract provisions.

There will be no direct payment for furnishing any product data, but the cost thereof shall be considered as included in the general cost of the work.

5. Contract Items:

- a. **Traffic Signal Items:** When required by the Contract or when ordered by the Engineer, the Contractor shall prepare and submit product data sheets, working drawings and/or shop drawings for all traffic signal items, except Steel Span Poles and Mast Arm Assemblies when applicable, to the Division of Traffic Engineering for approval before fabrication. The packaged set of product data sheets, working drawings or shop drawings shall be submitted

in an electronic portable document format (PDF).

The PDF packaged set shall be in an individual file with appropriate bookmarks for each item. The electronic files for product data sheets shall be created on ANSI A (8 1/2 inch × 11 inch, letter) sheets. Working drawings and shop drawings shall be created on ANSI B (11 inch × 17 inch, ledger/tabloid) sheets.

The PDF documents for Traffic Signal items shall be sent via email to:

DOT.TrafficElectrical@ct.gov

- b. **Steel Span Poles and Mast Arm Assembly Items:** When these items are included in the Contract, the submission for Steel Span Poles and Mast Arm Assemblies shall follow the Traffic Signal Items format and be sent to the “Engineer of Record” as described in the Steel Span Pole and Steel Mast Arm Assembly Guide Sheets and special provisions in the Contract.
- c. **Illumination Items:** When these items are included in the Contract, the packaged set of product data sheets, working drawings and/or shop drawings shall be submitted in an electronic portable document format (PDF). All approvals of disapprovals and comments will be returned in one package.

The PDF packaged set submitted shall be in an individual file with appropriate bookmarks for each item. The electronic files for shop drawings shall be created on ANSI A (8 1/2 inch × 11 inch, letter) sheets.

The PDF documents for Illumination items shall be sent via email to:

<mailto:jon.andrews@ct.gov>

- d. **Incident Management System and Computerized Traffic Signal System Items:** When required by the Contract or when ordered by the Engineer, the Contractor shall prepare and submit product data sheets, working drawings and/or shop drawings for all Incident Management System (IMS) related items to the Bureau of Highway Operations for approval before fabrication.

IMS related items include multiduct conduit, pullboxes, fiber optic and communications cables, cabinets, cameras, camera lowering devices, variable message signs (VMS), traffic flow monitors (TFM) and telecommunications related equipment.

Computerized Traffic Signal System (CTSS) related items include fiber optic and communications cables, fiber optic splice enclosure and optical fiber termination patch panel, and Ethernet switch.

The packaged set of product data sheets, working drawings and/or shop drawings shall be

submitted in an electronic portable document format (PDF).

The PDF documents for IMS and CTSS related items shall be sent via email to:

John.Korte@ct.gov and Robert.Kennedy@ct.gov

6. Submittal Preparation and Processing – Review Timeframes: The Contractor shall allow 30 calendar days for submittal review by the Department, from the date receipt is acknowledged by the Department’s reviewer. For any submittals marked with “Revise and Resubmit” or “Rejected,” the Department is allowed an additional 20 calendar days for review of any resubmissions.

An extension of Contract time will not be authorized due to the Contractor’s failure to transmit submittals sufficiently in advance of the work to permit processing.

The furnishing of shop drawings, working drawings or product data, or any comments or suggestions by the Designer or Engineer concerning shop drawings, working drawings or product data, shall not relieve the Contractor of any of its responsibility for claims by the State or by third parties, as per 1.07.10.

The furnishing of the shop drawings, working drawings and product data shall not serve to relieve the Contractor of any part of its responsibility for the safety or the successful completion of the Project construction.

7. Department’s Action: The Designer or Engineer will review each submittal, mark each with a self-explanatory action stamp, and return the stamped submittal promptly to the Contractor. The Contractor shall not proceed with the part of the Project covered by the submittal until the submittal is marked “No Exceptions Noted” or “Exceptions as Noted” by the Designer or Engineer. The Contractor shall retain sole responsibility for compliance with all Contract requirements. The stamp will be marked as follows to indicate the action taken:

- a. If submittals are marked “No Exceptions Noted,” the Designer or Engineer has not observed any statement or feature that appears to deviate from the Contract requirements. This disposition is contingent on being able to execute any manufacturer’s written warranty in compliance with the Contract provisions.
- b. If submittals are marked “Exceptions as Noted” the considerations or changes noted by the Department’s Action are necessary for the submittal to comply with Contract requirements. The Contractor shall review the required changes and inform the Designer or Engineer if they feel the changes violate a provision of the Contract or would lessen the warranty coverage.
- c. If submittals are marked “Revise and Resubmit,” the Contractor shall revise the submittals to address the deficiencies or provide additional information as noted by the Designer or Engineer. The Contractor shall allow an additional review period as specified in 1.05.02-5.
- d. If submittals are marked “Rejected,” the Contractor shall prepare and submit a new submittal in accordance with the Designer’s or Engineer’s notations. The resubmissions require an additional review and determination by the Designer or Engineer. The

Contractor shall allow an additional review period as specified in 1.05.02-5.

SECTION 1.06 – CONTROL OF MATERIALS

Article 1.06.01 - Source of Supply and Quality:

Add the following:

Traffic Signal Items:

For the following traffic signal items the contractor shall submit a complete description of the item, shop drawings, product data sheets and other descriptive literature which completely illustrates such items presented for formal review. Such review shall not change the requirements for a certified test report and materials certificate as may be called for. All documents shall be grouped into one separate file for each group of items as indicated by the Roman numerals below (for example, one pdf file for all of the pedestal items). The documents for all of the traffic signal items shall be submitted at one time, unless otherwise allowed by the engineer.

- I. 1003XXX - Light Standard, Aluminum
- II. 10080XX – Rigid Metal Conduit
- III. 11020XX – Aluminum Pedestals
- IV. 11050XXA – Traffic Signals, Span Mounted - LEDs, Housings and Hardware
11051XXA – Traffic Signals, Mast Arm Mounted - LEDs, Housings and Hardware
11052XXA – Traffic Signals, Pole Mounted - LEDs, Housings and Hardware
11053XXA – Traffic Signals, Pedestal Mounted - LEDs, Housings and Hardware
- V. 11060XXA – Pedestrian Signals - LEDs, Housings, and Hardware
11070XXA – Accessible Pedestrian Signal & Detector - Button, Housings & Sign (Type)
- VI. 1108115A – Full Actuated Controller, 8-Phase – Cabinet and Components
- VII. 1108665A – 10/100/1000 Base T Ethernet Switch
- VIII. 11XXXXXXA – Optical Pre-Emption - Emitter, Detector, Phase Selector and Chassis
1114201A – Auxiliary Equipment Cabinet
- IX. 11122XXA – Vehicle Detection - Camera Assembly, Processor and Monitor
- X. 111339XA – Cable closure (Type)

XI. 1113XXXXA – Cable - Control Cable, Comm., CAT6, VC, Detector Cable (optical)
11134XXXA – Control Cable – Communication Interconnect

XII. 1116110A – Blank-Out Sign

Computerized Traffic Signal System Items:

Submit a complete description of the item, together with either in paper (hard copy) form or in an electronic portable document format (.pdf) one (1) copy of shop drawings, cuts, data sheets and other descriptive literature which completely illustrates such items presented for formal approval. Such approval shall not change the requirements for a certified test report, and materials certificate as may be called for.

Approval of the Shop Drawings and product data sheets shall not change the requirements for a certified test report, materials certificate and certificate of compliance as may be called for.

Shop drawings shall be submitted on 8-1/2 inch by 11 inch sheets, 11 inch by 17 inch sheets or on 24 inch by 36 inch standard plan sheets. Shop drawings and data sheets shall be required for, but not limited to the following:

Optical Fiber Cable (Communication Cable)
Fiber Optic Patch Cords
Fiber Optic Splice Enclosure
Optical Fiber Termination Patch Panel
Ethernet Switch

Article 1.06.07 - Certified Test Reports and Materials Certificate.

Add the following:

Computerized Traffic Signal Systems (CTSS) Items:

2) For the materials in the following Computerized Traffic Signal System items, a Certified Test Report will be required confirming their conformance to the requirements set forth in these plans or specifications or both.

Conduit
Fiber Optic Cable
Fiber Optic Cable Connectors

SECTION 1.07 – LEGAL RELATIONS AND RESPONSIBILITIES

Article 1.07.13 - Contractor's Responsibility for Adjacent Property, Facilities and Services is supplemented as follows:

The following company and representative shall be contacted by the Contractor to coordinate the protection of their utilities on this project 30 days prior to the start of any work on this project involving their utilities:

State of Connecticut

All Towns

Mr. Arnold Ozols
District 3 Electrical Supervisor
Department of Transportation
Milford, Connecticut
(203) 878-1869

Electric Distribution

Town of Westport

Mr. Anthony Capodagli
Eversource Energy
860-845-3407
anthony.capodagli@eversource.com

Towns of East Haven, Fairfield, New Haven, North Haven, West Haven, Stratford

Mr. Fred Arnold
Project Management Engineer
The United Illuminating Company
180 Marsh Hill Road
Orange, CT 06477-3629
(203) 499-3922
Fred.arnold@uinet.com

Town of Madison

Mr. Neal Sorenson
Field Engineer Design
Eversource
135 New Road
Madison, CT 06443
(203) 245-5416
neal.sorensen@eversource.com

Communications

All Towns

Mr. Michael Brecher
Telecommunications Specialist
Frontier Communications
1441 North Colony Road
Meriden, CT 06450
(203) 235-0800
Michael.Brecher@ftr.com

All Towns

Mr. Eric Clark
Manager of Fiber Construction
Lighttower Fiber Networks
1781 Highland Avenue
Cheshire, CT 06410
(203) 649-3904
eclark@lighttower.com

Cable TV

Towns of Fairfield, Westport, Stratford, Bridgeport, and Milford

Mr. Richard Slomiana
Construction Manager
Cablevision dba Altice USA
28 Cross Street
Norwalk, CT 06851
(203) 750-5617
richard.slomiana@alticetechservicesusa.com

Towns of East Haven, New Haven, North Haven, West Haven, and Madison

Mr. Jim Bitzas
Regional Construction Director
Comcast of Connecticut, Inc.
1110 East Mountain Road
Westfield, MA 01085
(413) 642-8582
Jim_bitzas@cable.comcast.com

Natural Gas

Town of East Haven

Mr. Kenneth Ruel
Area Supervisor
Algonquin Gas Transmission dba Enbridge
252 Shunpike Road
Cromwell, CT 06416
(508) 894-1600
kenneth.ruel@enbridge.com

Town of Fairfield

Mr. David Wood
Project Manager - Ops
Tennessee Gas Pipeline L.L.C.
8 Anngina Drive
Enfield, CT 06082
(860) 763-6005
david_wood@kindermorgan.com

Towns of Fairfield, East Haven, West Haven

Mr. Kevin Gerety, P.E.
Engineering Manager
The Southern Connecticut Gas Company
60 Marsh Hill Road
Orange, CT 06477
(203) 795-7767
kgerety@soconngass.com

Sanitary Sewer

Town of East Haven

Mr. Thomas Sgroi, P.E.,
Director of Engineering
260 East Street
New Haven, CT 06511
(203) 466-5280
sewerinfo@gnhwpc.com

The following Department representative shall be contacted by the Engineer to coordinate an inspection of the service entrance into the controller/flasher cabinet for controllers within the State right-of-way, when ready for inspection, release, and connection of electrical service. The local Building Department shall be contacted for electrical service inspections for controllers located on Town roads located within the respective municipality.

Mr. Michael LeBlanc
Property & Facilities
Department of Transportation
Newington, CT 06111
860-594-2238
Michael.leblanc@ct.gov

Please provide the electrical service request number provided by the power company. This is a Work Request (WR) Number provided by Eversource (formerly Northeast Utilities [CL&P]) or a Work Order Number provided by United Illuminating (UI). For State-owned traffic signals in CL&P territory, contact the Department's Traffic Electrical Unit to obtain the WR Number. For State-owned traffic signals in UI territory, contact the Department's Traffic Electrical Unit to obtain a Request for Metered Service to provide to UI to obtain the Work Order Number. The street address is required for release to local power companies.

Raymark Superfund Site

Part of intersection 138-250 is located within the limits of the Raymark Industries, Inc. Superfund Site. The Raymark Industries facility was located at what is now 150-350 Barnum Ave. Cutoff, Stratford, which is now the Stratford Crossing Shopping Center.

By EPA definition, waste associated with the Superfund Site (also called Raymark Waste or RMW) contains lead above 400 milligrams per kilogram (mg/kg), chrysotile asbestos greater than 1 percent, and either copper above 288 mg/kg or polychlorinated biphenyls (PCBs) (Aroclor 1268 only) above 1 mg/kg. An impermeable cap is installed over the RMW at the Superfund Site. The cap system is comprised of an orange snow fence warning layer, a layer of compacted

processed gravel/sand mixed with Portland cement, and the impermeable membrane cap. The top of the cap system (warning layer) is typically present at depths of 2.5 to 3.0 feet below existing grade. Clean fill (the same processed gravel/sand mixed with Portland cement covered with topsoil) extends from the top of the warning layer to the ground surface. In certain areas, the warning layer and impermeable cap were not installed. The intent was to provide a “cut out” for work requiring deeper excavations to occur without damaging the cap system. Information related to the cut out can be found in the Plans.

The following restrictions apply to all work within the Superfund Site limits:

- A representative from DEEP must be present during all subsurface and excavation activities that occur on the Superfund Site, including work within the Department’s Right of Way. The Contractor shall schedule such work with the following personnel at DEEP a minimum of 14 days prior to commencing work:

Ronald Curran
Ronal.Curran@ct.gov
860-424-3764

Anthony Allevo
Anthony.Allevo@ct.gov
860-424-3649

No intrusive work may progress without DEEP on-site. Failure to follow direction given by DEEP may cause the Contractor to be subject to enforcement action or removal from the Superfund Site.

- Excavations MUST NOT penetrate the impermeable cap present at the Raymark Superfund site. Furthermore, **any** deviations from the design plans for the western side of Intersection 138-250 must be approved by the DEEP and the EPA before the work can begin.
- All digging and excavation must be performed either via hand digging or using mechanized equipment with buckets that do not have teeth.
- In the cut out area, clean fill not containing asbestos are present from the surface to approximately three (3) feet below existing grade. Such soils are not considered part of the Asbestos Contaminated Soil (ACS) AOEC. Should excavation be required in this area, the depth of cover material will need to be field verified by DEEP and the Engineer.
- Any change to Contract work requiring contact with the RMW requires OSHA Hazardous Waste Operations and Emergency Response Standard (HAZWOPER) training and special material handling procedures not currently in the Contract. Should such work become necessary, provisions will be incorporated into the Contract at that time.

SECTION 1.08 – PROSECUTION AND PROGRESS

Article 1.08.03 - Prosecution of Work:

Add the following:

The Contractor shall stake the limits of the concrete sidewalks and ramps in conjunction with staking the locations of foundations to ensure that pedestrian push buttons will be located appropriately and will be accessible from a landing area.

The Contractor will not be allowed to install traffic signal or pedestrian heads until the controllers are on hand and ready for installation. Once installation of this equipment commences, the Contractor shall complete this work in a most expeditious manner.

The Contractor shall notify the Traffic Signal Lab at Telephone (860) 258-0346 or (860) 258-0349 forty five (45) days prior to starting work on computer controlled signalized intersections only.

The above notice will initiate work to be completed by the Signal Lab. (Note: The Signal Lab will also replace the controllers for 16 other signals in the New Haven Route 80 Closed Loop System for compatibility with Int. 092-241 & 092-242 and the West Haven Route 162 Closed Loop System for compatibility with Int. 156-212). The Contractor shall be responsible for any timely updates that need to be reported to this Unit for the successful coordination of work.

The Contractor shall notify the project engineer on construction projects, or the district permit agent on permit jobs, when all traffic signal work is completed. This will include all work at signalized intersections including loop replacements, adjusting existing traffic signals or any relocation work including handholes. The project engineer or district permit agent will notify the Division of Traffic Engineering to coordinate a field inspection of all work. Refer to Section 10.00 – General Clauses For Highway Illumination And Traffic Signal Projects, Article 10.00.10 and corresponding special provision.

The project will be constructed in various phases as described herein.

Phase 1 – Organization Phase up to (168) Calendar Days.

The first phase is to afford the Contractor time for the administrative/engineering/procurement function required for the project. This would include such items as performing construction staking, digging test pits, submitting catalog cuts or shop drawings and purchasing materials. Actual construction is not permitted during the period. The Contractor is to use this time to fully prepare for the successive phases so that construction can proceed quickly and efficiently. During the phase, after the construction staking is complete and underground utilities are marked out the Contractor, the designer and the Engineer will walk the project to determine if there are test pits necessary or if there are any apparent conflicts with private property, utilities, or other roadside appurtenances such as obstructions, rocks, large trees, etc. Those conflicts will be resolved prior

to ordering equipment for the specific area where the conflict exists. Calendar days for this phase will run through the winter shutdown (March 16, 2020 through March 31, 2020).

Phase 2 – Construction Phase up to (358) Calendar Days

When all apparent conflicts have been identified and resolved, and written commitments have been received from suppliers that all equipment and materials will be received within 30 days, the Contractor may request that the construction phase begin. Once commencement of construction begins, as and when approved by the Engineer, the Contractor will have the remaining contract calendar days to complete the work, including cleanup. That work, once started, must be completed within the time established for the original contract, and liquidated damages, as specified elsewhere in the Contract, will be assessed against the Contractor per calendar day from that day until the date on which the work is complete. If unforeseen situations arise, the Contractor may request an extension of time for an individual location and, if justified, the Engineer may grant an extension of time for that location. Granting an extension of time for one location will not entitle the Contractor to extensions of time for other locations in the project.

Phase 2 will not start prior to the conclusion of Phase 1, without the written permission of the Engineer. If Phase 1 is completed during the winter period Phase 2 will begin on the following April 1. The Contractor may begin Phase 2 only with prior written permission from the Engineer to do so, unless all the work allotted for this phase can be completed prior to the winter period. If the project will not be completed in the one construction season, the contractor shall complete all work started at or between intersections, including cleanup, prior to the winter shutdown.

New Work

Additional work, including work at a separate location, may be added to the contract in accordance with Article 1.04.05 of the Standard Specifications. This work may result in a contract extension, which would require an organization phase and a construction phase for the new location. If a contract extension is granted for the additional work, liquidated damages for this portion of the work will be negotiated with the Contractor. Such an extension of time would not affect the time allowed for the original work in the contract. Original work, once started must be completed within the original construction phase, and liquidated damages will be assessed for any days beyond that phase which the Contractor takes to complete the original work.

Article 1.08.04 - Limitation of Operations - Add the following:

In order to provide for traffic operations as outlined in the Special Provision "Maintenance and Protection of Traffic," the Contractor will not be permitted to perform any work which will interfere with the described traffic operations on all project roadways as follows:

Ramps and Turning Roadways

Monday through Friday between 6:00 a.m. and 9:00 a.m. & between 3:00 p.m. and 6:00 p.m.
Saturday and Sunday between 10:00 a.m. and 6:00 p.m.

All Other Roadways

Monday through Friday between 6:00 a.m. and 9:00 a.m. & between 3:00 p.m. and 6:00 p.m.
Saturday and Sunday between 10:00 a.m. and 6:00 p.m.

Additional Lane Closure Restrictions

It is anticipated that work on adjacent projects will be ongoing simultaneously with this project. The Contractor shall be aware of those projects and anticipate that coordination will be required to maintain proper traffic flow at all times on all project roadways, in a manner consistent with these specifications and acceptable to the Engineer.

The Contractor will not be allowed to perform any work that will interfere with traffic operations on a roadway when traffic operations are being restricted on that same roadway, unless there is at least a one mile clear area length where the entire roadway is open to traffic or the closures have been coordinated and are acceptable to the Engineer. The one mile clear area length shall be measured from the end of the first work area to the beginning of the signing pattern for the next work area.

Article 1.08.07 - Determination of Contract Time:

Delete the second, third and fourth paragraphs and replace them with the following:

When the contract time is on a calendar day basis, it shall be the number of consecutive calendar days stated in the contract, INCLUDING the time period from March 16, 2020 through March 31, 2020. The contract time will begin on the effective date of the Engineer's order to commence work, and it will be computed on a consecutive day basis, including all Saturdays, Sundays, Holidays, and non-work days. After March 31, 2020, the contract time shall be on a calendar day basis, including all Saturdays, Sundays, Holidays, and non-work days which shall be the number of consecutive calendar days stated in the contract, EXCLUDING the time period from December 1, through March 31.

SECTION 2.86 - DRAINAGE TRENCH EXCAVATION, ROCK IN DRAINAGE TRENCH EXCAVATION

2.86.01—Description

2.86.03—Construction Methods

2.86.04—Method of Measurement

2.86.05—Basis of Payment

2.86.01—Description: Drainage trench excavation consists of the excavation necessary for the proper installation of drainage structures, pipes, pipe ends and any other incidental drainage items.

It shall include earth and rock excavation, removal of existing pipes, dewatering, backfill, and disposal of materials; to the trench limits described herein, to the dimensions shown on the plans, or as directed by the Engineer.

Classifications:

- (1) **Drainage Trench Excavation** will include only the excavation necessary for the construction of the drainage items and the removals specified above.
- (2) **Rock in Drainage Trench Excavation**, insofar as it applies to drainage trench excavation, shall be defined as **1/2 cubic yard or more** in volume of the following obstructions removed from the limits of the drainage trench:
 - (a) rock in definite ledge formation
 - (b) boulders, or portions of boulders
 - (c) cement masonry structures
 - (d) concrete or reinforced concrete structures
 - (e) reinforced concrete pipe
 - (f) subsurface concrete pavement or concrete base

The removal shall be as indicated or directed from within the limits defined in 2.86.03 for drainage trench excavation.

2.86.03—Construction Methods:

(1) Drainage Trench Excavation Limits:

Horizontal Limits: Trench widths for pipes, pipe ends, pipe-arches, and drainage structures shall be as follows:

- (a) 2 feet greater than the nominal inside diameter of circular pipe or nominal inside span of elliptical pipe or pipe-arch for such diameters or spans of less than 30 inches
- (b) 3 feet greater than the nominal inside diameter of circular pipe or the nominal inside span of elliptical pipe or pipe-arch for such diameters or spans that are 30 inches or greater
- (c) 4 feet greater than the nominal inside diameter or nominal horizontal inside span for pipe-arches fabricated from structural plates
- (d) 2 feet beyond the neat lines of all exterior or foundation walls of drainage structures

Vertical Limits: Trench depths shall extend vertically as follows:

- (a) From the bottom of the trench to the bottom of the roadway excavation, or in areas away from roadway excavation, to the top of existing ground surface.

(b) Where drainage pipe is to be laid in a fill area, the embankment shall be placed and compacted to a minimum elevation 12 inches above the top of the proposed pipe, whereupon the drainage trench excavation shall be performed and the pipe installed.

- (2) **Drainage Trench Excavation:** Drainage trench excavation shall be made in conformity with the requirements of the plans, or as directed by the Engineer. The Contractor shall furnish and employ such shores, braces, pumps, or ancillary equipment as needed for the proper protection of property, proper completion of the work, as well as safety of the public and employees of both the Contractor and the Department. All bracing and shoring shall be removed when no longer required for the construction or safety of the work. When required, the Contractor shall provide or have on the Site at all times any OSHA certification for equipment to be used, per 1.07.07. For support of trenches greater than 10 feet in depth, working drawings shall be submitted, in accordance with 1.05.02. The Contractor shall control erosion and sedimentation at trench locations and ensure that pumped water from the drainage excavation is discharged in accordance with the requirements of 1.10.

Where a firm foundation is not encountered at the grades established due to unsuitable material, such as soft, spongy, or unstable soil, the unsuitable material shall be removed and replaced with approved backfill, thoroughly compacted in lifts not to exceed 6 inches, for the full trench width. The Engineer shall be notified prior to removal of the unsuitable material in order to determine the depth of removal necessary.

After the excavation is complete, the Contractor shall notify the Engineer and no drainage structure or material shall be placed in the excavated area until the Engineer has approved the depth of excavation and the character of the foundation material.

- (3) **Rock in Drainage Trench Excavation:**

(a) Rock in Drainage Trench Excavation - Ledge: When rock in definite ledge form is encountered, the Contractor shall excavate a minimum of 12 inches below the bottom of the proposed pipe or drainage structure; and this depth shall be filled with bedding material (as specified in M.08.03-1) below the proposed pipe; or granular fill (as specified in M.02.01) below the proposed drainage structure, which shall be thoroughly compacted in lifts not to exceed 6 inches.

(b) Rock in Drainage Trench Excavation - Boulders: When boulders are encountered, the Contractor shall remove them from the trench and if backfill is required, the void shall be filled with bedding material, surplus excavated material (as specified in 2.02.03-8) or granular fill which shall be thoroughly compacted in lifts not to exceed 6 inches.

(c) Rock in Drainage Trench Excavation –Structures: When cement masonry, concrete or reinforced concrete structures are encountered within the drainage trench limits, the Contractor shall remove the structure in its entirety or as directed by the Engineer, and if backfill is required, the void shall be filled with bedding material, surplus excavated material or granular fill which shall be thoroughly compacted in lifts not to exceed 6 inches.

- (4) **Backfill:** Suitable material excavated from the drainage trench shall be used as backfill material prior to consideration of using any other source of backfill. Backfill material used shall be of a quality satisfactory to the Engineer and shall be free from large or frozen lumps, wood and other extraneous material. Rock fill or stones larger than 5 inches shall not be placed within 1 foot of the drainage structure or pipe. The grading shall be

completed to the lines shown on the plans, or as ordered, by refilling to the required elevation with approved material, placed in layers not to exceed 6 inches in depth after compaction, which shall be thoroughly compacted with equipment approved by the Engineer.

All surplus or unsuitable material shall be removed and disposed of as directed. Should additional material be required for backfilling, it may be obtained from the Project surplus excavation in accordance with 2.02.03-8 or from borrow pits, gravel pits, or elsewhere as directed by the Engineer.

2.86.04—Method of Measurement:

Drainage Trench Excavation: Drainage trench excavation will not be measured for payment.

If granular fill or borrow is required to replace unsuitable material it will be measured for payment as directed by the Engineer.

Rock in Drainage Trench Excavation: If any material meeting the definition of Rock in Drainage Trench Excavation is encountered, the Contractor shall strip it of sufficient overlying material to allow for proper measurement and shall then notify the Engineer that the rock surface is ready for measurement. If the Contractor fails to give such notice, the Engineer will presume that the measurements taken at the time the Engineer first saw the material in question will give the true quantity of excavation.

Rock in Drainage Trench Excavation will be measured according to the classification provided in 2.86.01 and within the drainage trench excavation limits provided in 2.86.03.

For the removal of underground obstructions, as classified in 2.86.01-2, the measurement shall be the actual volume of rock removed (1/2 cubic yard or more) as approved by the Engineer.

Rock in Drainage Trench Excavation will not be measured for payment in fills.

Bedding Material or other suitable fill, as specified in 2.86.03(3), used to fill voids after rock is excavated will not be measured for payment.

2.86.05—Basis of Payment:

Drainage Trench Excavation: There will be no direct payment for drainage trench excavation required for the installation of drainage pipes, pipe ends, catch basins, drop inlets, manholes, and other drainage structures, or any other incidental drainage work including materials, tools, equipment and labor necessary to complete the drainage trench excavation in conformity with the plans or as directed by the Engineer.

There will be no direct payment for backfill or disposal of surplus material necessary for the satisfactory completion of this work.

There will be no direct payment made for shoring, bracing, dewatering, or for material or equipment necessary for the satisfactory completion of the work.

Where called for on the plans to install temporary earth retaining systems for the support of existing facilities, pavement, utilities, or for other constraints, payment will be made in accordance with such items in the Contract.

If granular fill or borrow is used to replace unsuitable material, payment will be made at the respective Contract unit prices, or in the absence of such items in the Contract, as Extra Work in accordance with 1.04.05.

Rock in Drainage Trench Excavation: When rock, conforming to the description in 2.86.01 is encountered within the limits of drainage trench excavation, its removal will be classified and

paid for at the Contract unit price per cubic yard for "Rock in Drainage Trench Excavation 0' – 10' Deep," or "Rock in Drainage Trench Excavation 0' – 20' Deep," as the case may be.

Those portions of drainage trench excavation classified and paid for as "Rock in Drainage Trench Excavation" of the various depths will be the actual volumes of rock excavated within the limits for drainage trench excavation, at the applicable bottom depth price.

Where no item or items for "Rock in Drainage Trench Excavation" at the applicable depth appear in the proposal and rock is encountered in drainage trench excavation, its removal will be paid for as Extra Work in accordance with 1.04.05.

When excavation is necessary in fill, no such excavation will be paid for as "Rock in Drainage Trench Excavation."

When excavation is necessary for any purpose other than drainage-related items, no such excavation will be paid under this item.

Bedding material or any other suitable material used to fill voids vacated by excavated rock will not be paid for but shall be included in the unit price per cubic yard for "Rock in Drainage Trench Excavation."

Pay Item	Pay Unit
Rock in Drainage Trench Excavation 0' - 10' Deep	c.y.
Rock in Drainage Trench Excavation 0' - 20' Deep	c.y.

SECTION 4.06 BITUMINOUS CONCRETE

Section 4.06 is being deleted in its entirety and replaced with the following:

4.06.01—Description

4.06.02—Materials

4.06.03—Construction Methods

- 1. Material Documentation**
- 2. Transportation of Mixture**
- 3. Paving Equipment**
- 4. Test Section**
- 5. Transitions for Roadway Surface**
- 6. Spreading and Finishing of Mixture**
- 7. Longitudinal Joint Construction Methods**
- 8. Contractor Quality Control (QC) Requirements**
- 9. Temperature and Seasonal Requirements**
- 10. Field Density**
- 11. Acceptance Sampling and Testing**
- 12. Density Dispute Resolution Process**
- 13. Corrective Work Procedure**
- 14. Protection of the Work**
- 15. Cut Bituminous Concrete Pavement**

4.06.04—Method of Measurement

4.06.05—Basis of Payment

4.06.01—Description: Work under this Section shall include the production, delivery, placement and compaction of a uniform textured, non-segregated, smooth bituminous concrete pavement to the grade and cross section shown on the plans.

The following terms as used in this specification are defined as:

Bituminous Concrete: A composite material consisting of prescribed amounts of asphalt binder and aggregates. Asphalt binder may also contain additives engineered to modify specific properties and/or behavior of the composite material. References to bituminous concrete apply to all of its forms, such as those identified as hot-mix asphalt (HMA) or polymer-modified asphalt (PMA).

Bituminous Concrete Plant (Plant): A structure where aggregates and asphalt binder are combined in a controlled fashion into a bituminous concrete mixture suitable for forming pavements and other paved surfaces.

Course: A continuous layer (a lift or multiple lifts) of the same bituminous concrete mixture placed as part of the pavement structure.

Density Lot: The total tonnage of all bituminous concrete placed in a single lift which are:

PWL density lots = When the project total estimated quantity per mixture is larger than 3,500 tons

Simple Average density lots = When the project total estimated quantity per mixture is 3,500 tons or less

Disintegration: Erosion or fragmentation of the pavement surface which can be described as

polishing, weathering-oxidizing, scaling, spalling, raveling, or formation of potholes.

Dispute Resolution: A procedure used to resolve conflicts between the Engineer and the Contractor's results that may affect payment.

Hot Mix Asphalt (HMA): A bituminous concrete mixture typically produced at 325°F.

Job Mix Formula (JMF): A recommended aggregate gradation and asphalt binder content to achieve the required mixture properties.

Lift: An application of a bituminous concrete mixture placed and compacted to a specified thickness in a single paver pass.

Percent Within Limits (PWL): The percentage of the lot falling between the Upper Specification Limit (USL) and the Lower Specification Limit (LSL).

Polymer Modified Asphalt (PMA): A bituminous concrete mixture containing a polymer-modified asphalt binder and using a qualified warm mix technology.

Production Lot: The total tonnage of a bituminous concrete mixture from a single source that may receive an adjustment.

Production Sub Lot: Portion of the production lot typically represented by a single sample.

Quality Assurance (QA): All those planned and systematic actions necessary to provide CTDOT the confidence that a Contractor will perform the work as specified in the Contract.

Quality Control (QC): The sum total of activities performed by the vendor (Producer, Manufacturer, and Contractor) to ensure that a product meets contract specification requirements.

Superpave: A bituminous concrete mix design used in mixtures designated as "S*" Where "S" indicates Superpave and * indicates the sieve related to the nominal maximum aggregate size of the mix.

Segregation: A non-uniform distribution of a bituminous concrete mixture in terms of gradation, temperature, or volumetric properties.

Warm Mix Asphalt (WMA) Technology: A qualified additive or technology that may be used to produce a bituminous concrete at reduced temperatures and/or increase workability of the mixture.

4.06.02—Materials: All materials shall meet the requirements of Section M.04.

1. Materials Supply: The bituminous concrete mixture must be from one source of supply and originate from one Plant unless authorized by the Engineer.

2. Recycled Materials: Reclaimed Asphalt Pavement (RAP), Crushed Recycled Container Glass (CRCG), Recycled Asphalt Shingles (RAS), or crumb rubber (CR) from recycled tires may be incorporated in bituminous concrete mixtures in accordance with Project Specifications.

4.06.03—Construction Methods

1. Material Documentation: All vendors producing bituminous concrete must have Plants with automated vehicle-weighting scales, storage scales, and material feeds capable of producing a delivery ticket containing the information below.

- a. State of Connecticut printed on ticket.
- b. Name of Producer, identification of Plant, and specific storage silo if used.
- c. Date and time.
- d. Mixture Designation, mix type and level. Curb mixtures for machine-placed curbing must state "curb mix only."

- e. If WMA Technology is used, “-W” must be listed following the mixture designation.
- f. Net weight of mixture loaded into the vehicle. (When RAP and/or RAS is used, the moisture content shall be excluded from mixture net weight.)
- g. Gross weight (equal to the net weight plus the tare weight or the loaded scale weight).
- h. Tare weight of vehicle (daily scale weight of the empty vehicle).
- i. Project number, purchase order number, name of Contractor (if Contractor other than Producer).
- j. Vehicle number - unique means of identification of vehicle.
- k. For Batch Plants: individual aggregate, recycled materials, and virgin asphalt max/target/min weights when silos are not used.
- l. For every mixture designation: the running daily and project total delivered and sequential load number.

The net weight of mixture loaded into the vehicle must be equal to the cumulative measured weights of its components.

The Contractor must notify the Engineer immediately if, during production, there is a malfunction of the weight recording system in the automated Plant. Manually written tickets containing all required information will be allowed for no more than 1 hour.

The State reserves the right to have an Inspector present to monitor batching and/or weighing operations.

2. Transportation of Mixture: The mixture shall be transported in vehicles that are clean of all foreign material, excessive coating or cleaning agents, and that have no gaps through which material might spill. Any material spilled during the loading or transportation process shall be quantified by re-weighing the vehicle. The Contractor shall load vehicles uniformly so that segregation is minimized. Loaded vehicles shall be tightly covered with waterproof covers acceptable to the Engineer. Mesh covers are prohibited. The cover must minimize air infiltration. Vehicles found not to be in conformance shall not be loaded

Vehicles with loads of bituminous concrete being delivered to State projects must not exceed the statutory or permitted load limits referred to as gross vehicle weight (GVW). The Contractor shall furnish a list and allowable weights of all vehicles transporting mixture. The State reserves the right to check the gross and tare weight of any vehicle. If the gross or tare weight varies from that shown on the delivery ticket by more than 0.4%, the Engineer will recalculate the net weight. The Contractor shall correct the discrepancy to the satisfaction of the Engineer.

If a vehicle delivers mixture to the Project and the delivery ticket indicates that the vehicle is overweight, the load may not be rejected but a “Measured Weight Adjustment” will be taken in accordance with Article 4.06.04.

Vehicle body coating and cleaning agents must not have a deleterious effect on the mixture. The use of solvents or fuel oil, in any concentration, is prohibited for the coating of vehicle bodies.

For each delivery, the Engineer shall be provided a clear, legible copy of the delivery ticket.

3. Paving Equipment: The Contractor shall have the necessary paving and compaction equipment at the Project Site to perform the work. All equipment shall be in good working order and any equipment that is worn, defective, or inadequate for performance of the work shall be repaired or replaced by the Contractor to the satisfaction of the Engineer. During the paving operation, the use of solvents or fuel oil, in any concentration, is strictly prohibited as a release agent or cleaner on any paving equipment (i.e., rollers, pavers, transfer devices, etc.).

Refueling or cleaning of equipment is prohibited in any location on the Project where fuel or solvents might come in contact with paved areas or areas to be paved. Solvents used in cleaning mechanical equipment or hand tools shall be stored clear of areas paved or to be paved. Before any such equipment and tools are cleaned, they shall be moved off of areas paved or to be paved.

Pavers: Each paver shall have a receiving hopper with sufficient capacity to provide for a uniform spreading operation and a distribution system that places the mix uniformly, without segregation. The paver shall be equipped with and use a vibratory screed system with heaters or burners. The screed system shall be capable of producing a finished surface of the required evenness and texture without tearing, shoving, or gouging the mixture. Pavers with extendible screed units as part of the system shall have auger extensions and tunnel extenders as necessary. Automatic screed controls for grade and slope shall be used at all times unless otherwise authorized by the Engineer. The controls shall automatically adjust the screed to compensate for irregularities in the preceding course or existing base. The controls shall maintain the proper transverse slope and be readily adjustable, and shall operate from a fixed or moving reference such as a grade wire or floating beam (minimum length 20 feet).

Rollers: All rollers shall be self-propelled and designed for compaction of bituminous concrete. Roller types shall include steel wheeled, pneumatic, or a combination thereof. Rollers that operate in a dynamic mode shall have drums that use a vibratory or oscillatory system or combination. Vibratory rollers shall be equipped with indicators for amplitude, frequency, and speed settings/readouts to measure the impacts per foot during the compaction process. Oscillatory rollers shall be equipped with frequency indicators. Rollers can operate in the dynamic mode using the oscillatory system on concrete structures such as bridges and catch basins if at the lowest frequency setting.

Pneumatic tire rollers shall be equipped with wide-tread compaction tires capable of exerting an average contact pressure from 60 to 90 psi uniformly over the surface. The Contractor shall furnish documentation to the Engineer regarding tire size, pressure and loading to confirm that the proper contact pressure is being developed and that the loading and contact pressure are uniform for all wheels.

Lighting: For paving operations which will be performed during hours of darkness the paving equipment shall be equipped with lighting fixtures as described below or with an approved equal. Lighting shall minimize glare to passing traffic. The lighting options and minimum number of fixtures are listed in Tables 4.06-1 and 4.06-2.

TABLE 4.06-1: Minimum Paver lighting

Option	Fixture Configuration	Fixture Quantity	Requirement
1	Type A	3	Mount over screed area
	Type B (narrow) or Type C (spot)	2	Aim to auger and guideline
	Type B (wide) or Type C (flood)	2	Aim 25feet behind paving machine
2	Type D Balloon	2	Mount over screed area

TABLE 4.06-2: Minimum Roller Lighting

Option	Fixture Configuration	Fixture Quantity	Requirement
1	Type B (wide)	2	Aim 50 feet in front of and behind roller
	Type B (narrow)	2	Aim 100 feet in front of and behind roller
2	Type C (flood)	2	Aim 50 feet in front of and behind roller
	Type C (spot)	2	Aim 100 feet in front of and behind roller
3	Type D Balloon	1	Mount above the roller

*All fixtures shall be mounted above the roller.

Type A: Fluorescent fixture shall be heavy duty industrial type. Each fixture shall have a minimum output of 8,000 lumens. The fixtures shall be mounted horizontally and be designed for continuous row installation.

Type B: Each floodlight fixture shall have a minimum output of 18,000 lumens.

Type C: Each fixture shall have a minimum output of 19,000 lumens.

Type D: Balloon light – each balloon light fixture shall have minimum output of 50,000 lumens and emit light equally in all directions.

Material Transfer Vehicle (MTV): A MTV shall be used when placing bituminous concrete surface course (a lift or multiple lifts) as indicated in the Contract except as noted on the plans or as directed by the Engineer. In addition, continuous paving lengths of less than 500 feet may not require the use of a MTV as determined by the Engineer.

The MTV must be a vehicle specifically designed for the purpose of delivering the bituminous concrete mixture from the delivery vehicle to the paver. The MTV must continuously remix the bituminous concrete mixture throughout the placement process.

The use of a MTV will be subject to the requirements stated in Article 1.07.05 Load Restrictions. The Engineer may limit the use of the vehicle if it is determined that the use of the MTV may damage highway components, utilities, or bridges. The Contractor shall submit to the Engineer at time of pre-construction the following information:

1. The make and model of the MTV.
2. The individual axle weights and axle spacing for each piece of paving equipment (haul vehicle, MTV and paver).
3. A working drawing showing the axle spacing in combination with all pieces of equipment that will comprise the paving echelon.

4. Test Section: The Engineer may require the Contractor to place a test section whenever the requirements of this specification or Section M.04 are not met.

The Contractor shall submit the quantity of mixture to be placed and the location of the test section for review and approval by the Engineer. The same equipment used in the construction of a passing test section shall be used throughout production.

If a test section fails to meet specifications, the Contractor shall stop production, make necessary adjustments to the job mix formula, Plant operations, or procedures for placement and compaction. The Contractor shall construct test sections, as allowed by the Engineer, until all the required specifications are met. All test sections shall also be subject to removal as set forth in Article 1.06.04.

5. Transitions for Roadway Surface: Transitions shall be formed at any point on the roadway where the pavement surface deviates, vertically, from the uniform longitudinal profile as specified on the plans. Whether formed by milling or by bituminous concrete mixture, all transition lengths shall meet the criteria below unless otherwise specified.

Permanent Transitions: Defined as any gradual change in pavement elevation that remains as a permanent part of the work.

A transition shall be constructed no closer than 75 feet from either side of a bridge expansion joint or parapet. All permanent transitions, leading and trailing ends shall meet the following length requirements:

Posted Speed Limit	Permanent Transition Length Required
> 35 mph	30 feet per inch of elevation change
35 mph or less	15 feet per inch of elevation change

In areas where it is impractical to use the above-described permanent transition lengths, the use of a shorter permanent transition length may be permitted when approved by the Engineer.

Temporary Transitions: Defined as a transition that does not remain a permanent part of the work.

All temporary transitions shall meet the following length requirements:

Posted Speed Limit	Temporary Transition Length Required
> 50 mph	Leading Transition: 15 feet per inch of vertical change (thickness) Trailing Transition: 6 feet per inch of vertical change (thickness)
40, 45 or 50 mph	Leading and Trailing: 4 feet per inch of vertical change (thickness)
35 mph or less	Leading and Trailing: 3 feet per inch of vertical change (thickness)

Note: Any temporary transition to be in place over the winter shutdown period or during extended periods of inactivity (more than 14 calendar days) shall meet the greater than 50 mph requirements shown above.

6. Spreading and Finishing of Mixture: Prior to the placement of the mixture, the underlying base course shall be brought to the plan grade and cross section within the allowable tolerance.

Immediately before placing a bituminous concrete lift, a uniform coating of tack coat shall be applied to all existing underlying pavement surfaces and on the exposed surface of a wedge joint. Such surfaces shall be clean and dry. Sweeping or other means acceptable to the Engineer shall be used.

The mixture shall not be placed whenever the surface is wet or frozen.

Tack Coat Application: The tack coat shall be applied by a pressurized spray system that results in uniform overlapping coverage at an application rate of 0.03 to 0.05 gal./s.y. for a non-milled surface and an application rate of 0.05 to 0.07 gal./s.y. for a milled surface. For areas

where both milled and un-milled surfaces occur, the tack coat shall be an application rate of 0.03 to 0.05 gal /s.y. The Engineer must approve the equipment and the method of measurement prior to use. The material for tack coat shall be heated to 160°F ± 10°F and shall not be further diluted.

Tack coat shall be allowed sufficient time to break prior to any paving equipment or haul vehicles driving on it.

The Contractor may request to omit the tack coat application between bituminous concrete layers that have not been exposed to traffic and are placed during the same work shift. Requests to omit tack coat application on the upper and lower surfaces of a wedge joint will not be considered.

Placement: The mixture shall be placed and compacted to provide a smooth, dense surface with a uniform texture and no segregation at the specified thickness and dimensions indicated in the plans and specifications.

When unforeseen weather conditions prevent further placement of the mixture, the Engineer is not obligated to accept or place the bituminous concrete mixture that is in transit from the Plant.

In advance of paving, traffic control requirements shall be set up, maintained throughout placement, and shall not be removed until all associated work including density testing is completed.

The mixture temperature will be verified by means of a probe or infrared type of thermometer. The placement temperature range shall be listed in the quality control plan (QCP) for placement and meet the requirements of Table M.04.03-4. Any HMA material that falls outside the specified temperature range as measured by a probe thermometer may be rejected.

The Contractor shall inspect the newly placed pavement for defects in mixture or placement before rolling is started. Any deviation from standard crown or section shall be immediately remedied by placing additional mixture or removing surplus mixture. Such defects shall be corrected to the satisfaction of the Engineer.

Where it is impracticable due to physical limitations to operate the paving equipment, the Engineer may permit the use of other methods or equipment. Where hand spreading is permitted, the mixture shall be placed by means of suitable shovels and other tools, and in a uniformly loose layer at a thickness that will result in a completed pavement meeting the designed grade and elevation.

Placement Tolerances: Each lift of bituminous concrete placed at a specified thickness shall meet the following requirements for thickness and area. Any pavement exceeding these limits shall be subject to an adjustment or removal. Lift tolerances will not relieve the Contractor from meeting the final designed grade. Lifts of specified non-uniform thickness, i.e. wedge or shim course, shall not be subject to thickness and area adjustments.

- a) Thickness: Where the average thickness of the lift exceeds that shown on the plans beyond the tolerances shown in Table 4.06-3, the Engineer will calculate the thickness adjustment in accordance with Article 4.06.04.

TABLE 4.06-3: Thickness Tolerances

Mixture Designation	Lift Tolerance
S1	+/- 3/8 inch
S0.25, S0.375, S0.5	+/- 1/4 inch

Where the thickness of the lift of mixture is less than that shown on the plans beyond the

tolerances shown in Table 4.06-3, the Contractor, with the approval of the Engineer, shall take corrective action in accordance with this Section.

- b) Area: Where the width of the lift exceeds that shown on the plans by more than the specified thickness, the Engineer will calculate the area adjustment in Article 4.06.04.
- c) Delivered Weight of Mixture: When the delivery ticket shows that the truck exceeds the allowable gross weight for the vehicle type, the Engineer will calculate the weight adjustment in accordance with Article 4.06.04.

Transverse Joints: All transverse joints shall be formed by saw-cutting to expose the full thickness of the lift. Tack coat shall be applied to the sawn face immediately prior to additional mixture being placed.

Compaction: The Contractor shall compact the mixture to meet the density requirements as stated in Article 4.06.04 and eliminate all roller marks without displacement, shoving cracking, or aggregate breakage.

When placing a lift with a specified thickness less than 1 1/2 inches, or a wedge course, the Contractor shall provide a minimum rolling pattern as determined by the development of a compaction curve. The procedure to be used shall be documented in the Contractor's QCP for placement and demonstrated on the first day of placement.

The use of the vibratory system on concrete structures is prohibited. When approved by the Engineer, the Contractor may operate a roller using an oscillatory system at the lowest frequency setting.

If the Engineer determines that the use of compaction equipment in the dynamic mode may damage highway components, utilities or adjacent property, the Contractor shall provide alternate compaction equipment.

Rollers operating in the dynamic mode shall be shut off when changing directions.

These allowances will not relieve the Contractor from meeting pavement compaction requirements.

Surface Requirements:

Each lift of the surface course shall not vary more than 1/4 inch from a Contractor-supplied 10 foot straightedge. For all other lifts of bituminous concrete, the tolerance shall be 3/8 inch. Such tolerance will apply to all paved areas.

Any surface that exceeds these tolerances shall be corrected by the Contractor at its own expense.

7. Longitudinal Joint Construction Methods: The Contractor shall use Method I - Notched Wedge Joint (see Figure 4.06-1) when constructing longitudinal joints where lift thicknesses are 1 1/2 inches to 3 inches. S1.0 mixtures shall be excluded from using Method I. Method II - Butt Joint (see Figure 4.06-2) shall be used for lifts less than 1 1/2 inches or greater than 3 inches. Each longitudinal joint shall maintain a consistent offset from the centerline of the roadway along its entire length. The difference in elevation between the two faces of any completed longitudinal joint shall not exceed 1/4 inch at any location.

Method I - Notched Wedge Joint:

A notched wedge joint shall be constructed as shown in Figure 4.06-1 using a device that is attached to the paver screed and is capable of independently adjusting the top and bottom vertical notches. The device shall have an integrated vibratory system. The top vertical notch must be located at the centerline or lane line in the final lift. The requirement for paving full width "curb to curb" as described in Method II may be waived if addressed in the QC plan and approved by


the Engineer.

The taper portion of the wedge joint shall be evenly compacted using equipment other than the paver or notch wedge joint device. The compaction device shall be the same width as the taper and not reduce the angle of the wedge or ravel the top notch of the joint during compaction.

When placed on paved surfaces, the area below the sloped section of the joint shall be treated with tack coat. The top surface of the sloped section of the joint shall be treated with tack coat prior to placing the completing pass.

The taper portion of the wedge joint shall not be exposed to traffic for more than 5 calendar days.

Figure 4.06-1: Notched Wedge Joint (Not to Scale)

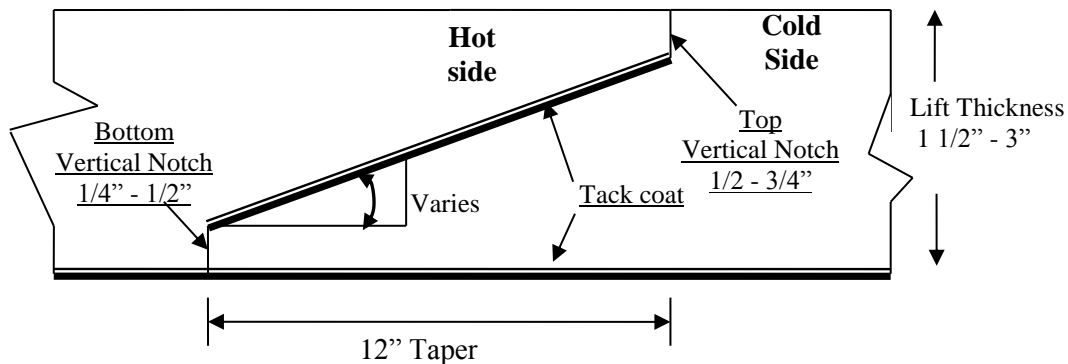

Any exposed wedge joint must be located to allow for the free draining of water from the road surface.


The Engineer reserves the right to define the paving limits when using a wedge joint that will be exposed to traffic.

If Method I cannot be used on those lifts which are 1 ½ inches to 3 inches, Method III may be substituted according to the requirements below for “Method III - Butt Joint with Hot Poured Rubberized Asphalt Treatment.”

Method II - Butt Joint:

When adjoining passes are placed, the Contractor shall use the end gate to create a near vertical edge (refer to Figure 4.06-2). The completing pass (hot side) shall have sufficient mixture so that the compacted thickness is not less than the previous pass (cold side). During placement of multiple lifts, the longitudinal joint shall be constructed in such a manner that it is located at least 6 inch from the joint in the lift immediately below. The joint in the final lift shall be at the centerline or at lane lines. The end gate on the paver should be set so there is an overlap onto the cold side of the joint.


The Contractor shall not allow any butt joint to be incomplete at the end of a work shift unless otherwise allowed by the Engineer. When using this method, the Contractor is not allowed to leave a vertical edge exposed at the end of a work shift and must complete paving of the roadway full width “curb to curb.”

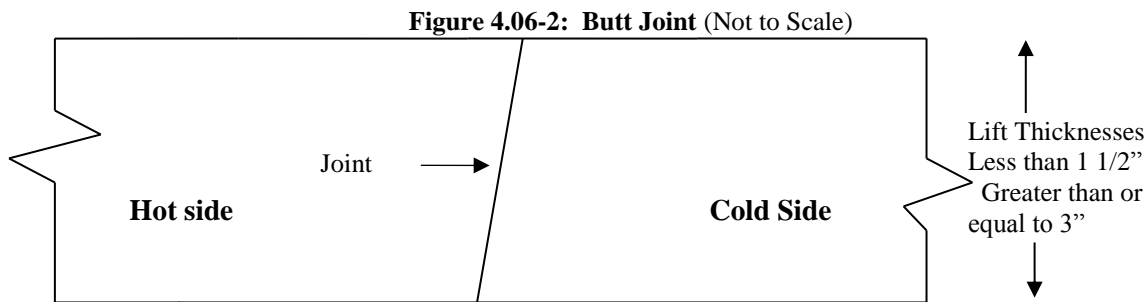

Method III - Butt Joint with Hot Poured Rubberized Asphalt Treatment:

If Method I cannot be used due to physical constraints in certain limited locations, the Contractor may submit a request in writing for approval by the Engineer to use Method III as a substitution in those locations. There shall be no additional measurement or payment made when Method III is substituted for Method I. When required by the Contract or approved by the Engineer, Method III (see Figure 4.06-3) shall be used.

Figure 4.06-3: Butt Joint with Hot Poured Rubberized Asphalt Treatment
(Not to Scale)

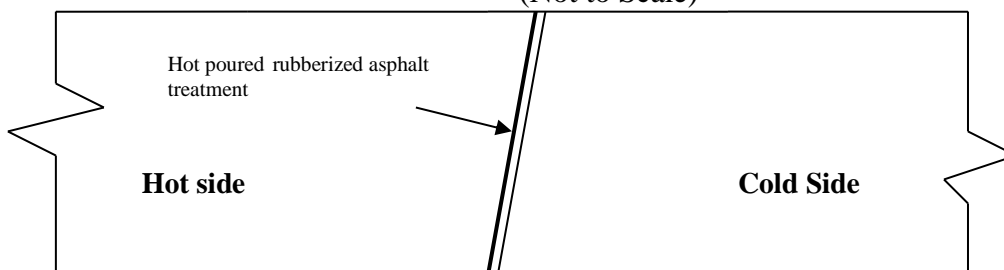

All of the requirements of Method II must be met with Method III. In addition, the longitudinal vertical edge must be treated with a rubberized joint seal material meeting the requirements of ASTM D6690, Type 2. The joint sealant shall be placed on the face of the “cold side” of the butt joint as shown above prior to placing the “hot side” of the butt joint. The joint seal material shall be applied in accordance with the manufacturer’s recommendation so as to provide a uniform coverage and avoid excess bleeding onto the newly placed pavement.

8. Contractor Quality Control (QC) Requirements: The Contractor shall be responsible for maintaining adequate quality control procedures throughout the production and placement operations. Therefore, the Contractor must ensure that the materials, mixture, and work provided by Subcontractors, Suppliers, and Producers also meet Contract specification requirements.

This effort must be documented in Quality Control Plans (QCP) and must address the actions, inspection, or sampling and testing necessary to keep the production and placement operations in control, to determine when an operation has gone out of control and to respond to correct the situation in a timely fashion.

The Standard QCP for production shall consist of the quality control program specific to the production facility.

There are 3 components to the QCP for placement: a Standard QCP, a Project Summary Sheet

that details Project-specific information, and, if applicable, a separate Extended Season Paving Plan as required in 4.06.03-9 “Temperature and Seasonal Requirements.”

The Standard QCP for both production and placement shall be submitted to the Department for approval each calendar year and at a minimum of 30 days prior to production or placement.

Production or placement shall not occur until all QCP components have been approved by the Engineer.

Each QCP shall include the name and qualifications of a Quality Control Manager (QCM). The QCM shall be responsible for the administration of the QCP, and any modifications that may become necessary.

The QCM shall have the ability to direct all Contractor personnel on the Project during paving operations.

The QCPs shall also include the name and qualifications of any outside testing laboratory performing any QC functions on behalf of the Contractor. The QC Technician performing in-place density testing shall be NETTCP certified as a paving inspector.

Approval of the QCP does not relieve the Contractor of its responsibility to comply with the Project specifications. The Contractor may modify the QCPs as work progresses and must document the changes in writing prior to resuming operations. These changes include but are not limited to changes in quality control procedures or personnel. The Department reserves the right to deny significant changes to the QCPs.

QCP for Production: Refer to M.04.03-1.

QCP for Placement: The Standard QCP, Project Summary Sheet, and Extended Season Paving Plan shall conform to the format provided by the Engineer. The format is available at http://www.ct.gov/dot/lib/dot/documents/dconstruction/pat/qcp_outline_hma_placement.pdf

The Contractor shall perform all quality control sampling and testing, provide inspection, and exercise management control to ensure that bituminous concrete placement conforms to the requirements as outlined in its QCP during all phases of the work. The Contractor shall document these activities for each day of placement.

The Contractor shall submit complete field density testing and inspection records to the Engineer within 48 hours in a manner acceptable to the Engineer.

The Contractor may obtain 1 mat core and 1 joint core per day for process control, provided this process is detailed in the QCP. The results of these process control cores shall not be used to dispute the Department’s determinations from the acceptance cores. The Contractor shall submit the location of each process control core to the Engineer for approval prior to taking the core. The core holes shall be filled to the same requirements described in Subarticle 4.06.03-10.

9. Temperature and Seasonal Requirements: Paving, including placement of temporary pavements, shall be divided into 2 seasons, “In-Season” and “Extended-Season.” In-Season paving occurs from May 1 to October 14, and Extended Season paving occurs from October 15 to April 30. The following requirements shall apply unless otherwise authorized or directed by the Engineer:

- Mixtures shall not be placed when the air or subbase temperature is less than 40°F regardless of the season.
- Should paving operations be scheduled during the Extended Season, the Contractor must submit an Extended Season Paving Plan for the Project that addresses minimum delivered mix temperature considering WMA, PMA, or other additives; maximum paver speed; enhanced rolling patterns; and the method to balance mixture delivery and placement

operations. Paving during Extended Season shall not commence until the Engineer has approved the plan.

10. Field Density The Contractor shall obtain cores for the determination of mat and longitudinal joint density of bituminous concrete pavements. Within five calendar days of placement, mat and joint cores shall be extracted on each lift with a specified thickness of 1 1/2 inches or more. Joint cores shall not be extracted on HMA S1.0 lifts.

The Contractor shall extract cores from random locations determined by the Engineer in accordance with ASTM D3665. Four (4) or six (6) inch diameter cores shall be extracted for S0.25, S0.375 and S0.5 mixtures; 6 inch diameter cores shall be required for S1.0 mixtures. The Contractor shall coordinate with the Engineer to witness the extraction, labeling of cores, and filling of the core holes.

Each lift will be separated into lots as follows:

- a. **Simple Average Density Lots:** For total estimated quantities below 2,000 tons, the lift will be evaluated in one lot which will include the total paved tonnage of the lift and all longitudinal joints between the curb lines.
For total estimated quantities between 2,000 and 3,500 tons, the lift will be evaluated in two lots in which each lot will include approximately half of the total tonnage placed for the full paving width of a lift including all longitudinal joints between the curb lines.
- b. **PWL Density Lots:** Mat density lots will include each 3,500 tons of mixture placed within 30 calendar days. Joint density lots will include 14,000 linear feet of constructed joints. Bridge density lots will always be analyzed using simple average lot methodology.
- c. **Partial Density Lot (For PWL only):** A mat density lot with less than 3,500 tons or a joint density lot with less than 14,000 linear feet due to:
 - completion of the course; or
 - a lot spanning 30 calendar days.

Prior to paving, the type and number of lot(s) will be determined by the Engineer.


Noncontiguous areas such as highway ramps may be combined to create one lot.

After the lift has been compacted and cooled, the Contractor shall cut cores to a depth equal to or greater than the lift thickness and shall remove them without damaging the lift(s) to be tested. Any core that is damaged or obviously defective while being obtained will be replaced with a new core from a location within 2 feet measured in a longitudinal direction.

A mat core shall not be located any closer than 1 foot from the edge of a paver pass. If a random number locates a core less than 1 foot from any edge, the location will be adjusted by the Engineer so that the outer edge of the core is 1 foot from the edge of the paver pass.

Method I, Notched Wedge Joint cores shall be taken so that the center of the core is 5 inches from the visible joint on the hot mat side (Figure 4.06-4).


Figure 4.06-4: Notched Wedge Joint Cores (Not to Scale)

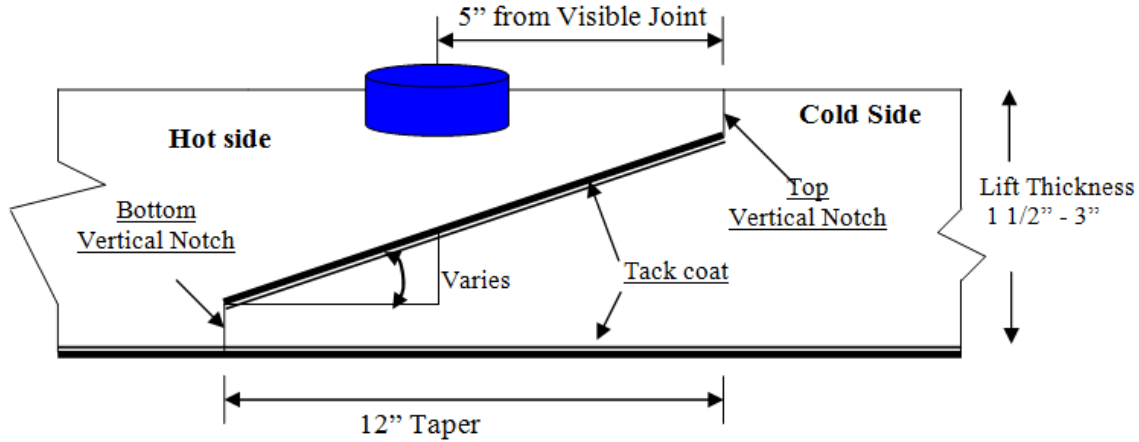

When Method II or Method III Butt Joint is used, cores shall be taken from the hot side so the edge of the core is within 1 inch of the longitudinal joint.

The cores shall be labeled by the Contractor with the Project number, date placed, lot number, and sub-lot number. The core’s label shall include “M” for a mat core and “J” for a joint core. For example, a mat core from the first lot and the first sub-lot shall be labeled with “M1 – 1.” A mat core from the second lot and first sub-lot shall be labeled “M2-1” (see Figure 4.06-5). The Engineer shall fill out a MAT-109 to accompany the cores. The Contractor shall deliver the cores and MAT-109 to the Department’s Central Lab. The Contractor shall use a container approved by the Engineer. The container shall have a lid capable of being locked shut and tamper proof. The Contractor shall use foam, bubble wrap, or another suitable material to prevent the cores from being damaged during handling and transportation. Once the cores and MAT-109 are in the container the Engineer will secure the lid using security seals at the removable hinges(s) and at the lid opening(s). The security seals’ identification number must be documented on the MAT-109. All sealed containers shall be delivered to the Department’s Central Lab within two working days from time of extraction. Central Lab personnel will break the security seal and take possession of the cores.

Figure 4.06-5: Labeling of Cores

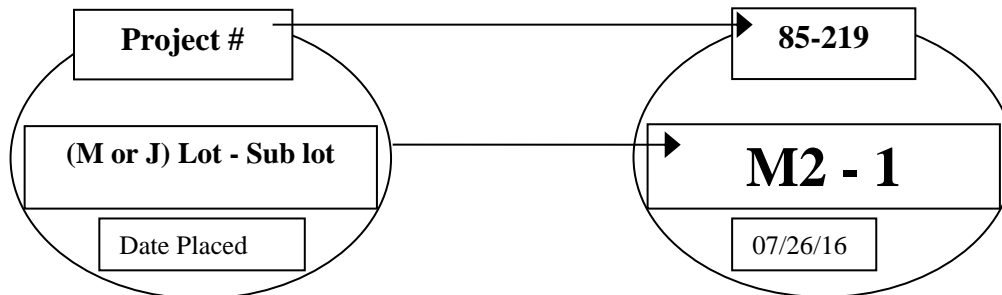

Each core hole shall be filled within 4 hours upon core extraction. Prior to being filled, the hole shall be prepared by removing any free water and applying tack coat using a brush or other

means to uniformly cover the cut surface. The core hole shall be filled using a bituminous concrete mixture at a minimum temperature of 240°F containing the same or smaller nominal maximum aggregate size and compacted with a hand compactor or other mechanical means to the maximum compaction possible. The bituminous concrete shall be compacted to 1/8 inch above the finished pavement.

Simple Average Density Lots:

A standard simple average density lot is the quantity of material placed within the defined area excluding any bridge decks.

A combo simple average density lot is the quantity of material placed within the defined area including bridge decks less than or equal to 500 feet long.

A bridge simple average density lot is the quantity of material placed on a bridge deck longer than 500 feet.

The number of cores per lot shall be determined in accordance with Table 4.06-4. If a randomly selected mat or joint core location is on a bridge deck, the core is to be obtained on the bridge deck in addition to the core(s) required on the bridge deck.

The number of cores per lot shall be determined in accordance with Table 4.06-5. Multiple bridge decks can be combined into one lot if the paving and underlying conditions are comparable. If multiple bridge decks are combined into a single bridge lot, at least one mat and joint core shall be obtained on each bridge.

The longitudinal locations of mat cores within a standard, combo, or bridge lot containing multiple paving passes will be determined using the combined length of the paving passes within the lot.

TABLE 4.06-4: Number of Cores per Lot (Simple Average)

Lot Type	No. of Mat Cores		No. of Joint Cores	
Standard Lot < 500 Tons	3		3	
Standard Lot ≥ 500 Tons	4		4	
Combo Lot < 500 Tons	2 plus	1 per bridge (≤ 300')	2 plus	1 per bridge (≤ 300')
Combo Lot ≥ 500 Tons ⁽¹⁾	4 plus	2 per bridge (301' – 500')	4 plus	2 per bridge (301' – 500')

TABLE 4.06-5: Number of Core per Bridge Density Lot (Simple Average)

Length of Bridge(s) (Feet)	Minimum No. of Mat Cores	Minimum No. of Joint Cores
< 500	2	2
501 – 1,500	3	3
1,501 – 2,500	4	4
2,501 and greater	5	5

PWL Density Lots:

A PWL mat density lot is 3,500 tons of material placed within the defined area excluding any bridges. One mat core will be obtained per every 500 tons placed.

A PWL joint density lot is 14,000 linear feet of longitudinal joint excluding any joints on bridge decks. One joint core will be obtained per every 2,000 linear feet of joint.

Bridge density lots will always be analyzed as using the simple average lot methodology. The number of cores per lot shall be determined in accordance with Table 4.06-5. Multiple bridge decks can be combined into one lot if the paving and underlying conditions are comparable. If multiple bridge decks are combined into a single bridge lot, at least one mat and joint core shall be obtained on each bridge.

11. Acceptance Sampling and Testing: Sampling shall be performed in accordance with ASTM D3665 or a statistically-based procedure of stratified random sampling approved by the Engineer.

Plant Material Acceptance: The Contractor shall provide the required sampling and testing during all phases of the work in accordance with M.04. The Department will verify the Contractor's acceptance test results. Should any test results exceed the specified tolerances in the Department's current QA Program for Materials, the Contractor's test results for a subject lot or sub lot may be replaced with the Department's results for the purpose of calculating adjustments. The verification procedure is included in the Department's current QA Program for Materials.

Density Acceptance: The Engineer will perform all acceptance testing in accordance with AASHTO T 331. The density of each core will be determined using the daily production's average maximum theoretical specific gravity (Gmm) established during the testing of the parent material at the Plant. When there was no testing of the parent material or any Gmm exceeds the specified tolerances in the Department's current QA Program for Materials, the Engineer will determine the maximum theoretical density value to be used for density calculations.

12. Density Dispute Resolution Process: The Contractor and Engineer will work in partnership to avoid potential conflicts and to resolve any differences that may arise during quality control or acceptance testing for density. Both parties will review their sampling and testing procedures and results and share their findings. If the Contractor disputes the Engineer's test results, the Contractor must submit in writing a request to initiate the Dispute Resolution Process within five calendar days of the notification of the test results. No request for dispute resolution will be allowed unless the Contractor provides quality control results from samples taken prior to and after finish rolling, and within the timeframe described in 4.06.03-8 supporting its position. No request for dispute resolution will be allowed for a density lot in which any core was not taken within the required 5 calendar days of placement. Should the dispute not be resolved through evaluation of existing testing data or procedures, the Engineer may authorize the Contractor to obtain a new core or set of core samples per disputed lot. The core samples must be extracted no later than seven calendar days from the date of the Engineer's authorization. All such core samples shall be extracted and the core hole filled using the procedure outlined in 4.06.03-10.

a) **Simple Average Lots:** The Contractor may only dispute any simple average lot that is adjusted at or below 95 percent payment. The number and location (mat, joint, or structure) of the cores taken for dispute resolution must reflect the number and location of the original cores. The location of each core shall be randomly located within the respective original sub lot. The dispute resolution results shall be combined with the original results and averaged for determining the final in-place density value.

b) **PWL Lots:** The Contractor may dispute any PWL subplot when the PWL falls below 50%

calculated in accordance with section 4.06.04.2.b. An additional random core in the subplot may be taken to validate the accuracy of the core in question. The Department will verify the additional core test result and may average the original test result with the additional core result for purpose of calculating adjustments.

13. Corrective Work Procedure:

If pavement placed by the Contractor does not meet the specifications, and the Engineer requires its replacement or correction, the Contractor shall:

- a) Propose a corrective procedure to the Engineer for review and approval prior to any corrective work commencing. The proposal shall include:
 - Limits of pavement to be replaced or corrected, indicating stationing or other landmarks that are readily distinguishable.
 - Proposed work schedule.
 - Construction method and sequence of operations.
 - Methods of maintenance and protection of traffic.
 - Material sources.
 - Names and telephone numbers of supervising personnel.
- b) Any corrective courses placed as the final wearing surface shall match the specified lift thickness after completion.

14. Protection of the Work: The Contractor shall protect all sections of the newly finished pavement from damage that may occur as a result of the Contractor's operations for the duration of the Project.

15. Cut Bituminous Concrete Pavement: Work under this item shall consist of making a straight-line cut in the bituminous concrete pavement to the lines delineated on the plans or as directed by the Engineer. The cut shall provide a straight, clean, vertical face with no cracking, tearing or breakage along the cut edge.

4.06.04—Method of Measurement:

1. HMA S* or PMA S*: Bituminous concrete will be measured for payment as the amount of material in tons placed as determined by the net weight on the delivered tickets and adjusted by area, thickness and weight as follows:

Quantity Adjustments: Adjustments may be applied to the placed bituminous concrete quantities that will be measured for payment using the following formulas:

Yield Factor for Adjustment Calculation = 0.0575 tons/SY/inch

Actual Area (SY) = [(Measured Length (ft)) x (Avg. of width measurements (ft))] ÷ 9 s.f./SY

Actual Thickness (t) = Total tons delivered / [Actual Area (SY) x 0.0575 tons/SY/inch]

- a) Area: If the average width exceeds the allowable tolerance, an adjustment will be made using the following formula. The tolerance for width is equal to the specified thickness (inch) of the lift being placed.

Quantity Adjusted for Area (T_A) = [(L x W_{adj})/9] x (t) x 0.0575 Tons/SY/inch = (-) tons

Where: L = Length (ft)

(t) = Actual thickness (inches)

W_{adj} = (Designed width (ft) + tolerance /12) - Measured Width)

- b) Thickness: If the actual average thickness is less than the allowable tolerance, the Contractor shall submit a repair procedure to the Engineer for approval. If the actual thickness exceeds the allowable tolerance, an adjustment will be made using the following formula:

$$\text{Quantity Adjusted for Thickness (T}_T\text{)} = A \times t_{\text{adj}} \times 0.0575 = (-) \text{ tons}$$

Where: A = Area = $\{[L \times (\text{Design width} + \text{tolerance (lift thickness)/12}]\} / 9\}$
 t_{adj} = Adjusted thickness = $[(Dt + \text{tolerance}) - \text{Actual thickness}]$
 Dt = Designed thickness (inches)

- c) Weight: If the quantity of bituminous concrete representing the mixture delivered to the Project is in excess of the allowable gross vehicle weight (GVW) for each vehicle, an adjustment will be made using the following formula:

$$\text{Quantity Adjusted for Weight (T}_w\text{)} = \text{GVW} - \text{DGW} = (-) \text{ tons}$$

Where: DGW = Delivered gross weight as shown on the delivery ticket or measured on a certified scale

2. Bituminous Concrete Adjustment Cost:

- a) Production Lot Adjustment: An adjustment may be applied to each production lot as follows:
- i. Non-PWL Production Lot (less than 3,500 tons):
 The adjustment values in Tables 4.06-6 and 4.06-7 will be calculated for each sub lot based on the Air Void (AV) and Asphalt Binder Content (PB) test results for that sub lot. The total adjustment for each day's production (lot) will be computed as follows:

$$\text{Tons Adjusted for Superpave Design (T}_{\text{SD}}\text{)} = [(\text{AdjAV}_t + \text{AdjPB}_t) / 100] \times \text{Tons}$$

Where: AdjAV_t: Percent adjustment for air voids
 AdjPB_t: Percent adjustment for asphalt binder
 Tons: Weight of material (tons) in the lot adjusted by 4.06.4-1

$$\text{Percent Adjustment for Air Voids} = \text{AdjAV}_t = [\text{AdjAV}_1 + \text{AdjAV}_2 + \text{AdjAV}_i + \dots + \text{AdjAV}_n] / n$$

Where: AdjAV_t = Total percent air void adjustment value for the lot
 AdjAV_i = Adjustment value from Table 4.06-6 resulting from each sub lot or the average of the adjustment values resulting from multiple tests within a sub lot, as approved by the Engineer.
 n = number of sub lots based on Table M.04.03-2

TABLE 4.06-6: Adjustment Values for Air Voids

Adjustment Value (AdjAV _i) (%)	S0.25, S0.375, S0.5, S1 Air Voids (AV)
+2.5	3.8 - 4.2
+3.125*(AV-3)	3.0 - 3.7
-3.125*(AV-5)	4.3 - 5.0
20*(AV-3)	2.3 - 2.9
-20*(AV-5)	5.1 - 5.7
-20.0	≤ 2.2 or ≥ 5.8

Percent Adjustment for Asphalt Binder = AdjPB_t = [(AdjPB₁ + AdjPB₂ + AdjPB_i + ... + AdjPB_n)] / n

Where: AdjPB_t = Total percent liquid binder adjustment value for the lot
 AdjPB_i = Adjustment value from Table 4.06-7 resulting from each sub lot
 n = number of binder tests in a production lot

TABLE 4.06-7: Adjustment Values for Binder Content

Adjustment Value (AdjAV _i) (%)	<u>S0.25, S0.375, S0.5, S1</u> Pb
0.0	JMF Pb ± 0.3
- 10.0	≤ JMF Pb - 0.4 or ≥ JMF Pb + 0.4

ii. PWL Production Lot (3500 tons or more):

For each lot, the adjustment values will be calculated using PWL methodology based on AV, VMA, and PB test results. The results will be considered as being normally distributed and all applicable equations in AASHTO R 9 and AASHTO R 42 Appendix X4 will apply.

Only one test result will be considered for each sub lot. The specification limits are listed in M.04.

For AV, PB, and voids in mineral aggregate (VMA), the individual material quantity characteristic adjustment (Adj) will be calculated as follows:

For PWL between 50 and 90%: Adj(AV_t or PB_t or VMA_t) = (55 + 0.5 PWL) - 100

For PWL at and above 90%: Adj(AV_t or PB_t or VMA_t) = (77.5 + 0.25 PWL) - 100

Where: AdjAV_t = Total percent AV adjustment value for the lot

AdjPB_t = Total percent PB adjustment value for the lot

AdjVMA_t = Total percent VMA adjustment value for the lot

A lot with PWL less than 50% in any of the 3 individual material quality characteristics will be evaluated under 1.06.04.

The total adjustment for each production lot will be computed using the following formula:

Tons Adjusted for Superpave Design (T_{SD}) = [(0.5AdjAV_t + 0.25AdjPB_t + 0.25 AdjVMA_t) / 100] X Tons

Where Tons: Weight of material (tons) in the lot adjusted by 4.06.4-1

iii. Partial Lots:

Lots with less than 4 sub lots will be combined with the prior lot. If there is no prior lot with equivalent material or if the last test result of the prior lot is over 30 calendar days old, the adjustment will be calculated as indicated in 4.06.04-2.a)i.

Lots with 4 or more sub lots will be calculated as indicated in 4.06.04-2.a)ii.

Production Lot Adjustment: $T_{SD} \times \text{Unit Price} = \text{Est. (Pi)}$

Where: Unit Price = Contract unit price per ton per type of mixture

Est. (Pi)= Pay Unit in dollars representing incentive or disincentive per lot

b) Density Lot Adjustment: An adjustment may be applied to each density lot as follows:

i. Simple Average Density Lot (less than 3500 tons) and Bridge Lots:

The final lot quantity shall be the difference between the total payable tons for the Project and the sum of the previous lots. If either the Mat or Joint adjustment value is “remove and replace,” the density lot shall be removed and replaced (curb to curb).

No positive adjustment will be applied to a density lot in which any core was not taken within the required 5 calendar days of placement.

Tons Adjusted for Density (T_D) = $[(P_{AM} \times 0.50) + (P_{AJ} \times 0.50)] / 100 \times \text{Tons}$

Where: T_D = Total tons adjusted for density for each lot

P_{AM} = Mat density percent adjustment from Table 4.06-8

P_{AJ} = Joint density percent adjustment from Table 4.06-9

Tons: Weight of material (tons) in the lot adjusted by 4.06.4-1

TABLE 4.06-8: Adjustment Values for Pavement Mat density

Average Core Result Percent Mat Density	Percent Adjustment (Bridge and Non-Bridge) ⁽¹⁾⁽²⁾
97.1 - 100	-1.667*(ACRPD-98.5)
94.5 – 97.0	+2.5
93.5 – 94.4	+2.5*(ACRPD-93.5)
92.0 – 93.4	0
90.0 – 91.9	-5*(92-ACRPD)
88.0 – 89.9	-10*(91-ACRPD)
87.0 – 87.9	-30
86.9 or less	Remove and Replace (curb to curb)

Notes:

⁽¹⁾ ACRPD = Average Core Result Percent Density

⁽²⁾ All Percent Adjustments to be rounded to the second decimal place; for example round 1.667 to 1.67.

TABLE 4.06-9: Adjustment Values for Pavement Joint Density

Average Core Result	Percent Adjustment (Bridge and Non-Bridge) ⁽¹⁾⁽²⁾
Percent Joint Density	
97.1 – 100	-1.667*(ACRPD-98.5)
93.5 – 97.0	+2.5
92.0 – 93.4	+1.667*(ACRPD-92)
91.0 – 91.9	0
89.0 – 90.9	-7.5*(91-ACRPD)
88.0 – 88.9	-15*(90-ACRPD)
87.0 – 87.9	-30
86.9 or less	Remove and Replace (curb to curb)

Notes:

⁽¹⁾ ACRPD = Average Core Result Percent Density

⁽²⁾ All Percent Adjustments to be rounded to the second decimal place; for example round 1.667 to 1.67

Additionally, any subplot with a density result below 87% will be evaluated under 1.06.04.

ii. PWL Density Lot (3,500 tons or more):

For each lot, the adjustment values will be calculated using PWL methodology based on mat and joint density test results. Only one result will be included for each subplot. The results will be considered as being normally distributed and all applicable equations in AASHTO R 9 and AASHTO R 42 Appendix X4 will apply.

The specification limits for the PWL determination are as follows:

Mat Density: 91.5-98%

Joint Density: 90-98%

For mat and joint density, the individual percent adjustment (PA) will be calculated as follows:

For PWL between 50 and 90%: $PA_{(M \text{ or } J)} = 0.25 * PWL - 22.50$

For PWL at and above 90%: $PA_{(M \text{ or } J)} = 0.125 * PWL - 11.25$

Where: PA_M = Total percent mat density adjustment value for the PWL mat density lot

PA_J = Total percent joint density adjustment value for the PWL joint density lot

No positive adjustment will be applied to a density lot in which any core was not taken within the required 5 calendar days of placement.

A lot with PWL less than 50% will be evaluated under 1.06.04.

The total adjustment for each PWL mat density lot will be computed as follows:

Tons Adjusted for Mat Density (T_{MD}) = $(PA_M / 100) \times \text{Tons}$

Where: Tons= Weight of material (tons) in the lot adjusted by 4.06.4-1.

The total adjustment for each PWL joint density lot will be computed as follows:

Tons Adjusted for Joint Density (T_{JD}) = $(PA_J / 100) \times J_Tons$

Tons Adjusted for Joint Density will be calculated at the end of each project or project phase.

Where: $J_Tons = Tons\ in\ project\ or\ phase\ adjusted\ by\ 4.06.4 - 1 \times \frac{Lot\ joint\ length}{Joint\ length\ in\ project\ or\ phase}$

All bridge density lot adjustments will be evaluated in accordance with 4.06.04-2.b)i.

Additionally, any subplot with a density result below 87% will be evaluated under 1.06.04.

iii. Partial Lots:

Lots with less than 4 sub lots will be combined with the prior lot. If there is no prior lot with equivalent material and placement conditions or if the last test result of the prior lot is over 30 calendar days old, the mat and joint individual adjustments will be calculated in accordance to Tables 4.06-8 and 4.06-9. T_{MD} and T_{JD} will be calculated as indicated in 4.06.04-2.b)i.

Lots with 4 or more sub lots will be calculated as indicated in 4.06.04-2.b)ii.

Density Lot Adjustment (Simple Average Lots): $T_D \times Unit\ Price = Est.\ (Di)$

Density Lot Adjustment (PWL Lots): $(T_{MD}\ or\ T_{JD}) \times Unit\ Price = Est.\ (DMi\ or\ DJi)$

Where: Unit Price = Contract unit price per ton per type of mixture

Est. (Di)= Pay Unit in dollars representing incentive or disincentive per simple average density lot

Est. (DMi)= Pay Unit in dollars representing incentive or disincentive per PWL mat lot

Est. (DJi)= Pay Unit in dollars representing incentive or disincentive per PWL joint lot

Additionally, any subplot with a density result below 87% will be evaluated under 1.06.04.

3. Transitions for Roadway Surface: The installation of permanent transitions will be measured under the appropriate item used in the formation of the transition.

The quantity of material used for the installation of temporary transitions will be measured for payment under the appropriate item used in the formation of the transition. The installation and removal of a bond breaker and the removal and disposal of any temporary transition formed by milling or with bituminous concrete pavement is not measured for payment.

4. Cut Bituminous Concrete Pavement: The quantity of bituminous concrete pavement cut will be measured in accordance with 2.02.04.

5. Material for Tack Coat: The quantity of tack coat will be measured for payment by the number of gallons furnished and applied on the Project and approved by the Engineer. No tack coat material shall be included that is placed in excess of the tolerance described in 4.06.03.

- a. Container Method – Material furnished in a container will be measured to the nearest 1/2 gallon. The volume will be determined by either measuring the volume in the original container by a method approved by the Engineer or using a separate graduated container

capable of measuring the volume to the nearest 1/2 gallon. The container in which the material is furnished must include the description of material, including lot number or batch number and manufacturer or product source.

b. Vehicle Method

i. Measured by Weight: The number of gallons furnished will be determined by weighing the material on calibrated scales furnished by the Contractor. To convert weight to gallons, one of the following formulas will be used:

Tack Coat (gallons at 60°F) = Measured Weight (pounds) / Weight per gallon at 60°F

Tack Coat (gallons at 60°F) = 0.996 x Measured Weight (pounds) / Weight per gallon at 77°F

ii. Measured by automated metering system on the delivery vehicle:

Tack Coat (gallons at 60°F) = 0.976 x Measured Volume (gallons).

6. Material Transfer Vehicle (MTV): The furnishing and use of a MTV will be measured separately for payment based on the actual number of surface course tons delivered to a paver using the MTV.

4.06.05—Basis of Payment:

1. HMA S* or PMA S*: The furnishing and placing of bituminous concrete will be paid for at the Contract unit price per ton for " HMA S*" or " PMA S*."

All costs associated with providing illumination of the work area are included in the general cost of the work.

All costs associated with cleaning the surface to be paved, including mechanical sweeping, are included in the general cost of the work. All costs associated with constructing longitudinal joints are included in the general cost of the work.

All costs associated with obtaining cores for acceptance testing and dispute resolution are included in the general cost of the work.

2. Bituminous Concrete Adjustment Costs: This adjustment will be calculated using the formulas shown below if all of the measured adjustments in 4.06.04-2 are not equal to zero. A positive or negative adjustment will be applied to monies due the Contractor.

Production Lot: $\Sigma \text{ Est (Pi)} = \text{Est. (P)}$

Density Lot (Simple Average Lots): $\Sigma \text{ Est (Di)} = \text{Est. (D)}$

Density Lot (PWL): $\Sigma \text{ Est (DMi)} + \Sigma \text{ (DJi)} = \text{Est. (D)}$

Bituminous Concrete Adjustment Cost= Est. (P) + Est. (D)

Where: Est. ()= Pay Unit in dollars representing incentive or disincentive in each production or density lot calculated in 4.06.04-2

The Bituminous Concrete Adjustment Cost item, if included in the bid proposal or estimate, is not to be altered in any manner by the Bidder. If the Bidder should alter the amount shown, the altered figure will be disregarded and the original estimated cost will be used for the Contract.

3. Transitions for Roadway Surface: The installation of permanent transitions will be paid under the appropriate item used in the formation of the transition. The quantity of material used for the installation of temporary transitions will be paid under the appropriate pay item used in the formation of the transition. The installation and removal of a bond breaker, and the removal and disposal of any temporary transition formed by milling or with bituminous concrete

pavement is included in the general cost of the work.

4. The cutting of bituminous concrete pavement will be paid in accordance with 2.02.05.
5. Material for tack coat will be paid for at the Contract unit price per gallon at 60°F for "Material for Tack Coat."
6. The Material Transfer Vehicle (MTV) will be paid at the Contract unit price per ton for "Material Transfer Vehicle."

Pay Item	Pay Unit
HMA S*	ton
PMA S*	ton
Bituminous Concrete Adjustment Cost	est.
Material for Tack Coat	gal.
Material Transfer Vehicle	ton

SECTION 5.86 - CATCH BASINS, MANHOLES AND DROP INLETS

5.86.01—Description

5.86.02—Materials

5.86.03—Construction Methods

5.86.04—Method of Measurement

5.86.05—Basis of Payment

5.86.01—Description: The work under this Section shall consist of furnishing, preparing, and installing catch basins, manholes and drop inlets (and also the removal, abandonment, alteration, reconstruction, or conversion of such existing structures) in conformity with the lines, grades, dimensions and details shown on the plans.

This Section shall also include resetting or replacing catch basin tops as well as manhole frames and covers.

5.86.02—Materials: The materials for this work shall meet the following requirements:

Drainage structures shall meet the requirements of M.08.02 and shall utilize concrete with a 28-day minimum compressive strength of 4000 psi.

Galvanizing shall meet the requirements of M.06.03.

Mortar shall meet the requirements of M.11.04.

Butyl rubber joint seal shall meet the requirements of ASTM C990.

Granular fill, if necessary, shall meet the requirements of M.02.01.

Protective compound material shall be a type appearing on the Department's Qualified Products List and be acceptable to the Engineer, as specified in M.03.09.

5.86.03—Construction Methods: Drainage trench excavation, including rock in drainage trench excavation and backfilling, shall be performed in accordance with 2.86.03 and the requirements of the plans.

Where a drainage structure is to be installed below the surface, a drainage trench shall be excavated to the required depth, the bottom of which shall be graded to the elevation of the bottom of the proposed drainage structure or to ensure a uniform foundation for the structure.

Where a firm foundation is not encountered at the grades established due to unsuitable material, such as soft, spongy, or unstable soil, the unsuitable material shall be removed and replaced with approved granular fill, thoroughly compacted in lifts not to exceed 6 inches. The Engineer shall be notified prior to removal of the unsuitable material in order to determine the depth of removal necessary.

When rock, as defined in 2.86.01-2, is encountered, work shall be performed in accordance with 2.86.03 and the requirements of the plans.

When a drainage structure outside of proposed drainage trench limits is to be removed, it shall be completely removed and all pipes shall be removed or plugged with cement masonry.

When a drainage structure is to be abandoned, the structure shall be removed to a depth 2 feet below the subgrade or as directed by the Engineer. The floor of the structure shall be broken and all pipes shall be plugged with cement masonry.

Drainage structures shall be constructed in accordance with the plans and the requirements contained herein for the character of the work involved. The provisions of 6.02.03 pertaining to bar reinforcement shall apply except that shop drawings need not be submitted for approval unless called for in the plans, Contract or directed by the Engineer. Welding shall be performed in accordance with the applicable sections of the AWS Structural Welding Code, D1.1.

When it becomes necessary to increase the horizontal dimensions of manholes, catch basins and drop inlets to sizes greater than those shown on the plans in order to provide for multiple pipe installations, large pipes or for other reasons, the Contractor shall construct such manholes, catch basins and drop inlets to modified dimensions as directed by the Engineer.

The surfaces of the tops of all catch basins, and drop inlets shall be given a coat of protective compound material, at the manufacturer's recommended application rate, immediately upon completion of the concrete curing period.

All masonry units shall be laid in full mortar beds.

Metal fittings for catch basins, manholes or drop inlets shall be set in full mortar beds or otherwise secured as shown on the plans.

All inlet and outlet pipes shall be set flush with the inside face of the wall of the drainage structure as shown on the plans. The pipes shall extend through the walls for a sufficient distance beyond the outside surface to allow for satisfactory connections, and the concrete or masonry shall be constructed around them neatly to prevent leakage along their outer surfaces.

When constructing a new drainage structure within a run of existing pipe, the section of existing pipe disturbed by the construction shall be replaced with new pipe of identical type and size extending from the drainage structure to the nearest joint of the existing pipe in accordance with 6.86.03 or as directed by the Engineer.

Backfilling shall be performed in accordance with 2.86.03.

Frames, covers and tops which are to be reset shall be removed from their present beds, the walls or sides shall be rebuilt to conform to the requirements of the new construction and the frames, covers and tops shall be reset as shown on the plans or as directed by the Engineer.

5.86.04—Method of Measurement:

Drainage Trench Excavation: In accordance with 2.86.04, excavation for drainage trench will not be measured for payment but shall be included in the Contract unit price for the type of structure being installed.

Rock in Drainage Trench Excavation: Rock in Drainage Trench Excavation will be measured in accordance with the drainage trench excavation limits described in 2.86.03.

Manholes, Catch Basins and Drop Inlets will be measured as separate units.

Resetting of Manholes, Catch Basins and Drop Inlets will be measured as separate units.

Replacement of frames, covers, and tops will be measured as a unit for catch basin top or manhole frame and cover.

Conversion of drainage structures as specified on the plans, or as directed by the Engineer, including structure reconstruction will be measured for payment as a unit.

Removal or abandonment of drainage structures outside of drainage trench excavation limits, as defined in 2.86.03, will be measured as separate units.

There will be no measurement or direct payment for the application of the protective compound material, the cost of this work shall be considered as included in the general cost of the work.

Measurement for payment for work and materials involved with installing pipes to connect new drainage structures into a run of existing pipe will be as provided for under the applicable Contract items in accordance with 6.86.04.

There will be no measurement or direct payment for plugging existing pipes with cement masonry, the cost of this work will be considered as included in the general cost of the work.

5.86.05—Basis of Payment:

Drainage Trench Excavation for the installation of proposed structures described herein will be paid for under the respective drainage Contract item(s) for which the excavation is being performed, in accordance with the provisions of 2.86.05.

Rock in Drainage Trench Excavation will be paid for in accordance with the provisions of 2.86.05.

Manholes and Catch Basins will be paid for at the Contract unit price for each "Manhole," or "Catch Basin," of the type specified, at "0' to 10' Deep" or "0' to 20' Deep," complete in place, which price shall include all excavation, backfill, materials, equipment, tools and labor incidental thereto.

Drop Inlets will be paid for at the Contract unit price for each "Drop Inlet," of the type specified, complete in place, which price shall include all excavation, backfill, materials, equipment, tools and labor incidental thereto.

Manholes, Catch Basins and Drop Inlets constructed to modified dimensions as directed by the Engineer, will be paid for as follows:

Where the interior floor area has to be increased to accommodate existing field conditions, as measured horizontally at the top of the base of the completed structure, and does not exceed 125% of the interior floor area as shown on the plans for that structure, then the structure shall be paid for at the Contract unit price for each "Manhole," "Catch Basin," or "Drop Inlet" of the type specified. Where the floor area is greater than 125%, the increase in the unit price for the individual structure shall be in direct proportion to the increase of the completed structure interior floor area as compared to the interior floor area as shown on the plans for that structure. Such increased unit price shall include all excavation, materials, equipment, tools, and labor incidental to the completion of the structure.

Reset Units will be paid for at the Contract unit price each for "Reset Manhole," "Reset Catch Basin," or "Reset Drop Inlet," of the type specified, respectively, complete in place, which price shall include excavation, cutting of pavement, removal and replacement of pavement structure, and all materials, equipment, tools and labor incidental thereto, except when the work requires reconstruction greater than 3 feet, measured vertically, then the entire cost of resetting the unit will be paid for as Extra Work in accordance with the provisions of 1.04.05.

Frames, Covers, and Tops when required in connection with reset units, will be paid for at the Contract unit price each for such "Manhole Frame and Cover" or "(Type) Catch Basin Top," complete in place, including all incidental expense; or when no price exists, the furnishing and placing of such material will be paid for as Extra Work in accordance with the provisions of 1.04.05.

When the catch basin top has a stone or granite curb in its design, the curb or inlet shall be included in the cost of the "(Type) Catch Basin Top."

Conversion of drainage structures will be paid for at the Contract unit price each for "Convert Catch Basin to (Type) Catch Basin," "Convert Catch Basin to (Type) Manhole," or

"Convert Manhole to (Type) Catch Basin," complete in place, which price shall include excavation, cutting of pavement, removal and replacement of pavement, backfill, all alterations to existing structure, all materials including catch basin frame and grate of the type specified, or manhole frame and cover, all equipment, tools and labor incidental thereto.

The maximum change in elevation of frame under these items shall not exceed 3 feet. Greater depth changes, if required, shall be paid for as Extra Work, in accordance with 1.04.05.

Removal or abandonment of drainage structures outside of drainage trench excavation limits as defined in 2.86.03 will be paid for at the Contract unit price each for "Remove Drainage Structure – 0' to 10' Deep," "Remove Drainage Structure – 0' to 20' Deep," or "Abandon Drainage Structure," which price shall include excavation, cutting of pavement, removal and replacement of pavement, backfill, and all equipment, tools and labor incidental thereto.

Pay Item	Pay Unit
(Type) Catch Basin – 0' to 10' Deep	ea.
(Type) Catch Basin – 0' to 20' Deep	ea.
Manhole (Size) – 0' to 10' Deep	ea.
Manhole (Size) – 0' to 20' Deep	ea.
(Type) Drop Inlet	ea.
Reset Catch Basin	ea.
Reset Manhole	ea.
Reset Drop Inlet	ea.
Convert Catch Basin to (Type) Catch Basin	ea.
Convert Catch Basin to (Type) Manhole	ea.
Convert Manhole to (Type) Catch Basin	ea.
Manhole Frame and Cover	ea.
(Type) Catch Basin Top	ea.
Remove Drainage Structure – 0' to 10' Deep	ea.
Remove Drainage Structure – 0' to 20' Deep	ea.
Abandon Drainage Structure	ea.

SECTION 6.03 – STRUCTURAL STEEL

Section 6.03 is amended as follows:

6.03.03—Construction Methods: Revise Subarticle 4(f) “High Strength Bolted Connections” as follows:

Replace the first paragraph and Table A: "Minimum Bolt Tension in kips" with the following:

" The assembly of structural connections using high-strength bolts shall be installed so as to develop the minimum required bolt tension specified in Table A. The Manufacturer’s certified test report; including the rotational capacity test results must accompany the fastener assemblies. Fastener Assemblies delivered without the certified reports will be rejected.

Table A: Minimum Bolt Tension in kips*

<u>Bolt Diameter (Inches)</u>	<u>ASTM F3125 Grade A325</u>	<u>ASTM F3125 Grade A490</u>
5/8	19	24
3/4	28	35
7/8	39	49
1	51	64
1 1/8	64	80
1 1/4	81	102
1 3/8	97	121
1 1/2	118	148

*Equal to 70% of specified minimum tensile strength of bolts (as specified in ASTM Specifications for tests of full-size F3125 Grade A 325 and F3125 Grade A 490 bolts with UNC threads, loaded in axial tension) rounded to the nearest kip.

Revise the last sentence of the sixteenth paragraph, "Rotational-Capacity Tests" as follows:

" When performed in the field, the procedure shall meet the requirements of ASTM F3125 Annex A2."

In Table C, insert the word "Grade" in the third row before every occurrence of "A325" and "A490."

SECTION 6.86 - DRAINAGE PIPES, DRAINAGE PIPE ENDS

6.86.01—Description

6.86.02—Materials

6.86.03—Construction Methods

6.86.04—Method of Measurement

6.86.05—Basis of Payment

6.86.01—Description: This work shall consist of furnishing, preparing and installing drainage pipes of the size and type specified, bedding material, joint sealant, rubber gaskets, clamps, collars, grout, grout collars, drainage trench excavation, backfilling or satisfactory disposal of all materials, the removal of which is necessary for the proper completion of the work, connecting proposed drainage systems to existing systems, plugging or abandoning existing pipes and removal of existing pipe within trench limits, as shown on the plans or as directed by the Engineer.

This Section shall also include removal of drainage pipes outside of drainage trench excavation limits, as defined in 2.86.03-1.

6.86.02—Materials: The materials for this work shall meet the following requirements: Drainage Pipe, Drainage Pipe Ends, Sealers, Gaskets and connection hardware shall meet the requirements of M.08.01.

Bedding Material shall meet the requirements of M.08.03-1.

Granular Fill, if necessary, shall meet the requirements of M.02.01.

Brick Masonry shall meet the requirements of M.11.03 and Mortar shall meet the requirements of M.11.04.

Concrete used for Concrete Pipe Connections shall be Class “F” Concrete meeting the requirements of M.03.

6.86.03—Construction Methods:

(1) **Drainage Trench Excavation:** Drainage trench excavation and backfilling shall be performed in accordance with 2.86.03 and the requirements of the plans.

Where drainage pipe is to be laid below the surface, a drainage trench shall be excavated to the required depth, the bottom of which shall be graded to the elevation of the bottom of the bedding material.

Where drainage pipe is to be laid in a fill area, the embankment shall be placed and compacted to a minimum elevation 12 inches above the top of the proposed pipe, whereupon the drainage trench excavation shall be performed and the pipe installed.

(2) **Rock in Drainage Trench Excavation:** When rock, as defined in 2.86.01-2, is encountered, work shall be performed in accordance with 2.86.03 and the requirements of the plans.

(3) **Drainage Pipe Installation:** New or re-laid drainage pipes shall be installed on 4 inches of bedding material (12 inches if over rock in ledge formation), the details as shown on the plans, or as directed by the Engineer. Prior to placement of the drainage pipe, in accordance with the plans, bedding material shall be pre-shaped to 10% of the total height

of the pipe in order to keep the pipe in the center of the trench. Following placement of the drainage pipe, bedding material backfill shall be placed in accordance with the following table:

Internal Pipe Diameter	Required Bedding Material Backfill
< 48 inches *	25% of total height of the pipe
≥ 48 inches *	12 inches above the top of the pipe
*Includes pipe arch of equivalent internal horizontal span See Standard Drawing	

The placement of the drainage pipe shall start at the downstream end and progress upstream or as shown on the plans, or as directed by the Engineer. All drainage pipes shall be carefully laid in the center of the drainage trench, true to the lines and grades given. Bell ends shall face upgrade and all joints shall be tight.

Joints in concrete pipe shall be sealed with cold-applied bituminous sealer, preformed plastic gaskets or flexible, watertight, rubber-type gaskets. Portland cement mortar shall not be used for sealing pipe joints except with permission of the Engineer.

When cold-applied bituminous sealer is used, the bell and spigot ends shall be wiped clean and dry before applying the bituminous sealer to the pipe ends. Before the drainage pipes are placed in contact with each other, the spigot or tongue end shall be completely covered with bituminous sealer; then the pipe shall be laid to line and grade so the inside surface of all abutting pipes are flush. Additional bituminous sealer shall be applied to the joint after the connection has been made to ensure a water tight connection.

Where the end of an existing drainage pipe is not compatible with the end of a proposed concrete pipe, the Contractor shall align the inner diameters of the pipes being connected, butt the pipe ends together, and construct a cast-in-place concrete pipe connection, as shown in the plans. Incompatible bell/spigot or tongue/groove ends shall be cut off as required to ensure the interior drainage pipe walls are aligned to provide a smooth transition between the pipes.

Metal pipe and pipe arches shall be carefully joined and firmly clamped together by approved connecting bands, which shall be properly bolted in place before any backfill is placed.

Newly installed drainage pipe which is not in true alignment, or which shows any settlement or distortion, shall be reinstalled in accordance with 1.05.03.

When drainage pipe outside of proposed drainage trench limits is to be removed, it shall be removed to the limits shown on the plans and all remaining pipes shall be plugged with cement masonry.

Where shown on the plans or directed by the Engineer, the Contractor shall plug abandoned existing pipes with cement masonry.

(4) Drainage Pipe End Installation: Reinforced concrete drainage pipe ends shall be placed on a prepared bed of the existing ground and accurately aligned as shown on the plans. The joints shall be sealed as specified in 6.86.03-3 and backfill shall be placed around both sides of the unit simultaneously to the elevation shown on the plans.

Metal drainage pipe ends shall be placed on a prepared bed of the existing ground and accurately aligned as shown on the plans. After the attachment of the drainage pipe end, backfill shall be placed around both sides of the unit up to the elevation shown on the plans, exercising caution to avoid displacement or deformation of the unit.

6.86.04—Method of Measurement: This work will be measured as follows:

Drainage Trench Excavation, in accordance with 2.86.04, will not be measured for payment.

Rock in Drainage Trench Excavation will be measured in accordance with 2.86.04.

Bedding Material will not be measured for payment.

New and Re-laid Pipes and Pipe Arches will be measured for payment by the actual number of linear feet of pipe or pipe arch of the various sizes and types, completed and accepted and measured in place along the invert. Coupling bands and fittings for pipes and pipe arches will not be measured for payment.

Reinforced Concrete Drainage Pipe Ends and Metal Drainage Pipe Ends will be measured for payment as separate units.

Corrugated Metal Pipe Elbows (of the Size and Type specified) will be measured for payment by the actual number of linear feet of pipe elbows completed and accepted, based on 6 linear feet per elbow, as shown on the plans. Coupling bands for elbows will not be measured for payment.

Concrete Pipe Connection will be measured for payment by the number of each concrete pipe connection constructed at locations where proposed concrete pipes tie into an existing pipe with an incompatible end, completed and accepted by the Engineer.

Removal of drainage pipe outside of drainage trench excavation limits, as defined in 2.86.03, will be measured for payment by the actual number of linear feet of drainage pipe removed.

There will be no measurement for plugging existing pipes with cement masonry.

6.86.05—Basis of Payment:

Drainage Trench Excavation for the installation of drainage pipes will not be paid separately but shall be included in the Contract unit price for the respective drainage pipe or pipe end item(s), in accordance with the provisions of 2.86.05.

Rock in Drainage Trench Excavation will be paid for in accordance with the provisions of 2.86.05.

Bedding Material necessary for the installation of drainage items described herein will be included in the Contract unit price for the respective drainage pipe or pipe end item(s). Bedding material required to fill voids when rock in drainage trench is encountered will not be measured for payment but shall be included in the Contract unit price for "Rock in Drainage Trench Excavation," in accordance with 2.86.05.

New Pipes and Pipe Arches will be paid for at the Contract unit price per linear foot for "(Size and Type) Pipe (Thickness) – 0' to 10' Deep," "(Size and Type) Pipe (Thickness) – 0' to 20' Deep," "(Size) Pipe Arch (Thickness) – 0' to 10' Deep" or "(Size) Pipe Arch (Thickness) – 0' to 20' Deep" complete in place, including materials, drainage trench excavation, bedding material, equipment, tools, and labor incidental thereto.

Relaid Pipes and Pipe Arches will be paid for at the Contract unit price per linear foot for "Relaid Pipe (Size and Type) – 0' to 10' Deep," "Re-laid Pipe (Size and Type) – 0' to 20' Deep," "Relaid Pipe Arch (Size and Type) – 0' to 10' Deep," or "Relaid Pipe Arch (Size and Type) – 0' to 20' Deep," complete in place, including all materials, drainage trench excavation, bedding material, equipment, tools, and labor incidental thereto.

Reinforced Concrete Drainage Pipe Ends and Metal Drainage Pipe Ends will be paid for at the Contract unit price for each drainage pipe end of the Size and Type specified, complete in place, including all excavation, materials, attachment systems, equipment, tools and labor incidental thereto.

Corrugated Metal Pipe Elbows will be paid for at the Contract unit price per linear foot for "(Size and Type) Corrugated Metal Pipe Elbow" including all materials, drainage trench excavation, bedding material, equipment, tools, and labor incidental thereto.

Concrete Pipe Connection will be paid for at the Contract unit price each for "Concrete Pipe Connection" complete in place, including all materials, equipment, tools and labor incidental thereto.

Removal of drainage pipes of all types and sizes, outside of drainage trench excavation limits, as defined in 2.86.03-1, will be paid for at the Contract unit price per linear foot for "Remove Existing Pipe – 0' to 10' Deep," or "Remove Existing Pipe – 0' to 20' Deep," which price shall include excavation, temporary trench protection, backfill, and all equipment, tools and labor incidental thereto.

There will be no direct payment for the plugging of existing drainage pipes, but the cost thereof shall be included in the respective drainage Contract item(s).

Pay Item	Pay Unit
(Size and Type) Pipe (Thickness) – 0' to 10' Deep	l.f.
(Size and Type) Pipe (Thickness) – 0' to 20' Deep	l.f.
(Size and Type) Pipe Arch (Thickness) – 0' to 10' Deep	l.f.
(Size and Type) Pipe Arch (Thickness) – 0' to 20' Deep	l.f.
Relaid (Size and Type) Pipe– 0' to 10' Deep	l.f.
Relaid (Size and Type) Pipe– 0' to 20' Deep	l.f.
(Size and Type) Relaid Pipe Arch – 0' to 10' Deep	l.f.
(Size and Type) Relaid Pipe Arch – 0' to 20' Deep	l.f.
(Size) Reinforced Concrete Drainage Pipe End	ea.
(Size) Metal Drainage Pipe End	ea.
(Size and Type) Corrugated Metal Pipe Elbow	l.f.
Concrete Pipe Connection	ea.
Remove Existing Pipe – 0' to 10' Deep	l.f.
Remove Existing Pipe – 0' to 20' Deep	l.f.

SECTION 10.00 – GENERAL CLAUSES FOR HIGHWAY ILLUMINATION AND TRAFFIC SIGNAL PROJECTS

Article 10.00.03 – Plans:

In the first paragraph, replace the 2nd, 3rd, and 4th sentences with the following:

The Contractor shall digitally mark, in red, any changes on the plan(s) using a pdf program. Markups shall also include field-obtained GPS coordinates for installed span pole, mast arm assembly, controller, and light standard locations.

- The GPS technology used should be able to provide coordinates that are within 12” of accuracy.
- Coordinates provided are to be as accurate as possible for locations where satellite coverage is compromised by tree canopies, buildings, etc.

The Contractor shall submit the digital pdf file(s) to the Engineer and to DOT.TrafficElectrical@ct.gov, for Traffic Signals, prior to requesting the Functional Inspection.

Also prior to requesting the Functional Inspection, the Contractor shall deliver to the Engineer the following:

In the first paragraph, last sentence, in item no. 1, replace “Four (4)” with “Digital PDF Files and Five (5)” [paper prints of schematics and wiring diagrams...].

Article 10.00.10 – Tests: Preliminary and Final, Section 2.b.3 – Functional Inspection

First paragraph, after the 2nd sentence: Add the following:

The Contractor shall have a bucket truck with crew on site during the Functional Inspection to make any necessary aerial signal adjustments as directed by the Engineer.

Article 10.00.12 - Negotiations with utility company: Add the following:

The Contractor shall give notice to utility companies a minimum of 30 days prior to required work or services to the utility company. Refer to Section 1.07 – Legal Relations and Responsibilities for the list of utility companies and representatives the contractor shall use.

The Contractor shall perform all work in conformance with Rules and Regulations of Public Utility Regulatory Authority (PURA) concerning Traffic Signals attached to Public Service Company Poles. The Contractor is cautioned that there may be energized wires in the vicinity of the specified installations. In addition to ensuring compliance with NESC and OSHA regulations, the Contractor and/or its Sub-Contractors shall coordinate with the appropriate utility company for securing/protecting the site during the installation of traffic signal mast arms, span poles or illumination poles.

When a span is attached to a utility pole, the Contractor shall ensure the anchor is in line with the proposed traffic signal span wire. More than 5 degree deviation will lower the holding strength and is not allowed. The Contractor shall provide any necessary assistance required by the utility company, and ensure the anchor and guy have been installed and properly tensioned prior to attaching the span wire to the utility pole.

SECTION 12.00 – GENERAL CLAUSES FOR HIGHWAY SIGNING

Description:

Work under this item shall conform to the requirements of Section 12.00 supplemented as follows:

12.00.07 – Global Positioning System (GPS) coordinates for signs:

The Contractor shall obtain and provide to the Engineer sign installation data, including Global Positioning System (GPS) latitude and longitude coordinates, for all new permanent State owned and maintained signs (temporary and construction signs are not to be included) installed in the project. The Engineer shall forward the sign data to the Division of Traffic Engineering for upload into the Highway Sign Inventory and Maintenance Management Program (SIMS). Sign data submissions or questions relating to SIMS or GPS shall be sent to DOT-SignInventory@ct.gov.

The horizontal datum is to be set to the State Plane Coordinate System, North American Datum of 1983 (NAD83) in feet. The minimum tolerance must be within 10 feet. The format of the GPS information shall be provided in a Microsoft Office compatible spreadsheet (Excel) file with data for each sign. The record for each sign installed is to be compatible with the anticipated CTDOT Sign Inventory and Management System (CTSIMS). The following format shall be used. However, the data fields noted by “#” are not required for the project submission. These entries will be completed as part of the Traffic Engineering CTSIMS data upload.

The cost of this work shall be included in the cost of the respective sign face – sheet aluminum and sign face – extruded aluminum items. The receipt of this electronic database must be received and accepted by the Engineer prior to final payment for items involving permanent highway signing. The electronic database information shall detail information regarding the sign actually installed by the project.

<u>Field Number</u>	<u>Type</u>	<u>size</u>	<u>Description</u>
1	text	20	Record Number (starting at 1...)
2	text	20	Sign Catalog Number
# 3	text	10	Size Height
# 4	text	10	Size Width
5	text	25	Legend
# 6	text	10	Background Color
# 7	text	10	Copy Color
8	Link	25	Material (see acceptable categories)
9	text	30	Comments if any
# 10	text	20	MUTCD Type
11	text	15	Town
12	text	5	Route
13	text	5	Route direction

#	14	text	10	Highway Log Mileage
	15	text	15	Latitude
	16	text	15	Longitude
	17	text	25	Mounting Type
	18	text	25	Reflective Sheeting Type
	19	date	25	Date Installed
	20	text	10	Number of Posts
	21	text	255	Sheeting Manufacturer name and address
	22	text	15	State Project Number (or)
	23	text	15	Encroachment Permit number.
	24	Graphic	*	Sign Picture Graphic.

* Graphics provided shall be representative of the sign supplied and be in color. Graphic formats shall be either JPG or TIFF and provided with a recommended pixel density of 800 x 600. The graphic shall be inserted in the supplied media in field 24 for each sign.

SECTION M.03 PORTLAND CEMENT CONCRETE

Replace Section M.03 in its entirety with the following:

M.03.01—Component Materials

M.03.02—Mix Design Requirements

M.03.03—Producer Equipment and Production Requirements

M.03.04—Curing Materials

M.03.05—Non Shrink, Non Staining Grout

M.03.06—Expansive Cement for Anchoring

M.03.07—Chemical Anchors

M.03.08—Joint Materials

M.03.09—Protective Compound/Sealers

M.03.10—Formwork

M.03.01—Component Materials

1. Coarse Aggregate: Coarse aggregate shall meet the requirements of M.01.

2. Fine Aggregate: Fine aggregate shall meet the requirements of M.01.

3. Cement:

(a) Portland: Types I, II, and III Portland cement shall meet the requirements of AASHTO M 85. Type I and Type III Portland cement shall be used only when required or expressly permitted by the Project specification or the Engineer. The use of Type I or III will require that these mixtures be submitted as Non-standard Mix Designs. All cement shall be provided by a mill participating in the Departments' Cement Certification program. The requirements of the Certification Program are detailed in the Departments' Quality Assurance Program for Materials.

(b) Pre-Blended Cements: Binary or Ternary cements consisting of Portland Cement and supplemental cementitious materials may be used provided that all the requirements of M.03.01- 3(a) and -3(c) are met.

(c) Replacement Materials: Unless already approved as a Standard Mix Design, any Contractor proposed Mix Designs with partial replacement of Portland Cement (PC) with fly ash or ground granulated blast furnace slag (GGBFS), shall be submitted in writing to the Engineer for approval prior to the start of work, on a project-by-project basis. The type of material, source, and the percentage of the PC replaced shall be clearly indicated. Upon request, a Certified Test Report for the cement replacement material shall be provided to the Engineer for use during the Mix Design review.

1. Fly Ash: Fly ash to be used as a partial replacement for Portland cement shall meet the requirements of AASHTO M 295, either Class C or Class F, including the uniformity requirements of Table 2A. Loss on Ignition for either class of fly ash shall not exceed 4.0%. Fly ash may be used to replace up to a maximum of 20% of the required Portland cement for mixes without permeability requirements. For mixes with permeability requirements, the maximum of 20% may be exceeded. The fly ash shall be substituted on a weight basis, with a minimum of 1 lb. of fly ash for 1 lb. of Portland cement. Different classes of fly ash or the same class from different sources shall not be permitted on any single project without the written approval of the Engineer.

2. **Ground Granulated Blast Furnace Slag (GGBFS):** GGBFS used as a partial replacement for Portland cement shall meet the requirements of AASHTO M 302/ASTM C989, Grade 100 or 120. As determined by the Engineer, GGBFS may be used to replace a maximum of 30% of the required Portland cement for mixes without permeability requirements. For mixes with permeability requirements, the maximum of 30% may be exceeded. The Engineer may restrict or prohibit the use of GGBFS if ambient temperatures anticipated during the placement and initial curing of the concrete are low. The GGBFS shall be substituted on a weight basis, with a minimum of 1 lb. of slag for 1 lb. of Portland cement. Different sources of GGBFS shall not be permitted on any single project without the written approval of the Engineer.

4. Water: All water used in the mixing of concrete shall be odorless and clear in appearance. Surface water may be used if not taken from shallow or muddy sources; classified as Class C or Class D on the Department of Energy and Environmental Protection (DEEP) Water Quality Classification mapping; and accommodations have been made to prevent contaminants from entering the supply to the satisfaction of the Engineer. The Engineer may request that water from any surface or ground source be tested in accordance with AASHTO T26 and AASHTO D512 if the appearance or scent of the water is suspect. To be acceptable, the pH of the water must not be less than 6.0 or greater than 8.0 and Chloride Ion Concentration of the water must not exceed 250ppm. Potable water taken directly from a municipal or regional water supply may be used for mixing concrete without testing. Heating or cooling of water may be required to meet mix temperature requirements at time of placement.

5. Admixtures: All admixtures shall perform their function without injurious effects upon the concrete. If requested by the TDC, the Contractor shall present a certified statement from a recognized laboratory attesting to this requirement. A "recognized" laboratory is any cement and concrete laboratory approved and inspected regularly by the Cement and Concrete Reference Laboratory (CCRL). The statement shall contain results of compression tests of cylinder specimens made with concrete utilizing the admixture(s) in proportions equal to those proposed by the Contractor. The results of at least 5 standard 6 inch x 12 inch cylinders of each mix design shall be listed with the results of at least 5 like-sized cylinders not utilizing the admixture(s). Specimens must be made and cured in the laboratory in accordance with AASHTO T 126 and will be tested in accordance with AASHTO T 22.

(a) Air-Entraining Admixtures: In the event that air entrained concrete is required, an admixture meeting the requirements of AASHTO M 154 may be used. Tests for 7 and 28-day compressive and flexural strengths and resistance to freezing and thawing are required whereas tests for bleeding, bond strength and volume change will not be required.

(b) Other Chemical Admixtures: In the event that concrete properties are specified that require the use of additional admixtures, or the Contractor proposes the use of additional admixtures to facilitate placement, the admixtures shall meet the requirements of AASHTO M194M/M, including the 1 year performance data.

M.03.02—Mix Design Requirements

1. Standard ConnDOT Mix Designs: Standard Mix Designs shall be designed in accordance with applicable sections of ACI 211 and ACI 318. The mixtures shall consist of Portland cement, fine aggregate, coarse aggregate, admixtures, and water proportioned in accordance with Table M.03.02-1. The mixtures shall also be designed to obtain the plastic properties of Portland cement concrete as specified in Table 6.01.03-2.

Table M.03.02-1 Standard Portland Cement Concrete Mixes

Class ¹	Max. Water/Cement ² ratio	Min. Cement ² Content - lb./c.y.	Air Content %	Electrical Resistivity (Permeability) kΩ-cm AASHTO T 358
PCC0223Z	0.69	455	6 +/- 1.5	NA
PCC0334Z	0.48	615		NA
PCC0336Z	0.50	564		NA
PCC0354Z	0.49	615		NA
PCC0446Z	0.44	658		NA
PCC04462	0.42			29 minimum
PCC0556Z	0.40			NA
PCC05562	0.40			29 minimum
PCCXXX81 ³	0.46		7.5 +/- 1.5	15 maximum
PCCXXX82	0.40			29 minimum

¹ PCCXYZ where:

PCC = Portland Cement Concrete

XXX = 28-day minimum compressive strength (psi/100)

Y = Nominal Maximum Aggregate Size (U.S. Sieve No. Designation)

Z = Exposure Factor (See Table M.03.02-1a)

² Portland Cement may be partially replaced within a Standard Mix Design by other approved cementitious material meeting the requirements of M.03.01-3(c) if permitted by the Engineer.

³ When this class is paid for in a surface or structural repair concrete item, the plastic properties necessary for confined placement to ensure appropriate workability for consolidation within the forms shall be noted on the delivery ticket by the concrete supplier.

Table M.03.02-1a Exposure Factor per Application

Exposure		Application
0	Benign	Elements not exposed to weather (buried, enclosed)
1	Moderate	Elements not in contact with salt water or deicing chemicals
2	Severe	Elements in contact with salt water, deicing chemicals, flowing/standing water

Mix designs shall indicate the dosage of admixtures anticipated to provide plastic properties required in the Project specification. Plastic properties of standard mix classes of concrete in the plastic state are listed in Table 6.01.03-2.

Standard Mix Designs are required to be designed and submitted by the concrete producers, and are approved by the Department on a standing basis. Submittal or re-approval of these Standard Mix Designs on an annual basis is not required. Previously approved producer-designed Standard Mixes that have a record of satisfactory performance may be utilized on Department projects unless there is a change in the gravimetric properties or the sources of any materials. Revisions to the Standard Mix Designs, which include changes in component sources, can be submitted at any time to the TDC, but must be approved prior to use on Department projects.

2. Non-Standard CTDOT Mix Designs: Any proposed Mix Designs that do not comply with Table M.03.02-1 are required to be submitted 15 days prior to use on a project-by-project basis and be approved by the TDC prior to use. The use of an approved admixture with an otherwise approved Standard Mix Design is not considered non-standard.

All Non-standard Mix Designs used for load-bearing structures shall contain a minimum of 658 lb./c.y. of cementitious materials.

Concrete used in applications such as flowable fill or controlled low-strength material may be designed with less than 658 lb./c.y. of cementitious materials.

M.03.03—Producer Equipment and Production Requirements

1. General Requirements: The source of the concrete must be approved by the Engineer prior to use on Department projects. Specifically the location and capacity of the central mix or dry batch plant, and complement of truck mixers/haulers, shall be adequate for continuous placement of concrete on a typical Department project. Approval may be revoked at any time in accordance with 1.06.01.

- (a) **Inspection:** The production facility supplying hydraulic cement concrete shall have a current Certification of Ready Mixed Concrete Production Facilities from the National Ready Mixed Concrete Association (NRMCA), or equivalent certification approved by the Engineer.
- (b) In addition to the requirements of approved third party certification, the facility shall produce batch tickets that meet the requirements of 6.01.03-3(a).
- (c) **Quality Control:** The Contractor is responsible for all aspects of Quality Control (QC). As determined by the Engineer, should material delivered to a project not meet specification, the Contractor may be required to submit to the Engineer a corrective procedure for approval within 3 calendar days. The procedure shall address any minor adjustments or corrections made to the equipment or procedures at the facility.
- (d) **Suspension:** As determined by the Engineer, repeated or frequent delivery of deficient material to a Department project may be grounds for suspension of that source of material. A detailed QC plan that describes all QC policies and procedures for that facility may be

required to formally address quality issues. This plan must be approved by the Engineer and fully implemented, prior to reinstatement of that facility.

2. Hand Mixed Concrete: Hand mixing shall be permitted only with the permission of the Engineer. Hand mixed batches shall not exceed 1/2 c.y. in volume. Hand mixing will not be permitted for concrete to be placed under water.

M.03.04—Curing Materials

1. Water: Any water source deemed acceptable by the Engineer for mixing concrete may be used to provide water for curing purposes. Surface water may be used if classified as Class C or Class D on the Department of Energy and Environmental Protection (DEEP) Water Quality Classification mapping and accommodations have been made to prevent contaminants from entering the supply to the satisfaction of the Engineer. In general, water shall not be taken from shallow or muddy sources. In cases where sources of supply are relatively shallow, the intake pipe shall be enclosed to exclude silt, mud, grass, etc.; and the water in the enclosure shall be maintained at a depth of not less than 2 feet under the intake pipe.

2. Mats: Mats for curing concrete shall be capable of maintaining moisture uniformly on the surface of the concrete. The mats shall not contain any materials such as dyes, sugar, etc., that may be injurious to the concrete.

The length or width of the mats shall be sufficient to cover all concrete surfaces being cured. Should more than one mat be required, sufficient overlap shall be provided by the Contractor as determined by the Engineer.

3. Liquid Membrane-Forming Compound: Liquid membrane-forming compound shall meet the requirements of AASHTO M 148 Type 2, Class B, or shall be a water-soluble linseed oil-based compound meeting the requirements of AASHTO M 148, Type 2.

4. White Polyethylene Sheeting (Film): White polyethylene sheeting (film) shall meet the requirements of AASHTO M 171.

M.03.05—Non Shrink, Non Staining Grout

1. Bagged (pre-mixed): Bagged (pre-mixed) formulations of non-shrink grout shall meet the requirements of ASTM C1107. The grout shall be mixed with potable water for use. The grout shall be mixed to a flowable consistency as determined by ASTM C230. All bagged material shall be clearly marked with the manufacturer's name, date of production, batch number, and written instructions for proper mixing, placement and curing of the product.

2. Bulk: The Contractor may formulate and design a grout mix for use on the Project in lieu of using a pre-bagged product. The Contractor shall obtain prior written approval of the Engineer for any such proposed Mix Design. Any such Mix Design shall include the proportions of hydraulic cement, potable water, fine aggregates, expansive agent, and any other necessary additive or admixture. This material shall meet all of the same chemical and physical requirements as shall the pre-bagged grout, in accordance with ASTM C1107.

M.03.06—Expansive Cement for Anchoring

The premixed anchoring cement shall be non-metallic, concrete gray in color and prepackaged. The mix shall consist of hydraulic cement, fine aggregate, expansive admixtures and water meeting the following requirements:

1. The anchoring cement shall have a minimum 24 hour compressive strength of 2,600 psi when tested in accordance with ASTM C109.

2. The water content of the anchoring cement shall be as recommended by the manufacturer. Water shall meet the requirements of M.03.01-4.

The Contractor shall provide a Certified Test Report and Materials Certificate for the premixed anchoring cement in accordance with 1.06.07. The Contractor shall also provide, when requested by the Engineer, samples of the premixed anchoring cement for testing and approval.

M.03.07—Chemical Anchors

Chemical anchor material must be listed on the Departments' Qualified Products List and approved by the Engineer for the specified use.

The chemical anchor material shall be epoxy or polyester polymer resin. It shall not contain any metals or other products that promote corrosion of steel. The Contractor shall supply the Engineer with a Certified Test Report and Materials Certificate for the chemical anchor material in accordance with 1.06.07. When requested by the Engineer, the Contractor shall also provide samples of the chemical anchor material.

M.03.08—Joint Materials

1. Transverse Joints for Concrete Pavement: Transverse joints shall consist of corrosion resistant load transfer devices, poured joint seal and in addition, in the case of expansion joints, expansion joint filler all meeting the following requirements:

- (a) The corrosion resistant load transfer device shall be coated steel or sleeved steel or be made of corrosion resistant material. The dimensions of any devices used shall be as shown on the plans, exclusive of any coating or sleeving. Core material of coated or sleeved metallic devices shall be steel meeting the requirements of AASHTO M 255M/M 255 Grade 520, or steel having equal or better properties and approved by the Engineer. Nonmetallic devices shall meet the various strength requirements applicable to metallic devices as well as all other requirements stated herein.
- (b) All coated load transfer devices shall meet the requirements of AASHTO M 254. Uncoated or sleeved load transfer devices shall meet the applicable physical requirements of AASHTO M 254. The use of field applied bond breakers will not be permitted.
- (c) The basis of acceptance for corrosion resistant load transfer devices shall be the submission by the Contractor of a minimum of 2 samples accompanied by Certified Test Reports meeting the requirements of 1.06.07 demonstrating that the load transfer device meets the requirements of AASHTO M 254 for the type of device supplied. The Engineer reserves the right to reject any load transfer device deemed unsatisfactory for use.

2. Joint Filler for Concrete Curbing: Expansion joint filler shall be either preformed expansion joint filler or wood joint filler as indicated on the plans and shall meet the following requirements:

- (a) Preformed expansion joint filler shall be the bituminous cellular type and shall meet the requirements of AASHTO M 213.
- (b) Boards for wood joint filler shall have 2 planed sides and shall be redwood, cypress or white pine. Redwood and cypress boards shall be of sound heartwood. White pine boards shall be of sound sapwood. Occasional small, sound knots and medium surface checks will be permitted provided the board is free of any defects that will impair its usefulness for the purpose intended. The joint filler may be composed of more than one length of board in the length of the joint, but no board of a length less than 6 feet shall be used; and the

separate boards shall be held securely to form a straight joint. Boards composed of pieces that are jointed and glued shall be considered as one board.

- (c) Dimensions shall be as specified or shown on the plans; and tolerances of plus 1/16 inch thickness, plus 1/8 inch depth and plus 1/4 inch length will be permitted.
- (d) All wood joint filler boards shall be given a preservative treatment by brushing with creosote oil meeting the requirements of AASHTO M 133. After treatment, the boards shall be stacked in piles, each layer separated from the next by spacers at least 1/4 inch thick; and the boards shall not be used until 24 hours after treatment. Prior to concreting, all exposed surfaces of the wood filler shall be given a light brush coating of form oil.
- (e) Testing of board expansion joint filler shall be in accordance with pertinent sections of AASHTO T 42.

3. Longitudinal Joint Devices: The metal used in the fabrication of longitudinal joint devices shall meet ASTM requirements for each type of metal used. The dimensions shall be as shown on the plans.

4. Expansion Joint Fillers for Bridges and Bridge Bearings:

- (a) Preformed expansion joint filler for bridges shall meet the requirements of AASHTO M 153, Type I or Type II.
- (b) Pre-molded expansion joint filler for bridge bearings shall meet the requirements of AASHTO M 33.

5. Joint Sealants:

- (a) **Joint Sealer for Pavement:** The joint sealer for pavement shall be a rubber compound of the hot-poured type and shall meet the requirements of AASHTO M 324 Type II unless otherwise noted on the plans or in the special provisions.
- (b) **Joint Sealer for Structures:** Structure joint sealers shall be one of the following type sealants:

1. Where "Joint Seal" is specified on the plans, it shall meet the requirements of the Federal Specifications SS-S-200-E (Self-leveling type), TT-S-0227E (COM-NBS) Type II-Class A (Non-sag type), or 1 component polyurethane-base elastomeric sealants conforming to FS TT-S-00230C Type II-Class A or an approved equal.

A Certified Test Report will be required in accordance with 1.06.07, certifying that the sealant meets the requirements set forth in the Federal Specification. Should the consignee noted on a Certified Test Report be other than the Prime Contractor, a Materials Certificate shall be required to identify the shipment.

2. Where "Silicone Joint Sealant" is specified on the plans, it shall be one of the following or an approved equal:
 - i. Sealant, manufactured by the Dow Corning Corporation, Midland, Michigan 48686-0994
 - ii. Dow Corning 888 Silicone Joint Sealant or
 - iii. Dow Corning 888-SL Self-Leveling Silicone Joint 48686-0994

6. Closed Cell Elastomer: The closed cell elastomer shall meet the requirements of ASTM D1056, Grade RE-41 B2. The elastomer shall have a pressure-sensitive adhesive backing on one side.

The Contractor shall deliver the closed cell elastomer to the job site a minimum of 30 days prior to installation. Prior to the delivery of the closed cell elastomer, the Contractor shall notify the Engineer of the date of shipment and the expected date of delivery. Upon delivery of the closed cell elastomer to the job site, the Contractor shall immediately notify the Engineer.

Each separate length, roll or container shall be clearly tagged or marked with the manufacturer's name, trademark and lot number. A lot is defined as that amount of closed cell elastomer manufactured at 1 time from 1 batch of elastomer. A batch is defined as that amount of elastomer prepared and compounded at 1 time. The Contractor shall furnish a Certified Test Report in accordance with 1.06.07, confirming that the closed cell elastomer meets the requirements set forth in these specifications. Should the co-signee noted on a Certified Test Report be other than the Prime Contractor, a Materials Certificate shall be required to identify shipment.

The Contractor shall furnish a 1 foot length of closed cell elastomer in each lot for purposes of inspection and testing by the Engineer. The Engineer will cut a 1 foot sample from each lot and inspect the sample for conformance to size, and perform physical tests on the sample as deemed necessary.

The Engineer shall reject any lot or portion of a lot that does not meet the requirements stated herein. A rejected lot or portion of a lot may be resubmitted provided the Contractor has removed or corrected, in a manner acceptable to the Engineer, all non-conforming material.

M.03.09—Protective Compound/Sealers

The brand and type of material must be listed on the Department's Qualified Products List and approved by the Engineer for the specified use.

M.03.10—Formwork

1. Stay-in-place Forms: Material for stay-in-place metal forms shall be made of zinc-coated (galvanized) steel sheet meeting ASTM Specification A653 (Structural Steel (SS) Grade 33 through 80). The minimum thickness shall be 20 gauge. Coating weight shall meet the requirements of ASTM A924, Class G235, and shall otherwise meet all requirements relevant to steel stay-in-place metal forms and the placing of concrete as specified herein and as noted in the Contract.

Form supports shall either be fabricated and meet the same material requirements as the forms, or be fabricated from structural steel meeting the requirements of ASTM A36 and shall be hot-dip galvanized in accordance with ASTM A123.

Lightweight filler material for forms shall be as recommended by the form manufacturer.

2. Temporary Forms and Falsework: Forms and Falsework shall be of wood, steel or other material approved by the Engineer. This approval does not relieve the Contractor from employing adequately sized materials of sufficient rigidity to prevent objectionable distortion of the formed concrete surfaces caused by pressure of the plastic concrete and other loads incidental to the construction operations.

SECTION M.04 BITUMINOUS CONCRETE MATERIALS

Section M.04 is being deleted in its entirety and replaced with the following:

M.04.01—Bituminous Concrete Materials and Facilities

M.04.02—Mix Design and Job Mix Formula (JMF)

M.04.03—Production Requirements

M.04.01—Bituminous Concrete Materials and Facilities: Each source of material, Plant, and laboratory used to produce and test bituminous concrete must be qualified on an annual basis by the Engineer. AASHTO or ASTM Standards noted with an (M) have been modified and are detailed in Table M.04.03-5.

Aggregates from multiple sources of supply must not be blended or stored in the same stockpile.

1. Coarse Aggregate: All coarse aggregate shall meet the requirements listed in M.01.

2. Fine Aggregate: All fine aggregate shall meet the requirements listed in M.01.

3. Mineral Filler: Mineral filler shall conform to the requirements of AASHTO M 17.

4. Performance Graded (PG) Asphalt Binder:

(a) General:

- i. PG asphalt binder shall be uniformly mixed and blended and be free of contaminants such as fuel oils and other solvents. Binder shall be properly heated and stored to prevent damage or separation.
- ii. The binder shall meet the requirements of AASHTO M 332 and shall be graded or verified in accordance with AASHTO R 29. The Contractor shall submit a Certified Test Report and bill of lading representing each delivery in accordance with AASHTO R 26(M). The Certified Test Report must also indicate the binder specific gravity at 77°F; rotational viscosity at 275°F and 329°F; and the mixing and compaction viscosity-temperature chart for each shipment.
- iii. The Contractor shall submit the name(s) of personnel responsible for receipt, inspection, and record keeping of PG binder. Contractor Plant personnel shall document specific storage tank(s) where binder will be transferred and stored until used and provide binder samples to the Engineer upon request. The person(s) shall assure that each shipment is accompanied by a statement certifying that the transport vehicle was inspected before loading was found acceptable for the material shipped and that the binder is free of contamination from any residual material, along with 2 copies of the bill of lading.
- iv. The blending or combining of PG binders in 1 storage tank at the Plant from different suppliers, grades, or additive percentages is prohibited.

(b) Basis of Approval: The request for approval of the source of supply shall list the location where the material will be manufactured, and the handling and storage methods, along with necessary certification in accordance with AASHTO R 26(M). Only suppliers/refineries that have an approved “Quality Control Plan for Performance Graded Binders” formatted in accordance with AASHTO R 26(M) may supply PG binders to Department projects.

(c) Standard Performance Grade (PG) Binder:

- i. Standard PG binder shall be defined as “Neat.” Neat PG binders shall be free from modification with: fillers, extenders, reinforcing agents, adhesion promoters,

thermoplastic polymers, acid modification and other additives such as re-refined motor oil, and shall indicate such information on each bill of lading and Certified Test Report.

ii. The standard asphalt binder shall be PG 64S-22.

(d) Modified Performance Grade (PG) Binder: The modified asphalt binder shall be Performance Grade PG 64E-22 asphalt modified solely with a Styrene-Butadiene-Styrene (SBS) polymer. The polymer modifier shall be added at either the refinery or terminal and delivered to the bituminous concrete production facility as homogenous blend. The stability of the modified binder shall be verified in accordance with ASTM D7173 using the Dynamic Shear Rheometer (DSR). The DSR $G^*/\sin(\delta)$ results from the top and bottom sections of the ASTM D7173 test shall not differ by more than 10%. The results of ASTM D7173 shall be included on the Certified Test Report. The binder shall meet the requirements of AASHTO M 332 (including Appendix X1) and AASHTO R 29.

(e) Warm Mix Additive or Technology:

- i. The warm mix additive or technology must be listed on the North East Asphalt User Producer Group (NEAUPG) Qualified Warm Mix Asphalt (WMA) Technologies List at the time of bid, which may be accessed online at <http://www.neaupg.uconn.edu>.
- ii. The warm mix additive shall be blended with the asphalt binder in accordance with the manufacturer's recommendations.
- iii. The blended binder shall meet the requirements of AASHTO M 332 and shall be graded or verified in accordance with AASHTO R 29 for the specified binder grade. The Contractor shall submit a Certified Test Report showing the results of the testing demonstrating the binder grade. In addition, it must include the grade of the virgin binder, the brand name of the warm mix additive, the manufacturer's suggested rate for the WMA additive, the water injection rate (when applicable), and the WMA Technology manufacturer's recommended mixing and compaction temperature ranges.

5. Emulsified Asphalts:

(a) General:

- i. The emulsified asphalt shall meet the requirements of AASHTO M 140(M) or AASHTO M 208 as applicable.
- ii. The emulsified asphalts shall be free of contaminants such as fuel oils and other solvents.
- iii. The blending at mixing Plants of emulsified asphalts from different suppliers is prohibited.

(b) Basis of Approval:

- i. The request for approval of the source of supply shall list the location where the material is manufactured, the handling and storage methods, and certifications in accordance with AASHTO R 77. Only suppliers that have an approved "Quality Control Plan for Emulsified Asphalt" formatted in accordance with AASHTO R 77 and that submit monthly split samples per grade to the Engineer may supply emulsified asphalt to Department projects.
- ii. Each shipment of emulsified asphalt delivered to the Project site shall be accompanied with the corresponding Certified Test Report listing Saybolt viscosity, residue by evaporation, penetration of residue, and weight per gallon at 77°F and Material Certificate.
- iii. Anionic emulsified asphalts shall meet the requirements of AASHTO M-140. Materials

used for tack coat shall not be diluted and meet grade RS-1 or RS-1h. When ambient temperatures are 80°F and rising, grade SS-1 or SS-1h may be substituted if permitted by the Engineer.

- iv. Cationic emulsified asphalt shall meet the requirements of AASHTO M-208. Materials used for tack coat shall not be diluted and meet grade CRS-1. The settlement and demulsibility test will not be performed unless deemed necessary by the Engineer. When ambient temperatures are 80°F and rising, grade CSS-1 or CSS-1h may be substituted if permitted by the Engineer.

6. Reclaimed Asphalt Pavement (RAP):

(a) General: RAP is a material obtained from the cold milling or removal and processing of bituminous concrete pavement. RAP material shall be crushed to 100% passing the 1/2 inch sieve and free from contaminants such as joint compound, wood, plastic, and metals.

(b) Basis of Approval: The RAP material will be accepted on the basis of one of the following criteria:

- i. When the source of all RAP material is from pavements previously constructed on Department projects, the Contractor shall provide a Materials Certificate listing the detailed locations and lengths of those pavements and that the RAP is only from those locations listed.
- ii. When the RAP material source or quality is not known, the Contractor shall request approval from the Engineer at least 30 calendar days prior to the start of the paving operation. The request shall include a Material Certificate and applicable test results stating that the RAP consists of aggregates that meet the specification requirements of M.04.01-1 through M.04.01-3 and that the binder in the RAP is substantially free of solvents, tars and other contaminants. The Contractor is prohibited from using unapproved material on Department projects and shall take necessary action to prevent contamination of approved RAP stockpiles. Stockpiles of unapproved material shall remain separate from all other RAP materials at all times. The request for approval shall include the following:
 - 1. A 50-lb. sample of the RAP to be incorporated into the recycled mixture.
 - 2. A 25-lb. sample of the extracted aggregate from the RAP.

7. Crushed Recycled Container Glass (CRCG):

(a) Requirements: The Contractor may propose to use clean and environmentally-acceptable CRCG in an amount not greater than 5% by weight of total aggregate.

(b) Basis of Approval: The Contractor shall submit to the Engineer a request to use CRCG. The request shall state that the CRCG contains no more than 1% by weight of contaminants such as paper, plastic, and metal and conforms to the following gradation:

CRCG Grading Requirements	
<u>Sieve Size</u>	<u>Percent Passing</u>
3/8 inch	100
No. 4	35-100
No. 200	0.0-10.0

The Contractor shall submit a Material Certificate to the Engineer stating that the CRCG complies with all the applicable requirements in this Section.

8. Joint Seal Material: Joint seal material must meet the requirements of ASTM D6690 - Type 2. The Contractor shall submit a Material Certificate in accordance with 1.06.07 certifying that the joint seal material meets the requirements of this Section.

9. Recycled Asphalt Shingles (RAS): RAS shall consist of processed asphalt roofing shingles from post-consumer asphalt shingles or from manufactured shingle waste. The RAS material under consideration for use in bituminous concrete mixtures must be certified as being asbestos-free and shall be entirely free of whole, intact nails. The RAS material shall meet the requirements of AASHTO MP 23.

The Producer shall test the RAS material to determine the asphalt content and the gradation of the RAS material. The Producer shall take necessary action to prevent contamination of RAS stockpiles.

The Contractor shall submit a Material Certificate to the Engineer stating that the RAS complies with all the applicable requirements in this Section.

10. Plant Requirements:

(a) General: The Plant producing bituminous concrete shall comply with AASHTO M 156.

(b) Storage Silos: The Contractor may use silos for short-term storage with the approval of the Engineer. A storage silo must have heated cones and an unheated silo cylinder if it does not contain a separate internal heating system. When multiple silos are filled, the Contractor shall discharge 1 silo at a time. Simultaneous discharge of multiple silos for the same Project is not permitted.

Type of silo cylinder	Maximum storage time for all classes (hr)	
	<u>HMA</u>	<u>WMA/PMA</u>
Open Surge	4	Mfg Recommendations*
Unheated - Non-insulated	8	Mfg Recommendations*
Unheated - Insulated	18	Mfg Recommendations*
Heated - No inert gas	TBD by the Engineer	TBD by the Engineer

*Not to exceed HMA limits

(c) Documentation System: The mixing Plant documentation system shall include equipment for accurately proportioning the components of the mixture by weight and in the proper order, controlling the cycle sequence, and timing the mixing operations. Recording equipment shall monitor the batching sequence of each component of the mixture and produce a printed record of these operations on each Plant ticket, as specified herein.

If recycled materials are used, the Plant tickets shall include their dry weight, percentage, and daily moisture content.

If a WMA Technology is added at the Plant, the Plant tickets shall include the actual dosage rate.

For drum Plants, the Plant ticket shall be produced at 5 minute intervals and maintained by the vendor for a period of 3 years after the completion of the Project.

For batch Plants, the Plant ticket shall be produced for each bath and maintained by the vendor for a period of 3 years after the completion of the Project. In addition, an asterisk (*)

shall be automatically printed next to any individual batch weight(s) exceeding the following tolerances:

Each Aggregate Component	±1.5% of individual or cumulative target weight for each bin
Mineral Filler	±0.5% of the total batch
Bituminous Material	±0.1% of the total batch
Zero Return (Aggregate)	±0.5% of the total batch
Zero Return (Bituminous Material)	±0.1% of the total batch

The entire batching and mixing interlock cut-off circuits shall interrupt and stop the automatic batching operations when an error exceeding the acceptable tolerance occurs in proportioning.

The scales shall not be manually adjusted during the printing process. In addition, the system shall be interlocked to allow printing only when the scale has come to a complete rest. A unique printed character (m) shall automatically be printed on the truck and batch plant printout when the automatic batching sequence is interrupted or switched to auto-manual or full manual during proportioning.

(d) Aggregates: Aggregate stockpiles shall be managed to prevent segregation and cross contamination. For drum Plants only, the percent moisture content, at a minimum prior to production and half way through production, shall be determined.

(e) Mixture: The dry and wet mix times shall be sufficient to provide a uniform mixture and a minimum particle coating of 95% as determined by AASTO T 195(M).

Bituminous concrete mixtures shall contain no more than 0.5% moisture when tested in accordance with AASHTO T 329.

(f) RAP: RAP moisture content shall be determined a minimum of twice daily (prior to production and halfway through production).

(g) Asphalt Binder: A binder log shall be submitted to the Department’s Central Lab on a monthly basis.

(h) Warm mix additive: For mechanically foamed WMA, the water injection rate shall be monitored during production and not exceed 2.0% by total weight of binder. For additive added at the Plant, the dosage rate shall be monitored during production.

(i) Testing Laboratory: The Contractor shall maintain a laboratory to test bituminous concrete mixtures during production. The laboratory shall have a minimum of 300 s.f., have a potable water source and drainage in accordance with the CT Department of Public Health Drinking Water Division, and be equipped with all necessary testing equipment as well as with a PC, printer, and telephone with a dedicated hard-wired phone line. In addition, the PC shall have a high speed internet connection and a functioning web browser with unrestricted access to <https://ctmail.ct.gov> . This equipment shall be maintained in working order at all times and be made available for use by the Engineer.

The laboratory shall be equipped with a heating system capable of maintaining a minimum temperature of 65°F. It shall be clean and free of all materials and equipment not associated with the laboratory. Sufficient light and ventilation must be provided. During summer months

adequate cooling or ventilation must be provided so the indoor air temperature shall not exceed the ambient outdoor temperature.

The laboratory testing apparatus, supplies, and safety equipment shall be capable of performing all the applicable tests in their entirety that are referenced in AASHTO R 35 and AASHTO M 323. The Contractor shall ensure that the Laboratory is adequately supplied at all times during the course of the Project with all necessary testing materials and equipment.

The Contractor shall maintain a list of laboratory equipment used in the acceptance testing processes including, but not limited to, balances, scales, manometer/vacuum gauge, thermometers, and gyratory compactor, clearly showing calibration and/or inspection dates, in accordance with AASHTO R 18. The Contractor shall notify the Engineer if any modifications are made to the equipment within the laboratory. The Contractor shall take immediate action to replace, repair, or recalibrate any piece of equipment that is out of calibration, malfunctioning, or not in operation.

M.04.02—Mix design and Job Mix Formula (JMF)

1. Curb Mix:

(a) Requirements: The Contractor shall use bituminous concrete that meets the requirements of Table M.04.02-1. RAP may be used in 5% increments by weight up to 30%.

(b) Basis of Approval: Annually, an approved JMF based on a mix design for curb mix must be on file with the Engineer prior to use.

The Contractor shall test the mixture for compliance with the submitted JMF and Table M.04.02-1. The maximum theoretical density (Gmm) will be determined by AASHTO T 209. If the mixture does not meet the requirements, the JMF shall be adjusted within the ranges shown in Table M.04.02-1 until an acceptable mixture is produced.

An accepted JMF from the previous operating season may be acceptable to the Engineer provided that there are no changes in the sources of supply for the coarse aggregate, fine aggregate, recycled material (if applicable) and the Plant operation had been consistently producing acceptable mixture.

Any change in component source of supply or consensus properties must be approved by the Engineer. A revised JMF shall be submitted prior to use.

**TABLE M.04.02-1:
Control Points for Curb Mix Mixtures**

Mix	Curb Mix	Production Tolerances from JMF Target
Grade of PG Binder content %	PG 64S-22 6.5 - 9.0	0.4
Sieve Size		
No. 200	3.0 - 8.0 (b)	2.0
No. 50	10 - 30	4
No. 30	20 - 40	5
No. 8	40 - 70	6
No. 4	65 - 87	7
1/4 inch		
3/8 inch	95 - 100	8
1/2 inch	100	8
3/4 inch		8
1 inch		
2 inch		
Additionally, the fraction of material retained between any 2 consecutive sieves shall not be less than 4%.		
Mixture Temperature		
Binder	325°F maximum	
Aggregate	280-350°F	
Mixtures	265-325°F	
Mixture Properties		
Air Voids (VA) %	0 – 4.0 (a)	
Notes: (a) Compaction Parameter 50 gyrations (N_{des}) (b) The percent passing the No. 200 sieve shall not exceed the percentage of bituminous asphalt binder.		

2. Superpave Design Method – S0.25, S0.375, S0.5, and S1:

(a) **Requirements:** All designated mixes shall be designed using the Superpave mix design method in accordance with AASHTO R 35. A JMF based on the mix design shall meet the requirements of Tables M.04.02-2 to M.04.02-5. Each JMF and component samples must be submitted no less than 7 days prior to production and must be approved by the Engineer prior to use. All JMFs expire at the end of the calendar year.

All aggregate component consensus properties and tensile strength ratio (TSR) specimens shall be tested at an AASHTO Materials Reference Laboratory (AMRL) by NETTCP Certified Technicians.

All bituminous concrete mixes shall be tested for stripping susceptibility by performing the TSR test procedure in accordance with AASHTO T 283(M) at a minimum every 36 months. The compacted specimens may be fabricated at the Plant and then tested at an AMRL accredited facility. A minimum of 45000 grams of laboratory or plant blended mixture and the

corresponding complete Form MAT-412s shall be submitted to the Division of Material Testing (DMT) for design TSR testing verification. The mixture submitted shall be representative of the corresponding mix design as determined by the Engineer.

- i. Superpave Mixtures with RAP: RAP may be used with the following conditions:
 - RAP amounts up to 15% may be used with no binder grade modification.
 - RAP amounts up to 20% may be used provided a new JMF is approved by the Engineer. The JMF submittal shall include the grade of virgin binder added. The JMF shall be accompanied by a blending chart and supporting test results in accordance with AASHTO M 323 Appendix X1, or by testing that shows the combined binder (recovered binder from the RAP, virgin binder at the mix design proportions, warm mix asphalt additive and any other modifier if used) meets the requirements of the specified binder grade.
 - Two (2) representative samples of RAP shall be obtained. Each sample shall be split, and 1 split sample shall be tested for binder content in accordance with AASHTO T 164 and the other in accordance with AASHTO T 308.
 - RAP material shall not be used with any other recycling option.
- ii. Superpave Mixtures with RAS: RAS may be used solely in HMA S1 mixtures with the following conditions:
 - RAS amounts up to 3% may be used.
 - RAS total binder replacement up to 15% may be used with no binder grade modification.
 - RAS total binder replacement up to 20% may be used provided a new JMF is approved by the Engineer. The JMF submittal shall include the grade of virgin binder added. The JMF shall be accompanied by a blending chart and supporting test results in accordance with AASHTO M 323 Appendix X1, or by testing that shows the combined binder (recovered binder from the RAP, virgin binder at the mix design proportions, warm mix asphalt additive and any other modifier if used) meets the requirements of the specified binder grade.
 - Superpave Mixtures with RAS shall meet AASHTO PP 78 design considerations.
- iii. Superpave Mixtures with CRCG: CRCG may be used solely in HMA S1 mixtures. One percent (1%) of hydrated lime, or other accepted non-stripping agent, shall be added to all mixtures containing CRCG. CRCG material shall not be used with any other recycling option.
- (b) Basis of Approval: The following information must be included in the JMF submittal:
 - i. Gradation, consensus properties and specific gravities of the aggregate, RAP or RAS.
 - ii. Average asphalt content of the RAP or RAS by AASHTO T 164.
 - iii. Source of RAP or RAS and percentage to be used.
 - iv. Warm mix Technology, manufacturer's recommended additive rate and tolerances, and manufacturer recommended mixing and compaction temperatures.
 - v. TSR test report and anti-strip manufacturer and recommended dosage rate if applicable.
 - vi. Mixing and compaction temperature ranges for the mix with and without the warm-mix technology incorporated.
 - vii. JMF ignition oven correction factor by AASHTO T 308.

With each JMF submittal, the following samples shall be submitted to the Division of Materials Testing:

- 4 - one (1) quart cans of PG binder, with corresponding Safety Data Sheet (SDS)
- 1 - 50 lbs. bag of RAP
- 2 - 50 lbs. bags of Plant-blended virgin aggregate

A JMF may not be approved if any of the properties of the aggregate components or mix do not meet the verification tolerances as described in the Department's current QA Program for Materials, Acceptance and Assurance Testing Policies and Procedures.

Any material based on a JMF, once approved, shall only be acceptable for use when it is produced by the designated Plant, it utilizes the same components, and the production of material continues to meet all criteria as specified in Tables M.04.02-2, M.04.02-3 and M.04.02-4. A new JMF must be submitted to the Engineer for approval whenever a new component source is proposed.

Only 1 mix with 1 JMF will be approved for production at a time. Switching between approved JMF mixes with different component percentages or sources of supply is prohibited.

TABLE M.04.02-2: Superpave Master Range for Bituminous Concrete Mixture Design Criteria

	S0.25		S0.375		S0.5		S1	
Sieve	Control Points		Control Points		Control Points		Control Points	
inches	Min (%)	Max (%)	Min (%)	Max (%)	Min (%)	Max (%)	Min (%)	Max (%)
2.0	-	-	-	-	-	-	-	-
1.5	-	-	-	-	-	-	100	-
1.0	-	-	-	-	-	-	90	100
3/4	-	-	-	-	100	-	-	90
1/2	100	-	100	-	90	100	-	-
3/8	97	100	90	100	-	90	-	-
No. 4	72	90	-	72	-	-	-	-
No. 8	32	67	32	67	28	58	19	45
No. 16	-	-	-	-	-	-	-	-
No. 30	-	-	-	-	-	-	-	-
No. 50	-	-	-	-	-	-	-	-
No. 100	-	-	-	-	-	-	-	-
No. 200	2.0	10.0	2.0	10.0	2.0	10.0	1.0	7.0
VMA (%)	16.5 ± 1		16.0 ± 1		15.0 ± 1		13.0 ± 1	
VA (%)	4.0 ± 1		4.0 ± 1		4.0 ± 1		4.0 ± 1	
Gse	JMF value		JMF value		JMF value		JMF value	
Gmm	JMF ± 0.030		JMF ± 0.030		JMF ± 0.030		JMF ± 0.030	
Dust / effective binder	0.6 - 1.2		0.6 - 1.2		0.6 - 1.2		0.6 - 1.2	
TSR	≥ 80%		≥ 80%		≥ 80%		≥ 80%	
T-283 Stripping	Minimal as determined by the Engineer							

(c) Mix Status: Each facility will have each type of bituminous concrete mixture rated based on the results of the previous year of production. Mix status will be provided to each bituminous concrete Producer prior to the beginning of the paving season.

The rating criteria are based on compliance with Air Voids and Voids in Mineral Aggregate (VMA) as indicated in Table M.04.03-4 and are calculated as follows:

Criteria A: Percentage of acceptance test results with compliant air voids.

Criteria B: The average of the percentage of acceptance results with compliant VMA and the percentage of acceptance results with compliant air voids.

The final rating assigned will be the lower of the rating obtained with Criteria A or Criteria B.

Mix status is defined as:

“A” – Approved: Assigned to each mixture type from a production facility with a current rating of 70% or greater, or to each mixture type completing a successful PPT.

“PPT” – Pre-Production Trial: Temporarily assigned to each mixture type from a production facility when:

1. there are no compliant acceptance production test results submitted to the Department from the previous year;
2. there is a source change in one or more aggregate components;
3. there is a component percentage change of more than 5% by weight;
4. there is a change in RAP percentage;
5. the mixture has a rating of less than 70% from the previous season;
6. it is a new JMF not previously submitted; or
7. the average of 10 consecutive acceptance results for VFA, Density to N_{ini} or dust to effective binder ratio does not meet the criteria in tables M.04.02-2 and M.04.02-4.

Bituminous concrete mixtures rated with a “PPT” status cannot be used on Department projects. Testing shall be performed by the Producer with NETTCP certified personnel on material under this status. Test results must confirm that specification requirements in Tables M.04.02-2 through M.04.02-4 are met and the binder content (Pb) meets the requirements in Table M.04.03-2 before material can be used. One of the following methods must be used to verify the test results:

Option A: Schedule a day when a Department Inspector can be at the facility to witness testing

Option B: When the Contractor or their representative performs testing without being witnessed by an Inspector, the Contractor shall submit the test results and a split sample including 2 gyratory molds, 5,000 grams of boxed bituminous concrete, and 5,000 grams of cooled loose bituminous concrete for verification testing and approval

Option C: When the Contractor or their representative performs testing without being witnessed by a Department Inspector, the Engineer may verify the mix in the Contractor’s laboratory

Witnessing or verifying by the Department of compliant test results will change the mix’s status to “A”

The differences between the Department’s test results and the Contractor’s must be within the “C” tolerances included in the [Department’s QA Program for Materials, Acceptance and Assurance Testing Policies and Procedures](#) in order to be verified.

“U” – Not Approved: Status assigned to a type of mixture that does not have an approved JMF. Bituminous concrete mixtures with a “U” status cannot be used on Department projects.

**TABLE M.04.02-3:
Superpave Consensus Properties Requirements for Combined Aggregate**

Traffic Level	Design ESALs (80kN) Millions	Coarse Aggregate Angularity ⁽¹⁾	Fine Aggregate Angularity AASHTO T 304, Method A Minimum %	Flat and Elongated Particles ⁽²⁾ ASTM D4791, Maximum %	Sand Equivalent AASHTO T 176, Minimum %
		ASTM D5821, Minimum %			
1	< 0.3	55/- -	40	10	40
2	0.3 to < 3.0	75/- -	40	10	40
3	≥ 3.0	95/90	45	10	45

Notes:
⁽¹⁾ 95/90 denotes that a minimum of 95% of the coarse aggregate, by mass, shall have one fractured face and that a minimum of 90% shall have two fractured faces.
⁽²⁾ Criteria presented as maximum Percent by mass of flat and elongated particles of materials retained on the No. 4 sieve, determined at 5:1 ratio.

TABLE M.04.02-4: Superpave Traffic Levels and Design Volumetric Properties

Traffic Level	Design ESALs (million)	Number of Gyration by Superpave Gyratory Compactor			Percent Density of Gmm from HMA/WMA Specimen			Voids Filled with Asphalt (VFA) Based on Nominal Mix Size - Inch			
		N _{ini}	N _{des}	N _{max}	N _{ini}	N _{des}	N _{max}	0.25	0.375	0.5	1
1	<0.3	6	50	75	≤91.5	96.0	≤98.0	70-80	70-80	70-80	67-80
2	0.3 to <3.0	7	75	115	≤90.5	96.0	≤98.0	65-78	65-78	65-78	65-78
3	≥3.0	7	75	115	≤90.0	96.0	≤98.0	65-77	65-76	65-75	65-75

**TABLE M.04.02-5:
Superpave Minimum Binder Content by Mix Type and Level**

Mix Type	Level	Binder Content Minimum
S0.25	1	5.80
S0.25	2	5.70
S0.25	3	5.70
S0.375	1	5.70
S0.375	2	5.60
S0.375	3	5.60
S0.5	1	5.10
S0.5	2	5.00
S0.5	3	5.00
S1	1	4.60
S1	2	4.50
S1	3	4.50

M.04.03—Production Requirements:

1. Standard Quality Control Plan (QCP) for Production: The QCP for production shall describe the organization and procedures, which the Contractor shall use to administer quality control. The QCP shall include the procedures used to control the production process, to determine when immediate changes to the processes are needed, and to implement the required changes. The QCP must detail the inspection, sampling and testing protocols to be used, and the frequency for each.

Control Chart(s) shall be developed and maintained for critical aspect(s) of the production process as determined by the Contractor. The control chart(s) shall identify the material property, applicable upper and lower control limits, and be updated with current test data. As a minimum, the following quality characteristics shall be included in the control charts:

- percent passing No. 4 sieve
- percent passing No. 200 sieve
- binder content
- air voids
- Gmm
- Gse
- VMA

The control chart(s) shall be used as part of the quality control system to document variability of the bituminous concrete production process. The control chart(s) shall be submitted to the Engineer the first day of each month.

The QCP shall also include the name and qualifications of a Quality Control Manager. The Quality Control Manager shall be responsible for the administration of the QCP, including compliance with the plan and any plan modifications.

The Contractor shall submit complete production testing records to the Engineer within 24 hours in a manner acceptable to the Engineer.

The QCP shall also include the name and qualifications of any outside testing laboratory performing any QC functions on behalf of the Contractor. The QCP must also include a list of sampling and testing methods and frequencies used during production, and the names of all Quality Control personnel and their duties.

Approval of the QCP does not imply any warranty by the Engineer that adherence to the plan will result in production of bituminous concrete that complies with these specifications. The Contractor shall submit any changes to the QCP as work progresses.

2. Acceptance Requirements:

(a) General:

For those mixes with a total estimated project tonnage over 500 tons, a NETTCP HMA Paving Inspector certified Contractor representative shall obtain a field sample of the material placed at the project site in accordance with AASHTO T 168 using the procedure indicated in Section 5.2.3 or an alternate procedure approved by the Engineer. Sampling from the truck at the Plant in accordance with AASHTO T 168 using the procedure indicated in Section 5.2.2 will be allowed for those mixes with a total estimated project tonnage equal to or less than 500 tons. Regardless of sampling location, the sample shall be quartered by the Contractor in accordance with AASHTO R 47 and placed in an approved container. The container shall be sealed with a security tape provided by the Department and labelled to include the project number, date of paving, mix type, lot and subplot numbers and daily tonnage. The minimum weight of each quartered sample shall be 14000 grams. The Contractor shall transport one of the containers to the Departments Central Laboratory in Rocky Hill, retain one of the sealed containers for potential use in dispute resolution and test the remaining samples for acceptance in accordance with past practice.

The Contractor shall submit all acceptance tests results to the Engineer within 24 hours or prior to the next day's production. All acceptance test specimens and supporting documentation must be retained by the Contractor and may be disposed of with the approval of the Engineer. All quality control specimens shall be clearly labeled and separated from the acceptance specimens.

Contractor personnel performing QC and acceptance testing must be present at the facility prior to, during, and until completion of production, and be certified as a NETTCP HMA Plant Technician or Interim HMA Plant Technician and be in good standing. Production of material for use on State projects must be suspended by the Contractor if such personnel are not present. Technicians found by the Engineer to be non-compliant with NETTCP policies and procedures or Department policies may be removed by the Engineer from participating in the acceptance testing process for Department projects until their actions can be reviewed.

Verification and dispute resolution testing will be performed by the Engineer in accordance with the Department's QA Program for Materials.

Should the Department be unable to validate the Contractor's acceptance test result(s) for a lot of material, the Engineer will use results from verification testing and re-calculate the pay adjustment for that lot. The Contractor may request to initiate the dispute resolution process in writing within 24 hours of receiving the adjustment and must include supporting documentation or test results to justify the request.

(b) Curb Mix Acceptance Sampling and Testing Procedures: Curb Mixes shall be tested by the Contractor at a frequency of 1 test per every 250 tons of cumulative production, regardless of the day of production.

When these mix designs are specified, the following acceptance procedures and AASHTO test methods shall be used:

TABLE M.04.03-1: Curb Mix Acceptance Test Procedures

Protocol	Reference	Description
1	AASHTO T 30(M)	Mechanical Analysis of Extracted Aggregate
2	AASHTO T 168	Sampling of Bituminous Concrete
3	AASHTO T 308	Binder Content by Ignition Oven Method (adjusted for aggregate correction factor)
4	AASHTO T 209(M)⁽²⁾	Theoretical Maximum Specific Gravity and Density of Bituminous Paving Mixtures
5	AASHTO T 312⁽²⁾	⁽¹⁾ Superpave Gyrotory Molds Compacted to N _{des}
6	AASHTO T 329	Moisture Content of Hot-Mix Asphalt (HMA) by Oven Method

Notes: ⁽¹⁾ One (1) set equals 2 each of 6-inch molds. Molds to be compacted to 50 gyrations.
⁽²⁾ Once per year or when requested by the Engineer.

- i. Determination of Off-Test Status:
 1. Curb Mix is considered “off test” when the test results indicate that any single value for bitumen content or gradation are not within the tolerances shown in Table M.04.02-1 for that mixture. If the mix is “off test,” the Contractor must take immediate actions to correct the deficiency and a new acceptance sample shall be tested on the same day or the following day of production.
 2. When multiple silos are located at 1 site, mixture supplied to 1 project is considered as coming from 1 source for the purpose of applying the “off test” status.
 3. The Engineer may cease supply from the Plant when test results from 3 consecutive samples are not within the JMF tolerances or the test results from 2 consecutive samples not within the control points indicated in Table M.04.02-1 regardless of production date.
 - ii. JMF Revisions
 1. If a test indicates that the bitumen content or gradation are outside the tolerances, the Contractor may make a single JMF revision as allowed by the Engineer prior to any additional testing. Consecutive test results outside the requirements of Table M.04.02-1 JMF tolerances may result in rejection of the mixture.
 2. Any modification to the JMF shall not exceed 50% of the JMF tolerances indicated in Table M.04.02-1 for any given component of the mixture without approval of the Engineer. When such an adjustment is made to the bitumen, the corresponding production percentage of bitumen shall be revised accordingly.
- (c) Superpave Mix Acceptance:
- i. Sampling and Testing Procedures

Production Lot: The lot will be defined as one of the following types:

 - Non-PWL Production Lot for total estimated Project quantities per mixture less than 3500 tons: All mixture placed during a single continuous paving operation.
 - PWL Production Lot for total estimated Project quantities per mixture of 3500 tons or more: Each 3500 tons of mixture produced within 30 calendar days.

Production Sub Lot:

 - For Non-PWL: As defined in Table M.04.03-2
 - For PWL: 500 tons (The last sub lot may be less than 500 tons.)

Partial Production Lots (For PWL only): A Lot with less than 3500 tons due to:

- completion of the course;
- a Job Mix Formula revision due to changes in:
 - o cold feed percentages over 5%,
 - o target combined gradation over 5%,
 - o target binder over 0.15%,
 - o any component specific gravity; or
- a lot spanning 30 calendar days.

The acceptance sample(s) location(s) shall be selected using stratified - random sampling in accordance with ASTM D3665 based on:

- the total daily estimated tons of production for non-PWL lots, or
- the total size for PWL lots.

One (1) acceptance sample shall be obtained and tested per sub lot with quantities over 125 tons. The Engineer may direct that additional acceptance samples be obtained. For non-PWL lots, one (1) acceptance test shall always be performed in the last sub lot based on actual tons of material produced.

For non-PWL lots, quantities of the same mixture per Plant may be combined daily for multiple State projects to determine the number of sub lots.

The payment adjustment will be calculated as described in 4.06.

**TABLE M.04.03-2:
Superpave Acceptance Testing Frequency per Type/Level/Plant for Non-PWL Lots**

Daily Quantity Produced in Tons (Lot)	Number of Sub Lots/Tests
0 to 125	0, Unless requested by the Engineer
126 to 500	1
501 to 1,000	2
1,001 to 1,500	3
1,500 or greater	1 per 500 tons or portions thereof

The following test procedures shall be used for acceptance:

TABLE M.04.03-3: Superpave Acceptance Testing Procedures

Protocol	Procedure	Description
1	AASHTO T 168	Sampling of bituminous concrete
2	AASHTO R 47	Reducing samples to testing size
3	AASHTO T 308	Binder content by ignition oven method (adjusted for aggregate correction factor)
4	AASHTO T 30(M)	Gradation of extracted aggregate for bituminous concrete mixture
5	AASHTO T 312	⁽¹⁾ Superpave gyratory molds compacted to N_{des}
6	AASHTO T 166	⁽²⁾ Bulk specific gravity of bituminous concrete
7	AASHTO R 35	⁽²⁾ Air voids, VMA
8	AASHTO T 209(M)	Maximum specific gravity of bituminous concrete (average of 2 tests)
9	AASHTO T 329	Moisture content of bituminous concrete

Notes: ⁽¹⁾ One (1) set equals 2 each of 6-inch molds. Molds to be compacted to N_{max} for PPTs and to N_{des} for production testing. The first sub lot of the year shall be compacted to N_{max} .

⁽²⁾ Average value of 1 set of 6-inch molds.

If the average ignition oven corrected binder content differs by 0.3% or more from the average of the Plant ticket binder content in 5 consecutive tests regardless of the production date (moving average), the Contractor shall immediately investigate, determine an assignable cause, and correct the issue. When 2 consecutive moving average differences are 0.3% or more and no assignable cause has been established, the Engineer may require a new ignition oven aggregate correction factor to be performed or to adjust the current factor by the average of the differences between the corrected binder content and production Plant ticket for the last 5 acceptance results.

The Contractor shall perform TSR testing within 30 days after the start of production for all design levels of HMA- and PMA- S0.5 Plant-produced mixtures, in accordance with AASHTO T 283(M). The TSR test shall be performed at an AMRL certified laboratory by NETTCP certified technicians. The compacted specimens may be fabricated at the Plant and then tested at an AMRL accredited facility. A minimum of 45000 grams of plant blended mixture and the corresponding complete Form MAT-412s shall be submitted to the DMT for production TSR testing verification. The mixture submitted shall be representative of the corresponding mix design as determined by the Engineer. Additionally, the TSR test report and tested specimens shall be submitted to the Engineer for review. Superpave mixtures that require anti-strip additives (either liquid or mineral) shall continue to meet all requirements specified herein for binder and bituminous concrete. The Contractor shall submit the name, manufacturer, percent used, technical datasheet and SDS for the anti-strip additive (if applicable) to the Engineer.

i. Determination of Off-Test Status:

1. Superpave mixes shall be considered “*off test*” when any control point sieve, binder content, VA, VMA, and Gmm value is outside of the limits specified in Table M.04.03-4 or the target binder content at the Plant is below the minimum binder

content stated in Table M.04.02-5. Note that further testing of samples or portions of samples not initially tested for this purpose cannot be used to change the status.

2. Any time the bituminous concrete mixture is considered off-test:
 - A. The Contractor shall notify the Engineer when the Plant is “*off test*” for any mix design that is delivered to the Project in any production day. When multiple silos are located at 1 site, mixture supplied to 1 project is considered as coming from 1 source for the purpose of applying the “*off test*” determination.
 - B. The Contractor must take immediate actions to correct the deficiency, minimize “*off test*” production to the Project, and obtain an additional Process Control (PC) test after any corrective action to verify production is in conformance with the specifications. A PC test will not be used for acceptance and is solely for the use of the Contractor in its quality control process.

ii. Cessation of Supply for Superpave Mixtures in Non-PWL Lots:

A mixture **shall not be used** on Department projects when it is “off test” for:

1. four (4) consecutive tests in any combination of VA, VMA or Gmm, regardless of date of production, or
2. two (2) consecutive tests in the control point sieves in 1 production shift.

As a result of cessation of supply, the mix status will be changed to PPT

iii. JMF revisions:

JMF revisions are only permitted prior to or after a production shift. A JMF revision is effective from the time it was submitted and is not retroactive to the previous test(s).

JMF revisions shall be justified by a documented trend of test results.

Revisions to aggregate or RAP specific gravities are only permitted when testing is performed at an AMRL certified laboratory by NETTCP certified technicians.

A JMF revision is required when the Plant target RAP or bin percentage deviates by more than 5% or the Plant target binder content deviates by more than 0.15% from the active JMF.

TABLE M.04.03-4: Superpave Mixture Production Requirements

	S0.25		S0.375		S0.5		S1		Tolerances
Sieve	Control Points		Control Points		Control Points		Control Points		From JMF Targets ⁽²⁾
inches	Min (%)	Max (%)	Min (%)	Max (%)	Min (%)	Max (%)	Min (%)	Max (%)	+/- Tolerance
1.5	-	-	-	-	-	-	100	-	
1.0	-	-	-	-	-	-	90	100	
3/4	-	-	-	-	100	-	-	90	
1/2	100	-	100	-	90	100	-	-	
3/8	97	100	90	100	-	90	-	-	
No. 4	72	90	-	72	-	-	-	-	
No. 8	32	67	32	67	28	58	19	45	
No. 16	-	-	-	-	-	-	-	-	
No. 200	2.0	10.0	2.0	10.0	2.0	10.0	1.0	7.0	
Pb	JMF value		JMF value		JMF value		JMF value		0.3 ⁽³⁾
VMA (%)	16.5		16.0		15.0		13.0		1.0 ⁽⁴⁾
VA (%)	4.0		4.0		4.0		4.0		1.0 ⁽⁵⁾
Gmm	JMF value		JMF value		JMF value		JMF value		0.030
Mix Temp. – HMA ⁽⁶⁾	265-325°F ⁽¹⁾		265-325°F ⁽¹⁾		265-325°F ⁽¹⁾		265-325°F ⁽¹⁾		
Mix Temp. – PMA ⁽⁶⁾	285-335°F ⁽¹⁾		285-335°F ⁽¹⁾		285-335°F ⁽¹⁾		285-335°F ⁽¹⁾		
Prod. TSR	N/A		N/A		≥80%		N/A		
T-283 Stripping	N/A		N/A		Minimal TBD by the Engineer		N/A		

Notes: ⁽¹⁾ 300°F minimum after October 15.

⁽²⁾ JMF tolerances shall be defined as the limits for production compliance.

⁽³⁾ 0.4 for PWL lots

⁽⁴⁾ 1.3 for all PWL lots except S/P 0.25 mixes. 1.1 for S/P 0.25 Non-PWL lots. 1.4 for S/P 0.25 PWL lots

⁽⁵⁾ 1.2 for PWL lots

⁽⁶⁾ Also applies to placement

**Table M.04.03-5:
Modifications to Standard AASHTO and ASTM Test Specifications and Procedures**

AASHTO Standard Method of Test	
Reference	Modification
T 30	Section 7.2 through 7.4 Samples are not routinely washed for production testing
T 209	Section 7.2 The average of 2 bowls is used proportionally in order to satisfy minimum mass requirements. 8.3 Omit Pycnometer method.
T 283	When foaming technology is used, the material used for the fabrication of the specimens shall be cooled to room temperature, and then reheated to the manufacturer's recommended compaction temperature prior to fabrication of the specimens.
AASHTO Standard Recommended Practices	
Reference	Modification
R 26	<p>All laboratory technician(s) responsible for testing PG binders shall be certified or Interim Qualified by NETTCP as a PG Asphalt Binder Lab Technician.</p> <p>All laboratories testing binders for the Department are required to be accredited by the AMRL.</p> <p>Sources interested in being approved to supply PG binders to the Department by use of an "in-line blending system" must record properties of blended material and additives used.</p> <p>Each source of supply of PG binder must indicate that the binders contain no additives used to modify or enhance their performance properties. Binders that are manufactured using additives, modifiers, extenders, etc., shall disclose the type of additive, percentage and any handling specifications or limitations required.</p> <p>All AASHTO M 320 references shall be replaced with AASHTO M 332.</p> <p>Once a month, 1 split sample and test results for each asphalt binder grade and each lot shall be submitted by the PG binder supplier to the Department's Central Lab. Material remaining in a certified lot shall be re-certified no later than 30 days after initial certification. Each April and September, the PG binder supplier shall submit test results for 2 BBR tests at 2 different temperatures in accordance with AASHTO R 29.</p>

SECTION M.06 – METALS

Section M.06 is amended as follows:

M.06.01—Reinforcing Steel:

Delete the entire last paragraph in Subarticle 1 "Bar Reinforcement" that reads: "Prior to the incorporation... ..and type of bar reinforcement."

M.06.02—Structural Steel:

Revise Subarticle 2 "Anchor Bolts" as follows:

"(a) Anchor bolt assemblies shall meet the requirements of ASTM F1554, and the grade shall be as specified on the plans. All components of the bolt assembly shall be galvanized in accordance with ASTM F2329."

Replace Subarticle 3 "High Strength Bolts" with the following:

" **3. High-Strength Bolts:** High-strength bolts, including suitable nuts and hardened washers, shall meet the following requirements:

- (a) High-strength bolts shall meet the requirements of ASTM F3125 Grade A325 or ASTM F3125 Grade A490 as shown on the plans. High-strength bolts used with coated steel shall be mechanically galvanized, unless otherwise specified. High-strength bolts used with uncoated weathering grades of steel shall be Type 3.

Nuts for ASTM F3125 Grade A325 bolts shall meet the requirements of ASTM A563, Grades DH, DH3, C, C3 and D. Where galvanized high-strength bolts are used, the nuts shall be galvanized, heat-treated Grade DH. Where Type 3 high-strength bolts are used, the nuts shall be Grade C3 or DH3.

Nuts for ASTM F3125 Grade A490 bolts shall meet the requirements of ASTM A563, Grade DH. Where Type 3 high-strength bolts are used, the nuts shall be Grade DH3.

All galvanized nuts shall be lubricated with a lubricant containing a visible dye of any color that contrasts with the color of the galvanizing. Black bolts must be oily to the touch when delivered and installed.

Circular flat and square or rectangular beveled, hardened steel washers shall meet the requirements of ASTM F436. Unless otherwise specified, galvanized washers shall be furnished when galvanized high-strength bolts are specified, and washers with atmospheric corrosion resistance and weathering characteristics shall be furnished when Type 3 high-strength bolts are specified.

Compressible-washer-type direct tension indicator washers, used in conjunction with high-strength bolts, shall meet the requirements of ASTM F959. Where galvanized high-strength bolts are used, the washers shall be galvanized in accordance with ASTM B695,

Class 55. Where Type 3 high-strength bolts are used, the washers shall be galvanized in accordance with ASTM B695, Class 55 and coated with epoxy.

- (b) Identifying Marks:** ASTM F3125 Grade A325 for bolts and the specifications referenced therein for nuts require that bolts and nuts manufactured to the specification be identified by specific markings on the top of the bolt head and on one face of the nut. Markings may be raised or depressed at the manufacturer's option and shall be visible after coating if coating is required. Head markings must identify the grade by the symbol "A325," the manufacturer and the type, if Type 3. Nut markings must identify the grade, the manufacturer and if Type 3, the type. Markings on direct tension indicators must identify the manufacturer and Type "A325." Other washer markings must identify the manufacturer and if Type 3, the type.

ASTM F3125 Grade A490 for bolts and the specifications referenced therein for nuts require that bolts and nuts manufactured to the specifications be identified by specific markings on the top of the bolt head and on one face of the nut. Markings may be raised or depressed at the manufacturer's option and shall be visible after coating if coating is required. Head markings must identify the grade by the symbol "A490," the manufacturer and the type, if Type 3. Nut markings must identify the grade, the manufacturer and if Type 3, the type. Markings on direct tension indicators must identify the manufacturer and Type "A490." Other washer markings must identify the manufacturer and if Type 3, the type.

ASTM F3125 Grade A325 and ASTM F3125 Grade A490 bolt lengths up to 4 times the diameter which are fully threaded but which are not required to be fully threaded by the relevant ASME standard shall be marked with a "T" immediately after the grade designation, for example "A325T." Bolts with any other non-standard dimensions, including thread length, shall be marked with an "S" immediately after the grade designation, for example "A325S." All other markings, if used, such as a private label distributor's mark shall also be separate and distinct.

- (c) Dimensions:** Bolt and nut dimensions shall meet the requirements for Heavy Hexagon Structural Bolts and for Heavy Semi-Finished Hexagon Nuts given in ASME Standard B18.2.6.
- (d) Galvanized Bolts:** Galvanized bolts shall meet the requirements of ASTM F3125 Grade A325, Type 1. The bolts shall be hot-dip galvanized in accordance with ASTM F2329, to a thickness of 50 μm or mechanically galvanized in accordance with ASTM B695, Class 55. Bolts, nuts, and washers of any assembly shall be galvanized by the same process. The nuts shall be overtapped to the minimum amount required for the fastener assembly, and shall be lubricated with a lubricant containing a visible dye so a visual check can be made for the lubricant at the time of field installation. Galvanized bolts shall be tension tested after galvanizing. ASTM F3125 Grade A490 bolts shall be uncoated or shall be coated in accordance with either ASTM F1136 Grade 3 or ASTM F2833 Grade 1.
- (e) Test Requirements:** The maximum hardness of ASTM F3125 Grade A325 bolts shall be 34 HRC. The maximum hardness of ASTM F3125 Grade A490 bolts shall be 38 HRC. Plain, ungalvanized nuts shall have a minimum hardness of 89 HRB.

Proof load tests, in accordance with the requirements of ASTM F606 Method 1, shall be required for the bolts. Wedge tests of full-size bolts are required in accordance with Section 10.1 of ASTM F3125. Galvanized bolts shall be wedge tested after galvanizing.

Proof load tests of ASTM A563 are required for nuts. Proof load tests for nuts used with galvanized bolts shall be performed after galvanizing, overtapping and lubricating.

Rotational-capacity tests are required and shall be performed on all plain or galvanized (after galvanizing) bolt, nut and washer assemblies by the manufacturer or distributor prior to shipping and by the Contractor at the Site.

The thickness of galvanizing on bolts, nuts and washers shall be measured. On bolts, it shall be measured on the wrench flats or on top of the bolt head, and on nuts it shall be measured on the wrench flats.

- (f) Certified Test Reports and Materials Certificates:** The Contractor shall submit notarized copies of Certified Test Reports and Materials Certificates in accordance with Article 1.06.07 for fastener assemblies. In addition the Certified Test Reports and Materials Certificates shall include the following:
1. Mill test reports shall indicate the place where the material was melted and manufactured.
 2. Test reports for proof load tests, wedge tests, and rotational-capacity tests shall indicate where the tests were performed, date of tests, location of where the components were manufactured and lot numbers.
 3. The test report for galvanized components shall indicate the thickness of the galvanizing.
- (g) Material Samples:** Prior to incorporation into the work, the Contractor shall submit samples of the bolt assemblies to the Engineer for testing in accordance with the latest edition of the "[Materials Testing Manual](#) (Chapter 8, Minimum Schedule for Acceptance Testing)." Samples shall be submitted for each diameter, length, material designation, grade, coating and manufacturer of bolt assembly."

M.06.03—Galvanizing:

Replace the entire subarticle with the following:

- " **M.06.03—Galvanizing:** Unless otherwise specified on the plans or in the special provisions, the zinc coating on all iron and steel materials, other than wire, shall meet the requirements of ASTM A123, A153 or F2329, whichever shall apply.
When mechanical galvanizing is used it shall meet the requirements of ASTM B695 Class 55."

ON-THE-JOB TRAINING (OJT) WORKFORCE DEVELOPMENT PILOT

Description

To provide construction industry related job opportunities to minorities, women and economically disadvantaged individuals; and to increase the likelihood of a diverse and inclusive workforce on Connecticut Department of Transportation (ConnDOT) projects.

All contractors (existing and newcomers) will be automatically placed in the Workforce Development Pilot. Standard OJT requirements typically associated with individual projects will no longer be applied at the project level for new projects. Instead, these requirements will be applicable on an annual basis for each contractor performing work on ConnDOT projects.

The OJT Workforce Development Pilot will allow a contractor to train employees on Federal, State and privately funded projects located in Connecticut. However, contractors should give priority to training employees on ConnDOT Federal Aid funded projects.

Funding

The Department will establish an OJT fund annually from which contractors may bill the Department directly for eligible trainee hours. The funds for payment of trainee hours on federal aid projects will be allocated from the ½ of 1% provided for OJT funding, and will be based on hours trained, not to exceed a maximum of \$25,000.00 per year; per contractor.

Minorities and Women

Developing, training and upgrading of minorities, women and economically disadvantaged individuals toward journeyman level status is the primary objective of this special training provision. Accordingly, the Contractor shall make every effort to enroll minority, women and economically disadvantaged individuals as trainees to the extent that such persons are available within a reasonable area of recruitment. This training commitment is not intended, and shall not be used, to discriminate against any applicant for training whether a member of a minority group or not.

Assigning Training Goals

The Department, through the OJT Program Coordinator, will assign training goals for a calendar year based on the contractor's past two year's activities and the contractor's anticipated upcoming year's activity with the Department. At the beginning of each year, all contractors eligible will be contacted by the Department to determine the number of trainees that will be assigned for the upcoming calendar year. At that time, the Contractor shall enter into an agreement with the Department to provide a self-imposed on-the-job training program for the calendar year. This agreement will include a specific number of annual training goals agreed to by both parties. The number of training assignments may range from one (1) to six (6) per

contractor per calendar year. Each January, a summary of the trainees required and the OJT Workforce Development Pilot package will be sent to participating contractors. The number of trainees assigned to each contractor in the summary will increase proportionately not to exceed 6, as shown in the following table. This package will also be provided to contractors as they become newly eligible for the OJT Workforce Development Pilot throughout the remainder of the year. Projects awarded after September 30 will be included in the following year's Program.

The dollar thresholds for training assignments are as follows:

\$4.5 – 8 million=	1 trainee
\$ 9 – 15 million=	2 trainees
\$16 – 23 million=	3 trainees
\$24 – 30 million=	4 trainees
\$31 – 40 million=	5 trainees
\$41 – and above=	6 trainees

Training Classifications

Preference shall be given to providing training in the following skilled work classifications. However, the classifications established are not all-inclusive:

Equipment Operators	Electricians
Laborers	Painters
Carpenters	Iron / Reinforcing Steel Workers
Concrete Finishers	Mechanics
Pipe Layers	Welders

The Department has on file common training classifications and their respective training requirements; that may be used by the contractors. Contractors shall submit new classifications for specific job functions that their employees are performing. The Department will review and recommend for acceptance the new classifications proposed by contractors, if applicable. New classifications shall meet the following requirements:

Proposed training classifications are reasonable and realistic based on the job skill classification needs, and the number of training hours specified in the training classification is consistent with common practices and provides enough time for the trainee to obtain journeyman level status.

Where feasible, 25% percent of apprentices or trainees in each occupation shall be in their first year of apprenticeship or training. The number of trainees shall be distributed among the work classifications on the basis of the contractor's needs and the availability of journeymen in the various classifications within a reasonable area of recruitment.

No employee shall be employed as a trainee in any classification in which they have successfully completed a training course leading to journeyman level status or in which they have been employed as a journeyman.

Records and Reports

The Contractor shall maintain enrollment in the program and submit all required reports documenting company compliance under these contract requirements. These documents and any other information shall be submitted to the OJT Program Coordinator as requested.

Upon the trainee's completion and graduation from the program, the Contractor shall provide each trainee with a certification Certificate showing the type and length of training satisfactorily completed.

Trainee Interviews

In order to determine the continued effectiveness of the OJT Program in Connecticut, the department will periodically conduct personal interviews with current trainees and may survey recent graduates of the program. This enables the OJT Program Coordinator to modify and improve the program as necessary. Trainee interviews are generally conducted at the job site to ensure that the trainees' work and training is consistent with the approved training program.

Trainee Wages

Contractors shall compensate trainees on a graduating pay scale based upon a percentage of the prevailing minimum journeyman wages (Davis-Bacon Act). Minimum pay shall be as follows:

60 percent	of the journeyman wage for the first half of the training period
75 percent	of the journeyman wage for the third quarter of the training period
90 percent	of the journeyman wage for the last quarter of the training period

In no case, will the trainee be paid less than the prevailing rate for general laborer as shown in the contract wage decision (must be approved by the Department of Labor).

Achieving or Failing to Meet Training Goals

The Contractor will be credited for each trainee currently enrolled or who becomes enrolled in the approved training program and providing they receive the required training under the specific training program. Trainees will be allowed to be transferred between projects if required by the Contractor's schedule and workload. The OJT Program Coordinator must be notified of transfers within five (5) days of the transfer or reassignments by email (Phylisha.Coles@ct.gov).

Where a contractor does not or cannot achieve its annual training goal with female or minority trainees, they must produce adequate Good Faith Efforts documentation. Good Faith Efforts are those designed to achieve equal opportunity through positive, aggressive, and continuous result-oriented measures. 23 CFR § 230.409(g) (4). Contractors should request minorities and females from unions when minorities and females are underrepresented in the contractor's workforce.

Whenever a contractor requests ConnDOT approval of someone other than a minority or female, the contractor must submit documented evidence of its Good Faith Efforts to fill that position with a minority or female. When a non-minority male is accepted, a contractor must continue to attempt to meet its remaining annual training goals with females and minorities.

Where a contractor has neither attained its goal nor submitted adequate Good Faith Efforts documentation, ConnDOT will issue a letter of non-compliance. Within thirty (30) days of receiving the letter of non-compliance, the contractor must submit a written Corrective Action Plan (CAP) outlining the steps that it will take to remedy the non-compliance. The CAP must be approved by ConnDOT. Failure to comply with the CAP may result in your firm being found non-responsive for future projects.

Measurement and Payment

Optional reimbursement will be made to the contractor for providing the required training under this special provision on ConnDOT Federal6Aid funded projects only.

Contractor will be reimbursed at \$0.80 for each hour of training given to an employee in accordance with an approved training or apprenticeship program. This reimbursement will be made even though the Contractor receives additional training program funds from other sources, provided such other source does not specifically prohibit the contractor from receiving other reimbursement.

Reimbursement for training is made annually or upon the trainees completion and not on a monthly basis. No payment shall be made to the Contractor if either the failure to provide the required training, or the failure to hire the trainee as a journeyman, is caused by the Contractor.

Program reimbursements will be made directly to the prime contractor on an annual basis. To request reimbursement, prime contractors must complete the Voucher for OJT Workforce Development Pilot Hourly Reimbursement for each trainee in the OJT Program. This form is included in the OJT Workforce Development Pilot package and is available on the Department's web site at:

www.ct.gov/dot

The completed form must be submitted to the Office of Contract Compliance for approval. The form is due on the 15th day of January for each trainee currently enrolled and for hours worked on ConnDOT Federal6Aid funded projects only.

D.B.E. SUBCONTRACTORS AND MATERIAL SUPPLIERS OR MANUFACTURERS

January 2013

I. ABBREVIATIONS AND DEFINITIONS AS USED IN THIS SPECIAL PROVISION

A. *CTDOT* means the Connecticut Department of Transportation.

B. *USDOT* means the U.S. Department of Transportation, including the Office of the Secretary, the Federal Highway Administration (“FHWA”), the Federal Transit Administration (“FTA”), and the Federal Aviation Administration (“FAA”).

C. *Broker* means a party acting as an agent for others in negotiating Contracts, Agreements, purchases, sales, etc., in return for a fee or commission.

D. *Contract, Agreement or Subcontract* means a legally binding relationship obligating a seller to furnish supplies or services (including but not limited to, construction and professional services) and the buyer to pay for them. For the purposes of this provision, a lease for equipment or products is also considered to be a Contract.

E. *Contractor* means a consultant, second party or any other entity under Contract to do business with CTDOT or, as the context may require, with another Contractor.

F. *Disadvantaged Business Enterprise (“DBE”)* means a for profit small business concern:

1. That is at least 51 percent owned by one or more individuals who are both socially and economically disadvantaged or, in the case of a corporation, in which 51 percent of the stock is owned by one or more such individuals; and
2. Whose management and daily business operations are controlled by one or more of the socially and economically disadvantaged individuals who own it; and
3. Certified by CTDOT under Title 49 of the Code of Federal Regulations, Part 26, (Title 49 CFR Part 23 of the Code of Federal Regulations for Participation of Disadvantaged Business Enterprise in Airport Concessions)

G. *USDOT-assisted Contract* means any Contract between CTDOT and a Contractor (at any tier) funded in whole or in part with USDOT financial assistance.

H. *Good Faith Efforts (“GFE”)* means all necessary and reasonable steps to achieve a DBE goal or other requirement which by their scope, intensity, and appropriateness to the objective, can reasonably be expected to fulfill the program requirement.

I. *Small Business Concern* means, with respect to firms seeking to participate as DBEs in USDOT-assisted Contracts, a small business concern as defined pursuant to Section 3 of the Small Business Act and Small Business Administration (“SBA”) regulations implementing it (13 CFR Part 121) that also does not exceed the cap on average annual gross receipts in 49 CFR Part 26, Section 26.65(b).

J. *Socially and Economically Disadvantaged Individual* means any individual who is a citizen (or lawfully admitted permanent resident) of the United States and who is:

1. Any individual who CTDOT finds, on a case-by-case basis, to be a socially and economically disadvantaged individual.
2. Any individuals in the following groups, members of which are rebuttably presumed to be socially and economically disadvantaged:
 - “Black Americans”, which includes persons having origins in any of the Black racial groups of Africa;
 - “Hispanic Americans”, which includes persons of Mexican, Puerto Rican, Cuban, Dominican, Central or South American, or other Spanish or Portuguese culture or origin, regardless of race;
 - “Native Americans”, which includes persons who are American Indians, Eskimos, Aleuts, or Native Hawaiians.
 - “Asian-Pacific Americans”, which includes persons whose origins are from Japan, China, Taiwan, Korea, Burma (Myanmar), Vietnam, Laos, Cambodia (Kampuchea), Thailand, Malaysia, Indonesia, the Philippines, Brunei, Samoa, Guam, the U.S. Trust Territories of the Pacific Islands (Republic of Palau), the Commonwealth of the Northern Marianas Islands, Macao, Fiji, Tonga, Kiribati, Juvalu, Nauru, or Federated States of Micronesia;
 - “Subcontinent Asian Americans”, which includes persons whose origins are from India, Pakistan, Bangladesh, Bhutan, the Maldives Islands, Nepal or Sri Lanka;
 - Women;
 - Any additional groups whose members are designated as socially and economically disadvantaged by the SBA, at such time as the SBA designation becomes effective.

K. *Commercially Useful Function (“CUF”)* means the DBE is responsible for the execution of the work of the contract and is carrying out its responsibilities by actually performing, managing, and supervising the work involved with its own forces and equipment. The DBE must be responsible for procuring, determining quantity, negotiating price, determining quality and paying for all materials (where applicable) associated with their work. The DBE must also perform at least 30% of the total cost of its contract with its own workforce.

II. ADMINISTRATIVE REQUIREMENTS

A. General Requirements

A DBE goal percentage equaling **12.0** percent (%) of the Contract value has been established for this Contract. This DBE goal percentage will be applied to the final Contract value to ultimately determine the required DBE goal. If additional work is required, DBE firms should be provided the appropriate opportunities to achieve the required DBE goal.

In order to receive credit toward the Contract DBE goal, the firms utilized as DBE subcontractors or suppliers must be certified as DBEs in the type of work to be counted for credit by CTDOT’s Office of Contract Compliance prior to the date of the execution of the subcontract. Neither CTDOT nor the State of Connecticut’s Unified Certification Program (UCP) makes any representation as to any DBE’s technical or financial ability to perform the work. Prime contractors are solely responsible for performing due diligence in hiring DBE subcontractors.

All DBEs shall perform a CUF for the work that is assigned to them. The Contractor shall monitor and ensure that the DBE is in compliance with this requirement. The Connecticut DBE UPC Directory of certified firms can

be found on the CTDOT website <http://www.ct.gov/dot>. The directory lists certified DBE firms with a description of services that they are certified to perform. Only work identified in this listing may be counted towards the project's DBE goal. A DBE firm may request to have services added at any time by contacting CTDOT's Office of Contract Compliance. No credit shall be counted for any DBE firm found not to be performing a CUF.

Once a Contract is awarded, all DBEs that were listed on the pre-award DBE commitment document must be utilized. The Contractor is obligated to provide the value and items of the work originally established in the pre-award documentation to the DBE firms listed in the pre-award documentation. Any modifications to the pre-award commitment must follow the procedure established in Section II-C.

The Contractor shall designate a liaison officer who will administer the Contractor's DBE program. Upon execution of this Contract, the name of the liaison officer shall be furnished in writing to CTDOT's unit administering the Contract, CTDOT's Office of Contract Compliance and CTDOT's Office of Construction ("OOC"). Contact information for the designated liaison officer shall be furnished no later than the scheduled date for the pre-construction meeting.

The Contractor shall submit a bi-monthly report to the appropriate CTDOT unit administering the Contract. This report shall indicate what work has been performed to date, with the dollars paid and percentage of DBE goal completed.

Verified payments made to DBEs shall be included in this bi-monthly report. A sample form is included on the CTDOT website.

In addition, the report shall include:

1. A projected time frame of when the remaining work is to be completed for each DBE.
2. A statement by the Contractor either confirming that the approved DBEs are on schedule to meet the Contract goal, or that the Contractor is actively pursuing a GFE.
3. If retainage is specified in the Contract specifications, then a statement of certification that the subcontractors' retainage is being released in accordance with 1.08.01 (Revised or supplemented).

Failure by the Contractor to provide the required reports may result in CTDOT withholding an amount equal to one percent (1%) of the monthly estimate until the required documentation is received.

The Contractor shall receive DBE credit when a DBE, or any combination of DBEs, perform work under the Contract in accordance with this specification.

Only work actually performed by and/or services provided by DBEs which are certified for such work and/or services, as verified by CTDOT, can be counted toward the DBE goal. Supplies and equipment a DBE purchases or leases from the Contractor or its affiliate cannot be counted toward the goal.

Monitoring of the CUF will occur by CTDOT throughout the life of the project. If it is unclear that the DBE is performing the work specified in its subcontract with the prime Contractor, further review may be required. If it is determined that the DBE is not performing a CUF, then the work performed by that DBE will not be counted towards the DBE goal percentage.

B. Subcontract Requirements

The Contractor shall submit to CTDOT's OOC all requests for subcontractor approvals on the standard CLA-12 forms provided by CTDOT. The dollar amount and items of work identified on the CLA-12 form must, at minimum, equal the dollar value submitted in the pre-award commitment. CLA-12 forms can be found at <http://www.ct.gov/dot/construction> under the "Subcontractor Approval" section. All DBE subcontractors must be identified on the CLA-12 form, regardless of whether they are being utilized to meet a Contract goal percentage. A copy of the legal Contract between the Contractor and the DBE subcontractor/supplier, a copy of the Title VI Contractor Assurances and a copy of the Required Contract Provision for Federal Aid Construction Contracts (Form FHWA-1273) (Federal Highway Administration projects only) must be submitted along with a request for subcontractor approval. These attachments cannot be substituted by reference.

If retainage is specified in the Contract specifications, then the subcontract agreement must contain a prompt payment mechanism that acts in accordance with Article 1.08.01 (Revised or supplemented).

If the Contract specifications do not contain a retainage clause, the Contractor shall not include a retainage clause in any subcontract agreement, and in this case, if a Contractor does include a retainage clause, it shall be deemed unenforceable.

In addition, the following documents are to be included with the CLA-12, if applicable:

- An explanation indicating who will purchase material.
- A statement explaining any method or arrangement for utilization of the Contractor's equipment.

The subcontract must show items of work to be performed, unit prices and, if a partial item, the work involved by all parties. If the subcontract items of work or unit prices are modified, the procedure established in Section II-C must be followed.

Should a DBE subcontractor further sublet items of work assigned to it, only lower tier subcontractors who are certified as a DBE firm will be counted toward the DBE goal. If the lower tier subcontractor is a non-DBE firm, the value of the work performed by that firm will not be counted as credit toward the DBE goal.

The use of joint checks between a DBE firm and the Contractor is acceptable, provided that written approval is received from the OOC prior to the issuance of any joint check. Should it become necessary to issue a joint check between the DBE firm and the Contractor to purchase materials, the DBE firm must be responsible for negotiating the cost, determining the quality and quantity, ordering the material and installing (where applicable), and administering the payment to the supplier. The Contractor should not make payment directly to suppliers.

Each subcontract the Contractor signs with a subcontractor must contain the following assurance:

"The subcontractor/supplier/manufacture shall not discriminate on the basis of race, color, national origin, or sex in the performance of this contract. The contractor shall carry out applicable requirements of 49 CFR Part 26 in the award and administration of DOT-assisted contracts. Failure by the contractor/subcontractor/supplier/manufacture to carry out these requirements is a material breach of this contract, which may result in the termination of this contract or such other remedy as the recipient deems appropriate."

C. Modification to Pre-Award Commitment

Contractors may not terminate for convenience any DBE subcontractor or supplier that was listed on the pre-award DBE commitment without prior written approval of the OOC. This includes, but is not limited to, instances

in which a Contractor seeks to perform work originally designated for a DBE subcontractor with its own forces or those of an affiliate, a non-DBE firm, or with another DBE firm. Prior to approval, the Contractor must demonstrate to the satisfaction of the OOC, that it has good cause, as found in 49CFR Part 26.53 (f)(3), for termination of the DBE firm.

Before transmitting its request for approval to terminate pre-award DBE firms to the OOC, the Contractor must give written notice to the DBE subcontractor and include a copy to the OOC of its notice to terminate and/or substitute, and the reason for the notice.

The Contractor must provide five (5) days for the affected DBE firm to respond. This affords the DBE firm the opportunity to advise the OOC and the Contractor of any reasons why it objects to the termination of its subcontract and why the OOC should not approve the Contractor's action.

Once the Contract is awarded, should there be any amendments or modifications of the approved pre-award DBE submission other than termination of a DBE firm, the Contractor shall follow the procedure below that best meets the criteria associated with the reason for modification:

1. If the change is due to a scope of work revision or non-routine quantity revision by CTDOT, the Contractor must notify CTDOT's OOC in writing or via electronic mail that their DBE participation on the project may be impacted as soon as they are aware of the change. In this case, a release of work from the DBE firm may not be required; however the Contractor must concurrently notify the DBE firm in writing, and copy the OOC for inclusion in the project DBE file. This does not relieve the Contractor of its obligation to meet the Contract specified DBE goal, or of any other responsibility found in this specification.
2. If the change is due to a factor other than a CTDOT directive, a request for approval in writing or via electronic mail of the modification from the OOC must be submitted, along with an explanation of the change(s), prior to the commencement of work. The Contractor must also obtain a letter of release from the originally named DBE indicating their concurrence with the change, and the reason(s) for their inability to perform the work. In the event a release cannot be obtained, the Contractor must document all efforts made to obtain it.
3. In the event a DBE firm that was listed in the pre-award documents is **unable** or **unwilling** to perform the work assigned, the Contractor shall:
 - Notify the OOC Division Chief immediately and make efforts to obtain a release of work from the firm.
 - Submit documentation that will provide a basis for the change to the OOC for review and approval prior to the implementation of the change.
 - Use the DBE Directory to identify and contact firms certified to perform the type of work that was assigned to the unable or unwilling DBE firm. The Contractor should also contact CTDOT's Office of Contract Compliance for assistance in locating additional DBE firms to the extent needed to meet the contract goal.

Should a DBE subcontractor be terminated or fail to complete work on the Contract for any reason, the Contractor must make a GFE to find another DBE subcontractor to substitute for the original DBE. The DBE replacement shall be given every opportunity to perform at least the same amount of work under the Contract as the original DBE subcontractor.

If the Contractor is unable to find a DBE replacement:

- The Contractor should identify other contracting opportunities and solicit DBE firms in an effort to meet the Contract DBE goal requirement, if necessary, and provide documentation to support a GFE. (Refer to GFE in Section III.)
- The Contractor must demonstrate that the originally named DBE, who is unable or unwilling to perform the work assigned, is in default of its subcontract, or identify other issues that affected the DBE firm's ability to perform the assigned work. **The Contractor's ability to negotiate a more advantageous agreement with another subcontractor is not a valid basis for change.**

III. GOOD FAITH EFFORTS

The DBE goal is **NOT** reduced or waived for projects where the Contractor receives a Pre-Award GFE determination from the Office of Contract Compliance prior to the award of the Contract. It remains the responsibility of the Contractor to make a continuing GFE to achieve the specified Contract DBE goal. The Contractor shall pursue every available opportunity to obtain additional DBE firms and document all efforts made in such attempts.

At the completion of all Contract work, the Contractor shall submit a final report to CTDOT's unit administering the Contract indicating the work done by and the dollars paid to DBEs. Only verified payments made to DBEs performing a CUF will be counted towards the Contract goal.

Goal attainment is based on the total Contract value, which includes all construction orders created during the Contract. If the Contractor does not achieve the specified Contract goal for DBE participation or has not provided the value of work to the DBE firms originally committed to in the pre-award submission, the Contractor shall submit documentation to CTDOT's unit administering the Contract detailing the GFE made during the performance of the Contract to satisfy the goal.

A GFE should consist of the following, where applicable (CTDOT reserves the right to request additional information):

1. A detailed statement of the efforts made to replace an unable or unwilling DBE firm, and a description of any additional subcontracting opportunities that were identified and offered to DBE firms in order to increase the likelihood of achieving the stated goal.
2. A detailed statement, including documentation of the efforts made to contact and solicit bids from certified DBEs, including the names, addresses, and telephone numbers of each DBE firm contacted; the date of contact and a description of the information provided to each DBE regarding the scope of services and anticipated time schedule of work items proposed to be subcontracted and the response from firms contacted.
3. Provide a detailed explanation for each DBE that submitted a subcontract proposal which the Contractor considered to be unacceptable stating the reason(s) for this conclusion.
4. Provide documentation, if any, to support contacts made with CTDOT requesting assistance in satisfying the specified Contract goal.

5. Provide documentation of all other efforts undertaken by the Contractor to meet the defined goal. Additional documentation of efforts made to obtain DBE firms may include but will not be limited to:
 - Negotiations held in good faith with interested DBE firms, not rejecting them without sound reasons.
 - Written notice provided to a reasonable number of specific DBE firms in sufficient time to allow effective participation.
 - Those portions of work that could be performed by readily available DBE firms.

In instances where the Contractor can adequately document or substantiate its GFE and compliance with other DBE Program requirements, the Contractor will have satisfied the DBE requirement and no administrative remedies will be imposed.

IV. PROJECT COMPLETION

At the completion of all Contract work, the Contractor shall:

1. Submit a final report to CTDOT's unit administering the Contract indicating the work done by, and the dollars paid to DBEs.
2. Submit verified payments made to all DBE subcontractors for the work that was completed.
3. Submit documentation detailing any changes to the DBE pre-award subcontractors that have not met the original DBE pre-award commitment, including copies of the Department's approvals of those changes.
4. Retain all records for a period of three (3) years following acceptance by CTDOT of the Contract and those records shall be available at reasonable times and places for inspection by authorized representatives of CTDOT and Federal agencies. If any litigation, claim, or audit is started before the expiration of the three (3) year period, the records shall be retained until all litigation, claims, or audit findings involving the records are resolved.

If the Contractor does not achieve the specified Contract goal for DBE participation in addition to meeting the dollar value committed to the DBE subcontractors identified in the pre-award commitment, the Contractor shall submit documentation to CTDOT's unit administering the Contract detailing the GFE made during the performance of the Contract to satisfy the goal.

V. SHORTFALLS

A. Failure to meet DBE goals

As specified in (II-A) above, attainment of the Contract DBE goal is based on the final Contract value. The Contractor is expected to achieve the amount of DBE participation originally committed to at the time of award; however, additional efforts must be made to provide opportunities to DBE firms in the event a Contract's original value is increased during the life of the Contract.

The Contractor is expected to utilize the DBE subcontractors originally committed in the DBE pre-award documentation for the work and dollar value that was originally assigned.

If a DBE is terminated or is unable or unwilling to complete its work on a Contract, the Contractor shall make a GFE to replace that DBE with another certified DBE to meet the Contract goal.

The Contractor shall immediately notify the OOC of the DBE's inability or unwillingness to perform, and provide reasonable documentation and make efforts to obtain a release of work from the firm.

If the Contractor is unable to find a DBE replacement, then the Contractor should identify other contracting opportunities and solicit DBE firms in an effort to meet the Contract DBE goal requirement, if necessary, and provide documentation to support a GFE.

When a DBE is unable or unwilling to perform, or is terminated for just cause, the Contractor shall make a GFE to find other DBE opportunities to increase DBE participation to the extent necessary to at least satisfy the Contract goal.

For any DBE pre-award subcontractor that has been released appropriately from the project, no remedy will be assessed, provided that the Contractor has met the criteria described in Section II-C.

B. Administrative Remedies for Non-Compliance:

In cases where the Contractor has failed to meet the Contract specified DBE goal or the DBE pre-award commitment, and where no GFE has been demonstrated, then one or more of the following administrative remedies will be applied:

1. A reduction in Contract payments to the Contractor as determined by CTDOT, not to exceed the shortfall amount of the **DBE goal**. The maximum shortfall will be calculated by multiplying the Contract DBE goal (adjusted by any applicable GFE) by the final Contract value, and subtracting any verified final payments made to DBE firms by the Contractor.
2. A reduction in Contract payments to the Contractor determined by CTDOT, not to exceed the shortfall amount of the **pre-award commitment**. The maximum shortfall will be calculated by subtracting any verified final payments made by the Contractor to each DBE subcontractor from the amount originally committed to that subcontractor in the pre-award commitment.
3. A reduction in Contract payments to the Contractor determined by CTDOT for any pre-award DBE subcontractor who has not obtained the dollar value of work identified in the DBE pre-award commitment and has not followed the requirements of Section II-C or for any DBE firm submitted for DBE credit that has not performed a CUF.
4. The Contractor being required to submit a written DBE Program Corrective Action Plan to CTDOT for review and approval, which is aimed at ensuring compliance on future projects.
5. The Contractor being required to attend a Non-Responsibility Meeting on the next contract where it is the apparent low bidder.
6. The Contractor being suspended from bidding on contracts for a period not to exceed six (6) months.

VI. CLASSIFICATIONS OTHER THAN SUBCONTRACTORS

A. Material Manufacturers

Credit for DBE manufacturers is 100% of the value of the manufactured product. A manufacturer is a firm that operates or maintains a factory or establishment that produces on the premises the materials or supplies obtained by the Contractor.

If the Contractor elects to utilize a DBE manufacturer to satisfy a portion of, or the entire specified DBE goal, the Contractor must provide the OOC with:

- Subcontractor Approval Form (CLA-12) indicating the firm designation,
- An executed "Affidavit for the Utilization of Material Suppliers or Manufacturers" (sample attached), and
- Substantiation of payments made to the supplier or manufacturer for materials used on the project.

B. Material Suppliers (Dealers)

Credit for DBE dealers/suppliers is limited to 60% of the value of the material to be supplied, provided such material is obtained from an approved DBE dealer/supplier.

In order for a firm to be considered a regular dealer, the firm must own, operate, or maintain a store, warehouse, or other establishment in which the materials, supplies, articles or equipment of the general character described by the specifications and required under the contract are bought, kept in stock, and regularly sold or leased to the public in the usual course of business. At least one of the following criteria must apply:

- To be a regular dealer, the firm must be an established, regular business that engages, as its principal business and under its own name, in the purchase and sale or lease of the products in question.
- A person may be a regular dealer in such bulk items as petroleum products, steel, cement, gravel, stone, or asphalt without owning, operating or maintaining a place of business if the person both owns and operates distribution equipment for the products. Any supplementing of the regular dealers' own distribution equipment shall be by long term lease agreement, and not on an ad hoc or contract to contract basis.
- Packers, brokers, manufacturers' representatives, or other persons who arrange or expedite transactions are not regular dealers within the meaning of this paragraph.

If the Contractor elects to utilize a DBE supplier to satisfy a portion or the entire specified DBE goal, the Contractor must provide the OOC with:

- Subcontractor Approval Form (CLA-12) indicating the firm designation,
- An executed "Affidavit for the Utilization of Material Suppliers or Manufacturers" (sample attached), and
- Substantiation of payments made to the supplier or manufacturer for materials used on the project.

C. Brokering

- Brokering of work for DBE firms who have been listed by the Department as certified brokers is allowed. Credit for those firms shall be applied following the procedures in Section VI-D.
- Brokering of work by DBEs who have been approved to perform subcontract work with their own workforce and equipment is not allowed, and is a Contract violation.

- Firms involved in the brokering of work, whether they are DBEs and/or majority firms who engage in willful falsification, distortion or misrepresentation with respect to any facts related to the project shall be referred to the U.S. DOT, Office of the Inspector General for prosecution under Title 18, U.S. Code, Part I, Chapter 47, Section 1020.

D. Non-Manufacturing or Non-Supplier DBE Credit

Contractors may count towards their DBE goals the following expenditures with DBEs that are not manufacturers or suppliers:

- Reasonable fees or commissions charged for providing a bona fide service such as professional, technical, consultant or managerial services and assistance in the procurement of essential personnel, facilities, equipment materials or supplies necessary for the performance of the Contract, provided that the fee or commission is determined by the OOC to be reasonable and consistent with fees customarily allowed for similar services.
- The fees charged only for delivery of materials and supplies required on a job site when the hauler, trucker, or delivery service is a DBE, and not the manufacturer, or regular dealer of the materials and supplies, and provided that the fees are determined by the OOC to be reasonable and not excessive as compared with fees customarily allowed for similar services.
- The fees or commissions charged for providing bonds or insurance specifically required for the performance of the Contract, provided that the fees or commissions are determined by CTDOT to be reasonable and not excessive as compared with fees customarily allowed for similar services.

E. Trucking

While technically still considered a subcontractor, the rules for counting credit for DBE trucking firms are as follows:

- The DBE must own and operate at least one fully licensed, insured, and operational truck used on the Contract.
- The DBE receives credit for the total value of the transportation services it provides on the Contract using trucks it owns, insures and operates using drivers it employs.
- The DBE may lease trucks from another DBE firm, including an owner-operator who is certified as a DBE. The DBE who leases trucks from another DBE receives credit for the total value of the transportation services the lessee DBE provides on the Contract.
- The DBE may lease trucks from a non-DBE firm; however the DBE may only receive credit for any fees or commissions received for arranging transportation services provided by the non-DBE firms. Additionally, the DBE firm must demonstrate that they are in full control of the trucking operation for which they are seeking credit.

VII. Suspected DBE Fraud

In appropriate cases, CTDOT will bring to the attention of the USDOT any appearance of false, fraudulent, or dishonest conduct in connection with the DBE program, so that USDOT can take the steps, e.g. referral to the

Department of Justice for criminal prosecution, referral to USDOT Inspector General, action under suspension and debarment or Program Fraud and Civil Penalties rules provided in 49 CFR Part 31.

**CONNECTICUT DEPARTMENT OF TRANSPORTATION
(OFFICE OF CONSTRUCTION)
BUREAU OF ENGINEERING AND CONSTRUCTION**

This affidavit must be completed by the State Contractor's DBE notarized and attached to the contractor's request to utilize a DBE supplier or manufacturer as a credit towards its DBE contract requirements; failure to do so will result in not receiving credit towards the contract DBE requirement.

State Contract No.

Federal Aid Project No.

Description of Project

I, _____, acting in behalf of _____,
(Name of person signing Affidavit) (DBE person, firm, association or corporation)

of which I am the _____ certify and affirm that _____
(Title of Person) (DBE person, firm, association or corporation)

is a certified Connecticut Department of Transportation DBE. I further certify and affirm that I have read and understand 49 CFR, Sec. 26.55(e)(2), as the same may be revised.

I further certify and affirm that _____ will assume the actual and
(DBE person, firm, association or Corporation)

for the provision of the materials and/or supplies sought by _____.

If a manufacturer, I operate or maintain a factory or establishment that produces, on the premises, the materials, supplies, articles or equipment required under the contract an of the general character described by the specifications.

If a supplier, I perform a commercially useful function in the supply process. As a regular dealer, I, at a minimum, own and operate the distribution equipment for bulk items. Any supplementing of my distribution equipment shall be by long-term lease agreement, and not on an ad hoc or contract-by-contract basis.

I understand that false statements made herein are punishable by Law (Sec. 53a-157), CGS, as revised).

(Name of Corporation or Firm)

(Signature & Title of Official making the Affidavit)

Subscribed and sworn to before me, this _____ day of _____ 20 _____.

Notary Public (Commissioner of the Superior Court)

My Commission Expires _____

CERTIFICATE OF CORPORATION

I, _____, certify that I am the _____
(Official) (President)

of the Corporation named in the foregoing instrument; that I have been duly authorized to affix the seal of the Corporation to such papers as require the seal; that _____, who signed said instrument on behalf of the Corporation, was then _____ of said corporation; that said instrument was duly signed for and in behalf of said Corporation by authority of its governing body and is within the scope of its corporation powers.

(Signature of Person Certifying)

(Date)

ITEM #0020806A – DISPOSAL OF ASBESTOS CONTAMINATED SOIL

Description:

Work under this item shall consist of the loading, transportation and final off-site disposal/recycling/treatment of asbestos contaminated soil (ACS) and ACS-impacted materials. ACS-impacted materials include project materials such as concrete that have been exposed to ACS and by their nature cannot be decontaminated, as determined by the Engineer.

Work under this item shall also include proper packaging of ACS in roll-off containers; sealing containers, both when full and when staged pending addition of material; maintaining container integrity.

Where ACS is excavated, such material will not be reusable as backfill except as allowed below and will require special handling, storage, disposal and documentation procedures. Any material processing (including, but not limited to the removal of large stones, concrete pieces, or similar materials) required by the Contractor's selected facility will be completed by the Contractor prior to the material leaving the site. It is solely the Contractor's responsibility to meet any such acceptance requirements of its facility.

Excavations performed in the ACS Areas of Environmental Concern (AOEC) will be backfilled with clean materials supplied meeting Contract requirements.

Pre-characterization sampling of the ACS AOEC has been conducted to facilitate material disposal. Additional sampling may be required to facilitate disposal. As required, the Engineer will sample ACS at a frequency and for the constituents to meet the acceptance criteria of the treatment/recycling/disposal facility(s) selected by the Contractor.

The Contractor shall use one or more of the following Department-approved treatment/recycle/disposal facilities for the disposal of non-hazardous ACS:

<p>Advanced Disposal Services* Greentree Landfill Attn: Tony LaBenne 635 Toby Road Kersey, PA 15846 Phone: (814) 265-1744 Fax: (814) 265-8745</p>	<p>Allied Waste Niagara Falls Landfill, LLC Attn: David Hanson 5600 Niagara Falls Blvd. Niagara Falls, NY 14304 Phone: (716) 285-3344 Fax: (716) 285-3398</p>
---	---

<p>Cumberland County Landfill Attn: Kevin Bush 135 Vaughn Road Shippensburg, PA 17257 Phone: (717) 423-9953 Fax: (732) 423-5917</p>	<p>Heritage Hazardous Waste Landfill Attn: Steve Cross 4370 West County Road 1275N Roachdale, IN 46172 Phone: (315) 406-9342 Fax: (732) 687-3898</p>
<p>Ontario County Landfill Attn: Scott Sampson 3555 Post Farm Road Stanley, NY 14561 Phone: (603) 235-3597 Fax: (585) 526-5459</p>	<p>Republic Services Conestoga* Attn: James Kuhn 420 Quarry Road Morgantown, PA 19543 Phone: (717) 246-4640 Fax: (610) 286-7048</p>
<p>Waste Management of New Hampshire Attn: Ellen Bellio 90 Rochester Neck Road PO Box 7065 Rochester, NH 03839 Phone: (603) 330-2170 Fax: (603) 330-2130</p>	

* Please note that if this facility is to be used, additional time may be required to allow for Pennsylvania Department of Environmental Protection (PADEP) review, including an additional 10 days (or more) above the 15 day lab period designated below, should any additional sampling need to be required.

The above list contains treatment/recycle/disposal facilities which can accept the waste stream generated by the Project in quantities that may be limited by their permits and their operational restrictions. It is the responsibility of the Contractor to verify that a facility will be available and capable of handling the volume as well as the chemical and physical characteristics of the material generated by the Project.

Materials:

All materials shall conform to the requirements of the Contract.

- Polyethylene plastic sheeting for underlayment for drums containing PPE or decontamination liquids and/or roll-offs shall be at least six (6) mils thick and at least nine (9) feet wide.
- ACS shipping containers (e.g., roll-off boxes) shall be double-lined with six (6) mil polyethylene sheeting and sealed to prevent contamination or leakage.
- Spray equipment for misting soils in the roll-offs while loading, as needed.

- No damaged or deteriorated materials shall be used. If material becomes contaminated with ACS, the material shall be decontaminated or disposed of as asbestos-containing waste material.
- Clean backfill, as defined in the regulations, meeting Contract material specifications.

Construction Methods:

A, General

All excavated ACS shall be replaced with clean fill meeting Contract requirements except material in trenches shall only be replaced 1 (one) foot on either side of conduit or cable. ACS removed from excavations within the ACS AOEC shall be placed directly into double lined roll-off(s). At the close of each shift and any time the contractor stops work, the roll-off shall be fully sealed and properly labelled. At no time shall the contractor leave an unsecured roll-off unattended. Work areas shall be managed according to Item No. 0020808A – Dust and Asbestos Fiber Control. The Contractor shall plan excavation activities within the ACS AOEC in consideration of the capacity of the roll-off(s) and and the material testing and disposal requirements. **No claims for delay shall be considered based on the Contractor's failure to coordinate excavation activities as specified herein.**

B. Material Disposal

As indicated above, the ACS has been pre-characterized for disposal, however, should the need arise for additional sampling to take place for any reason, the Engineer will sample the ACS. The Contractor shall designate to the Engineer which facility it intends to use prior to samples being taken. The Contractor is hereby notified that laboratory turnaround time is expected to be fifteen (15) working days. Turnaround time is the period of time beginning when the Contractor notifies the Engineer which facility it intends to use and that the ACS is ready for sampling and ending with the Contractor's receipt of the laboratory analytical results. Any change of intended treatment/recycling/disposal facility may prompt the need to resample and will therefore restart the time required for laboratory turnaround. The laboratory will furnish such results to the Engineer. Upon receipt, the Engineer will make available to the Contractor the results of the final waste characterization determinations. **No delay claim will be considered based upon the Contractor's failure to accommodate the laboratory turnaround time as identified above.**

The Contractor shall obtain and complete all paperwork necessary to arrange for material disposal (such as disposal facility waste profile sheets). It is solely the Contractor's responsibility to coordinate the disposal of the ACS and/or ACS-impacted materials with its selected treatment/recycling/disposal facility(s). Upon receipt of the final approval from the facility, the Contractor shall arrange for the loading, transport and treatment/recycling/disposal of the ACS in accordance with all Federal and State regulations. **No claim will be considered based on the failure of the Contractor's selected disposal facility(s) to meet the**

Contractor's production rate or for the Contractor's failure to select sufficient facilities to meet its production rate.

Note that any material processing (including but not limited to the removal of scrap metal and resizing large stone, concrete, polyethylene sheeting or similar material) required by the Contractor's selected facility will be completed by the Contractor prior to the material leaving the site. It is solely the Contractor's responsibility to meet any such requirements of its facility.

All manifests or bills of lading utilized to accompany the transportation of the ACS shall be prepared by the Contractor and signed by an authorized Department representative, as Generator, for each roll-off that leaves the site. The Contractor shall forward the appropriate original copies of all manifests or bills of lading to the Engineer the same day the material leaves the Project.

A load-specific certificate of treatment/recycling/disposal, signed by the authorized agent representing the disposal facility, shall be obtained by the Contractor and promptly delivered to the Engineer for each load.

C. Material Transportation

Unless otherwise specified, all ACS and/or ACS-impacted materials generated by excavation shall be removed from the premises.

Transported ACS is to be sufficiently wetted and properly sealed prior to leaving the point of generation.

All vehicles departing with ACS and/or ACS-impacted materials from the site are to be properly logged to show the vehicle identification, driver's name, time of departure, destination, and approximate volume, and contents of materials carried.

All ACS and/or ACS-impacted materials must be enclosed in roll-off containers that are double-lined six (6) mil polyethylene sheeting that are fully sealed to prevent contamination from leaking or spilled containers.

OSHA "Danger" signs must be attached to vehicles used to transport ACS and/or ACS-impacted materials. The signs must be posted so that they are plainly visible on all four (4) sides of the vehicle.

The Contractor shall ensure that all waste containers are properly lined, sealed, and labeled with USEPA NESHAP generator labels, OSHA "Danger" labels, and DOT shipping labels. For each shipment of ACS and/or ACS-impacted materials, the Contractor shall complete an EPA-approved asbestos waste shipment record.

The Contractor shall dispose of all ACS and/or ACS-impacted materials at EPA-authorized, ConnDOT-approved facilities and must be in compliance with the requirements of the Special Waste Provisions of the Office of Solid Waste Management, Department of Energy &

Environmental Protection, State of Connecticut, or other designated agency having jurisdiction over solid waste disposal.

D. Equipment Decontamination

All equipment shall be provided to the work site free of gross contamination. The Engineer may prohibit from the site any equipment that in his opinion has not been thoroughly decontaminated prior to arrival. Any decontamination of the Contractor's equipment prior to the start of ACS work shall be at the expense of the Contractor. Decontamination of equipment and supplies that are used to handle ACS and/or ACS-impacted materials shall be conducted in accordance with Item No. 0101124A - Decontamination. Disposal of residual ACS generated as a result of decontamination shall be managed under this Item.

Decontamination shall be conducted at areas designated in the Contractor's approved Decontamination Plan prior to equipment and supplies leaving any Regulated Area.

E. Dust Control

The Contractor shall implement a fugitive dust suppression program in accordance with the Contract and Item No. 0020808 – Dust and Asbestos Fiber Control to prevent the off-site migration of particulate matter and/or dust resulting from excavation, loading and operations associated with ACS. Work zone and perimeter air monitoring will be conducted to ensure allowable fugitive air emissions are maintained during active work. It shall be the Contractor's responsibility to supervise fugitive dust control measures and to monitor airborne particulate matter. The Contractor shall:

1. Employ reasonable fugitive dust suppression techniques.
2. Visually observe the amounts of particulate and/or fugitive dust generated during the handling of all ACS. If the fugitive dust is visible and/or monitoring results for particulate matter is not acceptable to the Engineer, the Contractor shall implement corrective measures including, but not limited to, the following:
 - (a) Apply water to pavement surfaces;
 - (b) Apply water to equipment and excavation faces; and
 - (c) Apply water during excavation, loading and dumping.

Additional direction concerning dust and asbestos fiber control can be found in Item 0020808 – Dust and Asbestos Fiber Control.

Note that all ACS must be maintained adequately wet by misting techniques so as to prevent asbestos fibers from becoming airborne.

F. Backfilling

All excavations conducted within the ACS AOEC shall be backfilled with clean material supplied by the Contractor in accordance with the regulations. This material must not contain asbestos fibers. The Contractor will identify to the Engineer the source of the backfill material. Such material will be sampled by the engineer prior to its use on the project.

G. Project Closeout Documents:

The Contractor shall provide the Engineer, within 30 days of completion of the work, a compliance package; which shall include, but not be limited to, the following:

1. Completed Waste Shipment Records/Bills of Lading (signed by authorized disposal facility representative)
2. Completed Weigh Bills (indicating each load's net weight).

Method of Measurement:

The work of "DISPOSAL OF ASBESTOS CONTAMINATED SOIL" will be measured for payment as the actual net weight in tons of material delivered to the treatment/recycling/disposal facility(s). Such determinations shall be made by measuring each hauling vehicle on the certified permanent scales at the treatment/recycling/disposal facility(s). Total weight will be the summation of weight bills issued by the facility specific to this Project. Excess excavations made by the Contractor beyond the payment limits specified in the Contract will not be measured for payment and the Contractor assumes responsibility for all costs associated with the appropriate handling, management and disposal of this material.

Equipment decontamination, the collection of residuals, and the collection and disposal of liquids generated during equipment decontamination activities will be measured separately for payment under separate Items.

Basis of Payment:

This work will be paid for at the Contract unit price, which shall include all materials tools and labor incidental to loading roll-offs, covering, labelling, securing, and maintaining the individual roll-offs and/or drums containing PPE or decontamination fluids, transportation of ACS and/or ACS-impacted materials to the treatment/recycling/disposal facility(s); the fees paid to the facility(s) for treatment/recycling/disposal; the preparation of all related paperwork; supply and placement of clean backfill, and all equipment, materials, tools, and labor incidental to this work. **This unit price will be applicable to all of the Contractor-selected disposal facilities and will not change for the duration of the Project.**

<u>Pay Item</u>	<u>Pay Unit</u>
Disposal of Asbestos Contaminated Soil	Ton (T)

ITEM #0020808A – DUST AND ASBESTOS FIBER CONTROL

Description:

Under this item, the Contractor shall control dust and asbestos fiber migration and stabilize (prevent wind and water erosion) all exposed asbestos contaminated soil (ACS) within the ACS AOEC (excavated, disturbed, uncovered, etc.). During work hours, the Contractor shall keep ACS adequately wet in order to prevent its migration by wind. Any time the Contractor is not on-site to employ active dust and asbestos fiber control, other methods stabilize the ACS will be required. Note that most of the soils within the Project Limits at Intersections 138-240, 138-241, 138-242, 138-250, and 138-275 are considered ACS. Additional information on the ACS AOEC limits are available in the Notice to Contractor – Asbestos Contaminated Soil and on the Plans.

As a part of this work, the Contractor shall develop and implement a written Fiber Control Plan (FCP) that addresses, in detail, the means and methods for mitigating risk to workers, the public, and the environment through proper stabilization of ACS. As part of the FCP, the Contractor must include an air monitoring plan that outlines a perimeter air monitoring program as detailed below.

No physical aspects of the work shall begin until the FCP is reviewed and approved by the Engineer. However, the Contract time, in accordance with Article 1.03.08, will begin on the date stipulated in the Notice to Proceed.

Submittals

Within fourteen (14) days of the Notice to Proceed, the Contractor shall submit for the Engineer's review a detailed methodology and plan of operation for the control of dust and stabilization of ACS. The plan shall include a detailed narrative indicating the means and methods for performing dust control, stabilization and procedures to prevent wind and water migration of ACS outside the Regulated Area(s) as defined in Item No. 0101021A – Environmental Health and Safety – Asbestos Contaminated Soil, particularly into areas occupied or traversed by the public. In addition, the FCP must include a section detailing the air monitoring program. The air monitoring program will serve as the basis for determining the effectiveness of the dust and fiber control measures. In the perimeter air monitoring portion of the FCP, the Contractor shall identify specific air sampling and dust monitoring equipment, locations, and monitoring frequency.

The FCP must include a statement that intrusive or soil disturbance activities will not occur any time perimeter air monitoring is not active.

Construction Methods:

a. General Requirements

All labor, materials, tools, equipment, services, testing, and incidentals which are necessary or required to perform the work in accordance with applicable governmental regulations, industry standards and codes, and these Specifications shall be provided by the Contractor. The Contractor will be solely responsible for the management of dust and asbestos fiber control and stabilization operations and verification that the control methods utilized are effective in preventing the migration of ACS.

The Contractor's FCP is considered a flexible document and shall be revised, if/as necessary based on changes in site activities or conditions or based on updated site monitoring results. Any revisions to the Plan shall be at no additional cost to the State.

b. Air Monitoring Program

Perimeter air monitoring shall be conducted to verify the Contractor's work practices have been adequate to ensure the protection of the public. No intrusive or soil disturbing activities will be permitted to commence until such time as perimeter air monitoring is fully operational. Such perimeter monitoring shall be performed between each Regulated Area and any area which is accessible by the public. Perimeter samples shall be located at points north, south, east and west of each work area with an additional sample away from the immediate work area to function as a background sample. Monitoring of the perimeter of material stockpiles (including at the WSA) shall also be conducted a minimum of once per day. Sample points should be moved slightly so that at least one sample remains directly down-wind of the work area. These samples shall be run for the duration of the work shift or 4 hours (whichever is greater) while the soil disturbance activities are being conducted with a target sample volume of 1000 liters (L).

All air samples shall be collected following the collection techniques described in NIOSH Method 7400, Issue 2, dated August 15, 1994. Battery powered low-volume [1-5 liter per minute (lpm)] sampling pumps shall be utilized for the site perimeter sampling. Flow rates shall be both pre and post sampling calibrated using a secondary standard rotameter, calibrated to a primary standard within the previous 12 months. During the sampling time period the HSO conducting the sampling shall periodically inspect the sample cassette filters to ensure the filters do not become overloaded with dirt/particulates and shall change sampling cassettes as necessary.

All samples shall be delivered at the end of each work day via proper chain of custody procedures to a CTDPH/AIHA accredited laboratory for analysis via Phase Contrast Microscopy (PCM) following NIOSH Method 7400. Should PCM analysis of the site background/perimeter samples be above the applicable EPA clearance/CTDPH re-occupancy standard [0.01 fiber per cubic centimeter (f/cc)], those samples shall be transferred via proper chain of custody procedures to a CTDPH/AIHA accredited laboratory for analysis via Transmission Electron Microscopy (TEM) following NIOSH Method 7402 for delineation of asbestos fibers. As soon as possible, but within 24 hours, perimeter monitoring samples analytical results (PCM, and TEM as necessary) shall be compared to the background sample(s) and the EPA clearance/CTDPH re-occupancy standard of 0.01 f/cc to determine if there has been an impact outside the immediate work area. The Contractor shall immediately (within 1 hour) notify CTDOT of such exceedance

and corrective actions being implemented. All perimeter air monitoring results for a given week shall be transmitted to the Engineer no later than 2:00 p.m. on the following Tuesday. The Contractor shall notify the Engineer as soon as it becomes aware such results will not be available in this time frame due to the need for TEM analysis or for any other reason.

In addition to perimeter air monitoring, a minimum of one dust meter will be placed downwind of the work area(s) in order to evaluate dust levels.

If at any time the Contractor's methods of control/stabilization are found to be unacceptable, the Contractor shall propose and, upon the Engineer's approval, implement an alternate method of control/stabilization. Note that the occurrence of visible dust will constitute an immediate trigger for mitigation efforts. The alternate method will undergo "testing" utilizing the same perimeter air monitoring protocols. From the time that the original method is found ineffective until such time as a new, acceptable method is implemented, the contractor shall also undertake immediate actions such as limiting soil disruption and round-the-clock wet misting to prevent the migration of asbestos fibers. Should results demonstrate a continued failure to control asbestos fibers at the perimeter of the work area, all work except that related to dust and fiber control shall stop until the contractor submits an alternate FCP acceptable to the Engineer. **No claims for delay shall be considered based on the Contractor's failure to control dust and asbestos fibers as specified herein.**

If at any time the FCP submitted by the Contractor proves to be ineffective, the Contractor shall submit a modified method to address these deficiencies for review by the Engineer. Such plan revision and method implementation shall be completed at no additional cost to the State.

Method of Measurement:

No measurement will be made for the work in this Section. The completed work shall be paid as a lump sum.

Basis of Payment:

The lump sum bid price for this item shall include: preparation of submittals, all labor, materials, and equipment incidental to proper dust/asbestos fiber control and stabilization of ACS and other materials as indicated above. This shall also include alternate methods and interim work.

<u>Pay Item</u>	<u>Pay Unit</u>
Dust and Asbestos Fiber Control	Lump Sum (L.S.)

ITEM #0097773A – SPARE PARTS

Description: This work consists of furnishing additional quantities of specific Contract item components to be used as replacement parts for future maintenance.

The Contractor shall furnish the quantities of each spare part as indicated. It shall be the responsibility of the Contractor to purchase, transfer ownership of, and deliver the spare parts to the Connecticut Department of Transportation (CTDOT).

Materials: Each spare part furnished shall be new, from the same manufacturer and have the identical model number as each item component furnished for installation as described in the item special provision.

The Contractor shall deliver the following quantities of each item component as a spare part for Project 0173-0468:

ITEM NO.	SPARE PART DESCRIPTION	QTY.	Ownership and Delivery
1112286A	360-Degree Camera Assembly	1	CTDOT
1112287A	360 Degree Video Detection Processor	1	CTDOT
1112288A	IP Video Detection Camera Assembly	2	CTDOT
1107011A	Accessible Pedestrian Signal and Detector (Type A)	1	CTDOT
1008665A	10/100/1000 Base-T Ethernet Switch	1	CTDOT

The Contractor shall deliver the following quantities of each item component as a spare part for Project 0138-0250:

ITEM NO.	SPARE PART DESCRIPTION	QTY.	Ownership and Delivery
1112286A	360-Degree Camera Assembly	1	CTDOT
1112287A	360 Degree Video Detection Processor	1	CTDOT
1112288A	IP Video Detection Camera Assembly	1	CTDOT
1107011A	Accessible Pedestrian Signal and Detector (Type A)	1	CTDOT

Construction Methods: All provisions outlined in the Contract shall be complied with for each component furnished from the spare parts list. Each component furnished under this item shall be provided by the Contractor prior to beginning any 30-day working test periods. The Contractor shall deliver the spare parts to the Connecticut Department of Transportation Signal Lab, 280 West Street, Rocky Hill, CT. Each spare part shall be tagged with the model number,

date manufactured, manufacturer's name, and project number on the original sealed packaging provided by the manufacturer. Transfer of ownership and delivery shall be coordinated with Mr. Don Assard (860) 258-0346 or Mr. Mark Zampini (860) 258-0349.

Method of Measurement: The sum of money shown on the estimate and in the itemized proposal as "Estimated Cost" for this work will be considered the price bid even though payment will be made only for actual work performed. The estimated cost figure is not to be altered in any manner by the bidder. Should the bidder alter the amount shown, the altered figures will be disregarded and the original price will be used to determine the total amount bid for the item.

Basis of Payment: "Spare Parts" furnished, transferred and delivered will be paid for under Article 1.09.04—Extra and Cost Plus Work.

Pay Item	Pay Unit
Spare Parts	est.

ITEM #0101021A – ENVIRONMENTAL HEALTH AND SAFETY – ASBESTOS CONTAMINATED SOIL

Description

Under this Item, the Contractor shall establish protocols and provide procedures to protect the health and safety of its employees and subcontractors as related to the proposed construction activities. As presented in the Notice to Contractor –Asbestos Contaminated Soil and Environmental Investigations, asbestos fibers have been found in soils within the Project Limits at Intersections 138-240, 138-241, 138-242, and 138-275 and is assumed to be present in all but one portion of Intersection 138-250. Based on these findings, the Contractor shall consider that 1) all portions of the project (except as noted below) at Intersections 138-240, 138-241, 138-242, 138-250, and 138-275 are an asbestos contaminated soil (ACS) AOEC, 2) asbestos fibers are present in all soils and decontamination fluids within the ACS AOEC, and 3) all work activities must be planned accordingly when preparing the health and safety plan (HASP). Note that most of the soils within the Project Limits at Intersections 138-240, 138-241, 138-242, 138-250, and 138-275 are considered ACS. Additional information on the ACS AOEC limits is available on the Plans. Raymark Waste (RMW), found within the limits of the Raymark Industries Inc. Superfund Site, is located within the limits of Intersection 138-250. Additional information on the Superfund Site can be found in the Notice to Contractor – Raymark Superfund Site.

Work under this Item includes the development and implementation of a written HASP that addresses the relative risk of exposure to potential hazards, including ACS, RMW and other contaminants present in Project soils and decontamination fluids. The HASP shall establish health and safety protocols that address the relative risk of exposure to asbestos in accordance with the Occupational Health and Safety Administration (OSHA) asbestos regulations in 29 CFR 1926.1101 and regulated substances in accordance with 29 CFR 1910.120 and 29 CFR 1926.65. Such protocols shall address all regulatory provisions applicable to site conditions.

The HASP developed by the Contractor, as indicated below, shall include provisions for site layout, security and control, with particular attention paid to the designation of Regulated Areas. The security shall include the consideration of appropriate methods for prevention of members of the public or otherwise unauthorized personnel from entering any portion of the work areas specified above (specific intersections) through the installation of physical barriers or other methods as site access controls.

The HASP developed under this Item shall also include visitors to the site that have not prepared their own HASPs, and may include, but not be limited to, representatives of the Town of Stratford, the EPA, DEEP, suppliers, and truck drivers. It shall also be sufficiently protective to prevent individuals from entering any Regulated Area and protect individuals outside the limits of a Regulated Area from being exposed to contaminants associated with the work (refer to Item No. 0020808 – Dust and Asbestos Fiber Control).

A “Regulated Area” is a location where airborne concentrations of asbestos exceed (or there is a

reasonable possibility they may exceed) the OSHA permissible exposure limit (PEL) of 0.1 fibers per cubic centimeter based upon an 8-hour time weighted average (TWA). Said area(s) shall be demarcated such that access is strictly controlled (authorized personnel only) and people outside the area are protected from exposure. The Contractor shall refer to 29 CFR 1926.1101 for additional details.

All activities involving RMW are considered to be clean-up operations on a National Priority List site and must comply with 29 CFR 1910.120 and 1926.65. DEEP personnel must be present during all intrusive work conducted at the Superfund site, located on the western side of Intersection 138-250, including work that does not extend beneath the cap. Work in this area will also be subject to EPA oversight.

Note: The Engineer will prepare a site-specific HASP, which is compatible with the Contractor's HASP and will be responsible for the health and safety of all Project Inspectors, Department employees and consulting engineers.

Materials

The Contractor must provide chemical protective clothing (CPC), personal protective equipment (PPE), monitoring equipment, and all necessary materials for use in personnel decontamination and subsequent proper disposal of potentially asbestos-impacted, expendable PPE as stipulated in the Contractor's HASP during the performance of work in areas identified as potentially posing a risk to worker health and safety for workers employed by the Contractor and all subcontractors. The Contractor is also responsible for providing and properly disposing of PPE (excluding respiratory protection) for up to two (2) Department employees per day.

Containers designated for the storage, transportation and proper disposal of potentially ACM-impacted PPE shall be double-lined, impermeable and both air and water-tight and shall be properly labelled in accordance with all applicable regulations.

Construction Methods

A. Existing Information

The Contractor shall utilize all available information and existing records and data pertaining to chemical and physical hazards associated with any of the regulated substances identified in the environmental site investigations to develop the HASP. The documents containing this data are listed in the Notice to Contractor – Asbestos Contaminated Soil and Environmental Investigations And Notice to Contractor – Raymark Superfund Site.

B. General

The requirements set forth herein pertain to the provision of workers' health and safety as it relates to proposed Project activities when performed in the presence of hazardous or regulated materials or otherwise environmentally sensitive conditions. THE PROVISION

OF WORKER HEALTH AND SAFETY PROTOCOLS, WHICH ADDRESS POTENTIAL AND/OR ACTUAL RISK OF EXPOSURE TO SITE-SPECIFIC HAZARDS POSED TO CONTRACTOR'S EMPLOYEES, IS SOLELY THE RESPONSIBILITY OF THE CONTRACTOR.

The Contractor shall be responsible for the development, implementation and oversight of the HASP throughout the performance of work within Project limits and in other areas identified by the Engineer or by the HASP where site conditions may pose a risk to worker health and safety, the public, and/or the environment. **No physical aspects of the work shall begin until the HASP is reviewed by the Engineer and is determined to meet the requirements of the specifications. However, the Contract time, in accordance with Article 1.03.08, will begin on the date stipulated in the Notice to Proceed.**

C. Regulatory Requirements

All construction-related activities performed by the Contractor within the limits of the ACS AOECs or in other areas where site conditions may pose a risk to worker health and safety and/or the environment shall be performed in conformance with 29 CFR 1926, Safety and Health Regulations for Construction and 29 CFR 1910, Safety and Health Regulations for General Industry. Conformance to 29 CFR 1910.120, Hazardous Waste Operations and Emergency Response (HAZWOPER) is also be required at locations at the Raymark Superfund site if work occurs either directly below the impermeable liner or at locations where the liner is not present in which the DEEP or Engineer has determined that RMW is present.

D. Submittals

Three copies of the HASP shall be submitted to the Engineer within four (4) weeks after the Award of Contract or four (4) weeks prior to the start of any work in the ACS AOECs, whichever is first, but not before the Award of the Contract.

The HASP shall be developed by a qualified person designated by the Contractor. This qualified person shall be a Certified Industrial Hygienist (CIH), Certified Hazardous Material Manager (CHMM), or a Certified Safety Professional (CSP). He/she shall have review and approval authority over the HASP and be identified as the Health and Safety Manager (HSM). The HASP shall bear the signature of said HSM indicating that the HASP meets the minimum requirements of 29 CFR 1910.120 and 29 CFR 1926.65 and includes appropriate provisions to address pertinent elements of 29 CFR 1926.1101.

The Engineer will review the HASP within four (4) weeks of submittal and provide written comments as to deficiencies in and/or exceptions to the plan, if any, to assure consistency with the specifications, applicable standards, policies and practices and appropriateness given potential or known site conditions. Items identified in the HASP which do not conform to the specifications will be brought to the attention of the Contractor, and the Contractor shall revise the HASP to correct the deficiencies and resubmit it to the Engineer for determination

of compliance with this Item within three (3) business days of written notification of deficiencies. The Contractor shall not be allowed to commence work activities in the ACS AOECs, as shown on the Plans, or where site conditions exist which may pose a risk to worker health and safety and/or the environment, until the HASP has been reviewed and determined to conform to the requirements of this specification by the Engineer. **No claim for delay in the progress of work will be considered for the Contractor's failure to submit a HASP that conforms to the requirements of the Contract.**

E. HASP Provisions

1. General Requirements

The Contractor shall prepare a HASP covering all Project site work regulated by 29 CFR 1910.120(b)/1926.65(b)/1926.1101 to be performed by the Contractor and all subcontractors under this Contract. The HASP shall establish in detail, the protocols necessary for the recognition, evaluation, and control of all hazards associated with each task performed under this Contract. The HASP shall address site-specific safety and health hazards of each phase of site operation and include the requirements and procedures for employee protection. The level of detail provided in the HASP shall be tailored to the type of work, complexity of operations to be performed, and hazards anticipated. Details about some activities may not be available when the initial HASP is prepared and submitted. Therefore, the HASP shall address, in as much detail as possible, all work tasks including methodology, their related hazards and control measures. Where sufficient information is not yet available, the HASP shall list all work tasks and a supplemental work plan shall be provided at a later date with the specified details. Such supplemental plans shall be provided for review and acceptance at least 4 weeks prior to the work being performed. Per Subsection G (HASP Revisions) below, the HASP shall be recognized as a flexible document that may require revisions and amendments in response to changes in site conditions and/or work practices.

The HASP shall interface with the Contractor's Safety and Health Program. Any portions of the Safety and Health Program that are referenced in the HASP shall be included as appendices to the HASP. All topics regulated by 29 CFR 1910.120(b)(4) and those listed below shall be addressed in the HASP. **Where the use of a specific topic is not applicable to the Project, the HASP shall include a statement to justify its omission or reduced level of detail and establish that adequate consideration was given to that topic.**

2. Elements

a. Site Description and Contamination Characterization

The Contractor shall provide a site description and contaminant characterization in the HASP that meets the requirements of 29 CFR 1910.120/1926.65.

b. Safety and Health Risk Analysis/Activity Hazard Analysis

The HASP shall address the safety and health hazards on this site for every operation to be performed. The Contractor shall review existing records and data to identify potential chemical and physical hazards associated with the site and shall evaluate their impact on field operations. Sources, concentrations (as known), potential exposure pathways, and other factors noted in 29 CFR 1910.120, 1926.65 and 1926.1101 used to assess risk shall be described. The Contractor shall develop and justify action levels for implementation of engineering controls and personal protective equipment upgrades and downgrades for controlling worker exposure to the identified hazards. If there is no permissible exposure limit (PEL) or published exposure level for an identified hazard, available information from other published studies may be used as guidance. Any modification of an established PEL must be fully documented.

The HASP shall include a comprehensive section that discusses the tasks and objectives of the site operations and logistics and resources required to complete each task. The hazards associated with each task, including physical, biological and chemical hazards, shall be identified. Hazard prevention techniques, procedures and/or equipment shall be identified to mitigate each of the hazards identified.

c. Staff Organization, Qualifications and Responsibilities

The HASP shall include a list of personnel expected to be engaged in site activities and certify that said personnel have completed the educational requirements stipulated in 29 CFR 1910.120, 29 CFR 1926.65, and 29 CFR 1926.1101, are currently monitored under a medical surveillance program in compliance with those regulations, and that they are fit for work under "Level C" conditions. It is the Contractor's responsibility to determine the level(s) of training required for its employees who will be working on various tasks for the duration of this project. The levels of training must be identified and justified within the HASP. Based on a discussion with OSHA regarding the conditions at this site, OSHA rendered their opinion that workers completing tasks that disturb ACS must have completed a minimum of the Asbestos Class III Operations and Maintenance training in addition to training required to comply with 29 CFR 1910.120 and 29 CFR 1926.65.

The Contractor shall assign responsibilities for safety activities and procedures. An outline or flow chart of the safety chain of command shall be provided in the HASP. Qualifications, including education, experience, certifications, and training in safety and health for all personnel engaged in safety and health functions shall be documented in the HASP. Specific duties of each on-site team member should be identified. Typical team members include, but are not limited to, Team Leader, Scientific Advisor, Site Safety Officer, Public Information Officer, Security Officer, Record Keeper, Financial Officer, Field Team Leader, and Field Team Members.

The HASP shall also include the name and qualifications of the individual proposed to serve as Health and Safety Officer (HSO). The HSO shall have full authority to carry out and ensure compliance with the HASP. The Contractor shall provide a competent HSO on-site who is capable of identifying existing and potential hazards in the surroundings or working conditions which are unsanitary, hazardous or dangerous to employees and who has authorization to take prompt corrective measures to eliminate or control them. The qualifications of the HSO shall include completion of OSHA 40-hour HAZWOPER training, including current 8-hour refresher training, and OSHA 8-hour HAZWOPER Supervisor training; asbestos training commensurate with meeting the definition of a "Competent Person" as defined in 29 CFR 1926.1101; a minimum of one year of working experience with the regulated compounds that have been documented to exist within the Project Limits; a working knowledge of Federal and State safety regulations; specialized training or documented experience (one year minimum) in personal and respiratory protective equipment program implementation; the proper use of air monitoring instruments, air sampling methods and procedures; and certification training in first aid and CPR by a recognized, approved organization such as the American Red Cross.

The primary duties of the HSO shall be those associated with worker health and safety. HSO responsibilities shall be detailed in the written HASP and shall include, but not be limited to the following:

- i. Directing and implementing the HASP;
- ii. Ensuring that all Project personnel have been adequately trained in the recognition and avoidance of unsafe conditions, and the regulations applicable to the work environment to control or eliminate any hazards or other exposure to illness or injury (29 CFR 1926.21). All personnel shall be adequately trained in procedures outlined in the Contractor's written HASP;
- iii. Authorizing Stop Work Orders, which shall be executed upon the determination of an imminent health and safety concern;
- iv. Contacting the Contractor's HSM and the Engineer immediately upon the issuance of a Stop Work Order when the HSO has made the determination of an imminent health and safety concern;
- v. Authorizing work to resume, upon approval from the Contractor's HSM;
- vi. Directing activities, as defined in the Contractor's written HASP, during emergency situations;
- vii. Providing personal monitoring as applicable, and as identified in the HASP;

- viii. Identifying and properly demarcating the outdoor Regulated Areas associated with each work task that entails potential disturbance of ACS;
- ix. Conducting a continuous perimeter air monitoring program as documented in the Contractor's written health and safety plan; and
- x. Ensuring that physical site controls/barriers are adequate to prevent unauthorized access into the Regulated Areas and confirming that ACS and/or ACS-impacted materials are not stored outside of a Regulated Area.

d. Employee Training Assignments

The Contractor shall develop a training program to inform employees, supplier's representatives, and official visitors of the special hazards and procedures (including PPE, its uses and inspections) to control these hazards during field operations. Official visitors include but are not limited to Federal Agency Representatives, State Agency Representatives, Municipal Agency Representatives, Contractors, subcontractors, etc. This program shall be consistent with the requirements of 29 CFR 1910.120, 29 CFR 1926.65, and 29 CFR 1926.1101.

e. Personal Protective Equipment

The plan shall include the requirements and procedures for employee protection and should include detailed sections on protective clothing to be worn within the outdoor Regulated Areas as designated by the HSO and respiratory protection. The Contractor shall describe in detail and provide appropriate PPE to ensure that workers are not exposed to levels greater than the action level for identified hazards for each operation stated for each work zone. The level of protection shall be specific for each operation and shall be in compliance with all requirements of 29 CFR 1910 and 29 CFR 1926. The Contractor shall provide, maintain, and properly dispose of all PPE.

f. Medical Surveillance Program

All on-site Contractor personnel engaged in 29 CFR 1910.120/1926.65/1926.1101 operations shall have medical examinations meeting the requirements of 29 CFR 1910.120(f) and 29 CFR 1926.1101(m) prior to commencement of work.

The HASP shall include certification on company letterhead that recent (within the previous 12 months) medical evaluations and clearances have been performed by a physician for each employee engaged in 29 CFR 1910.120/1926.65/1926.1101 operations at the site and such employees are fit to work in Level C conditions.

g. Exposure Monitoring/Personnel Air Sampling Program

The Contractor shall submit a Personnel Air Monitoring Plan as part of the HASP. Such plan shall include details regarding personnel monitoring consistent with 29 CFR 1910.120, paragraphs (b)(4)(ii)(E), (c)(6), and (h) and 29 CFR 1926.1101 as well as perimeter air monitoring. The Contractor shall identify specific air sampling equipment, locations, and frequencies for monitoring. Exposure monitoring requirements shall be specified in the Contractor's HASP. The Contractor's HSM shall specify exposure monitoring requirements after a careful review of the contaminants of concern and planned site activities. Such plan must also include a statement that no intrusive or soil disturbance activities will be permitted to commence until air monitoring has been set up and engaged. The Contractor shall supply all exposure monitoring air sampling results to the Engineer within 48 hours after they are generated, including the locations/activities/job assignments that were involved.

h. Site Layout, Security and Control

The HASP shall include a map showing work zone delineation (Regulated Areas and as needed, support, contamination, reduction and exclusion zones), detail on/off-site communications, describe provisions for robust site access controls (i.e., fencing, gates, other physical barriers, and signage) and security (physical and procedural). Particular attention needs to be paid to the method(s) to control unauthorized site access, which, at a minimum, shall include temporary fencing with appropriate signage (e.g., no trespassing signage, OSHA asbestos-danger signage, work zone signage) to be designated in the plan by the Contractor. In addition, this portion of the Contractor's HASP must describe, in detail, the means and methods for preventing the potential for asbestos to become airborne at any time that RMW, ACS or ACS-impacted materials are disturbed. The HASP shall also detail the sizes of individual Regulated Areas and methods to control unauthorized access thereto. Note that Regulated areas shall be sized appropriately for the work being conducted.

i. Communications

Written procedures for routine and emergency communications procedures (including the conveyance of air monitoring results) shall be included in the Contractor's HASP.

j. Personal Hygiene, Personal Decontamination and Equipment Decontamination

Decontamination facilities and procedures for personnel and non-expendable PPE decontamination shall be discussed in detail (including a presentation of means and methods) in the HASP. This includes provisions for use of decontamination facilities for the Engineer, representatives and authorized visitors to the site and any necessary training/demonstration to ensure decontamination is properly completed.

Decontamination of sampling equipment, materials, heavy equipment and other items associated with work within the ACS AOECs contained within the portions of the Project Limits specified above will be addressed under Item No. 0101124A - Decontamination.

k. Emergency Equipment and First Aid Requirements

The Contractor shall provide appropriate emergency first aid kits and equipment suitable to treat exposure to the hazards identified, including chemical agents. The Contractor will provide personnel that have certified first aid/CPR training on-site at all times during site operations. Further, the Contractor shall establish procedures for medical aid in the event of an injury or other medical emergency within a Regulated Area.

l. Emergency Response Plan and Spill Containment Program

The Contractor shall establish procedures in order to take emergency action in the event of immediate hazards (i.e., a chemical agent leak or spill, fire or personal injury). Personnel and facilities supplying support in emergency procedures will be identified. The emergency equipment to be present on-site and the Emergency Response Plan procedures, as required by 29 CFR 1910.120, paragraph (1)(1)(ii), shall be specified in the Emergency Response Plan. The Emergency Response Plan shall be included as part of the HASP. This Emergency Response Plan shall include written directions to the closest hospital, as well as a map showing the route to the hospital.

m. Logs, Reports and Record Keeping

The Contractor shall maintain safety inspections, logs, and reports, accident/incident reports, medical certifications, training logs, monitoring results, etc. All exposure and medical monitoring records are to be maintained according to regulatory requirements. The format of these logs and reports shall be developed by the Contractor to include training logs, daily logs, weekly reports, safety meetings, medical surveillance records, and a phase-out report. These logs, records, and reports shall be maintained by the Contractor and be made available to the Engineer.

The Contractor shall immediately notify the Engineer of any accident/incident. Within two working days of any reportable accident, the Contractor shall complete and submit an accident report to the Engineer.

n. Confined Space Entry Procedures

Confined space entry procedures, both permit-required and non-permit-required, shall be discussed in detail in the Contractor's HASP.

o. Pre-Entry Briefings

The HASP shall provide for pre-entry briefings to be held prior to initiating any site activity and at such other times as necessary to ensure that employees are apprised of the HASP and that this plan is being followed.

p. Inspections/Audits

The HSM or HSO shall conduct inspections or audits to determine the effectiveness of the HASP. The Contractor shall correct any deficiencies in the effectiveness of the HASP.

q. Negative Exposure Assessments (NEA)

The HASP shall detail the procedures for establishing a NEA for individual work activities.

F. HASP Implementation

The Contractor shall implement and maintain the HASP throughout the performance of work. In areas identified as having a potential risk to worker health and safety, and in any other areas deemed appropriate by the HSO, the Contractor shall be prepared to immediately implement the appropriate health and safety measures, including but not limited to the use of PPE, and engineering and administrative controls.

If the Engineer observes deficiencies in the Contractor's operations with respect to the HASP, they shall be assembled in a written field directive and given to the Contractor. The Contractor shall immediately correct the deficiencies and respond, in writing, as to how each was corrected. Failure to bring the work area(s) and implementation procedures into compliance will result in a Stop Work Order and a written directive to discuss an appropriate resolution(s) to the matter. When the Contractor demonstrates compliance, the Engineer shall remove the Stop Work Order. If a Stop Work Order has been issued for cause, no delay claims on the part of the Contractor will be honored.

Disposable CPC/PPE (i.e., disposable coveralls, gloves, etc.) that come in direct contact with hazardous or potentially hazardous material shall be placed into 55-gallon USDOT 17-H drums and disposed of in accordance with Federal, State, and local regulations. The drums shall be temporarily staged and properly secured until such time that they undergo proper disposal by the Contractor.

G. HASP Revisions

The HASP shall be maintained on-site by the Contractor and shall be kept current with construction activities and site conditions under this Contract. The HASP shall be recognized as a living document which shall be revised and amended as required, in response to actual

site conditions, changes in work methods, and/or alterations in the relative risk present. All changes and modifications shall be signed by the Contractor's HSM and shall require the review and acceptance by the Engineer prior to the implementation of such changes.

Should any unforeseen hazard become evident during the performance of the work, the HSO shall bring such hazard to the attention of the Engineer as soon as possible. In the interim, the Contractor shall take action, including Stop Work Orders and/or upgrading PPE as necessary, to re-establish and maintain safe working conditions and to safeguard on-site personnel, visitors, the public and the environment. The HASP shall then be revised/amended to reflect the changed condition.

Method of Measurement

- A. Within thirty (30) calendar days of the award of the Contract, the Contractor shall submit to the Engineer for acceptance a breakdown of its lump sum bid price for this Item detailing:
 1. The costs associated with developing/preparing the HASP in accordance with this Specification.
 2. The cost, per month for the duration of the Project, to implement the HASP and provide the services of the HSM and the HSO.
- B. If the lump sum bid price breakdown is unacceptable to the Engineer, substantiation showing that the submitted costs are reasonable shall be required.
- C. Upon acceptance of the payment schedule by the Engineer, payments for work performed will be made as follows:
 1. The lump sum development cost will be certified for payment.
 2. The Contractor shall demonstrate to the Engineer monthly that the HASP has been kept current and is being implemented and the monthly cost will be certified for payment.
 3. Any month where the HASP is found not to be current or is not being implemented, the monthly payment for the Environmental Health and Safety – Asbestos Containing Soil (ACS) Item shall be deferred to the next monthly payment estimate. If the HASP is not current or being implemented for more than thirty calendar days, there will be no monthly payment.
 4. Failure of the Contractor to implement the HASP in accordance with this Specification shall result in the withholding of all Contract payments.

Basis of Payment

This work shall be paid for at the Contract lump sum price for “ENVIRONMENTAL HEALTH AND SAFETY – ASBESTOS CONTAMINATED SOIL (ACS),” which shall include all materials, tools, equipment and labor incidental to the completion of this Item for the duration of the Project to maintain, revise, monitor and implement the HASP. Such costs include, but may not be limited to, providing the services of the HSM and HSO, Contractor employee training, CPC, PPE for Contractor employees, suppliers and Department personnel, monitoring equipment, disposal of PPE and CPC, medical surveillance, personnel decontamination facilities, engineering controls, monitoring and all other HASP protocols and procedures established to protect the health and safety for all on-site workers.

Pay Item

Environmental Health and Safety –
Asbestos Contaminated Soil

Pay Unit

Lump Sum (L.S.)

ITEM #0101124A – DECONTAMINATION

Description:

Under this item, the Contractor shall prepare a Decontamination Plan (DP) and decontaminate various materials and equipment utilized within the Project Limits that have been exposed to asbestos contaminated soil (ACS). All equipment and materials will require decontamination prior to exiting the Contractor's Regulated Area that was established per HASP requirements. This includes, but is not limited to, mechanized equipment, roll-offs, existing electrical equipment, jersey barriers, and other items mobilized to the work site that comes into contact with ACS. The existing controller cabinet foundation at Intersection 138-250 will require decontamination unless the impermeable membrane cap and clean fill associated with the Raymark Superfund Site are found to extend beneath the foundation.

Personnel decontamination shall be addressed under Item No. 0101021A – Environmental Health and Safety – Asbestos Contaminated Soil.

This item also includes the containment and disposal of decontamination wastewater.

No physical aspects of the work shall begin until the DP is reviewed and approved by the Engineer. However, the Contract time, in accordance with Article 1.03.08, will begin on the date stipulated in the Notice to Proceed.

The Contractor shall take into consideration in the development and implementation of the detailed decontamination plan that all items that have been exposed to ACS must be decontaminated in accordance with approved methods prior to exiting the Regulated Area(s) (see the "Notice to Contractor – Asbestos Contaminated Soil and Environmental Investigations" for more information regarding Regulated Areas) and prior to demobilization of equipment from the site. No materials or equipment shall be removed from the Project Site before full decontamination has been completed. All work must be implemented in such a way so as to prevent anyone beyond the Regulated Area(s) from being exposed to asbestos fibers generated by project work.

Materials:

Water service may not be available at the site. The Contractor shall supply sufficient water for the purposes of decontamination.

Containers for storage, transportation and disposal of asbestos-containing waste materials shall be impermeable and both air and watertight.

Labels and warning signs shall conform to OSHA 29 CFR 1926.1101, USEPA 40 CFR Part 61.152, and USDOT 49 CFR Part 172 as appropriate.

Submittals

Within fourteen (14) days of the Notice to Proceed, the Contractor shall submit for the Engineer's review, a DP with detailed methodology and plan of operation for the decontamination of equipment and other elements exposed to ACS and the proper disposal of resulting wastewater. The DP shall include a detailed narrative indicating the number and layout of the decontamination stations, means and methods for performing decontamination, and procedures to prevent contamination beyond the Regulated Area(s). As part of the DP, the Contractor shall include a detailed description of the proposed system of collecting and managing the decontamination wastewater. Such system shall not release contaminated wastewater into the environment. This submittal shall include schematics of proposed pump set-ups, proposed containment method and location(s) of temporary containment tanks, schematics of proposed methods to transfer liquids from temporary containment tanks to transport vehicles, and schematic of the proposed method to off-load liquids at the offsite disposal facility, as applicable. The Contractor shall include provisions to ensure proper decontamination of temporary containment tanks and/or vacuum truck(s).

If at any time the DP submitted by the Contractor proves to be ineffective, the Contractor shall submit a modified method to address these deficiencies for review by the Engineer. Such plan revision and method implementation shall be completed at no additional cost to the State.

Construction Methods:

a. General Requirements

All labor, materials, tools, equipment, services, testing, and incidentals which are necessary or required to perform the work in accordance with applicable governmental regulations, industry standards and codes, and these Specifications shall be provided by the Contractor. Note that all ACS-impacted materials shall be decontaminated in accordance with this Item prior to releasing or closing out any Regulated Area. The Contractor will be solely responsible for the management of decontamination operations.

b. Asbestos Decontamination Verification

As asbestos is a fibrous material and has no propensity for adsorption to surfaces, wet decontamination procedures will be used for all materials. Verification of adequate decontamination is based on visual inspection. This method of verification is consistent with the clearance for re-occupancy of a space under NESHAP asbestos abatement project rules and will be conducted by the Contractor's asbestos competent person (as defined by OSHA) following the performance of the decontamination procedures. The Contractor shall perform a visual inspection of all materials and equipment prior to their removal from each Regulated Area to ensure that decontamination has been properly completed. If at any time the Contractor's decontamination is found to be unacceptable or incomplete by the Engineer, the Contractor shall repeat the decontamination until a result acceptable to the Engineer is reached. Such repeated decontamination shall be completed at the Contractor's expense.

c. Decontamination Waste Disposal

All materials removed from the project site following decontamination shall become the property of the Contractor and the Contractor shall be responsible for the proper management and/or disposal in accordance with all applicable Federal, State and Local requirements.

The Contractor shall dispose of asbestos contaminated material at an EPA-authorized site in compliance with the requirements of the Special Waste Provisions of the CTDEEP Office of Solid Waste Management, or other designated agency having jurisdiction over solid waste disposal.

All ACS and ACS-impacted materials generated under this item will be disposed of in accordance with Item No. 0020806 – Disposal of Asbestos Contaminated Soil.

d. Decontamination Wastewater Disposal

Contaminated wastewater generated as a result of ACS decontamination operations within the Project Limits shall be containerized for off-site disposal. The Engineer will sample the wastewater at a frequency established by the Contractor's selected disposal facility. An environmental investigation identified the presence of other constituents of concern in soil including extractable total petroleum hydrocarbons (ETPH), polynuclear aromatic hydrocarbons (PAHs) and one VOC. Wastewater generated during the decontamination may also contain those contaminants of concern and require special provisions for management and disposal.

The Contractor shall designate to the Engineer which facility it intends to use prior to samples being collected. The Contractor is hereby notified that laboratory turnaround time is expected to be fifteen (15) working days. Turnaround time is the period of time beginning when the Contractor notifies the Engineer which facility it intends to use and that the temporary container is two-thirds full and ready for sampling, and ending with the Contractor's receipt of the laboratory analytical results. Any change of intended disposal facility may prompt the need to resample and will therefore restart the time required for laboratory turnaround. The laboratory will furnish such results to the Engineer. Upon receipt, the Engineer will make available to the Contractor the results of the final waste characterization determinations. **No delay claim will be considered based upon the Contractor's failure to accommodate the laboratory turnaround time as identified above.**

The containerized wastewater shall be transported off-site and disposed of at the approved disposal facility. All manifests or bills of lading utilized to accompany the transportation of the contaminated wastewater shall be prepared by the Contractor and signed by an authorized Department representative, as Generator, for each truckload of contaminated wastewater that leaves the site. The Contractor shall forward the appropriate original copies of all manifests or bills of lading to the Engineer the same day the contaminated wastewater leaves the Project Site. A load-specific certificate of disposal, signed by the authorized agent representing the disposal facility, shall be obtained by the Contractor and promptly delivered to the Engineer for each load.

The Contractor must use one of the following Department-approved treatment facilities for disposal:

<p>Clean Harbors of Connecticut, Inc. Attn: Glen Carlson 51 Broderick Road Bristol, CT 06010 Phone: (860) 583-8917 Fax: (860) 585-1740</p>	<p>Tradebe Environmental Services, LLC Attn: Eric Congdon 136 Gracey Avenue Meriden, CT 06451 Phone: (888) 276-0887 Fax: (203) 238-6772</p>
<p>Tradebe Environmental Services, LLC (Bridgeport United Recycling, Inc.) Attn: Eric Congdon 50 Cross Street Bridgeport, CT 06610 Phone: (888) 276-0887 Fax: (203) 630-4415</p>	

All transport vehicles shall provide documentation that they hold a current "Waste Transportation Permit" per Connecticut General Statutes (CGS) 22a-454.

Method of Measurement:

No measurement will be made for the work in this Section. The completed work shall be paid as a lump sum.

Basis of Payment:

The lump sum bid price for this item shall include: preparation of submittals, all labor, materials, and equipment incidental to the proper decontamination of all equipment and other materials as indicated above. It shall also include all equipment, materials, tools and labor incidental to containment, transfer, transport and off-site disposal of contaminated wastewater at an approved disposal facility and the disposal of those items unable to be decontaminated.

Pay Item

Pay Unit

Decontamination

Lump Sum (L.S.)

ITEM #0202451A – TEST PIT EXCAVATION

Description:

Excavate and backfill a designated area to determine the exact location of utility facilities which are near a proposed foundation.

Materials:

Compacted Granular Fill: Article M.02.02
Bituminous Concrete Materials: Article M.04

Construction Methods:

Keep affected utility owner apprised of proposed test pit excavation.

Excavate only as authorized and as directed by the Engineer. The size, depth and location will be as authorized by the Engineer.

If rock greater than 0.5 c.y. (cu.m) is encountered, the Engineer will determine if it must be removed and the method. Do not use explosives. See the pertinent construction methods of Section 2.02.03. When concrete must be removed, reinforced or not, it shall be considered, measured, and paid for as rock in foundation excavation.

If unsuitable backfill material is excavated, dispose as directed by the Engineer. Replace with suitable backfill and compact in accordance with Section 2.14.

Repair all damaged bituminous pavement in accordance with Section 4.06.03. Sawcut the edges to neat lines if there will be no subsequent excavation at the test pit for a foundation.

Method of Measurement:

Test pit excavation will be measured at the contract unit price per cubic yard (cubic meter) for the material actually removed from within the limits specified as directed by the engineer.

When necessary, rock in foundation excavation will be measured at the contract price per vertical foot (vertical meter) for the rock actually removed in accordance with Article 2.02.04.

Basis of Payment:

This work will be paid for at the contract unit price per cubic yard (cubic meter) for “Test Pit Excavation”, which price shall include excavation, unsuitable material disposal, compacted backfill, bituminous pavement, sawcut, pavement repair, all utility costs, all equipment, tools, labor and work incidental thereto. The volume excludes the volume of material that is measured as Rock In Foundation Excavation.

<u>Pay Item</u>	<u>Pay Unit</u>
Test Pit Excavation	c.y. (cu.m)

ITEM #0202513A – REMOVAL OF CONCRETE SIDEWALK
ITEM #0202530A – REMOVAL OF BITUMINOUS SIDEWALK

Work under this item shall conform to the requirements of Section 2.02, amended as follows:

2.02.01-Description: Add the following:

Concrete and bituminous sidewalks or ramps shall be removed and disposed of in accordance with these specifications, where shown on the contract plans or as ordered by the Engineer.

2.02.03-Construction Methods: Add the following:

Wherever portions of concrete or bituminous sidewalks or ramps are to be removed, such removals shall be made to neat lines. Partial removals shall generally be to existing joints except when a location other than a joint is set as the limit by the Engineer due to construction staging limits. At removal limits where a joint is not present, the Contractor shall sawcut the concrete full depth to create a neat line. If a new concrete sidewalk is not to be installed then the existing subbase should be turned and mixed prior to placing topsoil. The Contractor shall place topsoil to match existing surface grade.

2.02.04-Method of Measurement: Add the following:

The work of removing concrete and bituminous sidewalk or ramps shall be measured in place before removal for payment by the number of square yards of concrete sidewalk or ramp removed.

2.02.05-Basis of Payment: Add the following:

The removal of concrete and bituminous sidewalk or ramps will be paid for at the contract unit price per square yard for “Removal of Concrete Sidewalk” or “Removal of Bituminous Sidewalk” which price shall include all materials, equipment, tools and labor incidental thereto including cutting concrete at neat lines and all disposal costs.

The placement of topsoil will be paid for at the contract unit price per square yard for “Furnishing and Placing Topsoil”.

Pay Item	Pay Unit
Removal of Concrete Sidewalk	s.y.
Removal of Bituminous Sidewalk	s.y.

ITEM #0406125A – BITUMINOUS CONCRETE SURFACE PATCH

Description: This work shall consist of milling out deteriorated bituminous concrete pavement to a depth between 1.5 to 2.5 inches, disposing of pavement millings, sweeping and cleaning, application of tack coat on all surfaces within milled area, and placement of Hot-Mix Asphalt (HMA) or an equivalent Polymer Modified Asphalt (PMA) to match the elevation of the surrounding pavement.

For road sections being milled and paved, all patching operations must be completed after milling is complete and before paving begins. All patching operations shall be completed within one working day following milling and shall be completed before traffic is permitted to resume on the exposed roadway.

Materials: Materials for this work shall consist of the following:

1. HMA S0.375 or an equivalent PMA meeting the requirements of Sections 4.06 and M.04. All HMA, or PMA, shall be Traffic Level 2 unless indicated otherwise on the plans.
2. Tack coat meeting the material requirements in Sections 4.06 and M.04.

Construction Methods:

Equipment for this work shall include, but is not limited to, the following:

1. Milling machine: A milling machine designed and built for milling flexible pavements. It shall be self-propelled with sufficient power, traction, and stability to maintain depth and slope and shall be capable of removing the existing bituminous concrete pavement.

The milling machine shall be equipped with a built-in automatic grade averaging control system that can control the longitudinal profile and the transverse cross-slope to produce the specified results. The longitudinal controls shall be capable of operating from any longitudinal grade reference, including string line, contact ski (30 feet minimum), non-contact ski (20 feet minimum), or mobile string line (30 feet minimum). The transverse controls shall have an automatic system for controlling cross-slope at a given rate. The Engineer may waive the requirement for automatic grade or slope controls where warranted.

The rotary drum of the machine shall use carbide tip tools spaced not more than 5/8 inches apart. The forward speed of the milling machine shall be a maximum of 45 feet/minute. The tools on the revolving cutting drum must be continually maintained and shall be replaced as warranted to provide a uniform pavement texture.

The Contractor may request to perform a test strip to demonstrate that the required surface tolerance can be attained at an increased forward speed. The test strip shall be a maximum length of 500 feet and shall have the same criteria for surface tolerance as specified herein. The final decision for implementing the increased forward speed will be made by the Engineer.

The machine shall be equipped with an integral pickup and conveying device to immediately remove milled material from the surface of the roadway and discharge the millings into a truck, in one operation. The machine shall also be equipped with a means of effectively limiting the amount of dust escaping from the milling and removal operation. When milling smaller areas or areas where it is impractical to use the above

described equipment, the Contractor may be permitted to use a lesser equipped milling machine, if approved by the Engineer.

In addition, the minimum milling width shall be 20 inches, making the minimum achievable patch size 20 inches by 20 inches, or 0.30 square yards.

2. 10 foot straight edge.
3. Sweeper: A sweeper, equipped with a water tank, capable of remove millings and loose debris.
4. Air compressor: An air compressor capable of producing 100 psi, oil free, compressed air for cleaning the milled pavement surface.
5. Hot air lance: A hot air lance that can deliver 100 psi, oil free heated air to clean and dry the pavement surface. The compressed air emitted from the tip of the lance shall be flame-free and shall achieve a temperature of at least 1500° F.
6. Paving and compaction equipment: Paving and compaction equipment meeting the requirements of Section 4.06. It is expected that much of the placement will require hand work or a mixture of equipment and hand tools to achieve the required results. Smaller compaction equipment, including vibratory plate compactors, will be allowed by the Engineer to achieve the required results. At all times the Contractor is required to meet the density and compaction and all other requirements specified in Sections 4.06 and M.04.

The work shall include, but is not limited to, the following:

1. Demarcating: The Engineer will mark out areas for patching and will determine the appropriate milling depth between 1.5 inches and 2.5 inches. The minimum length and width dimension of the patch shall be 20 inches. Any area to be patched shall completely encompass the entire distressed pavement area and extend at least 6 inches beyond into the surrounding pavement wherever possible.
2. Milling: Mill marked out areas to specified depths
3. Sweeping, Cleaning and Drying: Sweep the milled surface clean and allow milled areas to dry. Any moisture in or on the milled areas must be allowed to evaporate or be removed with the assistance of the hot air lance. When the milled area is dry to the satisfaction of the Engineer, it shall be blown clean of any residual dust or debris using compressed air.
4. Applying Tack Coat: Apply tack coat to the entire clean and dry milled area, including the sides/walls of the area to be patched, and in accordance with the requirements of Section 4.06.
5. Placing Patch Material: After the tack coat has had sufficient time to cure or break, HMA S0.375, or equivalent PMA, shall be placed and compacted to the requirements above and in Section 4.06. The Contractor shall confirm that the surface elevation of the finished patch matches the elevation of the surrounding pavement surface to within 1/4 inch using the 10 foot straightedge.

Method of Measurement: This work will be measured by the number of square yards of patched bituminous concrete completed and accepted.

Basis of Payment: This work will be paid for at the Contract unit price per square yard of “Bituminous Concrete Surface Patch.” The price shall include all tools, materials, labor and

equipment; milling, removing, and disposing of pavement millings; sweeping and cleaning of the milled area; drying the milled area; applying tack coat to the milled area; and placement and compaction of HMA or PMA.

Pay Item	Pay Unit
Bituminous Concrete Surface Patch	s.y.

ITEM #0601020A – STAMPED CONCRETE

Construct Stamped Concrete Pavement Surfaces as shown on the plans and in accordance with Article 4.01, supplemented as follows:

Article 4.01.01 - Description: Add the following:

Work under this item includes construction of sidewalk using the specified concrete pavement color, pattern, textural surface, dry-shake color hardener, test slabs, and application of a sealant solution.

Work under this item also includes furnishing and installing wire mesh reinforcement and construction joints in accordance with this specification or as directed by the Engineer.

Article 4.01.02 – Materials: Add the following:

Concrete must have a minimum 28-day compressive strength of 4500 psi concrete for the sidewalk, with a maximum aggregate size of ½". Cement from the same mill and raw materials of the same type and brand should be used for all the stamped concrete and test panel to ensure color uniformity. In addition, the temperature of the concrete must be kept between 65 and 85 degrees Fahrenheit unless otherwise specified by the manufacturer.

1. **Coloring Agent** – The primary concrete coloring agent shall be pigmented coloring admixtures processed specifically for incorporating into the concrete mix and complying with ASTM C979 and ASTM C494. The coloring agent shall contain colored, water-reducing, coloring agents that are lime proof and UV resistant, and without calcium chloride. If the concrete mix is not delivered with the coloring admixture already mixed in, pre-weighed and packaged dry high-grade coloring pigments for integrally colored concrete shall be used. The pigment color to be added to the concrete shall be selected as shown on this specification or as directed by the engineer from manufacturer's standards. A colored release agent compatible with the integral pigments shall be used in accordance with the manufacturer's recommendations to achieve the desired finished appearance.
2. **Color** – The color shall be the following or approved equals:

Scofield #5059 Sorrento Red integral concrete followed by Texturetop A-28 Tile Red, manufactured by L.M. Scofield Company, 280 Park Avenue, Rutherford, NJ 07070, telephone (201) 672-9050, viewable on the following website: http://www.scofield.com/concreteresurfacing_main.html

Solomon Brickform #500 Tile Red, manufactured by Solomon Colors, Inc., 4050 Color Plant Road, Springfield, IL 62702, telephone (217) 522-3112, viewable on the following website: <http://www.brickform.com/ColorCard.aspx?ColorCardID=17>

3. **Releasing Agent** - The dry-shake powder releasing agent shall be used to facilitate release of imprinting tools as recommended by the manufacturer. The color of the releasing agent shall be matched to the color used for the coloring agent. One of the following or approved equals shall be used:

Scofield LITHOCHROME® Color Hardener and Antiquing Release, manufactured by L.M. Scofield Company, 280 Park Avenue, Rutherford, NJ 07070, telephone (201) 672-9050, viewable on the following website: http://www.scofield.com/lithochrome_main.html

Solomon Brickform Color Hardener and Releasing Agent, manufactured by Solomon Colors, Inc. 4050 Color Plant Road, Springfield, IL 06702, telephone (217) 522-3112, viewable on the following website: <http://www.brickform.com/Products/Antiquing-Products/Antique-Release2/>

4. **Mat Tools** - Mat tools shall be high quality resilient mats reproduced from castings of natural materials and providing uniform control of joint depth. The stamped concrete pattern shall be the following patterns or approved equals.

Scofield Pavecrafters® Used Brick – Running Bond Pattern, Order No. 2500, manufactured by L.M. Scofield Company, 280 Park Avenue, Rutherford, NJ 07070, telephone (201) 672-9050; viewable on the following website: http://www.scofield.com/stampedconcrete_patterns25.html

Butterfield Color New Brick Soldier Course Stacked, Product No. BST6901, manufactured by Butterfield Color, 625 W. Illinois Avenue, Aurora, IL 60506, telephone (630) 906-1980, viewable on the following website: <http://www.butterfieldcolor.com/tools/?product=new-brick-soldier-course-stacked>

5. **Curing and Sealing Compound** - The clear sealant shall be the following or an approved equal:

SCOFIELD® Cureseal-W™ [Semi Gloss], manufactured by L.M. Scofield Company, 280 Park Avenue, Rutherford, NJ 07070, telephone (201) 672-9050, viewable on the following website: <http://www.scofield.com/concretesealer-CURESEAL-W.html>

Solomon Brickform Gem Cure & Seal, manufactured by Solomon Colors, Inc. 4050 Color Plant Road, Springfield, IL 06702, telephone (217) 522-3112, viewable on the following website: <http://www.brickform.com/Products/Sealers-and-Additives-/Gem-Cure-and-Seal/>

Curing and sealing compound shall conform to the requirements of ASTM C309 and matching the color admixture manufacturer, for use with integrally colored concrete.

6. **Backer Rod** - An open-cell type rod with an impervious skin that will not outgas when ruptured. Use the backer rod together with the joint sealant. The backer rod shall be one of the following or an approved equal:

SOF ROD, manufactured by Nomaco Inc., 501 NMC Drive, Zebulon, NC 27597, telephone 1 800 345-7279, OR

CERA-ROD, manufactured by W.R. Meadows Inc., 2100 Monroe Street, York, PA 17404, telephone (717) 792-2627, OR

Preformed expansion joint filler shall conform to Article M.03.08-2(a). The steel wire fabric reinforcement shall conform to Article M.06.01-3.

Article 4.01.03 – Construction Methods: Add the following:

The contractor shall have at least 5 years of experience performing the installation of patterned and colored concrete on various state and/or municipal contracts. The prime Contractor shall submit a minimum of 5 references proving the satisfactory completion of such work performed by the concrete contractor within 7 calendar days of the award of the contract for Engineer approval. The submittal shall include the names, addresses, and phone numbers of the personnel responsible for the administering the contracts, and the location of the prior work. If the Engineer determines that the contractor proposed has insufficient experience, or has performed unsatisfactory work on other contracts, the prime Contractor will be required to resubmit documentation for an alternate contractor for the approval of the Engineer. Submit Contractor name and references to:

Gregory Straka
Manager of Contracts
2800 Berlin Turnpike
Newington, CT 06131-7546

At least 30 days prior to construction of the first stamped concrete surfaces, the Contractor shall prepare a test form with a full scale field mock-up of the stamped concrete surface (5'x5') showing the proposed color, stamp pattern, surface finish, joint treatment and layout, and standard of workmanship as shown on the plans. Construct the test slab using the same methods as outlined in the above Construction Methods and using the same materials. The test panel shall include a repaired area of at least 1.5' X 1.5' to demonstrate the Contractors ability to match the color and texture in the event the stamped concrete becomes damaged during construction and requires repair. Additional test panels ordered by the Engineer for purposes of color comparison only, may be 1.5' X 1.5'. The Contractor may choose to supply several test panels of this size for purposes of color selection prior to construction the stamped 5' X 5' textured panel. If the resulting appearance is not acceptable to the Engineer, adjustments shall be made to the color, pattern, finished texture and/or joint treatment and another test form shall be prepared for inspection. The construction of the stamped concrete shall not begin until the Engineer has approved the test panel. The test panels shall be maintained during construction in an

undisturbed condition as a standard for judging the completed work. All test panels shall be removed and disposed of when directed by the Engineer.

The pattern layout and joint locations shall be coordinated with and approved by the Engineer prior to any construction. The stamped concrete shall have a uniform and consistent color and pattern matching that of the approved test panel. Care is required while constructing the pattern with respect to the joints to insure the stones in the pattern line up with the joint locations. All manufacturers' recommendations shall be followed unless otherwise directed by the Engineer.

The concrete slab shall be placed on the prepared subbase to the depth and width as shown on the plans. The concrete shall be screeded to the finished grade and floated to a uniform surface using standard finishing techniques.

Low Temperature Placements: No concrete is to be placed when air temperature is below 50°F unless additional precautions are taken and prior approval is given by the Engineer. The Engineer must approve all placements below 50°F. No concrete will be placed on frozen subgrade or at temperatures below 20°F. Concrete exposed to temperatures below 40°F after placement must be protected through the use of insulating blankets, a six (6) inch layer of straw that is maintained in a dry condition by a covering of plastic sheeting, or other appropriate methods. Any concrete placed during cold weather that is damaged because of freezing shall be replaced at the Contractor's own expense.

A releasing agent shall be applied evenly to the surface. While the concrete is still in the plastic stage of set, the specified imprinting tools shall be applied to the surface in order to develop the desired patterned surface as indicated on the plans or specified by the Engineer. Once the concrete slab has reached initial cure, the releasing agent may be washed off with a normal garden hose. It is usually desirable to leave a certain amount of releasing agent in the imprint lines and textured areas to give a two-color effect, which is most desirable in stamped concrete surfaces.

The surface shall be cleaned of dirt, oil, gas and all other foreign material and allowed to dry completely before applying sealer per manufacturer's recommendations.

The Contractor shall have on the job, at all times, sufficient waterproof paper to provide complete coverage in the event of rain. Protect the surface if rain occurs before final set. If rain falls on the newly coated concrete before the curing film has dried sufficiently to resist damage, or if the film is damaged in any other manner, the contractor shall reapply same. Treated surfaces shall be protected from all foot or vehicular traffic for a sufficient period of time to prevent damage.

The Contractor shall protect newly poured concrete surfaces so as to prevent damage from falling objects, vandalism, etc. The Contractor shall repair or remove and replace any damaged or defaced concrete surface at his own expense. Determination to repair or remove and replace will be at the sole discretion of the Engineer.

The stamped concrete shall have a uniform and consistent color and pattern matching that of the approved test slab. Stamp patterns with respect to the joints to insure the stones in the pattern line up with the joint locations. Special procedures or stamping equipment is required to construct the pattern on the irregular shaped islands. The Contractor shall follow all manufacturers' recommendations unless otherwise directed by the Engineer.

A Pre-Placement meeting shall be held one week prior to concrete placement to discuss the project and application methods. It is strongly suggested that the Engineer, General Contractor, Subcontractor, concrete representative, and a manufacturer's representative are all present at the meeting.

Warranty:

For a minimum of 3 years but no more than 5 years post construction, The Contractor shall furnish and repair any defects of the stamped concrete. Defects include a stamped concrete surface showing pockets of varying color concrete degradation as a result of poor workmanship or poor material. Poor workmanship or material consists of any of the following characteristics; a concrete mix with water or air content outside manufacturer's specifications, 28-day minimum compressive strength less than 4500 psi, aggregate larger than 1/2", a concrete slump exceeding 5 inches, or excessive permeability. The Contractor shall furnish and repair all damaged sections resulting from poor workmanship or material, as directed by the Engineer, and at no cost to the State.

Article 4.01.04 - Method of Measurement: Delete Sections A & B in their entirety and add the following to Section C:

7. Stamped Concrete: This work will be measured by the actual number of square feet of stamped concrete completed and accepted.

There will be no measurement for payment for coloring agent, releasing agent, mat tools, joint sealer or filler, but the cost shall be considered as included in the contract unit price for the stamped concrete.

Test panels shall be included measured by the number of square feet of stamped concrete completed and accepted.

Article 4.01.05 - Basis of Payment: Add the following to Section C:

7. Stamped Concrete: This work will be paid for at the contract unit price per square foot for "Stamped Concrete," complete in place, which price shall include all PVC sleeves, welded wire fabric reinforcement, equipment, tools, materials and labor incidental thereto. The price shall also include concrete complete in place.

Pay Item	Pay Unit
Stamped Concrete	s.f.

ITEM #0755017A – GEOTEXTILE - HAZARDOUS WASTE

Description:

Under this Item, the Contractor shall procure and install suitable demarcation material within areas where asbestos contaminated soil (ACS) will remain as a permanent visual demarcation between remaining ACS and any clean backfill material.

Materials:

The selected geotextile shall be orange-colored synthetic fabric. Material may consist of woven fabric composed of high-tenacity monofilament polypropylene yarns (which are woven into a stable network such that the filaments retain their relative position), extruded polymer netting/fencing (e.g., safety fencing), or other suitable material that will effectively present a long-term, highly-visible indication if exposed through future disturbance.

The material shall be inert to biological degradation and naturally-encountered chemicals, alkalis, and acids, and shall be constructed to allow free drainage, such that infiltration from above the demarcation layer is not impeded.

Geotextile shall be protected from ultraviolet light exposure, precipitation or other inundation, mud, dirt, dust, puncture, cutting or any other damaging or deleterious conditions prior to installation. Geotextile rolls shall be shipped and stored in relatively opaque and watertight wrappings.

Construction Methods:

Prior to initiation of excavation activities, the Contractor shall submit to the Engineer the details, specifications, and/or cut sheet for the proposed geotextile material that will constitute the final warning/demarcation layer. In addition, the Contractor shall propose his proposed method of installing the warning layer. Details shall include proposed equipment, method/sequence, and means to secure the geotextile in-place prior to backfilling or other final installation. Note that general cross-sectional installation sequence of the geotextile, referred to as “Orange Warning Layer,” is provided in Drawing ENV-18 of the Project Plans.

Geotextile shall be installed in all excavations to separate the existing ACS and the concrete, conduit, clean backfill or other material installed by the Project.

Where multiple sections of the selected geotextile are required to cover the base of an excavation the Contractor shall overlap abutting sections sufficiently to ensure complete/continuous coverage and that fabric shifting will not create discontinuities during backfilling operations. Geotextile shall not extend to within 6” of the ground surface.

All geotextiles shall be weighted with sandbags or the equivalent, as needed. Such sandbags shall

be installed during placement and shall remain until backfilling is initiated.

Method of Measurement

The work of “GEOTEXTILE – HAZARDOUS WASTE” will be measured for payment as the actual surface area (in square yards) of orange warning layer geotextile installed in excavations within the specific intersections within the Project Limits as identified above. Measurements of installation shall be confirmed by the Engineer. Measurement for work and materials associated with this Item will include: all equipment, materials, tools and labor incidental to installation of permanent demarcation layer as indicated on the Project Plans.

Actual excavation, handling and management and/or disposal of excavated materials shall be paid under separate items. Backfill activities, equipment and materials shall also be paid under separate items.

Basis of Payment:

This work shall be paid for at the Contract lump sum price for “GEOTEXTILE - HAZARDOUS WASTE,” which shall include all equipment, materials, tools and labor incidental to supplying and installing suitable orange non-woven demarcation material in excavations within the ACS AOEC.

<u>Pay Item</u>	<u>Pay Unit</u>
Geotextile – Hazardous Waste	Square Yard

ITEM #0905019A – REMOVE AND REBUILD EXISTING STONE WALL

Section 9.05 is supplemented as follows:

Description: Under this item the Contractor shall remove and rebuild existing stone wall where shown on the plans, or in location as approved or directed by the Engineer. The Contractor shall be required to take existing condition photographs of stone wall and submit to Engineer prior to wall removal. The Contractor shall remove and stockpile stone from the existing wall to rebuild wall in same likeness and manner as existing condition, including, but not limited to: wall height, width, length as shown on plans or directed, stone placement and arrangement.

Materials: Stones for this work shall be sourced from removed and stockpiled stone from the existing stone wall. The stockpile location shall be on-site and approved by Engineer.

Method of Measurement: This work will be paid for on a lump sum basis, will not be measured for payment.


Basis of Payment: This work will be paid for at the Contract lump sum price for “Remove and Rebuild Existing Stone Wall” complete in place, which price shall include all materials, equipment, tools, labor and work incidental thereto. The lump sum shall include all stones, stockpiling of existing stones, photos of existing wall and conditions, and required excavation to reset foundation stones.

Pay Item	Pay Unit
Remove and Rebuild Existing Stone Wall	Lump Sum


ITEM #0921007A – SPECIAL CONCRETE SIDEWALK

[This special provision is for the Town of Westport Intersection #158-213.]

Description: This item shall consist of furnishing and installing brick sidewalk ramps constructed on a concrete base in the locations shown on the plans and as detailed below.

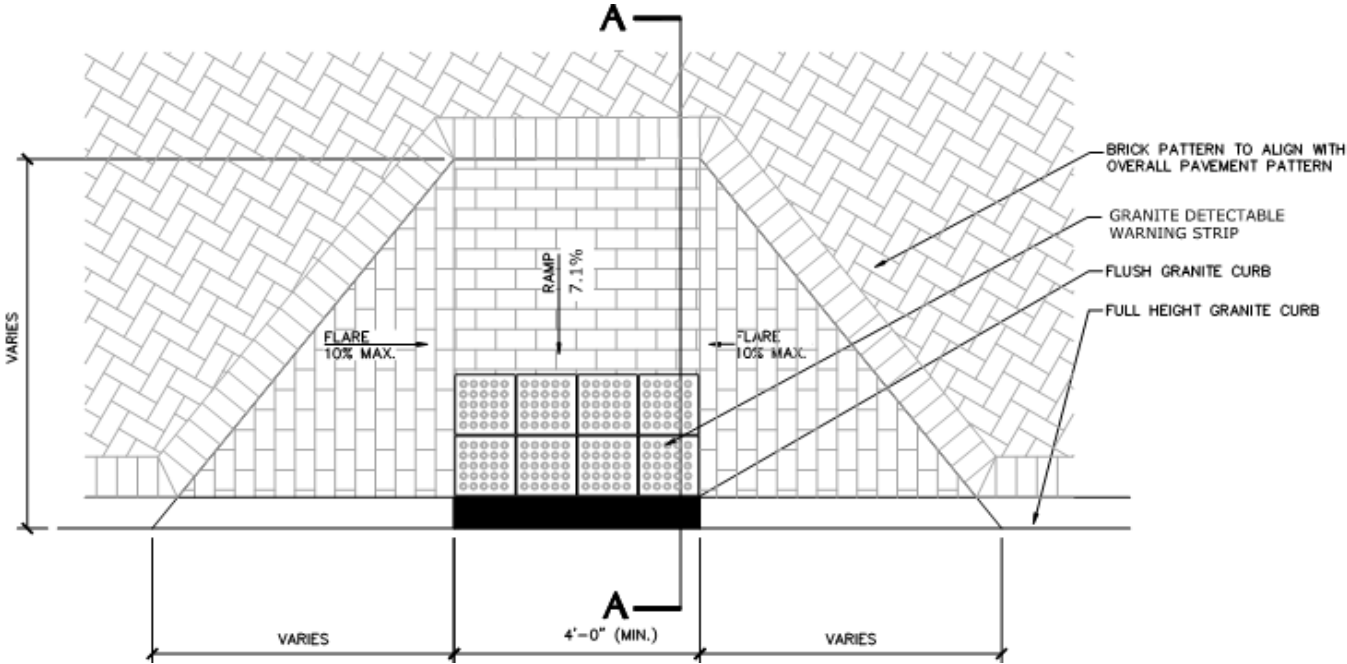

DECORATIVE HANDICAP RAMP
TYPICAL SECTION - NOT TO SCALE

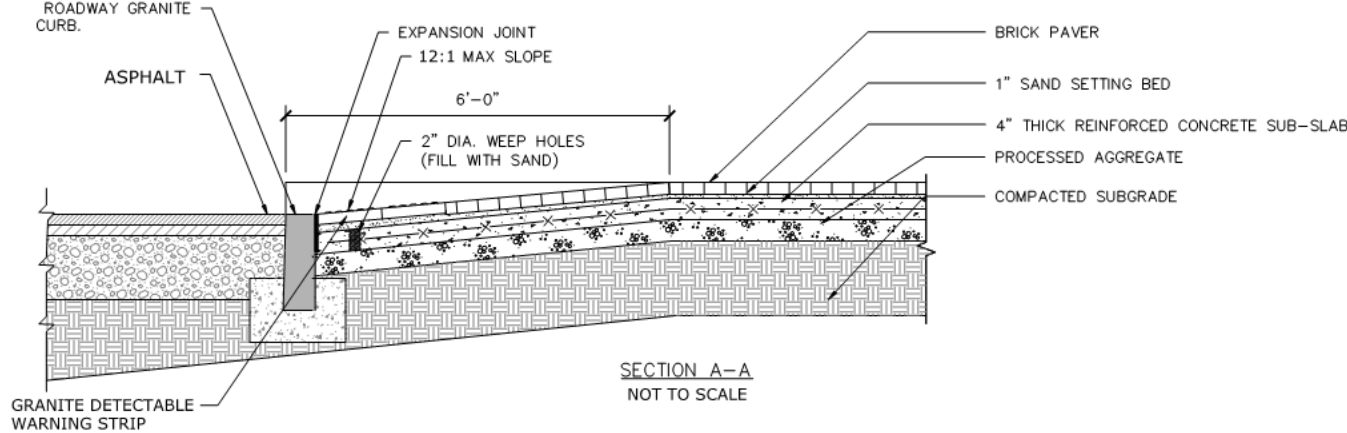

Materials: Materials for this work shall meet the requirements of Article M.03.01 for Class "F" Concrete.

ITEM #0921007A

Gravel base shall meet the requirements of Article M.02.01 for granular fill. Leveling base material shall be concrete sand conforming to ASTM C-33 for fine aggregates.

Detectable warning strip shall be made from prefabricated "Sierra White" granite truncated dome detectable warning pad by Cold Spring Granite, or approved equivalent, Cold Spring Granite, 17482 Granite West Road, Cold Spring, MN 56320.

Construction Methods: The existing bricks at the location of the proposed handicap ramp shall be removed and reused for the new handicap ramp (refer to Item #0925101A – Relay Brick Walk). Any additional bricks required shall match the existing bricks in kind.

A 2" weep hole shall be provided 3" from the back side of the curb no more than 3' apart through the 4" concrete base for drainage and filled with sand.

The curb, sidewalk and ramp shall be installed in the pattern shown, on a prepared base to the lines and grades acceptable to the Engineer. Handicap ramp shall be Type 2 (Perpendicular Sidewalk Ramp); refer to Drawing Title "Sidewalk Ramps Sheet 1". The detectable warning strip shall be installed as recommended by the manufacturer, in the location and orientation shown.

Method of Measurement: This work will be measured for payment as follows:

1. Special Concrete Sidewalk: This work will be measured by the actual quantity of square feet completed and accepted. The square foot measurement will include ramps.
2. Excavation: Excavation below the finished grade of Special Concrete Sidewalk, backfilling, and disposal of surplus material will not be measured for payment, but the cost shall be included in the price bid for Special Concrete Sidewalk. Excavation above the finished grade of the concrete will be measured and paid for as roadway excavation.
3. Gravel base: This work will not be measured for payment but the cost shall be considered as included in the price bid for Special Concrete Sidewalk or Sidewalk Ramp.
4. Detectable Warning Strip: The detectable warning strip will be measured for payment by the actual number of each ramp where a detectable warning strip has been installed and accepted regardless of the number of tiles installed.

Basis of Payment: This work will be paid for at the Contract unit price per square foot for "Special Concrete Sidewalk," complete in place, which price shall include all excavation as specified above, backfilling, disposal of surplus material, expansion joint fillers, gravel base, any monolithic sidewalk curb when required, equipment, tools, material and labor incidental thereto.

A new detectable warning strip will be paid for at the Contract unit price for "Detectable Warning Strip" at each ramp where the detectable warning strip has been installed complete in place. This price shall include all tiles, materials, equipment, tools and labor incidental thereto.

Pay Item
Special Concrete Sidewalk

Pay Unit
s.f.

ITEM #0921007A

ITEM #0925101A – RELAY BRICK WALK

Description:

Work under this item shall consist of removing and reconstructing brick walk which has been disturbed by excavation at the locations shown on the plans or as directed by the Engineer in conformance with these specifications.

Materials:

Gravel for base shall conform to Article M.02.01 for gravel fill. Leveling base material shall be concrete sand conforming to ASTM C-33 for fine aggregates or No. 10 as shown in AASHTO M 43-54 (1974) as specified in table II.

Construction Methods:

Existing bricks shall be carefully removed. If any bricks are broken during removal, the Contractor shall be responsible for replacing them. Upon reconstruction of the brick walk, all soft and yielding material and other portions of the subbase which will not readily compact shall be removed and replaced with suitable materials. The surface of the subbase shall be compacted with mechanical equipment capable of delivering a ground pressure of not less than 300 pounds per linear inch (54 kilograms per linear centimeter) of contact width. The amount of compaction shall be as specified by the Engineer but in no case shall that amount be less than four complete passes of the compacting equipment. The dry density after compaction shall conform to Article 2.02.03-6 of the standard specifications, Form 817. After compaction, the subbase shall be trued to the required line and grade. No additional payment will be made for any materials which are required to bring the subbase to the lines, grade and cross-sections of the site. The Contractor shall protect the subbase from damage by exercising such precautions as the Engineer deems necessary. The subbase surface shall be maintained in such condition as to permit proper drainage. It shall be checked and approved prior to placement of the leveling base. The leveling base shall be screeded loose to a thickness of approximately 2" (50mm). The leveling shall be treated with a soil sterilizer, of a type to be approved by the Engineer, prior to the placement of the bricks. The exact thickness of the leveling base is to be determined at the job site.

Care shall be taken by the Contractor to insure the screeded leveling base is loose and undisturbed placement. Bricks are to be installed "Hand-tight" with care being taken not to disturb the leveling bed. Mason string lines shall be used to insure proper lines and grades. Bricks are to be vibrated into the leveling base with a vibratory plate capable of achieving a 3500 to 5000 pounds (1590 to 2268 kilograms) compaction force. Such vibratory compaction shall be accomplished on all bricks prior to the end of operations on each working day. Compaction of the bricks shall continue until finish grade, as directed by the Engineer, is achieved. All joints shall be filled after final compaction with the same material used for the leveling base.

Method of Measurement:

This work will be measured for payment by the actual number of square feet (square meters) of complete and accepted relayed brick walk.

Basis of Payment:

This work will be paid for at the contract unit price per square foot (square meter) for "Relay Brick Walk" complete and accepted in place which price shall include removing, storing and reconstruction of Brick Walk and all material, labor, equipment and work incidental thereto.

Pay Item

Relay Brick Walk

Pay Unit

s.f. (m)

ITEM #0952001A – SELECTIVE CLEARING AND THINNING

Section 9.52 is amended as follows:

Article 9.52.03 – Construction Methods is supplemented as follows:

Where directed by the Engineer, materials to be cut, trimmed or removed shall be those items that restrict visibility to traffic signal heads, or the installation of traffic signal equipment. The signal heads shall be visible for a minimum of 500 feet.

All trees scheduled to be removed shall be visibly marked or flagged by the Contractor at least seven days prior to the cutting of such trees.

The Engineer will inspect the identified trees and verify the limits of clearing and thinning prior to the Contractor proceeding with his cutting operation.

ITEM #0969062A – CONSTRUCTION FIELD OFFICE, MEDIUM

Description: Under the item included in the bid document, adequate weatherproof office quarters with related furnishings, materials, equipment and other services, shall be provided by the Contractor for the duration of the work, and if necessary, for a close-out period determined by the Engineer. The office, furnishings, materials, equipment, and services are for the exclusive use of CTDOT forces and others who may be engaged to augment CTDOT forces with relation to the Contract. The office quarters shall be located convenient to the work site and installed in accordance with Article 1.08.02. This office shall be separated from any office occupied by the Contractor. Ownership and liability of the office quarters shall remain with the Contractor.

Furnishings/Materials/Supplies/Equipment: All furnishings, materials, equipment and supplies shall be in like new condition for the purpose intended and require approval of the Engineer.

Office Requirements: The Contractor shall furnish the office quarters and equipment as described below:

Description \ Office Size	Small	Med.	Large	Extra Large
Minimum Sq. Ft. of floor space with a minimum ceiling height of 7 ft.	400	400	1000	2000
Minimum number of exterior entrances.	2	2	2	2
Minimum number of parking spaces.	7	7	10	15

Office Layout: The office shall have a minimum square footage as indicated in the table above, and shall be partitioned as shown on the building floor plan as provided by the Engineer.

Tie-downs and Skirting: Modular offices shall be tied-down and fully skirted to ground level.

Lavatory Facilities: For field offices sizes Small and Medium the Contractor shall furnish a toilet facility at a location convenient to the field office for use by CTDOT personnel and such assistants as they may engage; and for field offices sizes Large and Extra Large the Contractor shall furnish two (2) separate lavatories with toilet (men and women), in separately enclosed rooms that are properly ventilated and comply with applicable sanitary codes. Each lavatory shall have hot and cold running water and flush-type toilets. For all facilities the Contractor shall supply lavatory and sanitary supplies as required.

Windows and Entrances: The windows shall be of a type that will open and close conveniently, shall be sufficient in number and size to provide adequate light and ventilation, and shall be fitted with locking devices, blinds and screens. The entrances shall be secure, screened, and fitted with a lock for which four keys shall be furnished. All keys to the construction field office shall be furnished to the CTDOT and will be kept in their possession while State personnel are using the office. Any access to the entrance ways shall meet applicable building codes, with appropriate handrails. Stairways shall be ADA/ABA compliant and have non-skid tread surfaces. An ADA/ABA compliant ramp with non-skid surface shall be provided with the Extra-Large field office.

Lighting: The Contractor shall equip the office interior with electric lighting that provides a minimum illumination level of 100 foot-candles at desk level height, and electric outlets for each desk and drafting table. The Contractor shall also provide exterior lighting that provides a minimum illumination level of 2 foot-candles throughout the parking area and for a minimum distance of 10 ft. on each side of the field office.

Parking Facility: The Contractor shall provide a parking area, adjacent to the field office, of sufficient size to accommodate the number of vehicles indicated in the table above. If a paved parking area is not readily available, the Contractor shall construct a parking area and driveway consisting of a minimum of 6 inches of processed aggregate base graded to drain. The base material will be extended to the office entrance.

Field Office Security: Physical Barrier Devices - This shall consist of physical means to prevent entry, such as: 1) All windows shall be barred or security screens installed; 2) All field office doors shall be equipped with dead bolt locks and regular day operated door locks; and 3) Other devices as directed by the Engineer to suit existing conditions.

Electric Service: The field office shall be equipped with an electric service panel, wiring, outlets, etc., to serve the electrical requirements of the field office, including: lighting, general outlets, computer outlets, calculators etc., and meet the following minimum specifications:

- A. 120/240 volt, 1 phase, 3 wire
- B. Ampacity necessary to serve all equipment. Service shall be a minimum 100 amp dedicated to the construction field office.
- C. The electrical panel shall include a main circuit breaker and branch circuit breakers of the size and quantity required.
- D. Additional 120 volt, single phase, 20 amp, isolated ground dedicated power circuit with dual NEMA 5-20 receptacles will be installed at each desk and personal computer table (workstation) location.
- E. Additional 120 volt, single phase, 20 amp, isolated ground dedicated power circuit with dual NEMA 5-20 receptacles will be installed, for use by the Telephone Company.
- F. Additional 120-volt circuits and duplex outlets as required meeting National Electric Code requirements.
- G. One exterior (outside) wall mounted GFI receptacle, duplex, isolated ground, 120 volt, straight blade.
- H. After work is complete and prior to energizing, the State's CTDOT electrical inspector, must be contacted at 860-594-2240. (Do Not Call Local Town Officials)
- I. Prior to field office removal, the CTDOT Office of Information Systems (CTDOT OIS) must be notified to deactivate the communications equipment.

Heating, Ventilation and Air Conditioning (HVAC): The field office shall be equipped with sufficient heating, air conditioning and ventilation equipment to maintain a temperature range of 68°-80° Fahrenheit within the field office.

Telephone Service: The Contractor shall provide telephone service with unlimited nation-wide calling plan. For a Small, Medium and Large field office this shall consist of the installation of two (2) telephone lines: one (1) line for phone/voice service and one (1) line dedicated for the facsimile machine. For an Extra-Large field office this shall consist of four (4) telephone lines: three (3) lines for phone/voice service and one (1) line dedicated for facsimile machine. The Contractor shall pay all charges.

Data Communications Facility Wiring: Contractor shall install a Category 6 568B patch panel in a central wiring location and Cat 6 cable from the patch panel to each PC station, Smart Board location, Multifunction Laser Printer/Copier/Scanner/Fax, terminating in a (Category 6 568B) wall or surface mount data jack. The central wiring location shall also house either the data circuit with appropriate power requirements or a category 5 cable run to the location of the installed data circuit. The central wiring location will be determined by the CTDOT OIS staff in coordination with the designated field office personnel as soon as the facility is in place.

For Small, Medium and Large field offices the Contractor shall run a CAT 6 LAN cable a minimum length of 25 feet for each CTDOT networked device (including but not limited to: smartboards and Multi-Function Laser Printer/Copier/Scanner/Fax) to LAN switch area leaving an additional 10 feet of cable length on each side with terminated RJ45 connectors. For an Extra-Large field office the Contractor shall run CAT 6 LAN cables from workstations, install patch panel in data circuit demark area and terminate runs with RJ45 jacks at each device location. Terminate runs to patch panel in LAN switch area. Each run / jack shall be clearly labeled with an identifying Jack Number.

The Contractor shall supply cables to connect the Wi-Fi printer to the Contractor supplied internet router and to workstations/devices as needed. These cables shall be separate from the LAN cables and data Jacks detailed above for the CTDOT network.

The number of networked devices anticipated shall be at least equal to the number of personal computer tables, Multi-Function Laser Printer/Copier/Scanner/Fax, and smartboards listed below.

The installation of a data communication circuit between the field office and the CTDOT OIS in Newington will be coordinated between the CTDOT District staff, CTDOT OIS staff and the local utility company once the Contractor supplies the field office phone numbers and anticipated installation date. The Contractor shall provide the field office telephone number(s) to the CTDOT Project Engineer within 10 calendar days after the signing of the Contract as required by Article 1.08.02. This is required to facilitate data line and computer installations.

Additional Equipment, Facilities and Services: The Contractor shall provide at the field Office at least the following to the satisfaction of the Engineer:

Furnishing Description	Office Size			
	Small	Med.	Large	Extra Large
	Quantity			
Office desk (2.5 ft. x 5 ft.) with drawers, locks, and matching desk chair that have pneumatic seat height adjustment and dual wheel casters on the base.	1	3	5	8
Standard secretarial type desk and matching desk chair that has pneumatic seat height adjustment and dual wheel casters on the base.	-	-	-	1
Personal computer tables (4 ft. x 2.5 ft.).	2	3	5	8
Drafting type tables (3 ft. x 6 ft.) and supported by wall brackets and legs; and matching drafters stool that have pneumatic seat height adjustment, seat back and dual wheel casters on the base.	1	1	1	2
Conference table, 3 ft. x 12 ft.	-	-	-	1
Table – 3 ft. x 6 ft.	-	-	-	1
Office Chairs.	2	4	8	20
Mail slot bin – legal size.	-	-	1	1
Non-fire resistant cabinet.	-	-	2	4
Fire resistant cabinet (legal size/4 drawer), locking.	1	1	2	3
Storage racks to hold 3 ft. x 5 ft. display charts.	-	-	1	2
Vertical plan racks for 2 sets of 2 ft. x 3 ft. plans for each rack.	1	1	2	2
Double door supply cabinet with 4 shelves and a lock – 6 ft. x 4 ft.	-	-	1	2
Case of cardboard banker boxes (Min 10 boxes/case)	1	1	2	3
Open bookcase – 3 shelves – 3 ft. long.	-	-	2	2
White Dry-Erase Board, 36" x 48" min. with markers and eraser.	1	1	1	1
Interior partitions – 6 ft. x 6 ft., soundproof type, portable and freestanding.	-	-	6	6
Coat rack with 20 coat capacity.	-	-	-	1
Wastebaskets - 30 gal., including plastic waste bags.	1	1	1	2
Wastebaskets - 5 gal., including plastic waste bags.	1	3	6	10
Electric wall clock.	-	-	-	2
Telephone.	1	1	1	-
Full size stapler 20 (sheet capacity, with staples)	1	2	5	8
Desktop tape dispensers (with Tape)	1	2	5	8
8 Outlet Power Strip with Surge Protection	3	4	6	9
Rain Gauge	1	1	1	1
Business telephone system for three lines with ten handsets, intercom capability, and one speaker phone for conference table.	-	-	-	1
Mini refrigerator - 3.2 c.f. min.	1	1	1	1

Hot and cold water dispensing unit. Disposable cups and bottled water shall be supplied by the Contractor for the duration of the project.	1	1	1	1
Microwave, 1.2 c.f. , 1000W min.	1	1	1	1
Fire extinguishers - provide and install type and *number to meet applicable State and local codes for size of office indicated, including a fire extinguisher suitable for use on a computer terminal fire.	*	*	*	*
Electric pencil sharpeners.	1	2	2	2
Electronic office type printing calculators capable of addition, subtraction, multiplication and division with memory and a supply of printing paper.	1	1	2	4
Small Multi-Function Laser Printer/Copier/Scanner/Fax combination unit, network capable, as specified below under <u>Computer Related Hardware and Software</u> .	1	1		
Large Multi-Function Laser Printer/Copier/Scanner/Fax combination unit, network capable, as specified below under <u>Computer Related Hardware and Software</u> .			1	1
Field Office Wi-Fi Connection as specified below under <u>Computer Related Hardware and Software</u>	1	1	1	1
Wi-Fi Printer as specified below under <u>Computer Related Hardware and Software</u> .	1	1	1	1
Digital Camera as specified below under <u>Computer Related Hardware and Software</u> .	1	1	3	3
Video Projector as specified below under <u>Computer Related Hardware and Software</u> .	-	-	-	1
Smart Board as specified below under <u>Computer Related Hardware and Software</u> .	-	-	-	1
Infrared Thermometer, including annual third party certified calibration, case, and cleaning wipes.	1	1	1	2
Concrete Curing Box as specified below under Concrete Testing Equipment.	1	1	1	1
Concrete Air Meter and accessories as specified below under Concrete Testing Equipment as specified below. Contractor shall provide third party calibration on a quarterly basis.	1	1	1	1
Concrete Slump Cone and accessories as specified below under Concrete Testing Equipment.	1	1	1	1
First Aid Kit	1	1	1	1
Flip Phones as specified under <u>Computer Related Hardware and Software</u> .	-	-	-	-
Smart Phones as specified under <u>Computer Related Hardware and Software</u> .	-	-	-	-

The furnishings and equipment required herein shall remain the property of the Contractor. Any supplies required to maintain or operate the above listed equipment or furnishings shall be provided by the Contractor for the duration of the project.

Computer Related Hardware and Software: The CTDOT will supply by its own means the actual Personal Computers for the CTDOT representatives. The Contractor shall supply the Field Office Wi-Fi Connection, Wi-Fi Printer, Digital Camera(s), Flip Phones, Smart Phones, Multifunction Laser Printer/Copier/Scanner/Fax, Video Projectors, and Smart Board(s) as well as associated hardware and software, must meet the requirements of this specification as well as the latest minimum specifications posted, as of the project advertising date, at CTDOTs web site <http://www.ct.gov/dot/cwp/view.asp?a=1410&q=563904>

Within 10 calendar days after the signing of the Contract but before ordering/purchasing the Wi-Fi Printer (separate from the Multifunction Laser Printer/Copier/Scanner/Fax), Field Office Wi-Fi, Digital Camera(s), Flip Phones, Smart Phones, Multifunction Laser Printer/Copier/Scanner/Fax, Video Projector(s) and Smart Board(s) as well as associated hardware, the Contractor must submit a copy of their proposed order(s) with catalog cuts and specifications to the Administering CTDOT District for review and approval. The Wi-Fi Printer, Wi-Fi Router, Flip Phones, Smart Phones, digital cameras, Projector(s) and Smart Board(s) will be reviewed by CTDOT District personnel. The Multifunction Laser Printer/Copier/Scanner/Fax will be reviewed by the CTDOT OIS. The Contractor shall not purchase the hardware, software, or services until the Administering CTDOT District informs them that the proposed equipment, software, and services are approved. The Contractor will be solely responsible for the costs of any hardware, software, or services purchased without approval.

The Contractor and/or their internet service provider shall be responsible for the installation and setup of the field office Wi-Fi, Wi-Fi printer, and the configuration of the wireless router as directed by the CTDOT. Installation will be coordinated with CTDOT District and Project personnel.

After the approval of the hardware and software, the Contractor shall contact the designated representatives of the CTDOT administering District, a minimum of 2 working days in advance of the proposed delivery or installation of the Field Office Wi-Fi Connection, Wi-Fi Printer, Digital Camera(s), Flip Phones, Smart Phones, Multifunction Laser Printer/Copier/Scanner/Fax, Video Projectors and Smart Board(s), as well as associated hardware, software, supplies, and support documentation.

The Contractor shall provide all supplies, paper, maintenance, service and repairs (including labor and parts) for the Wi-Fi printers, copiers, field office Wi-Fi, fax machines and other equipment and facilities required by this specification for the duration of the Contract. All repairs must be performed with-in 48 hours. If the repairs require more than a 48 hours then an equal or better replacement must be provided.

Once the Contract has been completed, the hardware and software will remain the property of the Contractor.

First Aid Kit: The Contractor shall supply a first aid kit adequate for the number of personnel expected based on the size of the field office specified and shall keep the first aid kit stocked for the duration that the field office is in service.

Rain Gauge: The Contractor shall supply install and maintain a rain gauge for the duration of the project, meeting these minimum requirements. The rain gauge shall be installed on the top of a post such that the opening of the rain gauge is above the top of the post an adequate distance to avoid splashing of rain water from the top of the post into the rain gauge. The Location of the rain gauge and post shall be approved by the Engineer. The rain gauge shall be made of a durable material and have graduations of 0.1 inches or less with a minimum total column height of 5 inches. If the rain gauge is damaged the Contractor shall replace it prior to the next forecasted storm event at no additional cost.

Concrete Testing Equipment: If the Contract includes items that require compressive strength cylinders for concrete, in accordance with the Schedule of Minimum Testing Requirements for Sampling Materials for Test, the Contractor shall provide the following equipment.

- A) Concrete Cylinder Curing Box – meeting the requirements of Section 6.12 of the Standard Specifications.
- B) Air Meter – The air meter provided shall be in good working order and meet the requirements of AASHTO T 152.
- C) Slump Cone Mold – Slump cone, base plate, and tamping rod shall be provided in like-new condition and meet the requirements of AASHTO T119, Standard Test Method for Slump of Hydraulic-Cement Concrete.

All testing equipment will remain the property of the Contractor at the completion of the project.

Insurance Policy: The Contractor shall provide a separate insurance policy, with no deductible, in the minimum amount of five thousand dollars (\$5,000) in order to insure all State-owned data equipment and supplies used in the office against all losses. The Contractor shall be named insured on that policy, and the CTDOT shall be an additional named insured on the policy. These losses shall include, but not be limited to: theft, fire, and physical damage. The CTDOT will be responsible for all maintenance costs of CTDOT owned computer hardware. In the event of loss, the Contractor shall provide replacement equipment in accordance with current CTDOT equipment specifications, within seven days of notice of the loss. If the Contractor is unable to provide the required replacement equipment within seven days, the CTDOT may provide replacement equipment and deduct the cost of the equipment from monies due or which may become due the Contractor under the Contract or under any other contract. The Contractor's financial liability under this paragraph shall be limited to the amount of the insurance coverage required by this paragraph. If the cost of equipment replacement required by this paragraph should exceed the required amount of the insurance coverage, the CTDOT will reimburse the Contractor for replacement costs exceeding the amount of the required coverage.

Maintenance: During the occupancy by the CTDOT, the Contractor shall maintain all facilities and furnishings provided under the above requirements, and shall maintain and keep the office

quarters clean through the use of weekly professional cleaning to include, but not limited to, washing & waxing floors, cleaning restrooms, removal of trash, etc. Exterior areas shall be mowed and clean of debris. A trash receptacle (dumpster) with weekly pickup (trash removal) shall be provided. Snow removal, sanding and salting of all parking, walkway, and entrance ways areas shall be accomplished during a storm if on a workday during work hours, immediately after a storm and prior to the start of a workday. If snow removal, salting and sanding are not completed by the specified time, the State will provide the service and all costs incurred will be deducted from the next payment estimate.

Method of Measurement: The furnishing and maintenance of the construction field office will be measured for payment by the number of calendar months that the office is in place and in operation, rounded up to the nearest month.

There will not be any price adjustment due to any change in the minimum computer related hardware and software requirements.

Basis of Payment: The furnishing and maintenance of the Construction Field Office will be paid for at the Contract unit price per month for “Construction Field Office, (Type),” which price shall include all material, equipment, labor, service contracts, licenses, software, repair or replacement of hardware and software, related supplies, utility services, parking area, external illumination, trash removal, snow and ice removal, and work incidental thereto, as well as any other costs to provide requirements of this specified this specification.

<u>Pay Item</u>	<u>Pay Unit</u>
Construction Field Office, Medium	Month

ITEM #0971001A – MAINTENANCE AND PROTECTION OF TRAFFIC

Article 9.71.01 – Description is supplemented by the following:

The Contractor shall maintain and protect traffic as described by the following and as limited in the Special Provision "Prosecution and Progress":

Ramps and Turning Roadways

The Contractor shall maintain and protect existing traffic operations.

Excepted therefrom will be those periods, during the allowable periods, when the Contractor is actively working, at which time the Contractor shall be allowed to maintain and protect a minimum of one lane of traffic, on a paved travel path not less than 12 feet in width.

City of Bridgeport – Route 730 at Intersection 015-267

Town of East Haven – Route 100 at Intersection 043-221

Town of Fairfield – U.S. Route 1 at Intersections 050-201 and 050-207

Town of Madison – U.S. Route 1 at Intersections 075-204 and 075-220

City of Milford – Route 162 at Intersections 083-237 and 083-244

City of New Haven – Route 80 and Route 103 at Intersection 092-241; Route 80 at Intersection 092-242

Town of North Haven – U.S. Route 5, Route 22, and Route 103 at Intersection 100-205

Town of Stratford – U.S. Route 1 at Intersections 138-201, 138-240, 138-241, 138-242 and 138-276; Route 110 at Intersection 138-250

City of West Haven – Route 162 at Intersections 156-212 156-218

Town of Westport – U.S. Route 1 at Intersection 158-213

The Contractor shall maintain and protect existing traffic operations.

Excepted therefrom will be those periods, during the allowable periods when the Contractor is actively working, at which time, the Contractor shall maintain and protect a minimum of one lane of traffic in each direction, each lane on a paved travel path not less than 11 feet in width.

Excepted therefrom will be those periods, during the allowable periods, when the Contractor is actively working on installing spans or mast arms, at which time the Contractor will be allowed to halt traffic for a period not to exceed ten minutes. The Contractor shall allow all stored vehicles to proceed through the work area before halting traffic for another ten-minute period.

All Other Roadways

The Contractor shall maintain and protect a minimum of one lane of traffic in each direction, each lane on a paved travel path not less than 11 feet in width.

Excepted therefrom will be those periods, during the allowable periods, when the Contractor is actively working, at which time the Contractor shall maintain and protect at least an alternating one-way traffic operation, on a paved travel path not less than 11 feet in width. The length of the alternating one-way traffic operation shall not exceed 300 feet and there shall be no more than one alternating one-way traffic operation within the project limits without prior approval of the Engineer.

Commercial and Residential Driveways

The Contractor shall maintain access to and egress from all commercial and residential driveways throughout the project limits. The Contractor will be allowed to close said driveways to perform the required work during those periods when the businesses are closed, unless permission is granted from the business owner to close the driveway during business hours. If a temporary closure of a residential driveway is necessary, the Contractor shall coordinate with the owner to determine the time period of the closure.

Intermediate Term Sidewalk Closures

The Contractor shall maintain and protect existing pedestrian accommodations, or a minimum of 4 feet in width, on all existing sidewalks, sidewalk ramps, and access to pedestrian pushbuttons. Except during the allowable periods when the Contractor is actively working, the Contractor will be allowed to close pedestrian sidewalks and sidewalk ramps and restrict access to pedestrian pushbuttons for no longer than a continuous 48 hour period for the purpose of constructing pedestrian amenities or installation of signal equipment. No more than two corners of an intersection may be closed for an intermediate term sidewalk closure at any time. Where all four corners of an intersection have sidewalks and sidewalk ramps, diagonal corners shall not be closed at the same time. During the intermediate term sidewalk closure, all approaches to the sidewalk shall be blocked by construction barricades with Sidewalk Closed signs. The construction barricades shall conform to the following:

- Have continuous detectable bottom and top surfaces able to be detected by a person with a visual disability traveling with the aid of a long cane
- The bottom of the bottom surface shall be no higher than 2 inches above the ground
- The top of the top surface shall be no lower than 32 inches above the ground.

Traffic control signals with pedestrian phases located within 50 feet of an intermediate term sidewalk or sidewalk ramp closure shall be revised during the duration of the closure to automatically activate the pedestrian phase in every signal cycle. Intermediate term sidewalk closures may be extended to 72 hours with prior approval of the Engineer.

Article 9.71.03 - Construction Method is supplemented as follows:

General

Unpaved travel paths will only be permitted for areas requiring full depth and full width reconstruction, in which case, the Contractor will be allowed to maintain traffic on processed aggregate for a duration not to exceed 10 calendar days. The unpaved section shall be the full width of the road and perpendicular to the travel lanes. Opposing traffic lane dividers shall be used as a centerline.

The Contractor is required to delineate any raised structures within the travel lanes, so that the structures are visible day and night, unless there are specific contract plans and provisions to temporarily lower these structures prior to the completion of work.

The Contractor shall schedule operations so that pavement removal and roadway resurfacing shall be completed full width across a roadway (bridge) section by the end of a workday (work night), or as directed by the Engineer.

When the installation of all intermediate courses of bituminous concrete pavement is completed for the entire roadway, the Contractor shall install the final course of bituminous concrete pavement.

When the Contractor is excavating adjacent to the roadway, the Contractor shall provide a 3-foot shoulder between the work area and travel lanes, with traffic drums spaced every 50 feet. At the end of the workday, if the vertical drop-off exceeds 3 inches, the Contractor shall provide a temporary traversable slope of 4:1 or flatter that is acceptable to the Engineer.

The Contractor, during the course of active construction work on overhead signs and structures, shall close the lanes directly below the work area for the entire length of time overhead work is being undertaken. At no time shall an overhead sign be left partially removed or installed.

If applicable, when an existing sign is removed, it shall be either relocated or replaced by a new sign during the same working day.

The Contractor shall not store any material on-site which would present a safety hazard to motorists or pedestrians (e.g. fixed object or obstruct sight lines).

The field installation of a signing pattern shall constitute interference with existing traffic operations and shall not be allowed, except during the allowable periods.

Construction vehicles entering travel lanes at speeds less than the posted speed are interfering with traffic, and shall not be allowed without a lane closure. The lane closure shall be of sufficient length to allow vehicles to enter or exit the work area at posted speeds, in order to merge with existing traffic.

Existing Signing

The Contractor shall maintain all existing overhead and side-mounted signs throughout the project limits during the duration of the project. The Contractor shall temporarily relocate signs and sign supports as many times as deemed necessary, and install temporary sign supports if necessary and as directed by the Engineer.

Requirements for Winter

The Contractor shall schedule a meeting with representatives from the Department including the offices of Maintenance and Traffic, and the Town/City to determine what interim traffic control measures the Contractor shall accomplish for the winter to provide safety to the motorists and permit adequate snow removal procedures. This meeting shall be held prior to October 31 of each year and will include, but not be limited to, discussion of the status and schedule of the following items: lane and shoulder widths, pavement restoration, traffic signal work, pavement markings, and signing.

Signing Patterns

The Contractor shall erect and maintain all signing patterns in accordance with the traffic control plans contained herein. Proper distances between advance warning signs and proper taper lengths are mandatory.

Pavement Markings -Non-Limited Access Multilane Roadways Secondary and Local Roadways

During construction, the Contractor shall maintain all pavement markings on paved surfaces on all roadways throughout the limits of the project.

Interim Pavement Markings

The Contractor shall install painted pavement markings, which shall include centerlines, edge lines, lane lines (broken lines), lane-use arrows, and stop bars, on each intermediate course of bituminous concrete pavement and on any milled surface by the end of the work day/night. If the next course of bituminous concrete pavement will be placed within seven days, edge lines are not required. The painted pavement markings will be paid under the appropriate items.

If the Contractor will install another course of bituminous concrete pavement within 24 hours, the Contractor may install Temporary Plastic Pavement Marking Tape in place of the painted pavement markings by the end of the work day/night. These temporary pavement markings shall include centerlines, lane lines (broken lines) and stop bars; edge lines are not required. Centerlines shall consist of two 4 inch wide yellow markings, 2 feet in length, side by side, 4 to 6 inches apart, at 40-foot intervals. No passing zones should be posted with signs in those areas where the final centerlines have not been established on two-way roadways. Stop bars may consist of two 6 inch wide white markings or three 4 inch wide white markings placed side by

side. The Contractor shall remove and dispose of the Temporary Plastic Pavement Marking Tape when another course of bituminous concrete pavement is installed. The cost of furnishing, installing and removing the Temporary Plastic Pavement Marking Tape shall be at the Contractor's expense.

If an intermediate course of bituminous concrete pavement will be exposed throughout the winter, then Epoxy Resin Pavement Markings should be installed unless directed otherwise by the Engineer.

Final Pavement Markings

The Contractor should install painted pavement markings on the final course of bituminous concrete pavement by the end of the work day/night. If the painted pavement markings are not installed by the end of the work day/night, then Temporary Plastic Pavement Marking Tape shall be installed as described above and the painted pavement markings shall be installed by the end of the work day/night on Friday of that week.

If Temporary Plastic Pavement Marking Tape is installed, the Contractor shall remove and dispose of these markings when the painted pavement markings are installed. The cost of furnishing, installing and removing the Temporary Plastic Pavement Marking Tape shall be at the Contractor's expense.

The Contractor shall install permanent Epoxy Resin Pavement Markings in accordance with Section 12.10 entitled "Epoxy Resin Pavement Markings, Symbols, and Legends" after such time as determined by the Engineer.

TRAFFIC CONTROL DURING CONSTRUCTION OPERATIONS

The following guidelines shall assist field personnel in determining when and what type of traffic control patterns to use for various situations. These guidelines shall provide for the safe and efficient movement of traffic through work zones and enhance the safety of work forces in the work area.

TRAFFIC CONTROL PATTERNS

Traffic control patterns shall be used when a work operation requires that all or part of any vehicle or work area protrudes onto any part of a travel lane or shoulder. For each situation, the installation of traffic control devices shall be based on the following:

- Speed and volume of traffic
- Duration of operation
- Exposure to hazards

Traffic control patterns shall be uniform, neat and orderly so as to command respect from the motorist.

In the case of a horizontal or vertical sight restriction in advance of the work area, the traffic control pattern shall be extended to provide adequate sight distance for approaching traffic.

If a lane reduction taper is required to shift traffic, the entire length of the taper should be installed on a tangent section of roadway so that the entire taper area can be seen by the motorist.

Any existing signs that are in conflict with the traffic control patterns shall be removed, covered, or turned so that they are not readable by oncoming traffic.

When installing a traffic control pattern, a Buffer Area should be provided and this area shall be free of equipment, workers, materials and parked vehicles.

Typical traffic control plans 19 through 25 may be used for moving operations such as line striping, pot hole patching, mowing, or sweeping when it is necessary for equipment to occupy a travel lane.

Traffic control patterns will not be required when vehicles are on an emergency patrol type activity or when a short duration stop is made and the equipment can be contained within the shoulder. Flashing lights and appropriate trafficperson shall be used when required.

Although each situation must be dealt with individually, conformity with the typical traffic control plans contained herein is required. In a situation not adequately covered by the typical traffic control plans, the Contractor must contact the Engineer for assistance prior to setting up a traffic control pattern.

PLACEMENT OF SIGNS

Signs must be placed in such a position to allow motorists the opportunity to reduce their speed prior to the work area. Signs shall be installed on the same side of the roadway as the work area. On multi-lane divided highways, advance warning signs shall be installed on both sides of the highway. On directional roadways (on-ramps, off-ramps, one-way roads), where the sight distance to signs is restricted, these signs should be installed on both sides of the roadway.

ALLOWABLE ADJUSTMENT OF SIGNS AND DEVICES SHOWN ON THE TRAFFIC CONTROL PLANS

The traffic control plans contained herein show the location and spacing of signs and devices under ideal conditions. Signs and devices should be installed as shown on these plans whenever possible.

The proper application of the traffic control plans and installation of traffic control devices depends on actual field conditions.

Adjustments to the traffic control plans shall be made only at the direction of the Engineer to improve the visibility of the signs and devices and to better control traffic operations. Adjustments to the traffic control plans shall be based on safety of work forces and motorists, abutting property requirements, driveways, side roads, and the vertical and horizontal curvature of the roadway.

The Engineer may require that the traffic control pattern be located significantly in advance of the work area to provide better sight line to the signing and safer traffic operations through the work zone.

Table I indicates the minimum taper length required for a lane closure based on the posted speed limit of the roadway. These taper lengths shall only be used when the recommended taper lengths shown on the traffic control plans cannot be achieved.

TABLE I – MINIMUM TAPER LENGTHS

POSTED SPEED LIMIT MILES PER HOUR	MINIMUM TAPER LENGTH IN FEET FOR A SINGLE LANE CLOSURE
30 OR LESS	180
35	250
40	320
45	540
50	600
55	660
65	780

SECTION 1. WORK ZONE SAFETY MEETINGS

- 1.a) Prior to the commencement of work, a work zone safety meeting will be conducted with representatives of DOT Construction, Connecticut State Police (Local Barracks), Municipal Police, the Contractor (Project Superintendent) and the Traffic Control Subcontractor (if different than the prime Contractor) to review the traffic operations, lines of responsibility, and operating guidelines which will be used on the project. Other work zone safety meetings during the course of the project should be scheduled as needed.
- 1.b) A Work Zone Safety Meeting Agenda shall be developed and used at the meeting to outline the anticipated traffic control issues during the construction of this project. Any issues that can't be resolved at these meetings will be brought to the attention of the District Engineer and the Office of Construction. The agenda should include:
- Review Project scope of work and time
 - Review Section 1.08, Prosecution and Progress
 - Review Section 9.70, Trafficpersons
 - Review Section 9.71, Maintenance and Protection of Traffic
 - Review Contractor's schedule and method of operations.
 - Review areas of special concern: ramps, turning roadways, medians, lane drops, etc.
 - Open discussion of work zone questions and issues
 - Discussion of review and approval process for changes in contract requirements as they relate to work zone areas

SECTION 2. GENERAL

- 2.a) If the required minimum number of signs and equipment (i.e. one High Mounted Internally Illuminated Flashing Arrow for each lane closed, two TMAs, Changeable Message Sign, etc.) are not available; the traffic control pattern shall not be installed.
- 2.b) The Contractor shall have back-up equipment (TMAs, High Mounted Internally Illuminated Flashing Arrow, Changeable Message Sign, construction signs, cones/drums, etc.) available at all times in case of mechanical failures, etc. The only exception to this is in the case of sudden equipment breakdowns in which the pattern may be installed but the Contractor must provide replacement equipment within 24 hours.
- 2.c) Failure of the Contractor to have the required minimum number of signs, personnel and equipment, which results in the pattern not being installed, shall not be a reason for a time extension or claim for loss time.
- 2.d) In cases of legitimate differences of opinion between the Contractor and the Inspection staff, the Inspection staff shall err on the side of safety. The matter shall be brought to

the District Office for resolution immediately or, in the case of work after regular business hours, on the next business day.

SECTION 3. INSTALLING AND REMOVING TRAFFIC CONTROL PATTERNS

- 3.a) Lane Closures shall be installed beginning with the advance warning signs and proceeding forward toward the work area.
- 3.b) Lane Closures shall be removed in the reverse order, beginning at the work area, or end of the traffic control pattern, and proceeding back toward the advance warning signs.
- 3.c) Stopping traffic may be allowed:
- As per the contract for such activities as blasting, steel erection, etc.
 - During paving, milling operations, etc. where, in the middle of the operation, it is necessary to flip the pattern to complete the operation on the other half of the roadway and traffic should not travel across the longitudinal joint or difference in roadway elevation.
 - To move slow moving equipment across live traffic lanes into the work area.
- 3.d) Temporary road closures using Rolling Road Blocks (RRB) may be allowed on limited access highways for operations associated with the installation and removal of temporary lane closures. RRB may be allowed for the installation and removal of lead signs and lane tapers only and shall meet the following requirements:
- RRB may not start prior to the time allowed in the contract Limitations of Operation for sign pattern installation. Sign pattern removal must be complete prior to the time indicated in the Limitations of Operation for restoring the lanes to traffic.
 - On limited access highways with 4 lanes or more, a RRB may not start until the Limitations of Operation Chart allows a 2 lane closure. In areas with good sight lines and full shoulders, opposite side lead signs should be installed in a separate operation.
 - Truck-Mounted Impact Attenuators (TMAs) equipped with arrow boards shall be used to slow traffic to implement the RRB. State Police Officers in marked vehicles may be used to support the implementation of the RRB. The RRB shall start by having all vehicles, including Truck-Mounted Impact Attenuators TMAs and police vehicles leave the shoulder or on-ramp and accelerate to a normal roadway speeds in each lane, then the vehicles will position themselves side by side and decelerate to the RRB speed on the highway.
 - An additional Truck-Mounted Impact Attenuator TMAs equipped with a Portable Changeable Message Sign shall be utilized to advise the motorists that sign pattern installation / removal is underway. The Pre-Warning Vehicle (PWV) should be initially positioned in the right shoulder ½ mile prior to the RRB operation. If a traffic queue reaches the PWV's initial location, the contractor shall slowly reverse the PWV along the shoulder to position itself prior to the new back of queue. A Pre-

Warning Vehicle, as specified elsewhere in the contract, shall be utilized to advise the motorists that sign pattern installation / removal is underway.

- The RRB duration shall not exceed 15 minutes from start of the traffic block until all lanes are opened as designated in the Limitation of Operation chart. If the RRB duration exceeds 15 minutes on 2 successive shifts, no further RRB will be allowed until the Contractor obtains approval for a revised installation procedure from the respective construction District.
 - RRB should not be utilized to expand a lane closure pattern to an additional lane during the shift. The workers and equipment required to implement the additional lane closure should be staged from within the closed lane. Attenuator trucks (and State Police if available) should be used to protect the workers installing the taper in the additional lane.
 - Exceptions to these work procedures may be submitted to the District Office for consideration. A minimum of 2 business days should be allowed for review and approval by the District.
 - The RRB procedures (including any approved exceptions) will be reviewed and discussed by the inspection team and the Contractor in advance of the work. The implementation of the agreed upon plan will be reviewed with the State Police during the Work Zone Safety meeting held before each shift involving temporary lane closures. If the State Police determine that alternative procedures should be implemented for traffic control during the work shift, the Department and Contractor will attempt to resolve any discrepancies with the duty sergeant at the Troop. If the discrepancies are unable to be resolved prior to the start of the shift, the work will proceed as recommended by the Department Trooper. Any unresolved issues will be addressed the following day.
- 3.e) The Contractor must adhere to using the proper signs, placing the signs correctly, and ensuring the proper spacing of signs.
- 3.f) Additional devices are required on entrance ramps, exit ramps, and intersecting roads to warn and/or move traffic into the proper travel path prior to merging/exiting with/from the main line traffic. This shall be completed before installing the mainline pattern past the ramp or intersecting roadway.
- 3.g) Prior to installing a pattern, any conflicting existing signs shall be covered with an opaque material. Once the pattern is removed, the existing signs shall be uncovered.
- 3.h) On limited access roadways, workers are prohibited from crossing the travel lanes to install and remove signs or other devices on the opposite side of the roadway. Any signs or devices on the opposite side of the roadway shall be installed and removed separately.

SECTION 4. USE OF HIGH MOUNTED INTERNALLY ILLUMINATED FLASHING ARROW

- 4.a) On limited access roadways, one Flashing Arrow shall be used for each lane that is closed. The Flashing Arrow shall be installed concurrently with the installation of the traffic control pattern and its placement shall be as shown on the traffic control plan. For multiple lane closures, one Flashing Arrow is required for each lane closed. If conditions warrant, additional Flashing Arrows should be employed (i.e.: curves, major ramps, etc.).
- 4.b) On non-limited access roadways, the use of a Flashing Arrow for lane closures is optional. The roadway geometry, sight line distance, and traffic volume should be considered in the decision to use the Flashing Arrow.
- 4.c) The Flashing Arrow shall not be used on two lane, two-way roadways for temporary alternating one-way traffic operations.
- 4.d) The Flashing Arrow board display shall be in the “arrow” mode for lane closure tapers and in the “caution” mode (four corners) for shoulder work, blocking the shoulder, or roadside work near the shoulder. The Flashing Arrow shall be in the “caution” mode when it is positioned in the closed lane.
- 4.e) The Flashing Arrow shall not be used on a multi-lane roadway to laterally shift all lanes of traffic, because unnecessary lane changing may result.

SECTION 5. USE OF TRUCK MOUNTED OR TRAILER MOUNTED IMPACT ATTENUATOR VEHICLES (TMAs)

- 5.a) For lane closures on limited access roadways, a minimum of two TMAs shall be used to install and remove traffic control patterns. If two TMAs are not available, the pattern shall not be installed.
- 5.b) On non-limited access roadways, the use of TMAs to install and remove patterns closing a lane(s) is optional. The roadway geometry, sight line distance, and traffic volume should be considered in the decision to utilize the TMAs.
- 5.c) Generally, to establish the advance and transition signing, one TMA shall be placed on the shoulder and the second TMA shall be approximately 1,000 feet ahead blocking the lane. The flashing arrow board mounted on the TMA should be in the “flashing arrow” mode when taking the lane. The sign truck and workers should be immediately ahead of the second TMA. In no case shall the TMA be used as the sign truck or a work truck. Once the transition is in place, the TMAs shall travel in the closed lane until all Changeable Message Signs, signs, Flashing Arrows, and cones/drums are installed. The flashing arrow board mounted on the TMA should be in the “caution” mode when traveling in the closed lane.
- 5.d) A TMA shall be placed prior to the first work area in the pattern. If there are multiple work areas within the same pattern, then additional TMAs shall be positioned at each

additional work area as needed. The flashing arrow board mounted on the TMA should be in the “caution” mode when in the closed lane.

- 5.e) TMAs shall be positioned a sufficient distance prior to the workers or equipment being protected to allow for appropriate vehicle roll-ahead in the event that the TMA is hit, but not so far that an errant vehicle could travel around the TMA and into the work area. For additional placement and use details, refer to the specification entitled “Truck-Mounted or Trailer-Mounted Impact Attenuator”. Some operations, such as paving and concrete repairs, do not allow for placement of the TMA(s) within the specified distances. In these situations, the TMA(s) should be placed at the beginning of the work area and shall be advanced as the paving or concrete operations proceed.
- 5.f) TMAs should be paid in accordance with how the unit is utilized. If it is used as a TMA and is in the proper location as specified, then it should be paid at the specified hourly rate for “Truck-Mounted or Trailer-Mounted Impact Attenuator”. When the TMA is used as a Flashing Arrow, it should be paid at the daily rate for “High Mounted Internally Illuminated Flashing Arrow”. If a TMA is used to install and remove a pattern and is also used as a Flashing Arrow in the same day, then the unit should be paid as a “Truck-Mounted or Trailer-Mounted Impact Attenuator” for the hours used to install and remove the pattern, typically 2 hours (1 hour to install and 1 hour to remove). If the TMA is also used as a Flashing Arrow during the same day, then the unit should be paid at the daily rate as a “High Mounted Internally Illuminated Flashing Arrow”.

SECTION 6. USE OF TRAFFIC DRUMS AND TRAFFIC CONES

- 6.a) Traffic drums shall be used for taper channelization on limited-access roadways, ramps, and turning roadways and to delineate raised catch basins and other hazards.
- 6.b) Traffic drums shall be used in place of traffic cones in traffic control patterns that are in effect for more than a 36-hour duration.
- 6.c) Traffic Cones less than 42 inches in height shall not be used on limited-access roadways or on non-limited access roadways with a posted speed limit of 45 mph and above.
- 6.d) Typical spacing of traffic drums and/or cones shown on the Traffic Control Plans in the Contract are maximum spacings and may be reduced to meet actual field conditions as required.

SECTION 7. USE OF (REMOTE CONTROLLED) CHANGEABLE MESSAGE SIGNS (CMS)

- 7.a) For lane closures on limited access roadways, one CMS shall be used in advance of the traffic control pattern. Prior to installing the pattern, the CMS shall be installed and in

operation, displaying the appropriate lane closure information (i.e.: Left Lane Closed - Merge Right). The CMS shall be positioned ½ - 1 mile ahead of the lane closure taper. If the nearest Exit ramp is greater than the specified ½ - 1 mile distance, than an additional CMS shall be positioned a sufficient distance ahead of the Exit ramp to alert motorists to the work and therefore offer them an opportunity to take the exit.

- 7.b) CMS should not be installed within 1000 feet of an existing CMS.
- 7.c) On non-limited access roadways, the use of CMS for lane closures is optional. The roadway geometry, sight line distance, and traffic volume should be considered in the decision to use the CMS.
- 7.d) The advance CMS is typically placed off the right shoulder, 5 feet from the edge of pavement. In areas where the CMS cannot be placed beyond the edge of pavement, it may be placed on the paved shoulder with a minimum of five (5) traffic drums placed in a taper in front of it to delineate its position. The advance CMS shall be adequately protected if it is used for a continuous duration of 36 hours or more.
- 7.e) When the CMS are no longer required, they should be removed from the clear zone and have the display screen cleared and turned 90° away from the roadway.
- 7.f) The CMS generally should not be used for generic messages (ex: Road Work Ahead, Bump Ahead, Gravel Road, etc.).
- 7.g) The CMS should be used for specific situations that need to command the motorist's attention which cannot be conveyed with standard construction signs (Examples include: Exit 34 Closed Sat/Sun - Use Exit 35, All Lanes Closed - Use Shoulder, Workers on Road - Slow Down).
- 7.h) Messages that need to be displayed for long periods of time, such as during stage construction, should be displayed with construction signs. For special signs, please coordinate with the Office of Construction and the Division of Traffic Engineering for the proper layout/dimensions required.
- 7.i) The messages that are allowed on the CMS are as follows:


<u>Message No.</u>	<u>Frame 1</u>	<u>Frame 2</u>	<u>Message No.</u>	<u>Frame 1</u>	<u>Frame 2</u>
1	LEFT LANE CLOSED	MERGE RIGHT	9	LANES CLOSED AHEAD	REDUCE SPEED
2	2 LEFT LANES CLOSED	MERGE RIGHT	10	LANES CLOSED AHEAD	USE CAUTION
3	LEFT LANE CLOSED	REDUCE SPEED	11	WORKERS ON ROAD	REDUCE SPEED
4	2 LEFT LANES CLOSED	REDUCE SPEED	12	WORKERS ON ROAD	SLOW DOWN
5	RIGHT LANE CLOSED	MERGE LEFT	13	EXIT XX CLOSED	USE EXIT YY
6	2 RIGHT LANES CLOSED	MERGE LEFT	14	EXIT XX CLOSED USE YY	FOLLOW DETOUR
7	RIGHT LANE CLOSED	REDUCE SPEED	15	2 LANES SHIFT AHEAD	USE CAUTION
8	2 RIGHT LANES CLOSED	REDUCE SPEED	16	3 LANES SHIFT AHEAD	USE CAUTION

For any other message(s), approval must be received from the Office of Construction prior to their use. No more than two (2) displays shall be used within any message cycle.

SECTION 8. USE OF STATE POLICE OFFICERS

- 8.a) State Police may be utilized only on limited access highways and secondary roadways under their primary jurisdiction. One Officer may be used per critical sign pattern. Shoulder closures and right lane closures can generally be implemented without the presence of a State Police Officer. Likewise in areas with moderate traffic and wide, unobstructed medians, left lane closures can be implemented without State Police presence. Under some situations it may be desirable to have State Police presence, when one is available. Examples of this include: nighttime lane closures; left lane closures with minimal width for setting up advance signs and staging; lane and shoulder closures on turning roadways/ramps or mainline where sight distance is minimal; and closures where extensive turning movements or traffic congestion regularly occur, however they are not required.
- 8.b) Once the pattern is in place, the State Police Officer should be positioned in a non-hazardous location in advance of the pattern. If traffic backs up beyond the beginning of the pattern, then the State Police Officer shall be repositioned prior to the backup to give warning to the oncoming motorists. The State Police Officer and TMA should not be in proximity to each other.
- 8.c) Other functions of the State Police Officer(s) may include:
- Assisting entering/exiting construction vehicles within the work area.
 - Enforcement of speed and other motor vehicle laws within the work area, if specifically requested by the project.
- 8.d) State Police Officers assigned to a work site are to only take direction from the Engineer.

SERIES 16 SIGNS

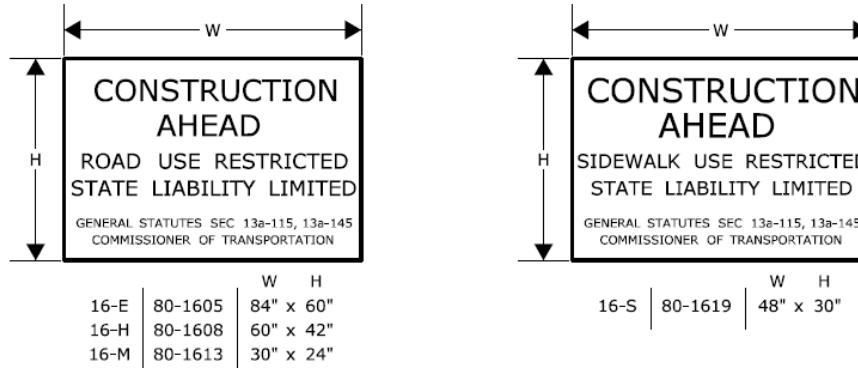

THE 16-S SIGN SHALL BE USED ON ALL PROJECTS THAT REQUIRE SIDEWALK RECONSTRUCTION OR RESTRICT PEDESTRIAN TRAVEL ON AN EXISTING SIDEWALK.

SERIES 16 SIGNS SHALL BE INSTALLED IN ADVANCE OF THE TRAFFIC CONTROL PATTERNS TO ALLOW MOTORISTS THE OPPORTUNITY TO AVOID A WORK ZONE. SERIES 16 SIGNS SHALL BE INSTALLED ON ANY MAJOR INTERSECTING ROADWAYS THAT APPROACH THE WORK ZONE. ON LIMITED-ACCESS HIGHWAYS, THESE SIGNS SHALL BE LOCATED IN ADVANCE OF THE NEAREST UPSTREAM EXIT RAMP AND ON ANY ENTRANCE RAMP PRIOR TO OR WITHIN THE WORK ZONE LIMITS.

THE LOCATION OF SERIES 16 SIGNS CAN BE FOUND ELSEWHERE IN THE PLANS OR INSTALLED AS DIRECTED BY THE ENGINEER.

SIGNS 16-E AND 16-H SHALL BE POST-MOUNTED.

SIGN 16-E SHALL BE USED ON ALL EXPRESSWAYS.

SIGN 16-H SHALL BE USED ON ALL RAMP, OTHER STATE ROADWAYS, AND MAJOR TOWN/CITY ROADWAYS.

SIGN 16-M SHALL BE USED ON OTHER TOWN ROADWAYS.



REGULATORY SIGN "ROAD WORK AHEAD, FINES DOUBLED"

THE REGULATORY SIGN "ROAD WORK AHEAD FINES DOUBLED" SHALL BE INSTALLED FOR ALL WORK ZONES THAT OCCUR ON ANY STATE HIGHWAY IN CONNECTICUT WHERE THERE ARE WORKERS ON THE HIGHWAY OR WHEN THERE IS OTHER THAN EXISTING TRAFFIC OPERATIONS.

THE "ROAD WORK AHEAD FINES DOUBLED" REGULATORY SIGN SHALL BE PLACED AFTER THE SERIES 16 SIGN AND IN ADVANCE OF THE "ROAD WORK AHEAD" SIGN.

"END ROAD WORK" SIGN

THE LAST SIGN IN THE PATTERN MUST BE THE "END ROAD WORK" SIGN.

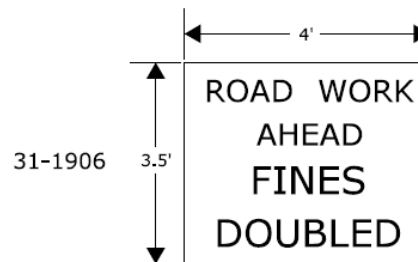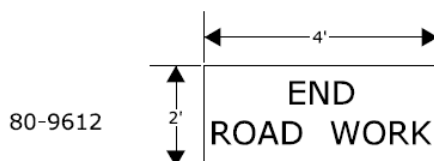

SCALE: NONE

CONSTRUCTION TRAFFIC CONTROL PLAN
REQUIRED SIGNS

NOTES FOR TRAFFIC CONTROL PLANS

1. IF A TRAFFIC STOPPAGE OCCURS IN ADVANCE OF SIGN (A), THEN AN ADDITIONAL SIGN (A) SHALL BE INSTALLED IN ADVANCE OF THE STOPPAGE.
2. SIGNS (AA), (A), AND (D) SHOULD BE OMITTED WHEN THESE SIGNS HAVE ALREADY BEEN INSTALLED TO DESIGNATE A LARGER WORK ZONE THAN THE WORK ZONE THAT IS ENCOMPASSED ON THIS PLAN.
3. SEE TABLE 1 FOR ADJUSTMENT OF TAPERS IF NECESSARY.
4. IF THIS PLAN REMAINS IN CONTINUOUS OPERATION FOR MORE THAN 36 HOURS, THEN TRAFFIC DRUMS SHALL BE USED IN PLACE OF TRAFFIC CONES.
5. ANY LEGAL SPEED LIMIT SIGNS WITHIN THE LIMITS OF A ROADWAY / LANE CLOSURE AREA SHALL BE COVERED WITH AN OPAQUE MATERIAL WHILE THE CLOSURE IS IN EFFECT, AND UNCOVERED WHEN THE ROADWAY / LANE CLOSURE IS RE-OPENED TO ALL LANES OF TRAFFIC.
6. IF THIS PLAN REMAINS IN CONTINUOUS OPERATION FOR MORE THAN 36 HOURS, THEN ANY EXISTING CONFLICTING PAVEMENT MARKINGS SHALL BE ERADICATED OR COVERED, AND TEMPORARY PAVEMENT MARKINGS THAT DELINEATE THE PROPER TRAVELPATHS SHALL BE INSTALLED.
7. DISTANCES BETWEEN SIGNS IN THE ADVANCE WARNING AREA MAY BE REDUCED TO 100' ON LOW-SPEED URBAN ROADS (SPEED LIMIT < 40 MPH).
8. IF THIS PLAN IS TO REMAIN IN OPERATION DURING THE HOURS OF DARKNESS, INSTALL BARRICADE WARNING LIGHTS - HIGH INTENSITY ON ALL POST-MOUNTED DIAMOND SIGNS IN THE ADVANCE WARNING AREA.
9. A CHANGEABLE MESSAGE SIGN SHALL BE INSTALLED ONE HALF TO ONE MILE IN ADVANCE OF THE LANE CLOSURE TAPER.
10. SIGN (P) SHALL BE MOUNTED A MINIMUM OF 7 FEET FROM THE PAVEMENT SURFACE TO THE BOTTOM OF THE SIGN.

TABLE 1 - MINIMUM TAPER LENGTHS

POSTED SPEED LIMIT (MILES PER HOUR)	MINIMUM TAPER LENGTH FOR A SINGLE LANE CLOSURE
30 OR LESS	180' (55m)
35	250' (75m)
40	320' (100m)
45	540' (165m)
50	600' (180m)
55	660' (200m)
65	780' (240m)

METRIC CONVERSION CHART (1" = 25mm)


ENGLISH	METRIC	ENGLISH	METRIC	ENGLISH	METRIC
12"	300mm	42"	1050mm	72"	1800mm
18"	450mm	48"	1200mm	78"	1950mm
24"	600mm	54"	1350mm	84"	2100mm
30"	750mm	60"	1500mm	90"	2250mm
36"	900mm	66"	1650mm	96"	2400mm




SCALE: NONE


CONSTRUCTION TRAFFIC CONTROL PLAN


NOTES

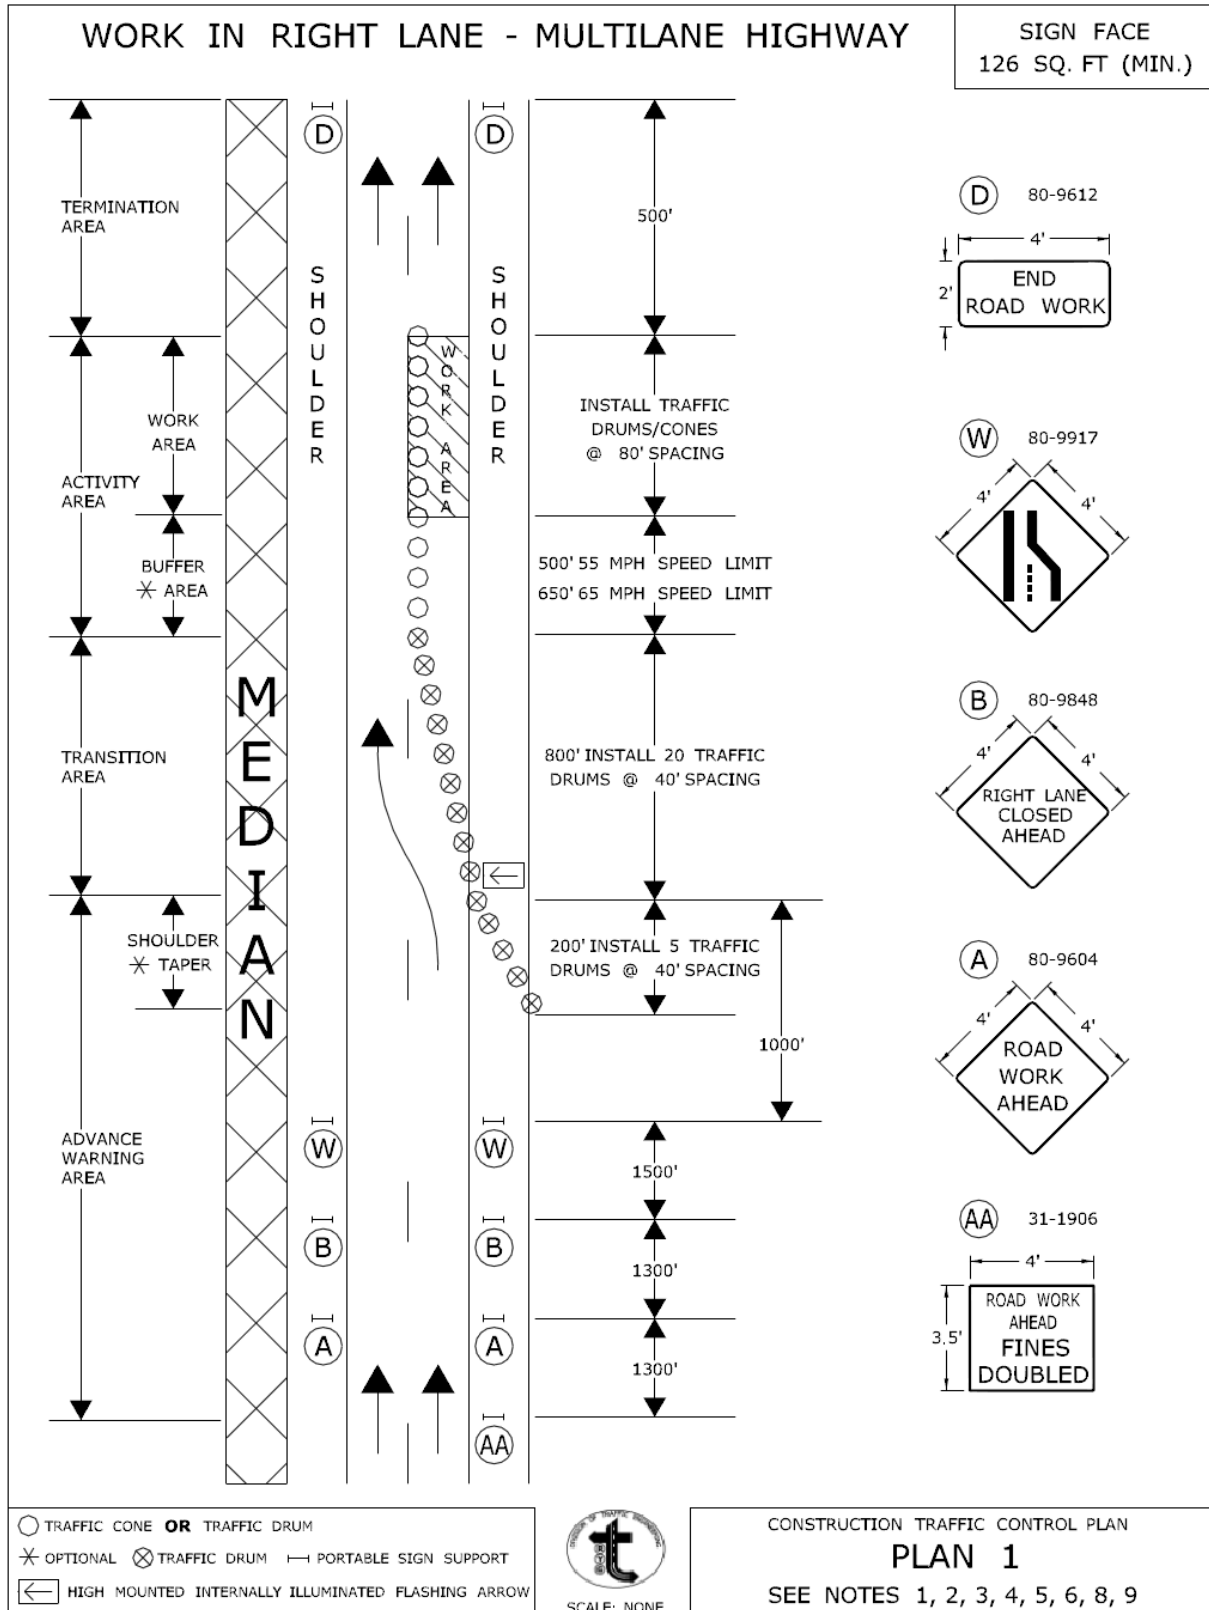

APPROVED *Charles S. Harlow*
Charles S. Harlow
2012.06.05 15:51:00-0400
PRINCIPAL ENGINEER

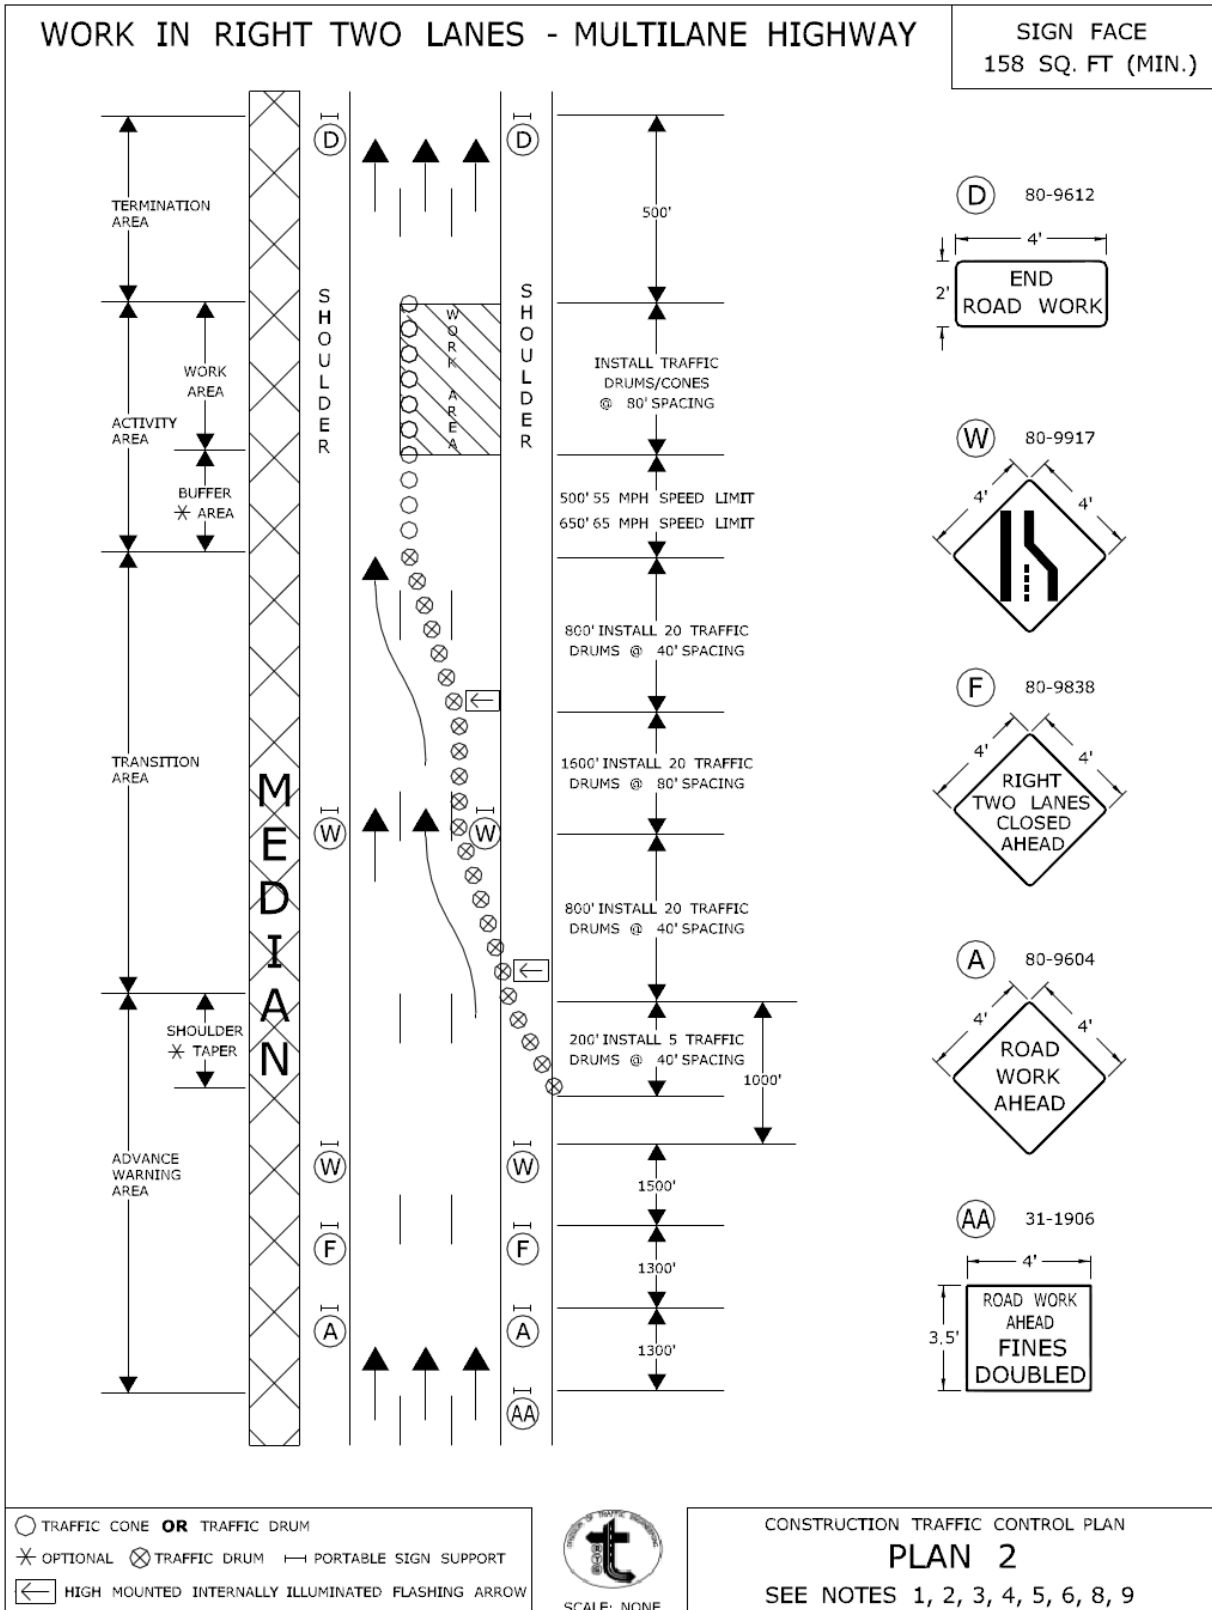

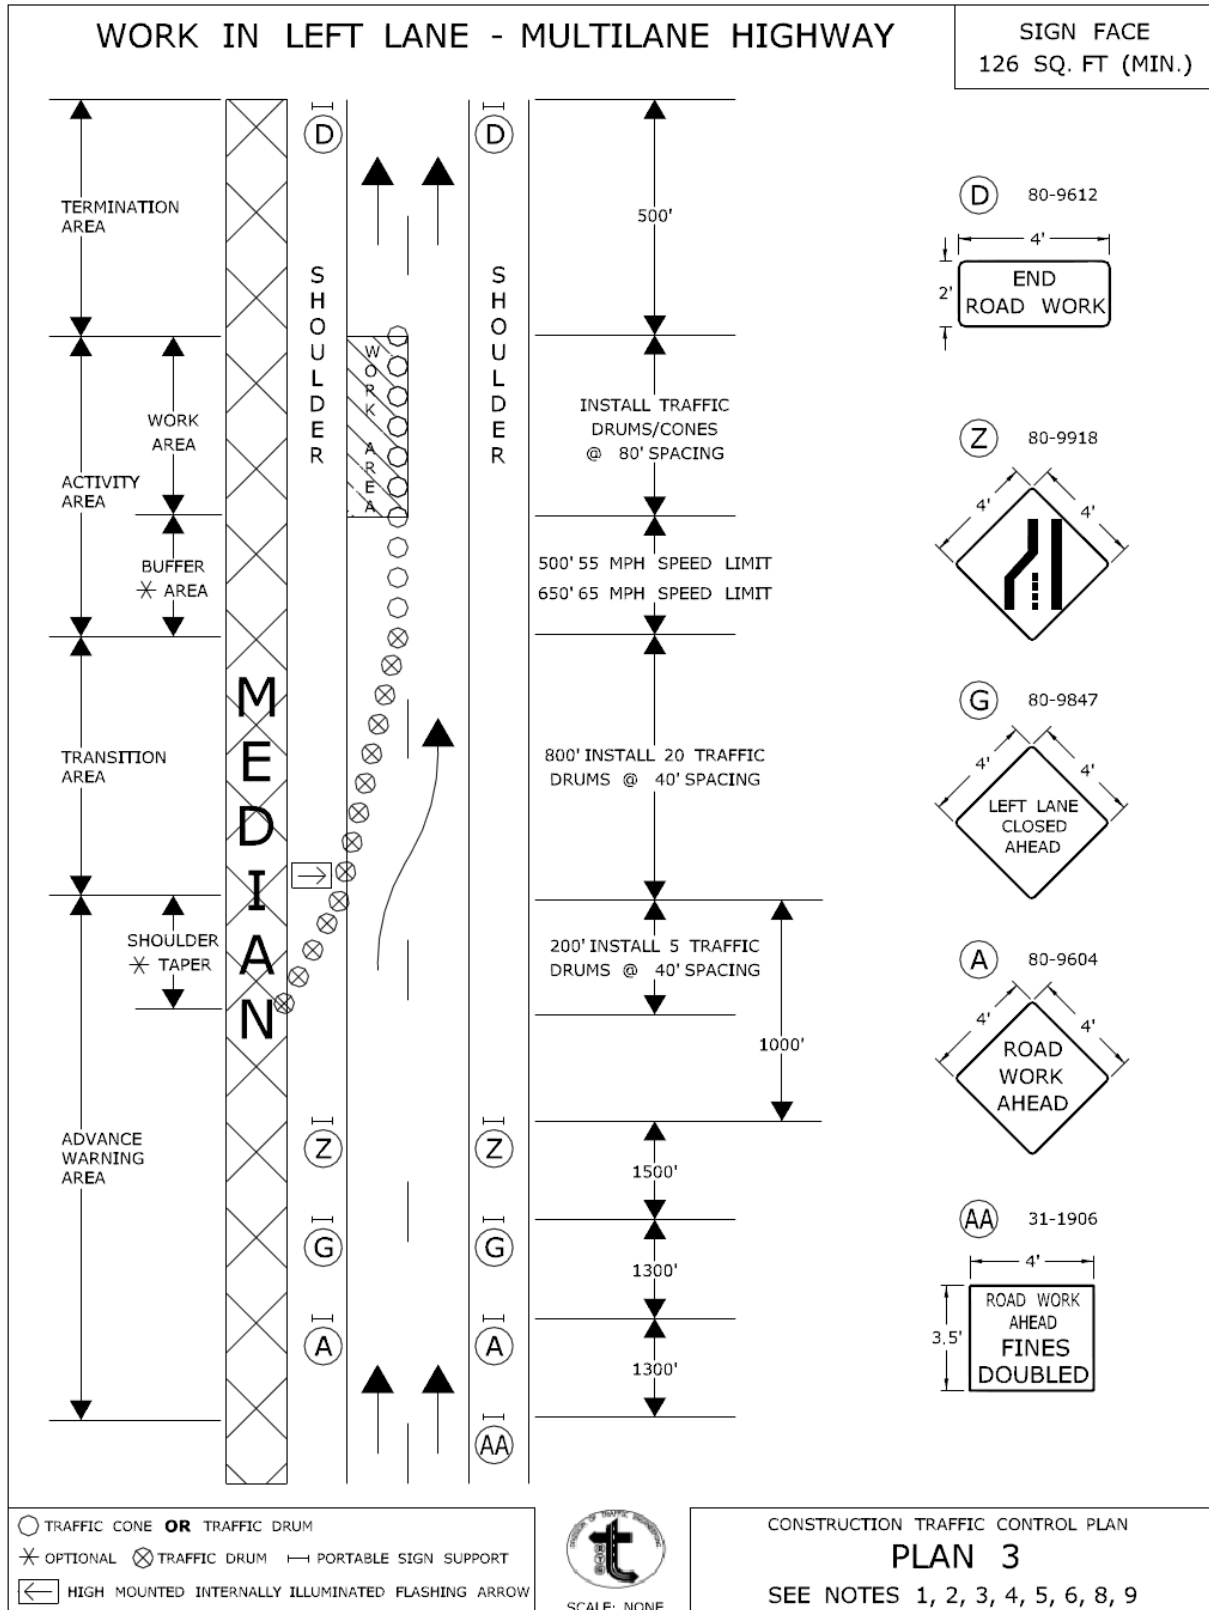

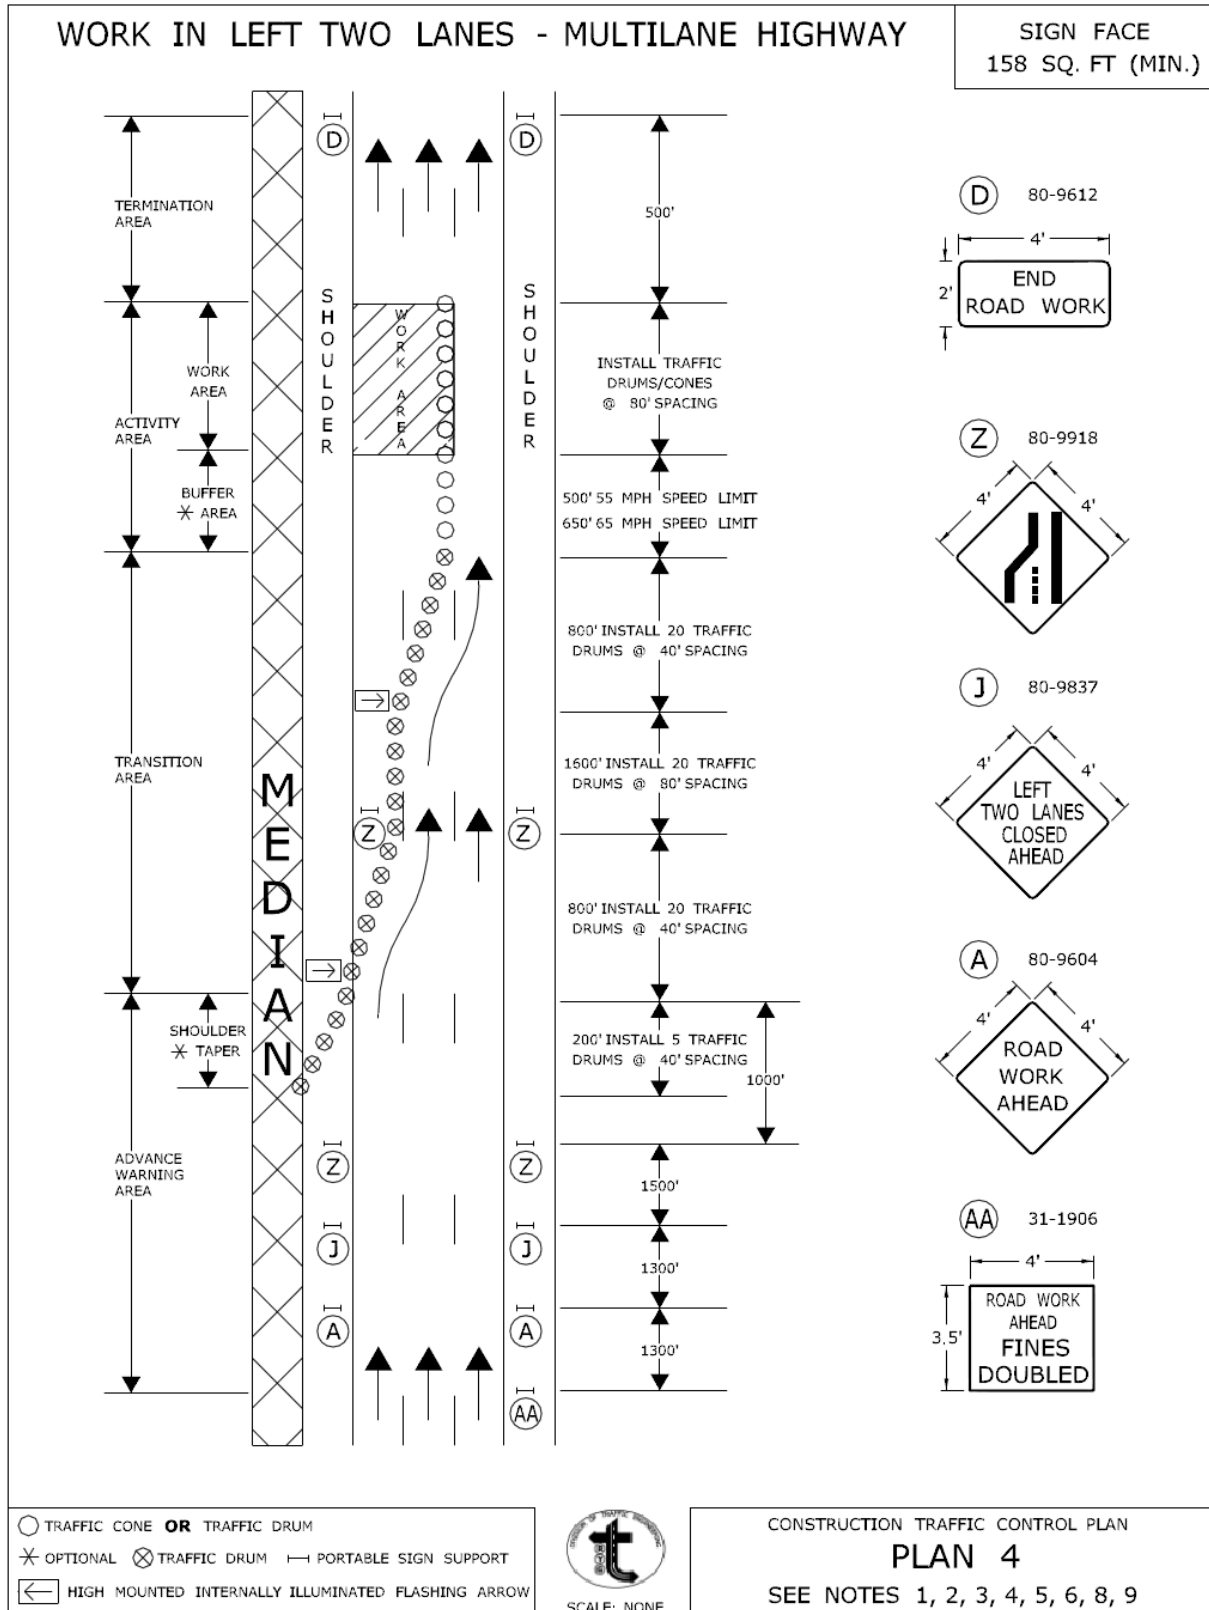

CONNECTICUT DEPARTMENT OF TRANSPORTATION
BUREAU OF ENGINEERING & CONSTRUCTION



SCALE: NONE


APPROVED

Charles S. Harlow
PRINCIPAL ENGINEER

Charles S. Harlow
2012.06.05 15:52:10-0400

WORK IN SHOULDER AREA - MULTILANE HIGHWAY

SIGN FACE
94 SQ. FT (MIN.)

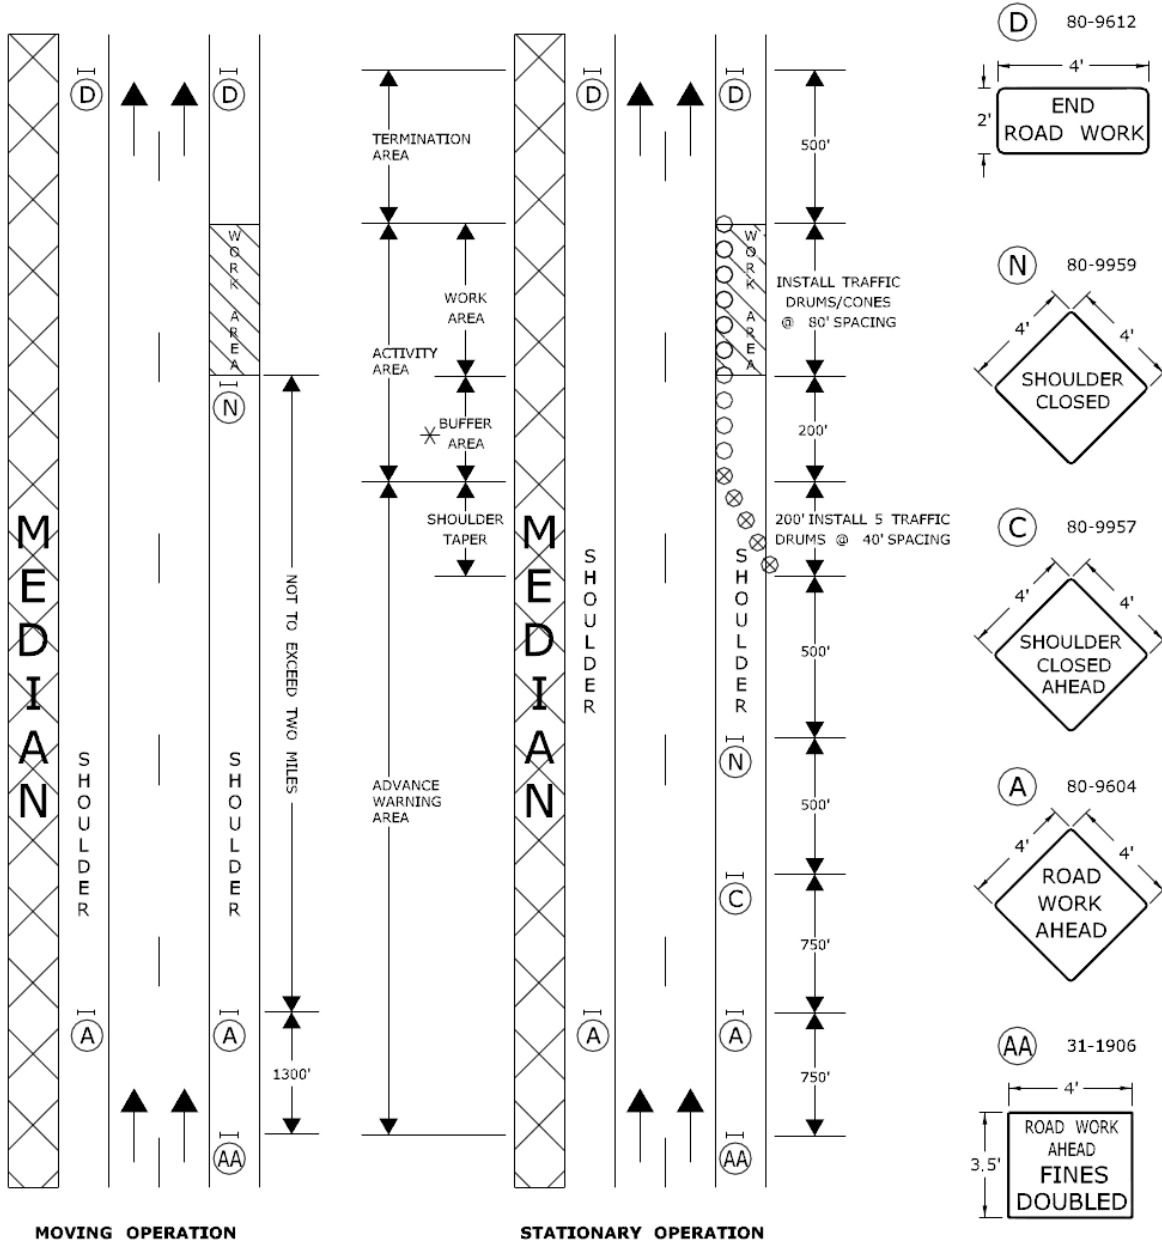

- TRAFFIC CONE OR TRAFFIC DRUM
- * OPTIONAL ⊗ TRAFFIC DRUM — PORTABLE SIGN SUPPORT
- ◀ HIGH MOUNTED INTERNALLY ILLUMINATED FLASHING ARROW



SCALE: NONE

CONSTRUCTION TRAFFIC CONTROL PLAN

PLAN 6

SEE NOTES 1, 2, 4, 8

CONNECTICUT DEPARTMENT OF TRANSPORTATION
BUREAU OF ENGINEERING & CONSTRUCTION


APPROVED

Charles S. Harlow
PRINCIPAL ENGINEER

Charles S. Harlow
2012.06.05 15:52:38-04'00"

WORK IN SHOULDER AREA - TURNING ROADWAYS / RAMPS

SIGN FACE
70 SQ. FT (MIN.)

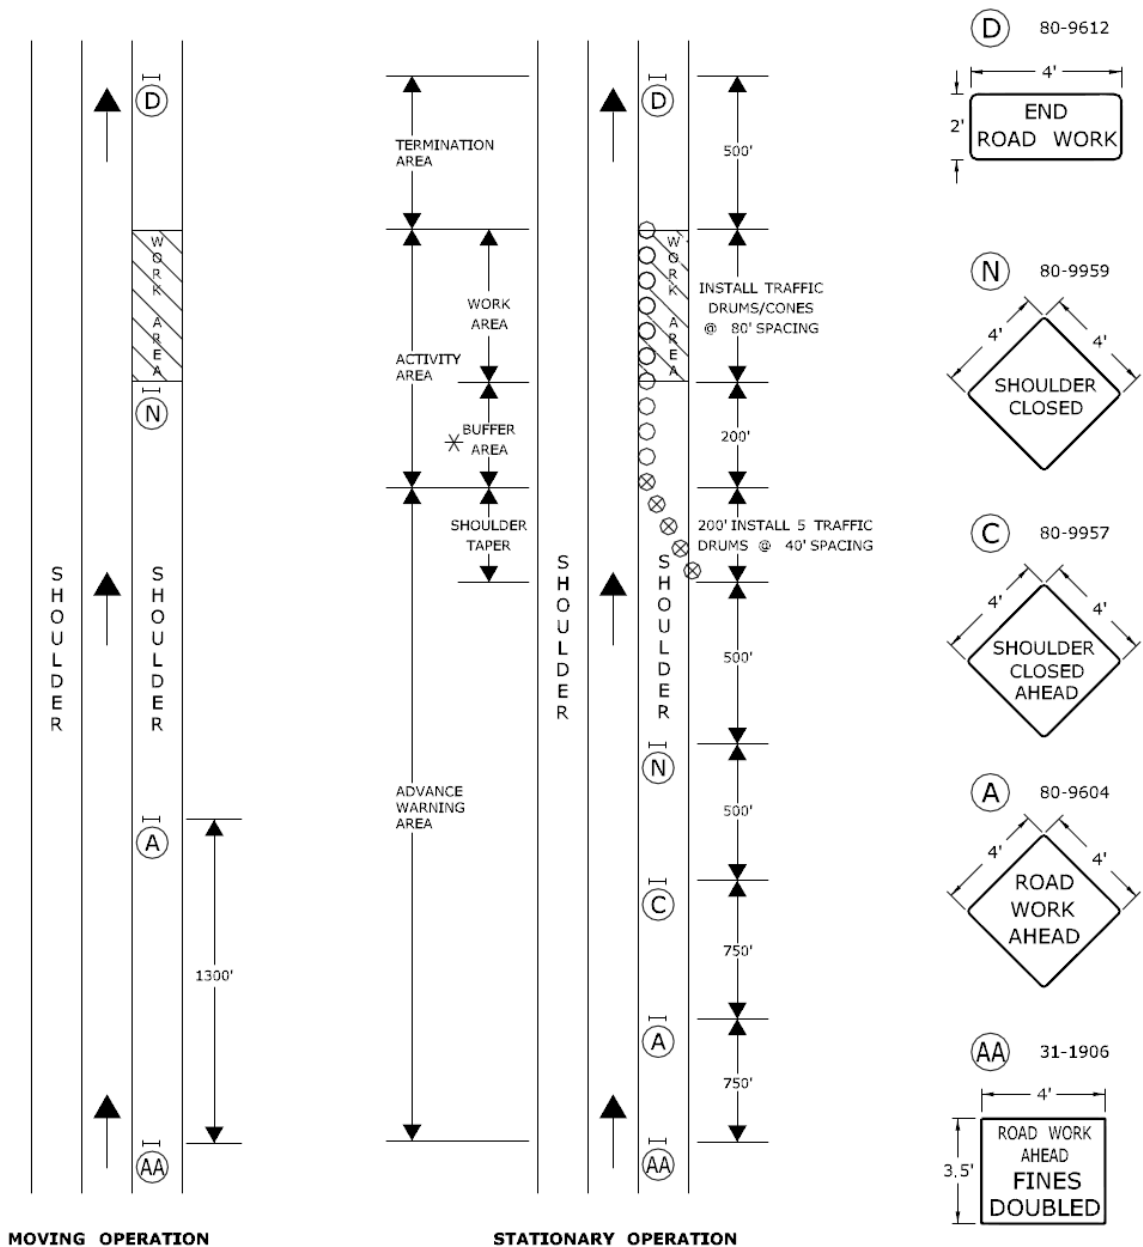

- TRAFFIC CONE **OR** TRAFFIC DRUM
- * OPTIONAL ⊗ TRAFFIC DRUM — PORTABLE SIGN SUPPORT
- ← HIGH MOUNTED INTERNALLY ILLUMINATED FLASHING ARROW



SCALE: NONE

CONSTRUCTION TRAFFIC CONTROL PLAN

PLAN 9


SEE NOTES 1, 2, 4, 8


CONNECTICUT DEPARTMENT OF TRANSPORTATION
BUREAU OF ENGINEERING & CONSTRUCTION

APPROVED

Charles S. Harlow
PRINCIPAL ENGINEER

Charles S. Harlow
2012.06.05 15:53:53-0400'

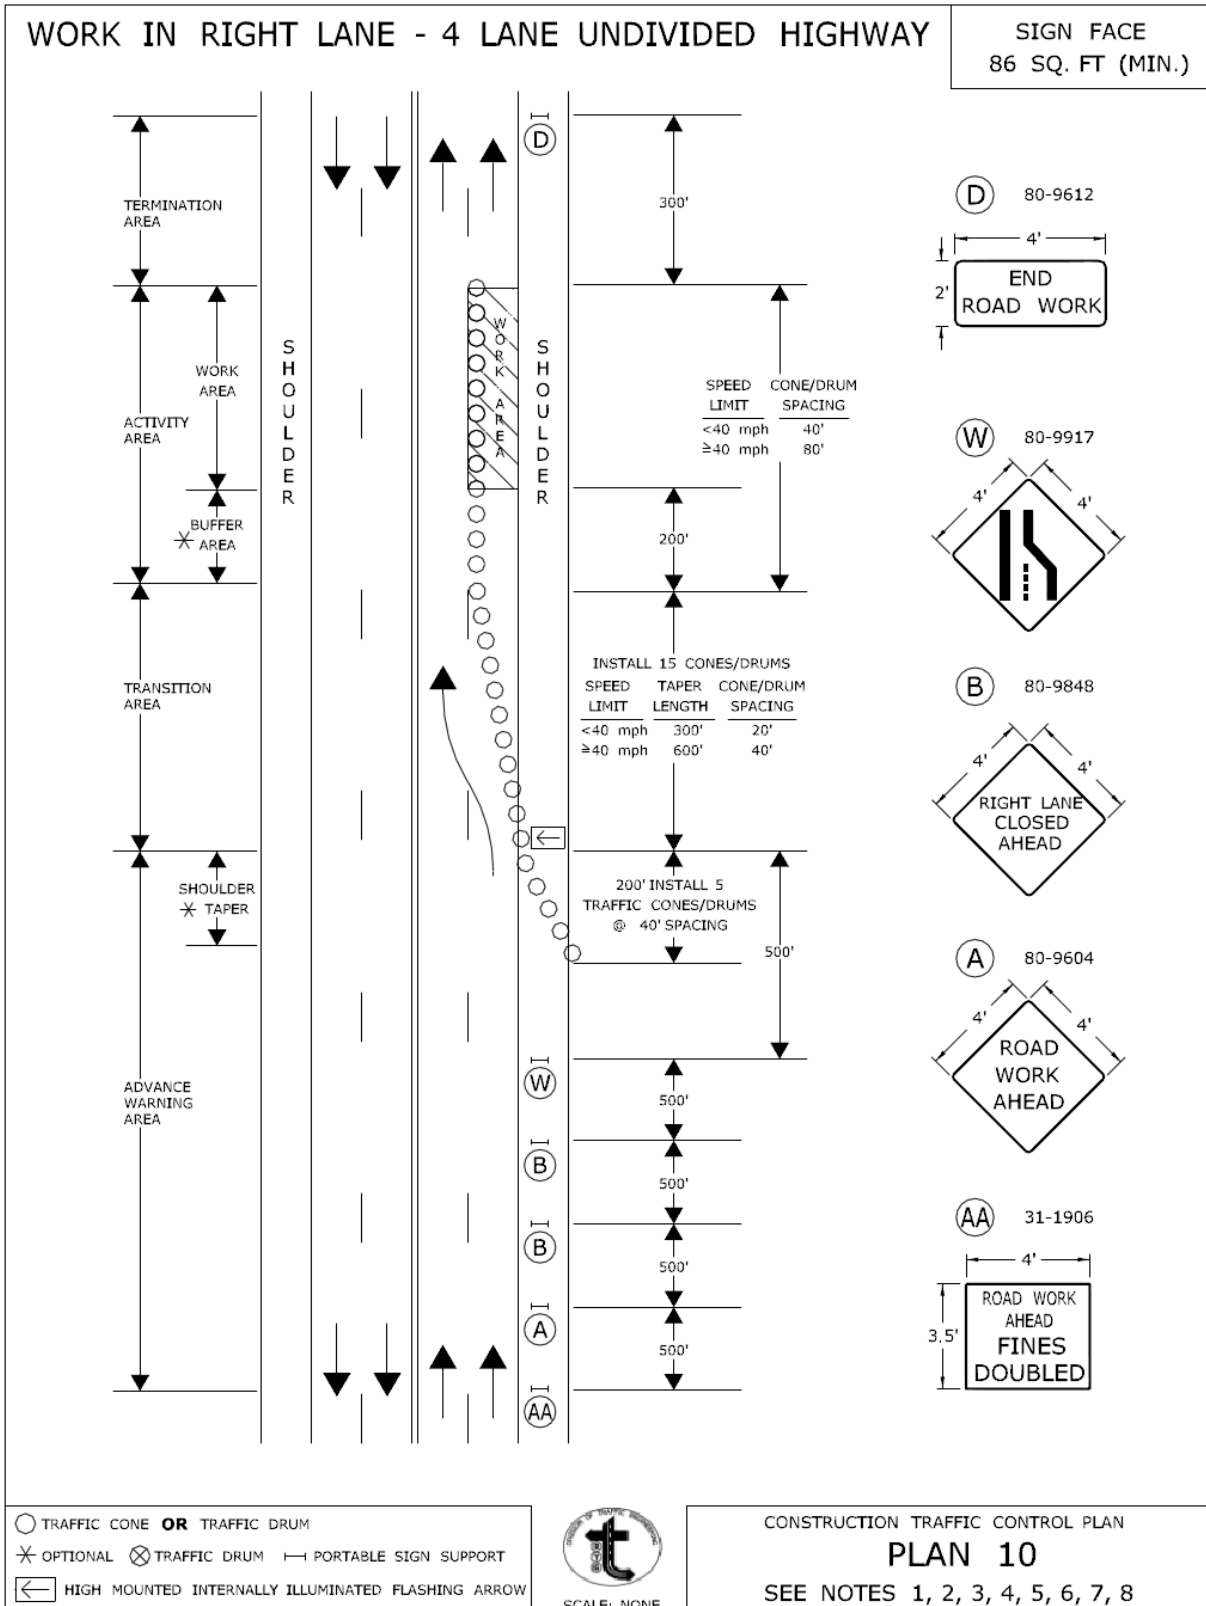

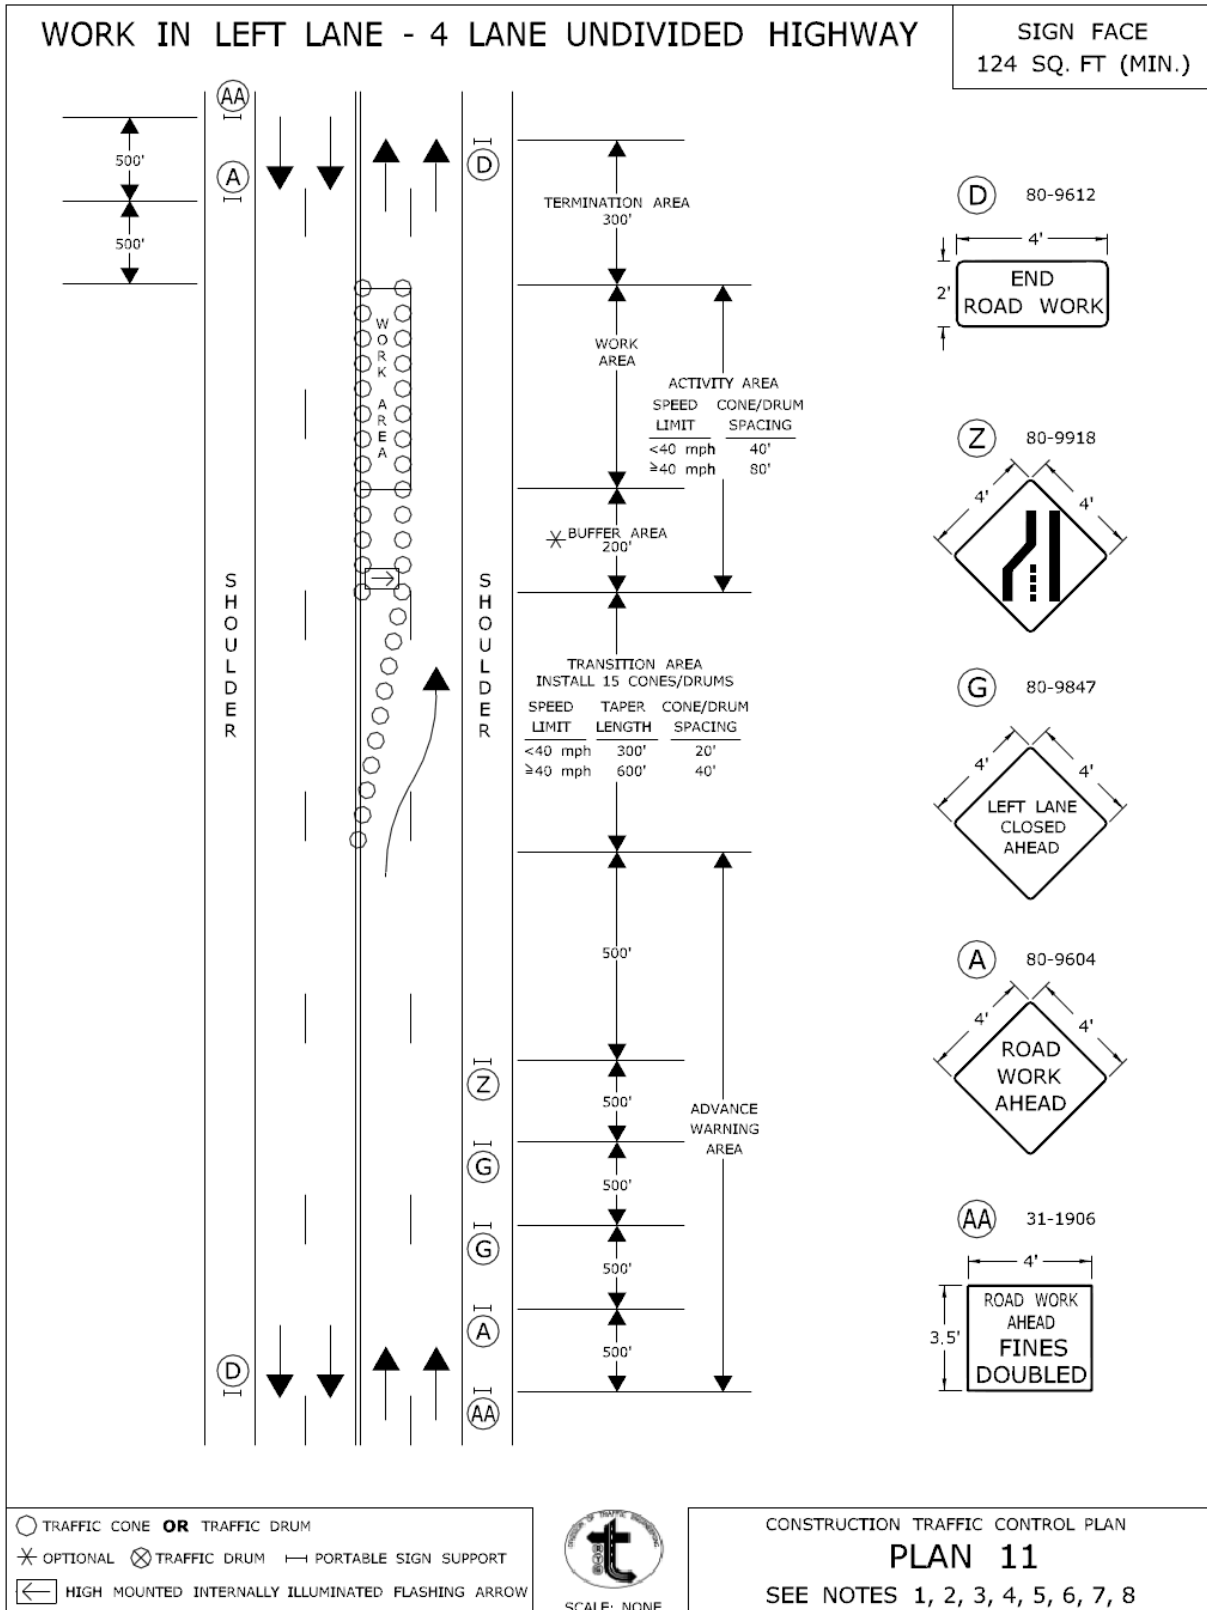

- TRAFFIC CONE **OR** TRAFFIC DRUM
- ✱ OPTIONAL ⊗ TRAFFIC DRUM — PORTABLE SIGN SUPPORT
- ◀ HIGH MOUNTED INTERNALLY ILLUMINATED FLASHING ARROW



SCALE: NONE


CONSTRUCTION TRAFFIC CONTROL PLAN
PLAN 11
SEE NOTES 1, 2, 3, 4, 5, 6, 7, 8

CONNECTICUT DEPARTMENT OF TRANSPORTATION
BUREAU OF ENGINEERING & CONSTRUCTION

APPROVED *Charles S. Harlow*
PRINCIPAL ENGINEER
Charles S. Harlow
2012.08.05 15:54:36-0400'

WORK IN BOTH LANES - 4 LANE UNDIVIDED HIGHWAY

SIGN FACE
204 SQ. FT. (MIN.)

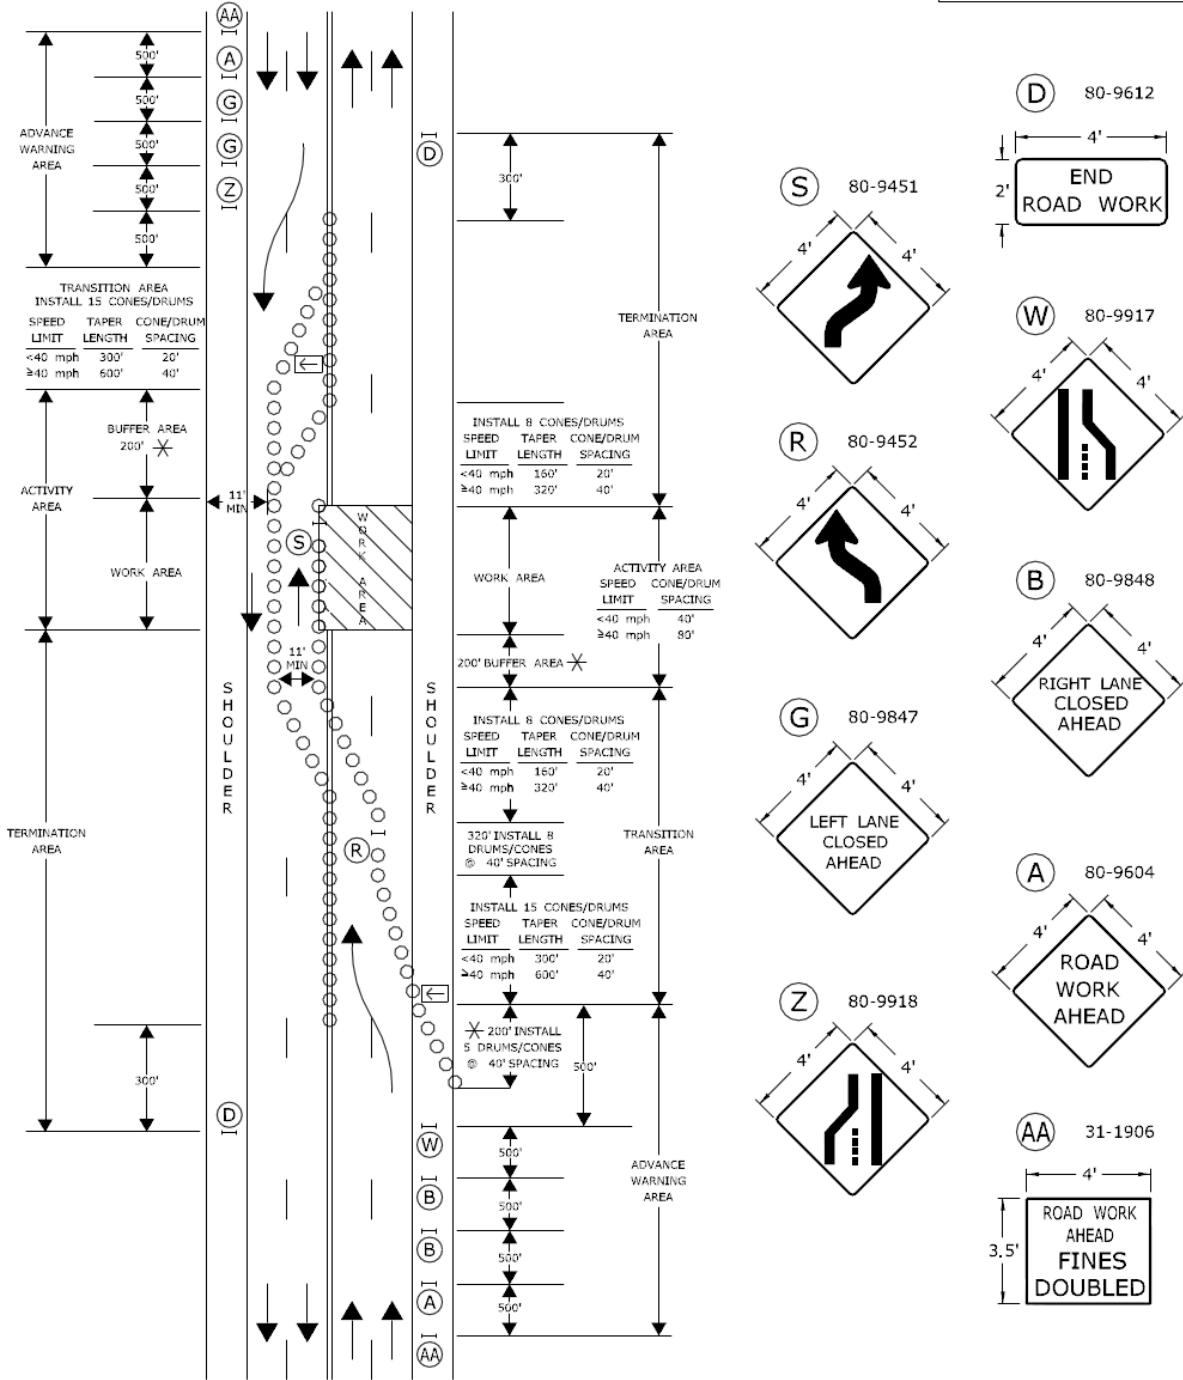

- TRAFFIC CONE **OR** TRAFFIC DRUM
- ✱ OPTIONAL ⊗ TRAFFIC DRUM — PORTABLE SIGN SUPPORT
- ← HIGH MOUNTED INTERNALLY ILLUMINATED FLASHING ARROW




CONSTRUCTION TRAFFIC CONTROL PLAN
PLAN 12
SEE NOTES 1, 2, 3, 4, 5, 6, 7, 8

SCALE: NONE

CONNECTICUT DEPARTMENT OF TRANSPORTATION
BUREAU OF ENGINEERING & CONSTRUCTION

APPROVED *Charles S. Harlow*
PRINCIPAL ENGINEER
Charles S. Harlow
2012.06.05 15:55:01-0400'

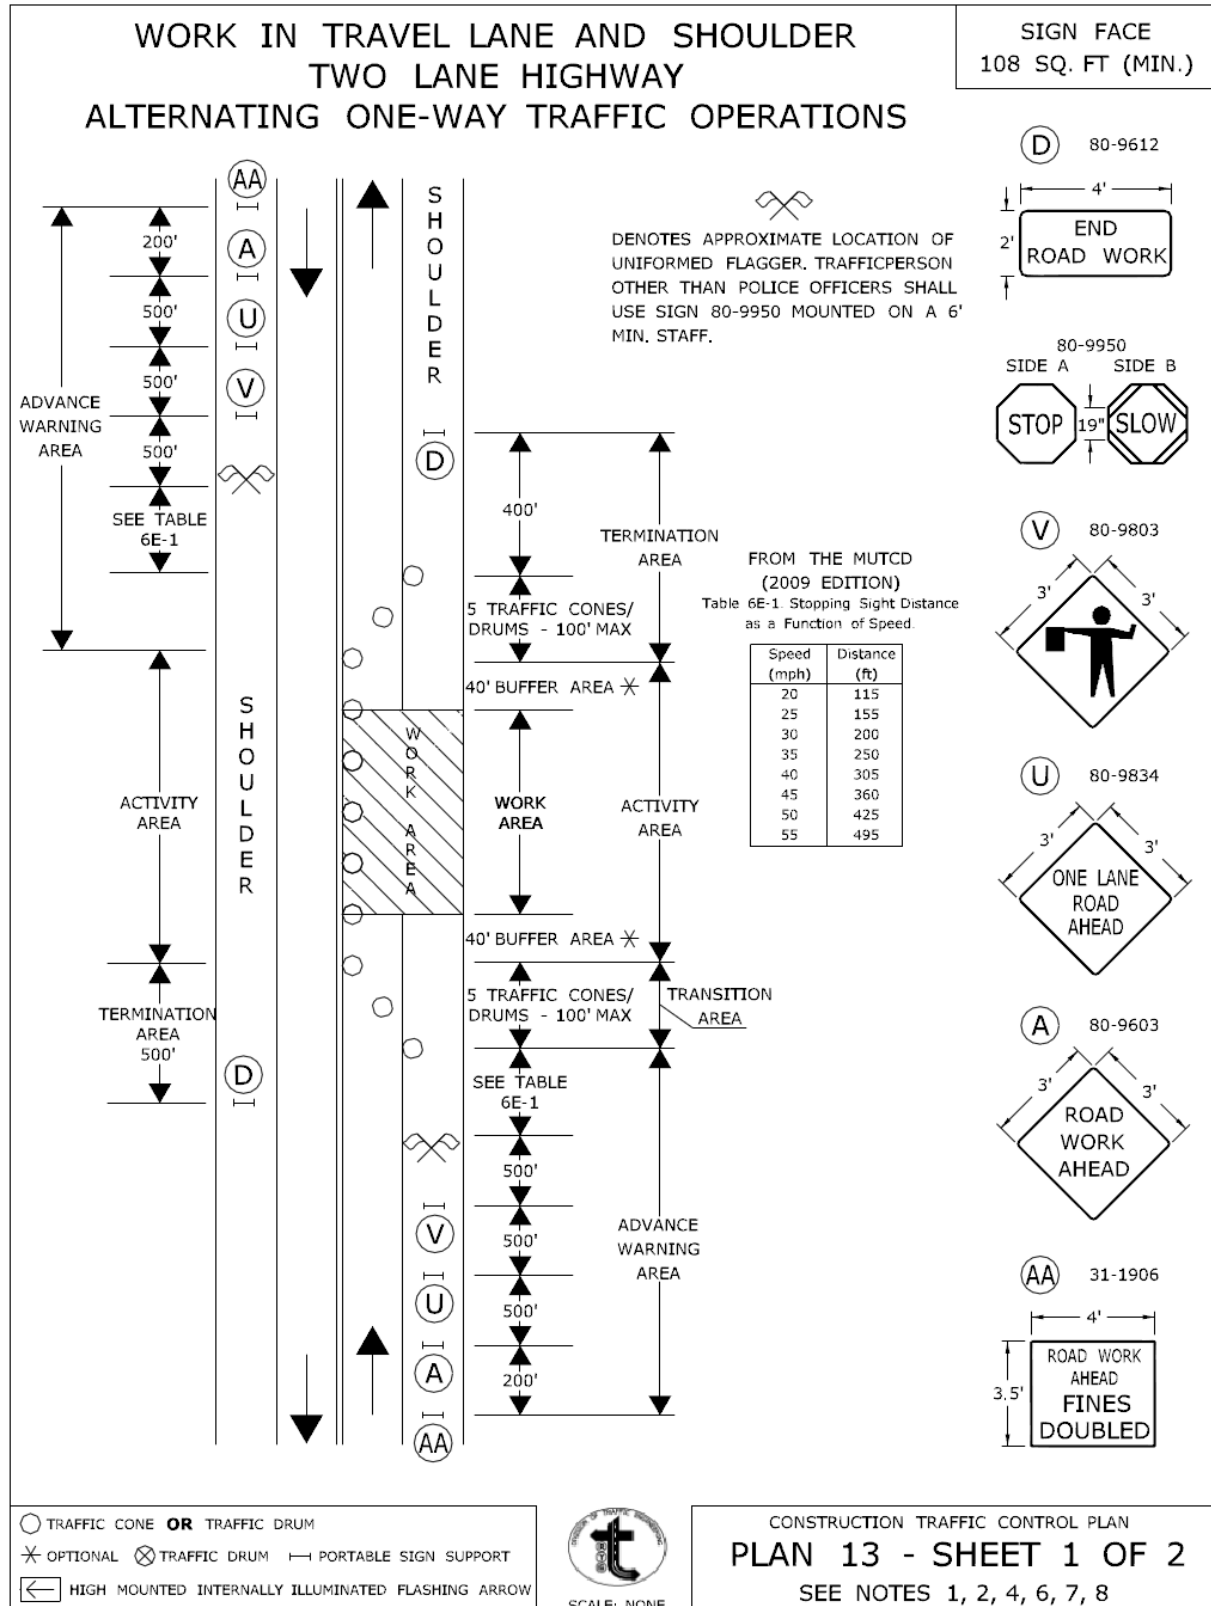

DENOTES APPROXIMATE LOCATION OF UNIFORMED FLAGGER, TRAFFICPERSON OTHER THAN POLICE OFFICERS SHALL USE SIGN 80-9950 MOUNTED ON A 6' MIN. STAFF.

FROM THE MUTCD (2009 EDITION)
 Table 6E-1. Stopping Sight Distance as a Function of Speed

Speed (mph)	Distance (ft)
20	115
25	155
30	200
35	250
40	305
45	360
50	425
55	495

- (D) 80-9612
- 80-9950
 SIDE A SIDE B
- (V) 80-9803
- (U) 80-9834
- (A) 80-9603
- (AA) 31-1906

WORK IN TRAVEL LANE AND SHOULDER TWO LANE HIGHWAY ALTERNATING ONE-WAY TRAFFIC OPERATIONS

SIGN FACE
108 SQ. FT (MIN.)

HAND SIGNAL METHODS TO BE USED BY UNIFORMED FLAGGERS

THE FOLLOWING METHODS FROM SECTION 6E.07, FLAGGER PROCEDURES, IN THE "MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES," SHALL BE USED BY UNIFORMED FLAGGERS WHEN DIRECTING TRAFFIC THROUGH A WORK AREA. THE STOP/SLOW SIGN PADDLE (SIGN NO. 80-9950) SHOWN ON THE TRAFFIC STANDARD SHEET TR-1220 01 ENTITLED, "SIGNS FOR CONSTRUCTION AND PERMIT OPERATIONS" SHALL BE USED.

A. TO STOP TRAFFIC

TO STOP ROAD USERS, THE FLAGGER SHALL FACE ROAD USERS AND AIM THE STOP PADDLE FACE TOWARD ROAD USERS IN A STATIONARY POSITION WITH THE ARM EXTENDED HORIZONTALLY AWAY FROM THE BODY. THE FREE ARM SHALL BE HELD WITH THE PALM OF THE HAND ABOVE SHOULDER LEVEL TOWARD APPROACHING TRAFFIC.



B. TO DIRECT TRAFFIC TO PROCEED

TO DIRECT STOPPED ROAD USERS TO PROCEED, THE FLAGGER SHALL FACE ROAD USERS WITH THE SLOW PADDLE FACE AIMED TOWARD ROAD USERS IN A STATIONARY POSITION WITH THE ARM EXTENDED HORIZONTALLY AWAY FROM THE BODY. THE FLAGGER SHALL MOTION WITH THE FREE HAND FOR ROAD USERS TO PROCEED.



C. TO ALERT OR SLOW TRAFFIC

TO ALERT OR SLOW TRAFFIC, THE FLAGGER SHALL FACE ROAD USERS WITH THE SLOW PADDLE FACE AIMED TOWARD ROAD USERS IN A STATIONARY POSITION WITH THE ARM EXTENDED HORIZONTALLY AWAY FROM THE BODY. TO FURTHER ALERT OR SLOW TRAFFIC, THE FLAGGER HOLDING THE SLOW PADDLE FACE TOWARD ROAD USERS MAY MOTION UP AND DOWN WITH THE FREE HAND, PALM DOWN.



- TRAFFIC CONE **OR** TRAFFIC DRUM
- * OPTIONAL ⊗ TRAFFIC DRUM — PORTABLE SIGN SUPPORT
- ◀ HIGH MOUNTED INTERNALLY ILLUMINATED FLASHING ARROW




SCALE: NONE

CONSTRUCTION TRAFFIC CONTROL PLAN
PLAN 13 - SHEET 2 OF 2
SEE NOTES 1, 2, 4, 6, 7, 8

CONNECTICUT DEPARTMENT OF TRANSPORTATION
BUREAU OF ENGINEERING & CONSTRUCTION

APPROVED *Charles S. Harlow*
PRINCIPAL ENGINEER 2012.06.05 15:55:45-04'00"

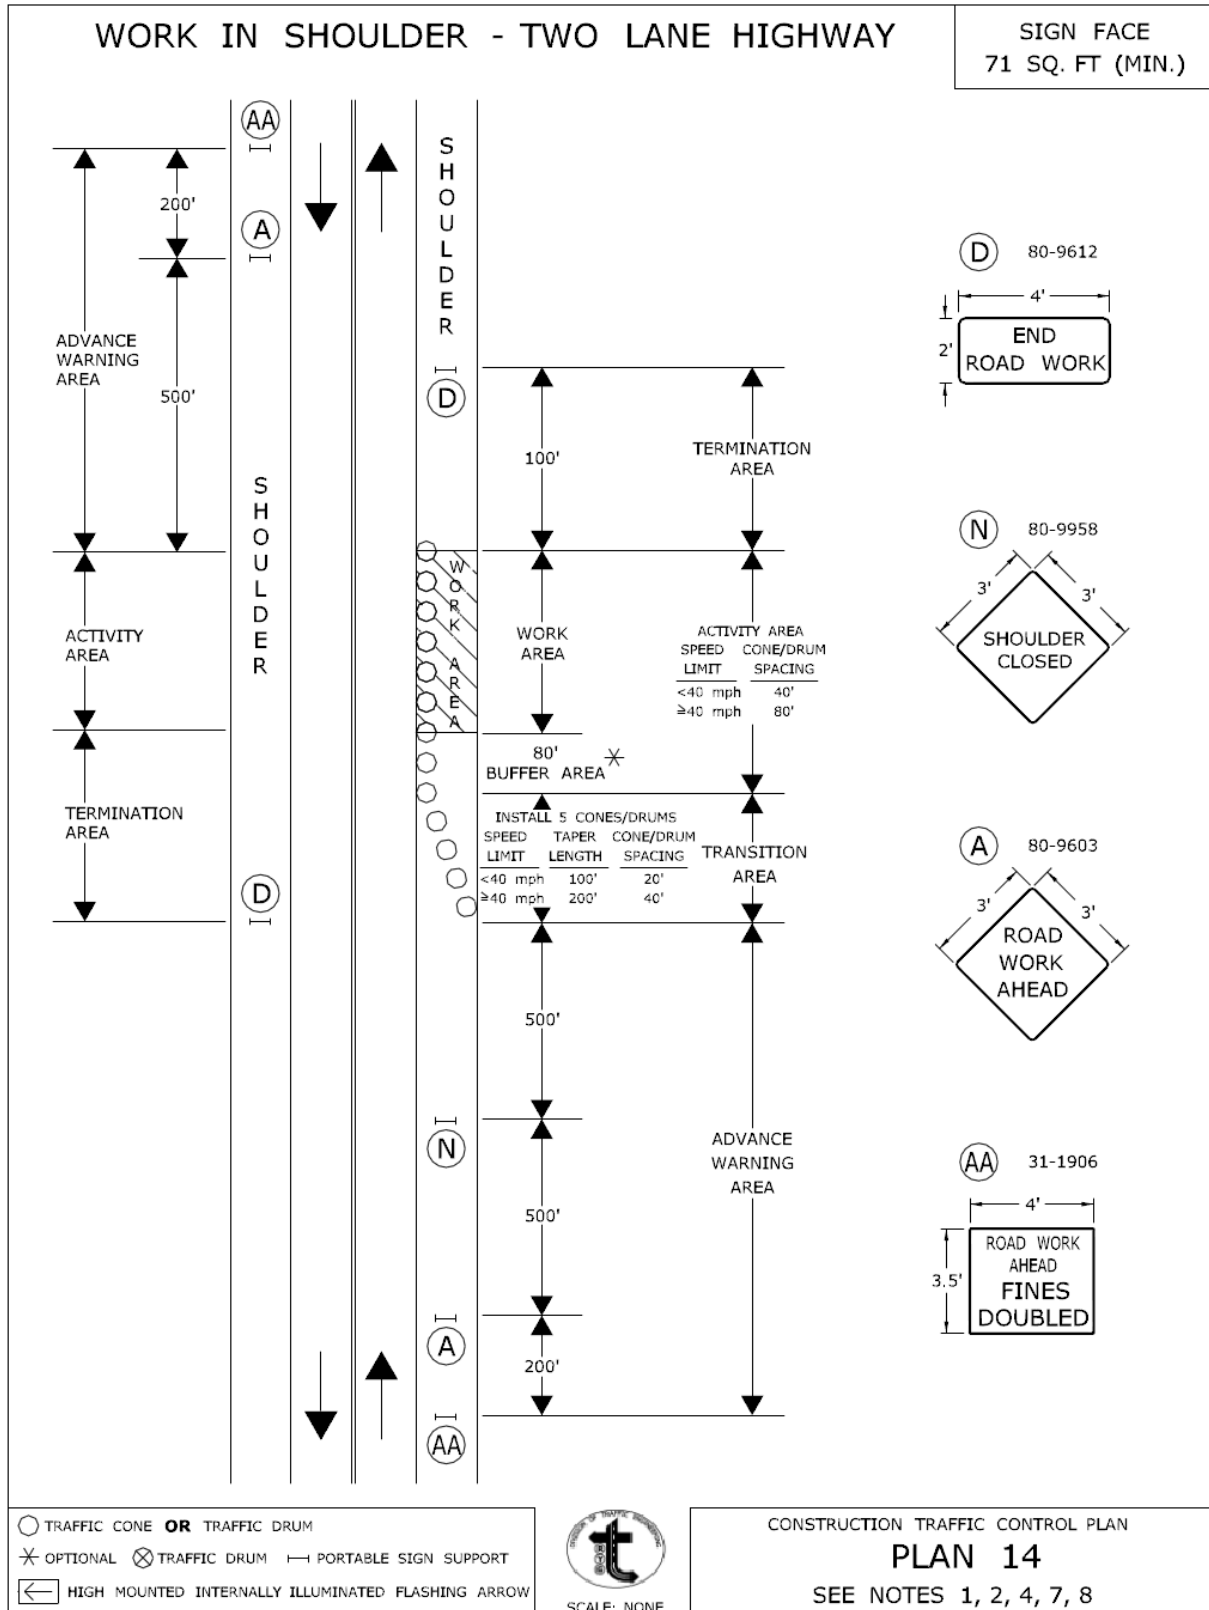

- TRAFFIC CONE **OR** TRAFFIC DRUM
- ✱ OPTIONAL ⊗ TRAFFIC DRUM — PORTABLE SIGN SUPPORT
- ◀ HIGH MOUNTED INTERNALLY ILLUMINATED FLASHING ARROW



SCALE: NONE

CONSTRUCTION TRAFFIC CONTROL PLAN


PLAN 14


SEE NOTES 1, 2, 4, 7, 8


CONNECTICUT DEPARTMENT OF TRANSPORTATION
BUREAU OF ENGINEERING & CONSTRUCTION

APPROVED

Charles S. Harlow
Charles S. Harlow
2012.08.05 15:56:09-04'00"
PRINCIPAL ENGINEER

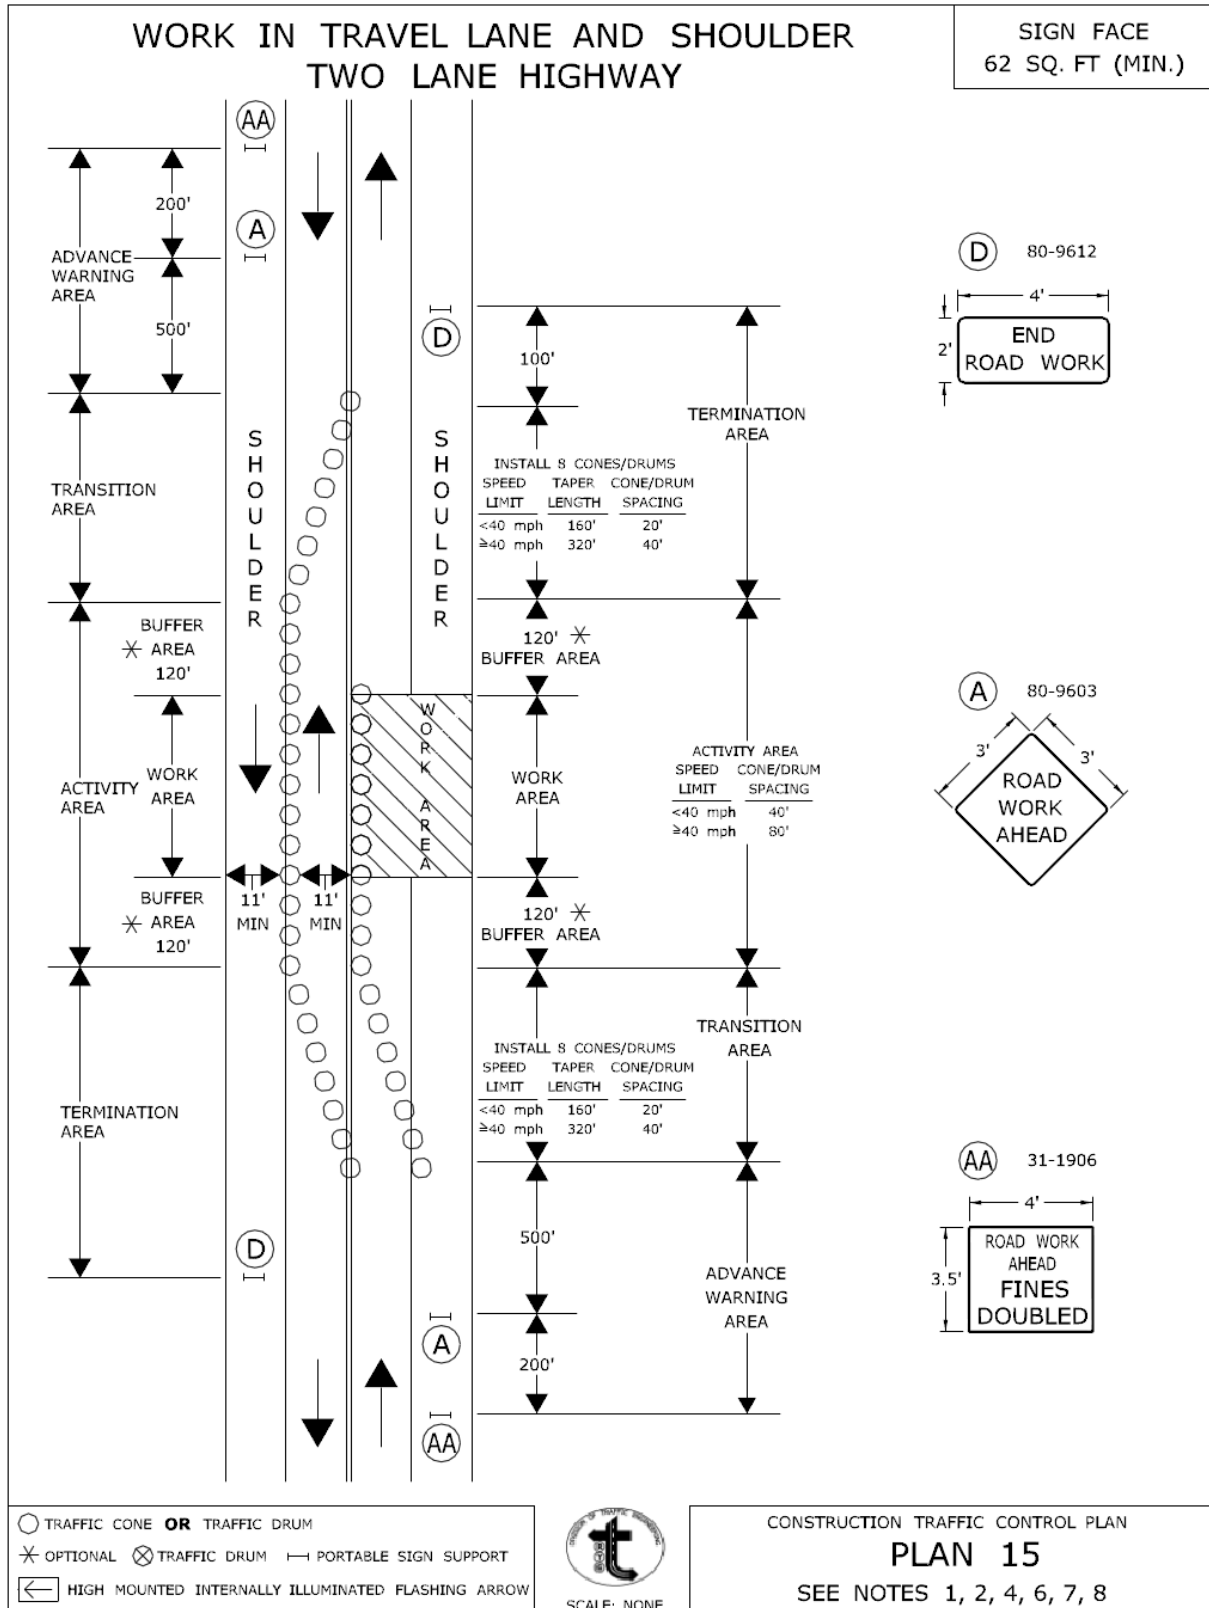

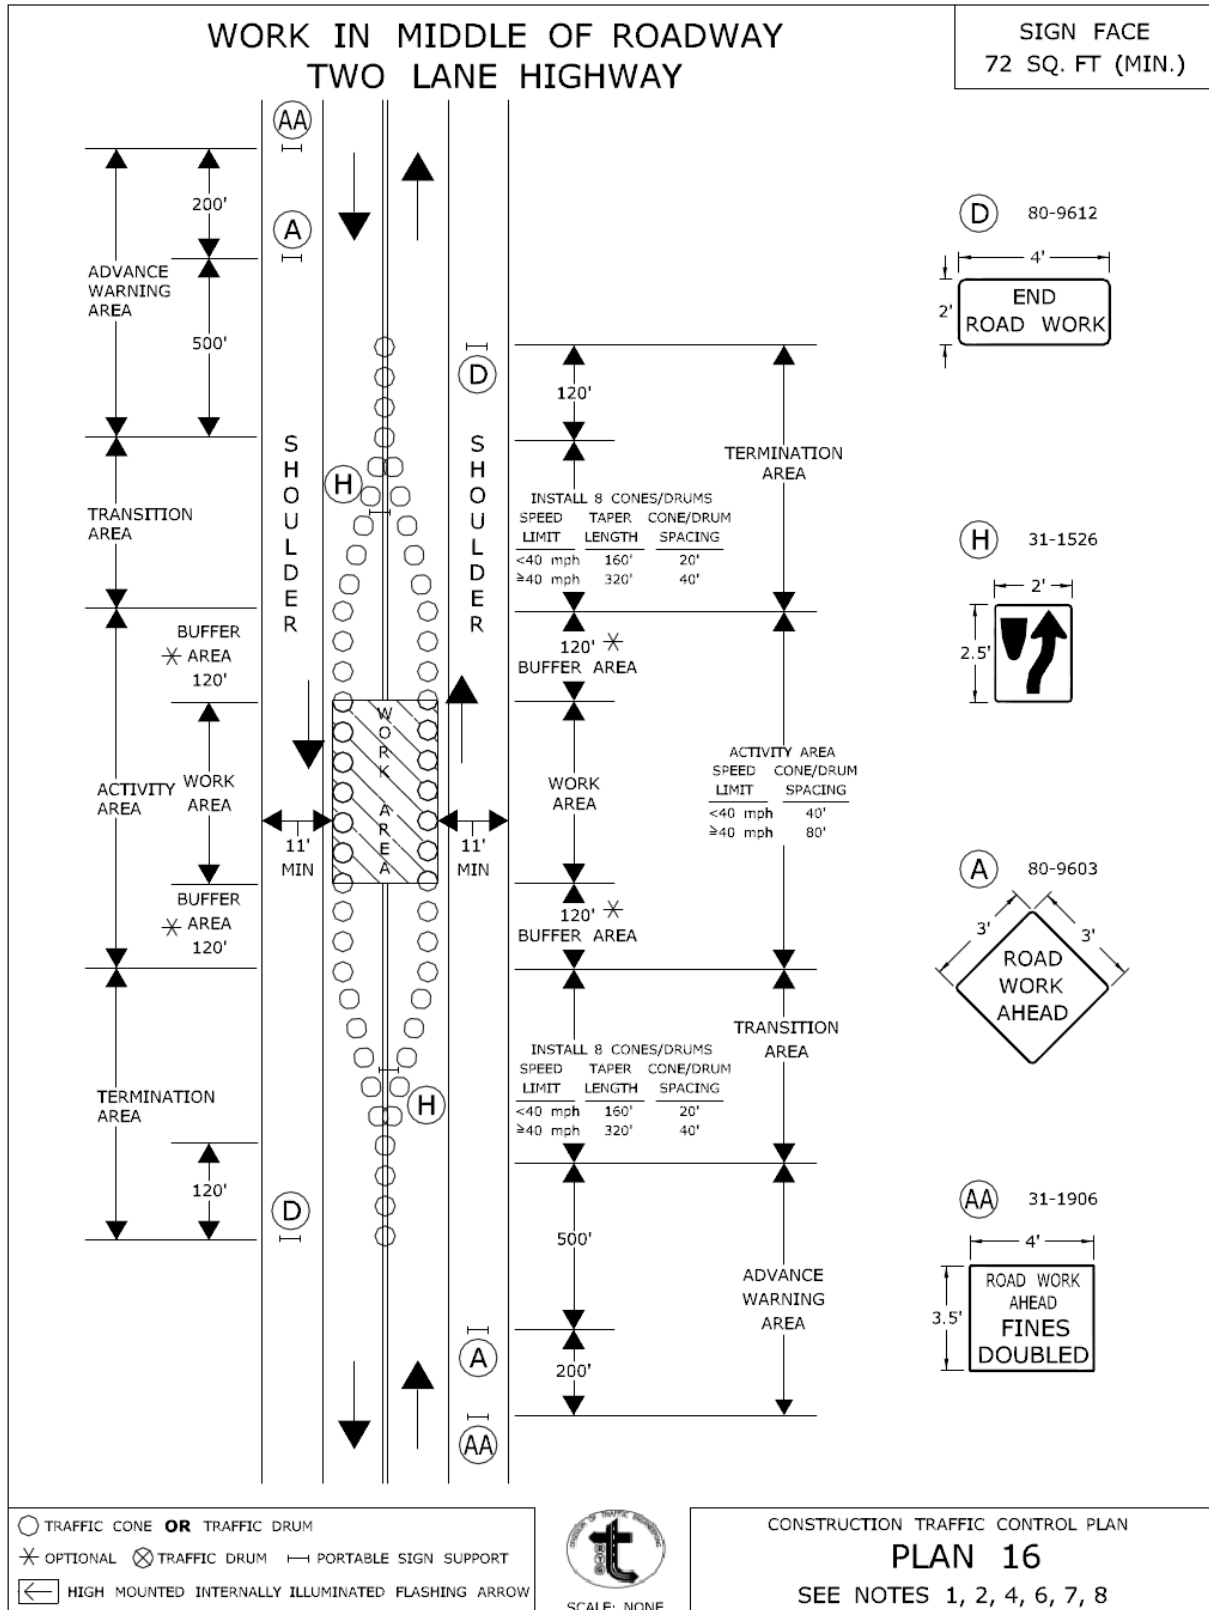

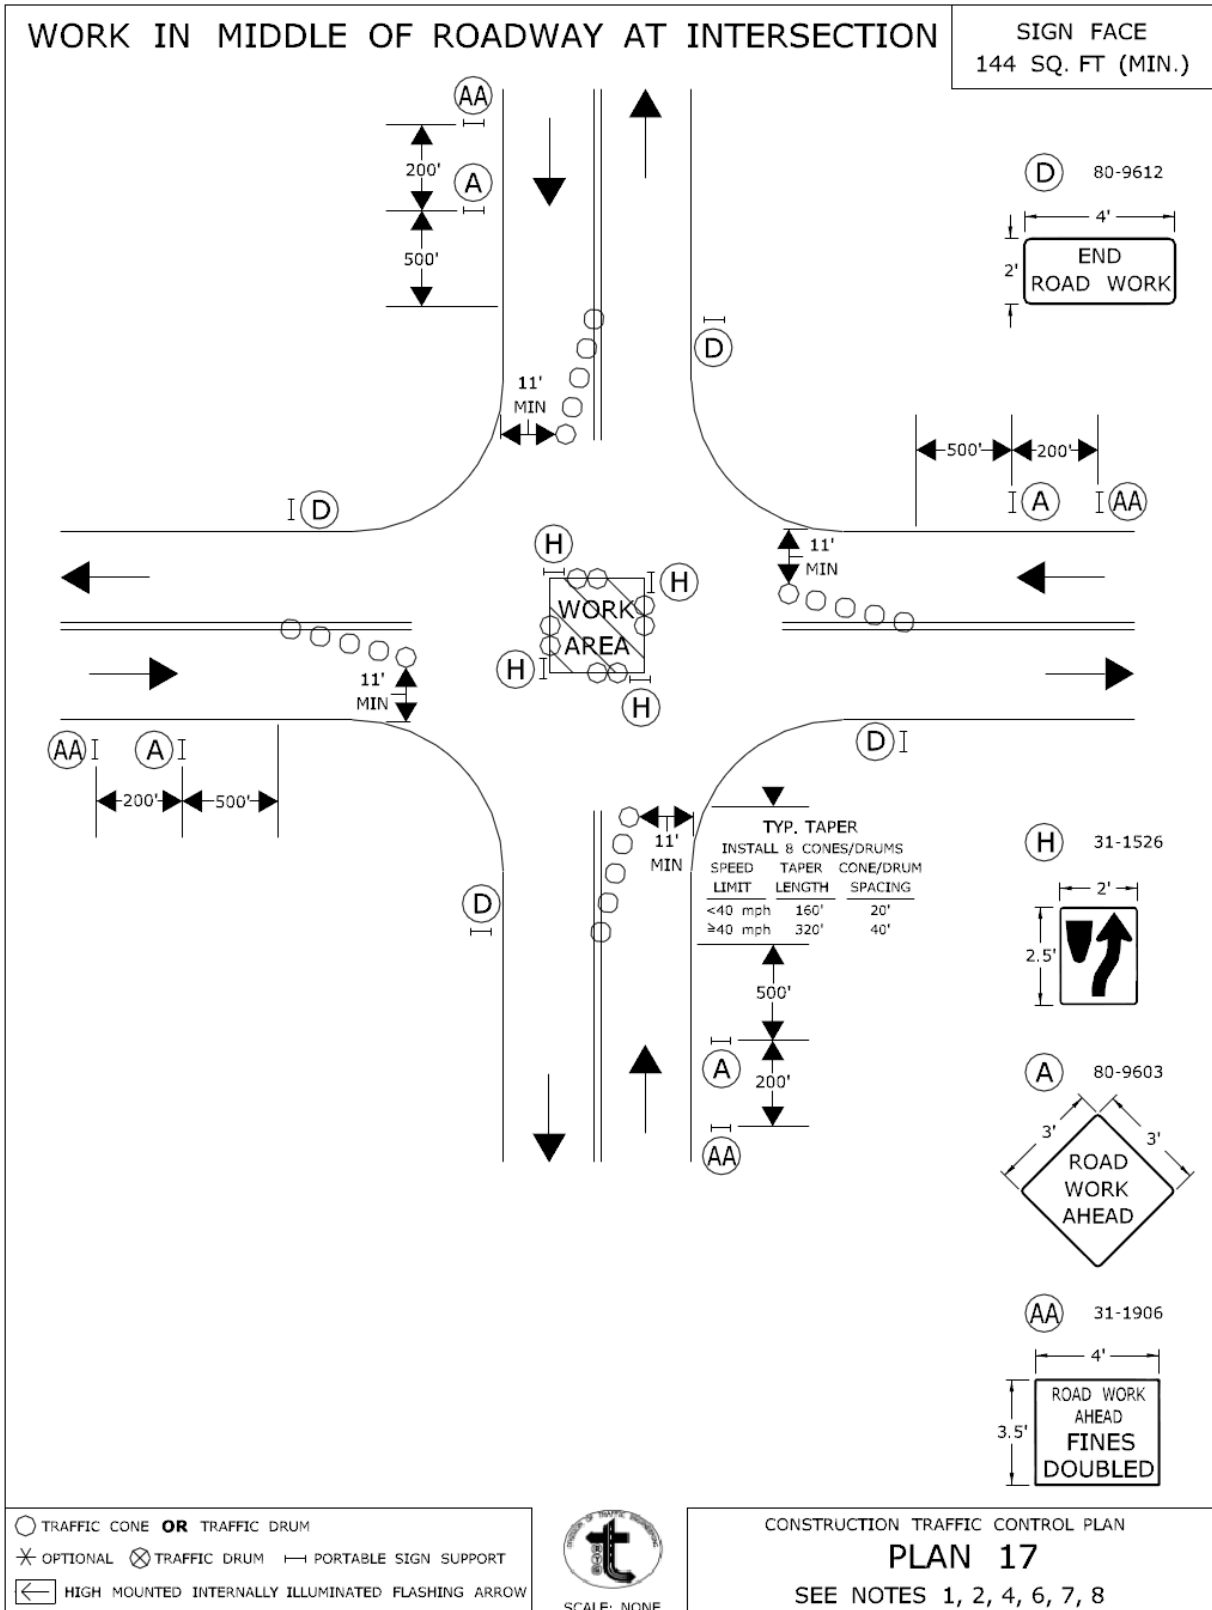

- TRAFFIC CONE **OR** TRAFFIC DRUM
- ✱ OPTIONAL ⊗ TRAFFIC DRUM — PORTABLE SIGN SUPPORT
- ← HIGH MOUNTED INTERNALLY ILLUMINATED FLASHING ARROW




SCALE: NONE

CONSTRUCTION TRAFFIC CONTROL PLAN
PLAN 17
 SEE NOTES 1, 2, 4, 6, 7, 8

CONNECTICUT DEPARTMENT OF TRANSPORTATION
 BUREAU OF ENGINEERING & CONSTRUCTION

APPROVED *Charles S. Harlow*
 PRINCIPAL ENGINEER
 2012.08.05 15:57:16-04'00"

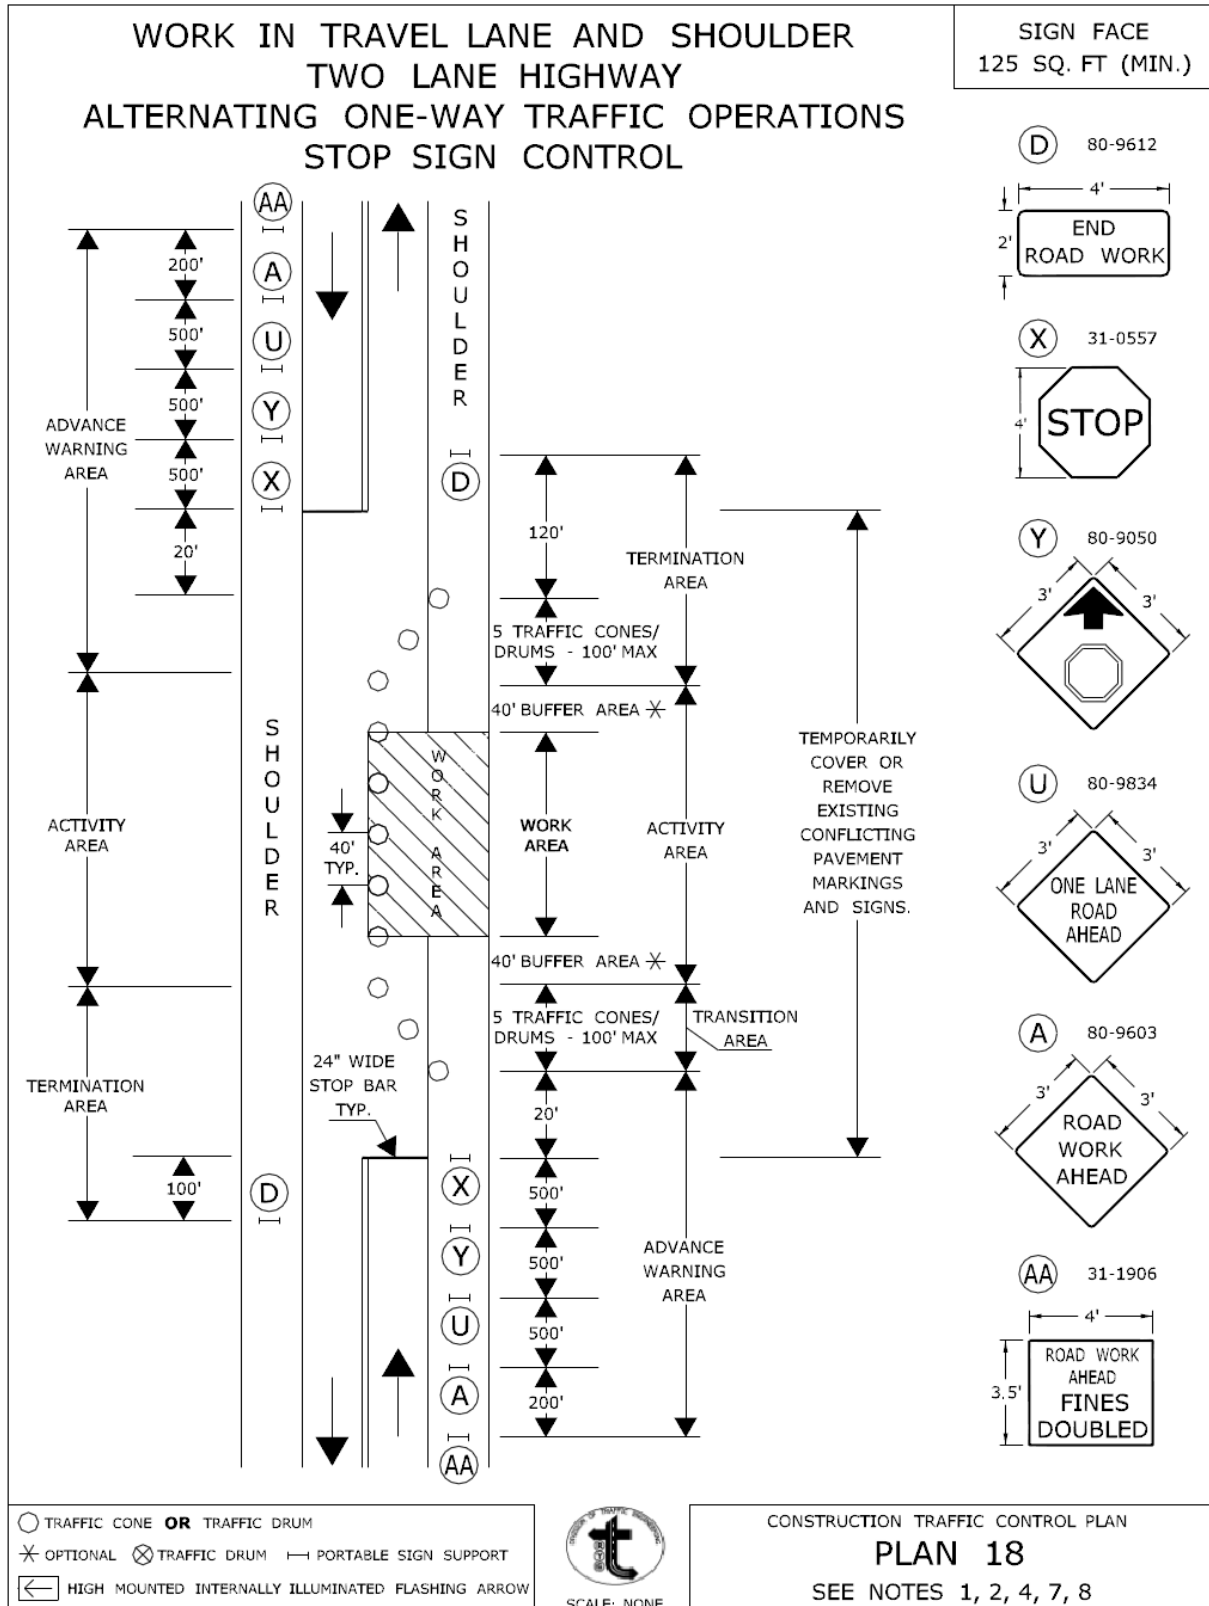

APPROVED *Charles S. Harlow* Charles S. Harlow
2012.06.05 15:57:37-0400
PRINCIPAL ENGINEER

CONNECTICUT DEPARTMENT OF TRANSPORTATION
BUREAU OF ENGINEERING & CONSTRUCTION

Article 9.71.05 – Basis of Payment is supplemented by the following:

The temporary relocation of signs and supports, and the furnishing, installation and removal of any temporary supports shall be paid for under the item “Maintenance and Protection of Traffic”. Temporary overhead sign supports and foundations shall be paid for under the appropriate item(s).

The cost of furnishing, installing, and removing the material for the 4H:1V traversable slope shall be paid for under the item “Maintenance and Protection of Traffic.”

The cost of furnishing, installing, and removing the construction barricades used for intermediate term sidewalk closures shall be paid for under the item “Maintenance and Protection of Traffic.”

ITEM #0992090A – BENCH

Description: The work under this item shall consist of relocating and installing Benches. Bench locations shall be as shown on the plans or as directed by the Engineer.

Materials: Wedge anchor bolt assemblies shall be made of stainless steel.

Construction Methods: Carefully remove existing nuts and washers from the existing anchor bolts and relocate Bench as shown on plan. Existing anchor bolts shall be trimmed flush with the existing concrete sidewalk. Determine location of new anchor bolts and drill anchor bolt holes in concrete sidewalk to the appropriate depth with ½ inch masonry drill bit. Anchor Bench with new stainless steel wedge anchor bolt assemblies (1/2 inch × 3 ¾ inch) which include nuts and washers.

Any items damaged by excavation, which are to remain or are newly installed shall be replaced or repaired to existing conditions by the Contractor at no cost to the Department.

Bench shall be securely installed and shall be plumb and level. Bolts and fasteners shall be trimmed to safe length, as applicable and as directed by the Engineer.

Method of Measurement: Work under this item will be measured for payment per each Bench relocated, as shown on the plans, complete in place and accepted by the Engineer.

Basis of Payment: This item will be paid at the Contract unit price per each “Bench” relocated and accepted, which price shall include all labor, material, equipment, tools and labor incidental thereto, and incidental costs required to complete the work. No additional payment will be made for material or equipment necessary for the satisfactory completion of the work.

Pay Item	Pay Unit
Bench	ea.

ITEM #1001001A – TRENCHING AND BACKFILLING

Section 10.01 is amended as follows:

10.01.01 – Description: *Revise the third paragraph to add “processed aggregate base, granular fill, suitable backfill material” after “crushed stone”.*

10.01.02 – Materials: *Add the following:*

Processed Aggregate Base shall be as specified in M.05.01.

Granular fill shall be specified in M.02.01

10.01.03 – Construction Methods: *Replace the fourth paragraph with the following:*

Where trenching occurs in riprap or crushed stone areas, the surface material shall be replaced in kind. Where trenching in bituminous concrete sidewalk or paved areas, the trench shall be sawcut and backfilled to within the depth from the surface required to replace the removed sidewalk or pavement structure, which shall then be replaced.

Granular fill material shall be used for sidewalks and processed aggregate base shall be used as backfill material for pavement or bituminous concrete surfaces.

The edges of all trenches in paved surfaces shall be sawcut to neat lines prior to paving. All trenches in existing paved surfaces, which parallel the curb, shall be no more than 1 1/2 ft from the curb, or when no curb is present, the apparent edge of road. The exception shall be to avoid existing appurtenances such as catch basins, water gates, manholes etc.

THIS SECTION APPLIES TO THE FOLLOWING INTERSECTIONS ONLY:

Stratford #138-240 – Route 1 (Ferry Blvd) @ Danny's Drive In

Stratford #138-241 – Route 1 (Ferry Blvd/Barnum Ave Cutoff) @ Shopping Center

Stratford #138-242 – Route 1 (Barnum Ave Cutoff) @ Route 1 (Ferry Blvd)

Delete the second paragraph and replace with the following:

All material removed in making the excavation shall be removed and disposed of as directed. All material required for backfilling shall be obtained from sources approved by the Engineer.

10.01.05 -- Basis of Payment: *Replace the second paragraph with the following and remove the fourth paragraph in its entirety:*

It shall also include all sand encasement, suitable backfill material, processed aggregate base, granular fill, backfilling, grading, seeding, fertilizing, mulching, clean-up and disposal of surplus material, sawcutting sidewalks and paved areas, as well as furnishing and installing curbing, riprap, crushed stone, topsoil, sidewalk, pavement or structure, as the case may be.

ITEM #1002201A – TRAFFIC CONTROL FOUNDATION - SPAN POLE

Description: Work under this item shall consist of designing and constructing drilled shaft foundations for steel span poles, in accordance with the details shown on the plans and as ordered by the Engineer.

Materials: The reinforcing steel shall be uncoated, ASTM A615, Grade 60 reinforcement conforming to the requirements of Article M.06.01.

The concrete for the drilled shaft shall conform to Article M.03 for Class PCC04460. The compressive strength of the concrete in the constructed foundation shall conform to the requirements of 6.01- Concrete for Structures and M.03 – Portland Cement Concrete. The concrete mix design, including admixtures, shall be submitted to the Engineer for approval.

The slurry shall be Contractor designed mineral slurry that meets the range of values listed herein. The slurry mix design, including admixtures, shall be submitted to the Engineer for approval.

Rigid metal conduit, ground rod sleeves and related hardware, and end caps shall be galvanized steel conduit, and shall conform to Article M.15.09.

Ground rods shall be 0.625 in. diameter by 10.0 ft. long copper clad steel. The copper cladding shall be a minimum thickness of 0.128 in. The ground clamp shall be a square-head bolt type, approved for direct burial.

Bare copper wire shall conform to Article M.15.13.

Topsoil shall conform to Article M.13.01.

Fertilizer shall conform to Article M.13.03.

Seed mixture shall conform to Article M.13.04.

Mulch shall conform to Article M.13.05.

Erosion control matting shall conform to Article M.13.09.

Construction Methods: For the purpose of bidding this item, the Contractor shall assume that the subsurface conditions for each drilled shaft foundation location consists of cohesionless, medium dense, granular soil (AASHTO A-1 or A-2) with cobbles present and a high groundwater table which requires the use of wet construction/concreting methods. During excavation and construction of each foundation, should the Contractor encounter subsurface conditions that differ materially from those assumed at the time of bid, the Contractor shall

notify the Engineer. All matters regarding increased cost relating to an agreed upon change in subsurface conditions will be handled per Section 1.04.04 – Differing Site Conditions.

The design of drilled shaft foundations shall conform to the requirements of AASHTO Standard Specifications for Structural Supports for Highway Signs, Luminaries and Traffic Signals – latest edition, including the latest interim specifications, available prior to the advertising date of the contract, amended as follows:

1. The foundation shall be designed for the soils and rock properties and parameters based on the subsurface conditions (character of the soil and rock, presence of ground water, etc.) in the location of, adjacent to and below the drilled shaft foundation excavation. The need and extent of all subsurface explorations and investigations shall be determined by the Contractor.
2. The compressive strength, f'_c , of the concrete used in the design shall be 4,000 psi.
3. The reinforcement shall be uncoated and conform to ASTM A615, Grade 60.
4. The foundation shall be designed for the span pole reactions of all group loads and load combinations. The reactions shall include axial, shear, flexural and torsional load effects. No reduction of the reactions or increase in the allowable stresses of the materials is permitted.
5. The diameter of the drilled shaft foundation shall be 3.0 ft., unless otherwise allowed by the Engineer.
6. The design of the drilled shaft foundation shall include embedment of the foundation in soil, the embedment of the foundation in rock or the embedment of the foundation partially in soil and partially in rock, as applicable.
7. The design of the drilled shaft embedment depth shall account for the slope of the finished grade.
8. The minimum embedment for a drilled shaft foundation, constructed entirely in soil, shall be no less than 12.0 ft. below the finished grade at the low side of a sloping grade. The minimum embedment for a drilled shaft foundation, constructed entirely in rock shall be no less than 8.0 ft. below the finished grade at the low side of a sloping grade.
9. The embedment depth for a drilled shaft foundation, determined by the Brom's design method, shall have a minimum factor of safety of 3.25 applied to the shear and moment load effects. The factor of safety applied to the torsional load effect shall be no less than 1.3.

10. The load factor method shall be used for the structural design of the drilled shaft foundation. The load factor applied to all loads, dead, wind and ice, and their effects, axial, shear, flexure and torsion, shall be no less than 1.6. The drilled shaft may be designed in accordance with the load factor method presented in the latest edition of the Building Code Requirements for Reinforced Concrete”, ACI 318.
11. The structural design of the drilled shaft shall be based on stress and strain compatibility in the circular drilled shaft cross section.
12. The drilled shaft foundation shall be reinforced with longitudinal and transverse reinforcement. The area of longitudinal reinforcement should be no less than the sum of the reinforcement required for flexure and the longitudinal reinforcement required for torsion. The area of transverse reinforcement should be no less than the sum of the reinforcement required for shear and the transverse reinforcement required for torsion.
13. The minimum number of longitudinal reinforcing bars shall be 16. The minimum size of longitudinal reinforcing bars shall be #8. The minimum area of longitudinal reinforcing bars shall be no less than 1% of the gross cross-sectional area of the shaft. The minimum clear distance between longitudinal reinforcing bars shall be no less than 5 times the maximum aggregate size or 5 in., whichever is greater. The reinforcement shall extend full length of the drilled shaft foundation, including the pedestal. Splicing of the longitudinal reinforcement is not permitted.
14. The drilled shaft foundation shall be transversely reinforced with spirals or circular, one piece, enclosed ties. The minimum size of the transverse reinforcement shall be #4. The maximum spacing/pitch of the transverse reinforcement shall be no more than 6 in. The minimum spacing/pitch of the transverse reinforcement shall be no more than 4 in. The spiral reinforcement shall be terminated at the top and the bottom with 1 ½ turns of the reinforcing and a 135° standard hook. Spirals may be spliced with lap splices or mechanical connectors. For spirals, the minimum lap splice length shall be 1.7 times the tension development length (including modification factors) of the bar or 48 bar diameters, whichever is greater. For spirals, the mechanical connectors shall develop both in tension and compression 125% of the specified yield strength of the bar and conform to the latest edition of the AASHTO LRFD Bridge Design Specifications, including the latest interim specifications. For ties, the minimum lap splice length shall be no less than 1.7 times the tension development length (including modification factors) of the bar. Tie lap splices shall be alternated.
15. The design of the foundation shall be coordinated with the traffic structure to avoid conflicts between the embedded support anchorage and the foundation reinforcement.

Prior to excavating for the foundation, the Contractor shall submit working drawings and design calculations, with all details and documents necessary for fabrication and construction, for each span pole foundation in a **span wire structure configuration** for review in accordance with Article 1.05.02.

The working drawings and design calculations for the span pole foundations shall conform to working drawing requirements for permanent construction. **A single set of working drawings with tabulated data for multiple span pole foundations in span wire structure configuration is allowed.** Each span pole foundation shall be referenced with an alpha-numeric identifier noted on the Contract documents. The working drawings and calculations shall be prepared in Customary U.S. units.

The span pole foundation working drawing and calculation submittal shall include the following:

1. title sheet
2. table of contents
3. contact information for designer – contact information shall include name and address of design firm, name of contact person with phone number and email address
4. copy of the certificate of insurance
5. foundation working drawings
6. foundation design calculations

The working drawings shall include complete details of all foundation components. The drawings shall include, but not be limited to the following:

1. the Project number, town and support identification number
2. reference to the design specifications, including interim specifications
3. material specifications for all components
4. embedment depths for foundation in soil, rock and a combination of soil and rock
5. anchor bolt details, including dimensions, embedment and projection

The design calculations shall include, but not be limited to the following:

1. the Project number, town and support identification number
2. references to design specifications, including interim specifications, and the applicable code section and articles
3. description/documentation for all computer programs used in the design
4. drawings/models of the foundation with dimensions, loads and references to the local and global coordinate systems used (as applicable), to facilitate review of the results
5. traffic structure reactions of all group loads and load combinations
6. soil and rock design parameters
7. computations demonstrating the geotechnical and structural capacity of the drilled shaft is adequate for all group load combinations

Prior to excavating for the foundation, the Contractor shall submit the following:

Reinforcing Steel Shop Drawings: Based on the reviewed foundation design, the Contractor shall prepare reinforcing steel shop drawings for each foundation. The drawings shall be reviewed and stamped by the foundation designer. Four copies of each reviewed drawing shall be submitted to the Engineer at the District Construction office. One copy of each reviewed and stamped drawing shall be submitted to the “Engineer of Record”.

Concrete and Slurry Mix Designs: The Contractor shall submit to the District Engineer the concrete mix design and the slurry mix design, including admixtures, for review.

Foundation Construction Procedure: The Contractor shall submit to the District Engineer a written foundation construction procedure outlining the equipment; drilling procedure for soil and rock, including removal of obstructions and removal of excavated spoils; temporary casing placement and removal; slurry placement; reinforcement, anchor bolt and conduit placement; and concrete placement required for the drilled shaft foundation construction for review. The procedure should include contingencies for the various soil, rock and subsurface water conditions that may be encountered during the foundation construction.

The Engineer will evaluate the foundation construction procedure for conformance with the contract documents and will then notify the Contractor of any additional information required and/or changes necessary to meet the contract requirements. All procedural approvals given by the Engineer shall be subject to trial in the field and shall not relieve the Contractor of the responsibility to

satisfactorily complete the work as detailed in the plans and specifications. The Contractor shall not commence construction of the drilled shafts until the Engineer has accepted the foundation construction procedure.

Excavations required for shafts shall be performed through whatever materials are encountered, to the dimensions and elevations in the working drawings or as ordered by the Engineer. The methods and equipment used shall be suitable for the intended purpose and materials encountered. Shaft excavation may be performed by combinations of augering, rotary drilling, down-the-hole hammer, reverse circulation drilling, clamming, scraping, or other means approved by the Engineer. Generally, either the dry method, wet method, or temporary casing method may be used, as necessary, to produce sound, durable concrete foundation shafts free of defects. The Contractor shall select and use the method that is needed to properly accomplish the work, as determined by site conditions and subject to the approval of the Engineer. The Contractor is responsible for maintaining the stability of the shaft excavation during all phases of construction.

The dry method consists of drilling the shaft excavation, removing accumulated water and loose material from the excavation, and placing the shaft concrete in a relatively dry excavation. The dry construction method shall be used only at sites where the groundwater table and site conditions are suitable to permit construction of the shaft in a relatively dry excavation, and where the sides and bottom of the shaft are stable and may be visually inspected prior to placing the concrete. The use of the dry construction method is permitted if less than one foot of water accumulates in the bottom of a hole without pumping over a one hour period, the excavation remains stable and any loose material and water can be removed prior to placement of concrete.

The wet construction method shall be used at sites where a dry excavation cannot be maintained for placement of the shaft concrete. Wet construction methods consist of using a mineral slurry to maintain stability of the hole perimeter while advancing the excavation to final depth, placing the reinforcing cage and shaft concrete. This procedure may require desanding and cleaning the slurry; final cleaning of the excavation by means of a bailing bucket, air lift, submersible pump or other devices; and placing the shaft concrete with a tremie. Unless it is demonstrated to the satisfaction of the Engineer that the surface casing is not required, temporary surface casings shall be provided to aid shaft alignment and position, and to prevent sloughing of the top of the shaft excavation. Surface casing is defined as the amount of casing required from the ground surface to a point in the shaft excavation where sloughing of the surrounding soil does not occur.

The temporary casing construction method shall be used at all sites where the dry or wet construction methods are inappropriate. Temporary casing construction method consists of advancing the excavation through caving material by the wet method. Temporary casing may be installed by driving or vibratory procedures in advance of excavation to the lower limits of the caving material. When a nearly impervious formation is reached, a casing is placed in the hole and sealed in the nearly impervious formation. After the drilling fluid is removed from the casing, drilling may proceed as with the dry method except that the casing is withdrawn when the shaft concrete is placed. If seepage conditions prevent use of the dry method, excavation is completed using the wet method. Temporary casing may be installed by driving or vibratory

procedures in advance of excavation to the lower limits of the caving material. Slurry may be omitted if the casing can be installed with only minor caving of the hole.

If the Engineer determines that the foundation material encountered during excavation is unsuitable or differs from that anticipated in the design of the shaft, or if rock is encountered at an unanticipated elevation, the Contractor's foundation designer shall determine if the foundation embedment should be revised from that shown on the working drawings. If rock is encountered, the Engineer shall be notified to inspect and determine the elevation of the top of competent rock. Any revisions to the foundation embedment during construction shall be reviewed by the Engineer.

Excavated materials which are removed from the shaft excavation and any drilled fluids used shall be disposed of by the Contractor as directed by the Engineer and in accordance with Section 1.10.

Casings shall be metal, smooth, clean, watertight, and of ample strength to withstand both handling and driving stresses and the pressure of both concrete and the surrounding earth materials. The outside diameter of casing shall not be less than the specified size of the shaft. Temporary casings shall be removed while the concrete remains workable (i.e., a slump of 4 in. or greater). Before the casing is withdrawn and while the casing is being withdrawn, a 5.0 ft. minimum head of fresh concrete in the casing shall be maintained so that all the fluid trapped behind the casing is displaced upward without contaminating the shaft concrete. The required minimum concrete head may have to be increased to counteract groundwater head outside the casing. Separation of the concrete by hammering or otherwise vibrating the casing, during withdrawal operations, shall be avoided. Casing extraction shall be at a slow, uniform rate with the pull in line with the shaft axis.

Slurry used in the drilling process shall be a mineral slurry. The slurry shall have both a mineral grain size that will remain in suspension and sufficient viscosity and gel characteristics to transport excavated material to a suitable screening system. The percentage and specific gravity of the material used to make the suspension shall be sufficient to maintain the stability of the excavation and to allow proper concrete placement. The level of the slurry shall be maintained at a height sufficient to prevent caving of the hole.

The mineral slurry shall be premixed thoroughly with clean fresh water at a temperature above 41° F and adequate time allotted for hydration prior to introduction into the shaft excavation. The elevation of the slurry within the shaft foundation shall be maintained within 24 in. of the top casing and at least 48 in. above the existing water level during drilling and until the concrete placement is essentially complete. The slurry properties shall be maintained at all times, including non-working periods and stoppages. The slurry shall be circulated and agitated, continuously if necessary, to maintain the slurry properties and to prevent it from setting up in the shaft.

The Contractor, in the presence of the Engineer, shall perform control tests on the slurry to ensure that the density, viscosity, and pH fall within the acceptable limits tabulated below. The

Contractor shall provide all equipment required to perform the tests. If desanding is required, sand content shall not exceed 4% (by volume) at any point in the shaft excavation as determined by the American Petroleum Institute sand content test.

Range of Values (at 68°F)

Property (Units)	Time of Slurry Introduction	Time of Concreting (in Hole)	Test Method
Density (pcf)	64.3 to 69.1	64.3 to 75.0	Density Balance
Viscosity (seconds per quart)	28 to 45	28 to 45	Marsh Cone
pH	8 to 11	8 to 11	pH paper or meter

The control tests to determine unit weight (density), viscosity, and pH values of the slurry shall be done during the shaft excavation to establish a consistent working pattern.

Prior to placing shaft concrete, slurry samples shall be taken from the bottom and at intervals not exceeding 10.0 ft. for the full height of slurry. Any heavily contaminated slurry that has accumulated at the bottom of the shaft shall be eliminated. The mineral slurry shall be within specification requirements immediately before shaft concrete placement.

The hole shall be covered when left unattended.

After completing the shaft excavation, all loose material existing at the bottom of the hole shall be removed.

Prior to placing the reinforcement into the shaft, the Contractor, in the presence of the Engineer, shall determine the shaft dimensions, depth and alignment of the shaft. The concrete shaft shall not be out of plumb by more than 0.25 in. per foot of depth. The Contractor shall provide all equipment necessary for checking the shaft excavation. The Engineer shall inspect the shaft and verify that it has been properly cleaned.

The reinforcing steel shall be fabricated and assembled in accordance with Article 6.02.03. All reinforcement shall be assembled with wire ties. Welding to assemble the reinforcement is not permitted.

Immediately after the shaft excavation has been inspected and approved by the Engineer and prior to placement of the concrete, the assembled reinforcing steel cage, including cage stiffener bars, spacers, centralizers, and other necessary appurtenances, shall be carefully placed into the shaft excavation as a unit. Dropping or forcing cages into the shaft will not be allowed. The reinforcing steel in the shaft shall be tied and supported so that the reinforcing steel will remain within allowable tolerances of its intended position until the concrete will support the reinforcing steel. When concrete is placed by tremie methods, temporary hold-down devices shall be used to

prevent uplifting of the reinforcing steel cage during concrete placement. Concrete spacers or other approved noncorrosive spacing devices shall be used at sufficient intervals not exceeding 5.0 ft. along the shaft to insure concentric location of the cage within the shaft excavation. When the size of the longitudinal reinforcing steel is larger than a #8 bar, such spacing shall not exceed 10.0 ft. After placement of the reinforcing cage, the Engineer shall inspect the shaft to ensure that it has remained clean. If the inspection indicates that loose material has accumulated at the bottom of shaft excavation, the Contractor shall remove the reinforcing cage and reclean the shaft.

If directed by the Engineer, the top of the shaft shall be formed square with the length of the sides matching the diameter of the shaft.

Concrete construction shall conform to Subarticle 6.01.03-2,3,4,5 and 6 as amended herein.

Concrete shall be placed in the shaft excavation as soon as possible, but no more than 4 hours after completion of excavation and cleaning of the bottom of the excavation, and no more than 2 hours after placement of the reinforcing steel cage. Concrete shall be placed in a continuous operation to the top of the shaft. The concrete level shall be horizontal during the pouring operations. Concrete placement shall continue after the shaft is full and good quality concrete is evident at the top of the shaft. The elapsed time from the beginning of concrete placement in the shaft to the completion of placement shall not exceed 2 hours.

In dry construction, concrete shall be placed in a single continuous operation with the flow of concrete down the center of the shaft excavation so as to consolidate the concrete on impact. During placement operations, the concrete is not permitted to hit the reinforcing steel. A dropchute, consisting of a hopper and flexible hose, may be used to direct the concrete down the center of the foundation and prevent the concrete from hitting the reinforcing steel. Accumulated water shall be removed before placing the concrete. At the time of concrete placement, no more than 2 in. of water may exist at the bottom of the excavation and loose sediment no more than 0.5 in. over one-half the base is acceptable.

In wet (slurry) construction, concrete is to be placed by the tremie method, where the concrete displaces the slurry from bottom of the excavation to the top. The concrete shall be placed through a top metal hopper and into a rigid leak-proof elephant trunk tremie tube, sufficiently large enough to permit free flow of concrete. The tremie tube shall be positioned so that it can be removed without disturbing the reinforcing. Initially, the discharge end of the tremie tube shall be sealed closed (plugged) to prevent slurry from entering the tube after it is placed in the excavation and before the tube is filled with concrete. After concrete placement has started, the tremie tube shall be kept full of concrete to the bottom of the hopper to maintain a positive concrete head. The flow of concrete shall be induced by slightly raising the discharge end of the tube, always keeping the tube end in the deposited concrete. No horizontal movement of the tremie tube will be permitted.

The shaft concrete shall be vibrated or rodded to a depth of 5.0 ft. below the ground surface except where soft uncased soil or slurry remaining in the excavation will possibly mix with the concrete.

Exposed concrete shall be cured and finished in accordance with Subarticle 6.01.03-7, 9 and 10.

Anchor bolt assemblies shall be embedded in the concrete as shown on the working drawings. A template plate shall be used to hold the anchor bolt assemblies, conduits and ground rod sleeve in the correct position. The anchor bolts shall be installed plumb.

All conduit ends terminating below grade shall be capped with a malleable iron caps. All above-grade conduit ends shall be terminated with an insulated bonding bushing with tinned insert.

Ground rod and ground wire shall be installed as shown on the plans.

No construction operations that would cause soil movement adjacent to the shaft, other than mild vibration, shall be conducted for at least 48 hours after shaft concrete has been placed.

The top of the foundations shall be backfilled and the adjacent disturbed ground surfaces restored to match the surrounding area after the concrete has cured and the forms are removed. Placement of topsoil shall conform to Articles 9.44.01 and 9.44.03. Turf establishment shall conform to Article 9.50.03.

The span poles shall not be erected on the foundation until the concrete in the shaft has attained a compressive strength, f'_c , greater than or equal to 4,000 psi.

Method of Measurement: This work will be measured for payment by the number of foundation units, each completely installed and accepted.

The work to remove rock from the foundation excavation will be measured from the top of rock to the bottom of rock excavation.

Basis of Payment: The work will be paid for at the contract unit price each for "Traffic Control Foundation – Span Pole," completed and accepted in place, which price shall include all equipment, materials, tools and labor incidental to the subsurface exploration, design, fabrication, construction and disposal of drilling spoils, of the foundations at the locations specified on the plans.

Backfilling and restoration of adjacent ground surfaces (pavement, slope protection, topsoil and seed, etc.) in all areas disturbed by the work will not be paid for separately, but will be included as part of the work. The Engineer will determine the type, thickness and horizontal limits of the surfaces to be restored.

When rock is encountered within the limits of excavation, its removal will be paid for at the contract unit price per vertical foot for "Rock in Foundation Excavation," which price shall

include any additional excavation to remove the rock and any additional concrete required to fill the excavation beyond the designed foundation hole dimensions. Rock, in so far as it applies to "Rock in Foundation Excavation," shall be defined as rock in definite ledge formation, boulders, or portions of boulders, cement masonry structures, concrete structures or Portland cement concrete pavement which has a cross-sectional area that exceeds 50% of the cross-sectional area of the designed foundation hole.

ITEM #1002202A – TRAFFIC CONTROL FOUNDATION - MAST ARM

Description: Work under this item shall consist of designing and constructing drilled shaft foundations for mast arm assemblies, in accordance with the details shown on the plans and as ordered by the Engineer.

Materials: The reinforcing steel shall be uncoated, ASTM A615, Grade 60 reinforcement conforming to the requirements of Article M.06.01.

The concrete for the drilled shaft shall conform to Article M.03 for Class PCC04460. The compressive strength of the concrete in the constructed foundation shall conform to the requirements of 6.01- Concrete for Structures and M.03 – Portland Cement Concrete. The concrete mix design, including admixtures, shall be submitted to the Engineer for approval.

The slurry shall be Contractor designed mineral slurry that meets the range of values listed herein. The slurry mix design, including admixtures, shall be submitted to the Engineer for approval.

Rigid metal conduit, ground rod sleeves and related hardware, and end caps shall be galvanized steel conduit, and shall conform to Article M.15.09.

Ground rods shall be 0.625 in. diameter by 10.0 ft. long copper clad steel. The copper cladding shall be a minimum thickness of 0.128 in. The ground clamp shall be a square-head bolt type, approved for direct burial.

Bare copper wire shall conform to Article M.15.13.

Topsoil shall conform to Article M.13.01.

Fertilizer shall conform to Article M.13.03.

Seed mixture shall conform to Article M.13.04.

Mulch shall conform to Article M.13.05.

Erosion control matting shall conform to Article M.13.09.

Construction Methods: For the purpose of bidding this item, the Contractor shall assume that the subsurface conditions for each drilled shaft foundation location consists of cohesionless, medium dense, granular soil (AASHTO A-1 or A-2) with cobbles present and a high groundwater table which requires the use of wet construction/concreting methods. During excavation and construction of each foundation, should the Contractor encounter subsurface conditions that differ materially from those assumed at the time of bid, the Contractor shall

notify the Engineer. All matters regarding increased cost relating to an agreed upon change in subsurface conditions will be handled per Section 1.04.04 – Differing Site Conditions.

The design of drilled shaft foundations shall conform to the requirements of AASHTO Standard Specifications for Structural Supports for Highway Signs, Luminaries and Traffic Signals – latest edition, including the latest interim specifications, available prior to the advertising date of the contract, amended as follows:

1. The foundation shall be designed for the soils and rock properties and parameters based on the subsurface conditions (character of the soil and rock, presence of ground water, etc.) in the location of, adjacent to and below the drilled shaft foundation excavation. The need and extent of all subsurface explorations and investigations shall be determined by the Contractor.
2. The compressive strength, f'_c , of the concrete used in the design shall be 4,000 psi.
3. The reinforcement shall be uncoated and conform to ASTM A615, Grade 60.
4. The foundation shall be designed for the mast arm assembly reactions of all group loads and load combinations. The reactions shall include axial, shear, flexural and torsional load effects. No reduction of the reactions or increase in the allowable stresses of the materials is permitted.
5. The diameter of the drilled shaft foundation shall be 3.0 ft., unless otherwise allowed by the Engineer.
6. The design of the drilled shaft foundation shall include embedment of the foundation in soil, the embedment of the foundation in rock or the embedment of the foundation partially in soil and partially in rock, as applicable.
7. The design of the drilled shaft embedment depth shall account for the slope of the finished grade.
8. The minimum embedment for a drilled shaft foundation, constructed entirely in soil, shall be no less than 12.0 ft. below the finished grade at the low side of a sloping grade. The minimum embedment for a drilled shaft foundation, constructed entirely in rock shall be no less than 8.0 ft. below the finished grade at the low side of a sloping grade.
9. The embedment depth for a drilled shaft foundation, determined by the Brom's design method, shall have a minimum factor of safety of 3.25 applied to the shear and moment load effects. The factor of safety applied to the torsional load effect shall be no less than 1.3.

10. The load factor method shall be used for the structural design of the drilled shaft foundation. The load factor applied to all loads, dead, wind and ice, and their effects, axial, shear, flexure and torsion, shall be no less than 1.6. The drilled shaft may be designed in accordance with the load factor method presented in the latest edition of the Building Code Requirements for Reinforced Concrete”, ACI 318.
11. The structural design of the drilled shaft shall be based on stress and strain compatibility in the circular drilled shaft cross section.
12. The drilled shaft foundation shall be reinforced with longitudinal and transverse reinforcement. The area of longitudinal reinforcement should be no less than the sum of the reinforcement required for flexure and the longitudinal reinforcement required for torsion. The area of transverse reinforcement should be no less than the sum of the reinforcement required for shear and the transverse reinforcement required for torsion.
13. The minimum number of longitudinal reinforcing bars shall be 16. The minimum size of longitudinal reinforcing bars shall be #8. The minimum area of longitudinal reinforcing bars shall be no less than 1% of the gross cross-sectional area of the shaft. The minimum clear distance between longitudinal reinforcing bars shall be no less than 5 times the maximum aggregate size or 5 in., whichever is greater. The reinforcement shall extend full length of the drilled shaft foundation, including the pedestal. Splicing of the longitudinal reinforcement is not permitted.
14. T
 he drilled shaft foundation shall be transversely reinforced with spirals or circular, one piece, enclosed ties. The minimum size of the transverse reinforcement shall be #4. The maximum spacing/pitch of the transverse reinforcement shall be no more than 6 in.. The minimum spacing/pitch of the transverse reinforcement shall be no more than 4 in.. The spiral reinforcement shall be terminated at the top and the bottom with 1 ½ turns of the reinforcing and a 135° standard hook. Spirals may be spliced with lap splices or mechanical connectors. For spirals, the minimum lap splice length shall be 1.7 times the tension development length (including modification factors) of the bar or 48 bar diameters, whichever is greater. For spirals, the mechanical connectors shall develop both in tension and compression 125% of the specified yield strength of the bar and conform to the latest edition of the AASHTO LRFD Bridge Design Specifications, including the latest interim specifications. For ties, the minimum lap splice length shall be no less than 1.7 times the tension development length (including modification factors) of the bar. Tie lap splices shall be alternated.

15. The design of the foundation shall be coordinated with the traffic structure to avoid conflicts between the embedded support anchorage and the foundation reinforcement.

Prior to excavating for the foundation, the Contractor shall submit working drawings and design calculations, with all details and documents necessary for fabrication and construction, for each mast arm assembly foundation for review in accordance with Article 1.05.02.

The working drawings and design calculations for the mast arm assembly foundation shall conform to working drawing requirements for permanent construction. **A single set of drawings with tabulated data for multiple mast arm foundations is not permitted.** Each mast arm foundation shall be referenced with an alpha-numeric identifier noted on the Contract documents. The working drawings and calculations shall be prepared in Customary U.S. units.

The mast arm foundation working drawing and calculation submittal shall include the following:

1. title sheet
2. table of contents
3. contact information for designer – contact information shall include name and address of design firm, name of contact person with phone number and email address
4. copy of the certificate of insurance
5. foundation working drawings
6. foundation design calculations

The working drawings shall include complete details of all foundation components. The drawings shall include, but not be limited to the following:

1. the Project number, town and support identification number
2. reference to the design specifications, including interim specifications
3. material specifications for all components
4. embedment depths for foundation in soil, rock and a combination of soil and rock
5. anchor bolt details, including dimensions, embedment and projection

The design calculations shall include, but not be limited to the following:

1. the Project number, town and support identification number
2. references to design specifications, including interim specifications, and the applicable code section and articles
3. description/documentation for all computer programs used in the design
4. drawings/models of the foundation with dimensions, loads and references to the local and global coordinate systems used (as applicable), to facilitate review of the results
5. traffic structure reactions of all group loads and load combinations
6. soil and rock design parameters
7. calculations demonstrating the geotechnical and structural capacity of the drilled shaft is adequate for all group load combinations

Prior to excavating for the foundation, the Contractor shall submit the following:

Reinforcing Steel Shop Drawings: Based on the reviewed foundation design, the Contractor shall prepare reinforcing steel shop drawings for each foundation. The drawings shall be reviewed and stamped by the foundation designer. Four copies of each reviewed drawing shall be submitted to the Engineer at the District Construction office. One copy of each reviewed and stamped drawing shall be submitted to the “Engineer of Record”.

Concrete and Slurry Mix Designs: The Contractor shall submit to the Engineer at the District Construction office the concrete mix design and the slurry mix design, including admixtures, for review.

Foundation Construction Procedure: The Contractor shall submit to the Engineer at the District Construction office a written foundation construction procedure outlining the equipment; drilling procedure for soil and rock, including removal of obstructions and removal of excavated spoils; temporary casing placement and removal; slurry placement; reinforcement, anchor bolt and conduit placement; and concrete placement required for the drilled shaft foundation construction for review. The procedure should include contingencies for the various soil, rock and subsurface water conditions that may be encountered during the foundation construction. Also required in this submission are the following;

The Engineer will evaluate the foundation construction procedure for conformance with the Contract documents and will then notify the Contractor of any additional information required and/or changes necessary to meet the

Contract requirements. All procedural approvals given by the Engineer shall be subject to trial in the field and shall not relieve the Contractor of the responsibility to satisfactorily complete the work as detailed in the plans and specifications. The Contractor shall not commence construction of the drilled shafts until the Engineer has accepted the foundation construction procedure.

Excavations required for shafts shall be performed through whatever materials are encountered, to the dimensions and elevations in the working drawings or as ordered by the Engineer. The methods and equipment used shall be suitable for the intended purpose and materials encountered. Shaft excavation may be performed by combinations of augering, rotary drilling, down-the-hole hammer, reverse circulation drilling, clamming, scraping, or other means approved by the Engineer. Generally, either the dry method, wet method, or temporary casing method may be used, as necessary, to produce sound, durable concrete foundation shafts free of defects. The Contractor shall select and use the method that is needed to properly accomplish the work, as determined by site conditions and subject to the approval of the Engineer. The Contractor is responsible for maintaining the stability of the shaft excavation during all phases of construction.

The dry method consists of drilling the shaft excavation, removing accumulated water and loose material from the excavation, and placing the shaft concrete in a relatively dry excavation. The dry construction method shall be used only at sites where the groundwater table and site conditions are suitable to permit construction of the shaft in a relatively dry excavation, and where the sides and bottom of the shaft are stable and may be visually inspected prior to placing the concrete. The use of the dry construction method is permitted if less than one foot of water accumulates in the bottom of a hole without pumping over a one hour period, the excavation remains stable and any loose material and water can be removed prior to placement of concrete.

The wet construction method shall be used at sites where a dry excavation cannot be maintained for placement of the shaft concrete. Wet construction methods consist of using a mineral slurry to maintain stability of the hole perimeter while advancing the excavation to final depth, placing the reinforcing cage and shaft concrete. This procedure may require desanding and cleaning the slurry; final cleaning of the excavation by means of a bailing bucket, air lift, submersible pump or other devices; and placing the shaft concrete with a tremie. Unless it is demonstrated to the satisfaction of the Engineer that the surface casing is not required, temporary surface casings shall be provided to aid shaft alignment and position, and to prevent sloughing of the top of the shaft excavation. Surface casing is defined as the amount of casing required from the ground surface to a point in the shaft excavation where sloughing of the surrounding soil does not occur.

The temporary casing construction method shall be used at all sites where the dry or wet construction methods are inappropriate. Temporary casing construction method consists of advancing the excavation through caving material by the wet method. Temporary casing may be installed by driving or vibratory procedures in advance of excavation to the lower limits of the caving material. When a nearly impervious formation is reached, a casing is placed in the hole and sealed in the nearly impervious formation. After the drilling fluid is removed from the casing, drilling may proceed as with the dry method except that the casing is withdrawn when

the shaft concrete is placed. If seepage conditions prevent use of the dry method, excavation is completed using the wet method. Temporary casing may be installed by driving or vibratory procedures in advance of excavation to the lower limits of the caving material. Slurry may be omitted if the casing can be installed with only minor caving of the hole.

If the Engineer determines that the foundation material encountered during excavation is unsuitable or differs from that anticipated in the design of the shaft, or if rock is encountered at an unanticipated elevation, the Contractor's foundation designer shall determine if the foundation embedment should be revised from that shown on the working drawings. If rock is encountered, the Engineer shall be notified to inspect and determine the elevation of the top of competent rock. Any revisions to the foundation embedment during construction shall be reviewed by the Engineer.

Excavated materials which are removed from the shaft excavation and any drilled fluids used shall be disposed of by the Contractor as directed by the Engineer and in accordance with Section 1.10.

Casings shall be metal, smooth, clean, watertight, and of ample strength to withstand both handling and driving stresses and the pressure of both concrete and the surrounding earth materials. The outside diameter of casing shall not be less than the specified size of the shaft. Temporary casings shall be removed while the concrete remains workable (i.e., a slump of 4 in. or greater). Before the casing is withdrawn and while the casing is being withdrawn, a 5.0 ft. minimum head of fresh concrete in the casing shall be maintained so that all the fluid trapped behind the casing is displaced upward without contaminating the shaft concrete. The required minimum concrete head may have to be increased to counteract groundwater head outside the casing. Separation of the concrete by hammering or otherwise vibrating the casing, during withdrawal operations, shall be avoided. Casing extraction shall be at a slow, uniform rate with the pull in line with the shaft axis.

Slurry used in the drilling process shall be a mineral slurry. The slurry shall have both a mineral grain size that will remain in suspension and sufficient viscosity and gel characteristics to transport excavated material to a suitable screening system. The percentage and specific gravity of the material used to make the suspension shall be sufficient to maintain the stability of the excavation and to allow proper concrete placement. The level of the slurry shall be maintained at a height sufficient to prevent caving of the hole.

The mineral slurry shall be premixed thoroughly with clean fresh water at a temperature above 41° F and adequate time allotted for hydration prior to introduction into the shaft excavation. The elevation of the slurry within the shaft foundation shall be maintained within 24 in. of the top casing and at least 48 in. above the existing water level during drilling and until the concrete placement is essentially complete. The slurry properties shall be maintained at all times, including non-working periods and stoppages. The slurry shall be circulated and agitated, continuously if necessary, to maintain the slurry properties and to prevent it from setting up in the shaft.

The Contractor, in the presence of the Engineer, shall perform control tests on the slurry to ensure that the density, viscosity, and pH fall within the acceptable limits tabulated below. The Contractor shall provide all equipment required to perform the tests. If desanding is required, sand content shall not exceed 4% (by volume) at any point in the shaft excavation as determined by the American Petroleum Institute sand content test.

Range of Values (at 68°F)

Property (Units)	Time of Slurry Introduction	Time of Concreting (in Hole)	Test Method
Density (pcf)	64.3 to 69.1	64.3 to 75.0	Density Balance
Viscosity (seconds per quart)	28 to 45	28 to 45	Marsh Cone
pH	8 to 11	8 to 11	pH paper or meter

The control tests to determine unit weight (density), viscosity, and pH values of the slurry shall be done during the shaft excavation to establish a consistent working pattern.

Prior to placing shaft concrete, slurry samples shall be taken from the bottom and at intervals not exceeding 10.0 ft. for the full height of slurry. Any heavily contaminated slurry that has accumulated at the bottom of the shaft shall be eliminated. The mineral slurry shall be within specification requirements immediately before shaft concrete placement.

The hole shall be covered when left unattended.

After completing the shaft excavation, all loose material existing at the bottom of the hole shall be removed.

Prior to placing the reinforcement into the shaft, the Contractor, in the presence of the Engineer, shall determine the shaft dimensions, depth and alignment of the shaft. The concrete shaft shall not be out of plumb by more than 0.25 in. per foot of depth. The Contractor shall provide all equipment necessary for checking the shaft excavation. The Engineer shall inspect the shaft and verify that it has been properly cleaned.

The reinforcing steel shall be fabricated and assembled in accordance with Article 6.02.03. All reinforcement shall be assembled with wire ties. Welding to assemble the reinforcement is not permitted.

Immediately after the shaft excavation has been inspected and approved by the Engineer and prior to placement of the concrete, the assembled reinforcing steel cage, including cage stiffener bars, spacers, centralizers, and other necessary appurtenances, shall be carefully placed into the shaft excavation as a unit. Dropping or forcing cages into the shaft will not be allowed. The reinforcing steel in the shaft shall be tied and supported so that the reinforcing steel will remain

within allowable tolerances of its intended position until the concrete will support the reinforcing steel. When concrete is placed by tremie methods, temporary hold-down devices shall be used to prevent uplifting of the reinforcing steel cage during concrete placement. Concrete spacers or other approved noncorrosive spacing devices shall be used at sufficient intervals not exceeding 5.0 ft. along the shaft to insure concentric location of the cage within the shaft excavation. When the size of the longitudinal reinforcing steel is larger than a #8 bar, such spacing shall not exceed 10.0 ft. After placement of the reinforcing cage, the Engineer shall inspect the shaft to ensure that it has remained clean. If the inspection indicates that loose material has accumulated at the bottom of shaft excavation, the Contractor shall remove the reinforcing cage and reclean the shaft.

If directed by the Engineer, the top of the shaft shall be formed square with the length of the sides matching the diameter of the shaft.

Concrete construction shall conform to Subarticle 6.01.03-2,3,4,5 and 6 as amended herein.

Concrete shall be placed in the shaft excavation as soon as possible, but no more than 4 hours after completion of excavation and cleaning of the bottom of the excavation, and no more than 2 hours after placement of the reinforcing steel cage. Concrete shall be placed in a continuous operation to the top of the shaft. The concrete level shall be horizontal during the pouring operations. Concrete placement shall continue after the shaft is full until good quality concrete is evident at the top of the shaft. The elapsed time from the beginning of concrete placement in the shaft to the completion of placement shall not exceed 2 hours.

In dry construction, concrete shall be placed in a single continuous operation with the flow of concrete down the center of the shaft excavation so as to consolidate the concrete on impact. During placement operations, the concrete is not permitted to hit the reinforcing steel. A dropchute, consisting of a hopper and flexible hose, may be used to direct the concrete down the center of the foundation and prevent the concrete from hitting the reinforcing steel. Accumulated water shall be removed before placing the concrete. At the time of concrete placement, no more than 2 in. of water may exist at the bottom of the excavation and loose sediment no more than 0.5 in. over one-half the base is acceptable.

In wet (slurry) construction, concrete to be placed by the tremie method, where the concrete displaces the slurry from bottom of the excavation to the top. The concrete shall be placed through a top metal hopper and into a rigid leak-proof elephant trunk tremie tube, sufficiently large enough to permit free flow of concrete. The tremie tube shall be positioned so that it can be removed without disturbing the reinforcing. Initially, the discharge end of the tremie tube shall be sealed closed (plugged) to prevent slurry from entering the tube after it is placed in the excavation and before the tube is filled with concrete. After concrete placement has started, the tremie tube shall be kept full of concrete to the bottom of the hopper to maintain a positive concrete head. The flow of concrete shall be induced by slightly raising the discharge end of the tube, always keeping the tube end in the deposited concrete. No horizontal movement of the tremie tube will be permitted.

The shaft concrete shall be vibrated or rodded to a depth of 5 ft. below the ground surface except where soft uncased soil or slurry remaining in the excavation will possibly mix with the concrete.

Exposed concrete shall be cured and finished in accordance with Subarticle 6.01.03-7, 9 and 10.

Anchor bolt assemblies shall be embedded in the concrete as shown on the working drawings. A template plate shall be used to hold the anchor bolt assemblies, conduits and ground rod sleeve in the correct position. The anchor bolts shall be installed plumb.

All conduit ends terminating below grade shall be capped with a malleable iron caps. All above-grade conduit ends shall be terminated with an insulated bonding bushing with tinned insert.

Ground rod and ground wire shall be installed as shown on the plans.

No construction operations that would cause soil movement adjacent to the shaft, other than mild vibration, shall be conducted for at least 48 hours after shaft concrete has been placed.

The top of the foundations shall be backfilled and the adjacent disturbed ground surfaces restored to match the surrounding area after the concrete has cured and the forms are removed. Placement of topsoil shall conform to Articles 9.44.01 and 9.44.03. Turf establishment shall conform to Article 9.50.03.

The mast arm assemblies shall not be erected on the foundation until the concrete in the shaft has attained a compressive strength, f'_c , greater than or equal to 4,000 psi.

Method of Measurement: This work will be measured for payment by the number of foundation units, each completely installed and accepted.

The work to remove rock from the foundation excavation will be measured from the top of rock to the bottom of rock excavation.

Basis of Payment: The work will be paid for at the Contract unit price each for "Traffic Control Structure – Mast Arm," completed and accepted in place, which price shall include all equipment, materials, tools and labor incidental to the subsurface exploration, design, fabrication, construction and disposal of drilling spoils, of the foundations at the locations specified on the plans.

Backfilling and restoration of adjacent ground surfaces (pavement, slope protection, topsoil & seed, etc.) in all areas disturbed by the work will not be paid for separately, but will be included as part of the work. The Engineer will determine the type, thickness and horizontal limits of the surfaces to be restored.

When rock is encountered within the limits of excavation, its removal will be paid for at the Contract unit price per vertical foot for "Rock in Foundation Excavation," which price shall include any additional excavation to remove the rock and any additional concrete required to fill

the excavation beyond the designed foundation hole dimensions. Rock, in so far as it applies to "Rock in Foundation Excavation," shall be defined as rock in definite ledge formation, boulders, or portions of boulders, cement masonry structures, concrete structures or portland cement concrete pavement which has a cross-sectional area that exceeds 50% of the cross-sectional area of the designed foundation hole.

ITEM #1002291A – MODIFICATION OF TRAFFIC CONTROL FOUNDATION

Description:

This item shall consist of modifying existing traffic control foundation of the type specified at the locations shown on the plans or as directed by the Engineer and in conformity with these special provisions.

Materials:

Concrete replacement shall be Class "A" concrete conforming to Section M.03 and for Rigid Metal Conduit, Article M.15.09.
Concrete bonding compound shall be of an approved type as directed by the Engineer.

Construction Methods:

All work shall be in accordance with the following procedure or as directed by the Engineer.

- a) Remove concrete foundation by cutting, chiseling or any other method approved by the Engineer as required to install new conduit sweeps.
- b) Position new conduit sweeps, and apply an approved concrete bonding compound on the exposed concrete surfaces as recommended by the manufacturer.
- c) Forms shall be positioned so that all existing exposed foundation at grade level or above will be matched. All work shall be in accordance with Section 6.01.
- d) Allow concrete to cure and backfill as indicated on the details.

When all conduits, existing and new, are used, one additional 50mm (2") rigid metal conduit sweep shall be installed as a spare. Existing conduits that will be abandoned shall be cut and capped approximately two feet from the foundation.

Surfaces, new and existing, of a foundation which is modified, shall be "Grout Clean-Down Finish" as described in Section 6.01.

Where a foundation is modified within or adjacent to a concrete sidewalk, unless otherwise directed by the Engineer, the entire section of sidewalk shall be replaced in accordance with Section 9.21.

Method of Measurement:

The work for this item shall be measured for payment by the number of foundations modified.

Basis of Payment:

This work will be paid for at the contract unit price each for "Modification Of Traffic Control Foundation", which price shall include all costs for cutting of bases, bonding compound, forms, concrete, conduit sweeps, and all fittings, material, equipment, labor and tools incidental thereto.

All concrete sidewalk replaced due to foundation modification shall be paid for at the contract unit price for "Concrete Sidewalk".

<u>Pay Item</u>	<u>Pay Unit</u>
Modification of Traffic Control Foundation	Ea.

ITEM #1008015A – 2” RIGID METAL CONDUIT – SURFACE

ITEM #1008115A – 2” RIGID METAL CONDUIT IN TRENCH

ITEM #1008215A – 2” RIGID METAL CONDUIT UNDER ROADWAY

Work under this item shall conform to the requirements of section 10.08 supplemented and amended as follows:

Article 10.08.01 – Materials: shall be amended as follows:

Underground utility marking tape shall have a minimum tensile strength of 350 N and a minimum elongation of 700 percent before breakage. The tape shall not delaminate nor smear when wet and shall be resistant to insects. The tape shall not degrade when exposed to alkalis, acids or other corrosive elements found in soil.

Pressure treated wood for Identification Posts shall conform to Article M.12.13 of the Standard Specifications. Signs on Identification Posts shall conform to Article M.18.13 of the Standard Specifications.

Article 10.08.03 - Construction Methods:

Only where conduit is used for Fiber Optic Cable:

The bending radius for the Rigid Metal Conduit shall not exceed the manufacturer's recommended safe pulling tension and minimum bending radius for Fiber Optic Cable during delivery and installation.

For Rigid Metal Conduit under Roadway, the Contractor shall be required to install the conduit **simultaneously** with the installation of the handholes.

The conduit shall be free from defects including non-circularity and foreign inclusions. It shall be nominally uniform (as commercially practical) in color, density, and physical properties. It shall be straight and the ends shall be cut square to the inside diameter.

Rigid Metal Conduit shall be galvanized steel also conforming to Section M.15.09 of the standard specifications.

Leave a pull rope in the conduit after installation of fiber optic cable.

Warning Tape shall be placed in trench over conduit as shown on the details. One (1) Identification Post shall be carefully placed adjacent to conduit in trench as shown on the signal plan for intersection no. 051-211. This applies to conduit for fiber optic cable only.

Article 10.08.05 – Basis of Payment: shall be amended as follows:

In the second paragraph, after the words “bonding bushings”, add the words “bonding wire,”.

This work shall be paid for at the contract unit price per meter for conduit of the size and type indicated, within the limits shown on the plans and in the details. This price shall include all materials required including expansion fittings, fixed and flexible sweep-bends, conduit fittings, pervious structure backfill, boxes, caps, pull tape, poly-line, inserts, warning tape, ground wire, identification posts with signs, structural supports, equipment, tools, labor and work incidental thereto.

ITEM #1008908A – CLEAN EXISTING CONDUIT

Description:

Clean existing conduit as required, as shown on the plans or as directed by the Engineer to remove dirt and debris to facilitate the installation of new cable.

Construction Methods:

Where cable is to be installed in existing conduit the conduit may have to be cleared prior to the installation. Cleaning will only be necessary if the new cable cannot be easily installed in the existing conduit. By field inspection, and with the concurrence of the Engineer, determine the sections of conduit that require cleaning.

Remove all existing cable from conduit. Install temporary cable elsewhere, as necessary, to maintain normal signalization complete with vehicle & pedestrian detection, EVPS, and coordination. Clean the conduit by one of the following methods:

- 1) Rodding.
- 2) A high pressure jet spray, or air pressure.
- 3) By pulling a mandrel or ball through the conduit.

Submit in writing the anticipated method of cleaning the conduit to the Engineer for approval prior to cleaning any conduit.

If the conduit is found damaged to any extent that the cleaning process will not clear the obstruction, it will be the judgment of the Engineer whether to replace the entire conduit run or excavate and replace only the damaged section.

If the existing conduit is found to be missing hardware such as bonding bushings and bond wire, the missing material shall be provided and installed under this item prior to installation of the cable.

Method of Measurement:

This work shall be measured from termination point to termination point. This work shall be measured for payment on actual number of linear feet (meters).

Basis of Payment:

The work under the Item “Clean Existing Conduit” shall be paid for at the contract unit price per linear foot (meters), which price shall include all material, tools, equipment, labor, and work incidental thereto. Work pertaining to temporary operation shall be paid for under Item 1108xxxA - Temporary Signalization (Site X). Replacement of any damaged conduit shall be paid for under the applicable conduit item.

Pay Item	Pay Unit
Clean Existing Conduit	l.f. (m)

ITEM #1010060A – CLEAN EXISTING CONCRETE HANDHOLE

DESCRIPTION:

Clean all debris from an existing concrete handhole where shown on the plans or as directed.

MATERIAL:

Insulated Bonding Bushings:
 Specification Grade
 Threaded
 Malleable Iron or Steel
 Galvanized
 UL listed
Bonding Wire:
 M.15.13
Grout:
 M.03.05

CONSTRUCTION METHODS:

Remove to a level even with the bottom of the handhole all sand, silt and other debris. Remove any material that is accessible from the ends of conduit. Additional conduit cleaning will be paid for under Item 1008908A-Clean Existing Conduit. Place approximately 4" (100) of ¾" (19) crushed stone in bottom of handhole using care not to allow crushed stone to enter conduits. Grout around conduits to prevent future entrance of dirt and silt. Properly dispose all removed debris. Inspect bonding bushings. Tighten loose bushings. Secure loose bond connections. Install new bonding bushings on spare conduits and bond to other conduits.

METHOD OF MEASUREMENT:

This work will be measured for payment by the number of concrete handholes cleaned, complete and accepted.

BASES OF PAYMENT:

This work will be paid for at the contract unit price each for "Clean Existing Concrete Handhole", which price shall include the removal and disposal of debris from handhole and associated conduit, crushed stone, grout, bonding bushings, bonding wire, and all equipment and work incidental thereto.

<u>Pay Item</u>	<u>Pay Unit</u>
Clean Existing Concrete Handhole	Each (Ea)

ITEM #1015034A – GROUNDING AND BONDING

Description:

Grounding and Bonding of the span wire when attached to public utility poles shall be performed as shown on the plans or as directed by the Engineer.

MATERIAL:

- No. 6 Bare Copper Grounding Conductor
- 5/8" X 10' Ground Rod
- Bronze Grounding Clamp
- Crimp Type Electrical Connector
- Miscellaneous Electrical Tools

Construction Methods:

Grounding and bonding of the span wire when attached to public utility poles shall comply with the National Electric Code (NEC), National Electric Safety Code (NESC), Public Utility Regulatory Authority (PURA), and the power company requirements. Install an independent No.6 bare copper ground wire and 5/8"X10' ground rod for span wire when attached to public utility pole to meet the NESC – Rule 215-C-3 – Span wires carrying luminaires or traffic signals. When installing ground rod, if rock bottom is encountered, refer to NEC 250.53G for installation requirements.

The following locations listed below in Project 0173-0468 require grounding and bonding of the span wire.

<u>Location No.</u>	<u>Intersection Description</u>	<u>Town</u>
015-267	Route 730 (Huntington Turnpike) at Broadbridge Road	Bridgeport
050-207	U.S. Route 1 (Boston Post Road) at Ruane Street	Fairfield
075-220	U.S. Route 1 (Boston Post Road) at Samson Rock Road and Wall Street	Madison
092-241	Route 80 (Foxon Boulevard) at Route 103(Quinnipiac Avenue)	New Haven
100-205	U.S. Route 5 & 22 (Washington Street) at Bishop Street	North Haven
138-250	Route 110 (East Main Street) at Drive to Dock Shopping Center and Stratford Crossing	Stratford
156-212	Route 162 (Saw Mill Road/Wagner Place) at Elm Street	West Haven
156-218	Route 162 (Jones Hill Road) at Colonial Boulevard and Morgan Lane	West Haven

Method of Measurement:

The installation of the Ground Rod, Ground Wire and Bonding shall be paid once per site at the contract Lump Sum price.

Basis of Payment: This work shall be paid for at the contract lump sum price for "Grounding and Bonding". This price shall include the installation of No.6 Bare Copper Ground Wire, 5/8"X10' Ground Rod, miscellaneous electrical tools, all equipment and work incidental thereto.

Pay Item	Pay Unit
Grounding and Bonding	L.S.

ITEM #1017032A – SERVICE (METERED)

Description:

Furnish and install a metered electric service at the location shown on the plans or as directed by the Engineer.

Materials:

- Meter Socket
 - UL listed
 - Manual lever bypass
 - P.V.C Slip fitting that complies with Utility Company requirements.
 - Locking metal cover for the glass enclosure
 - Contact the serving utility company for a list of approved meter sockets
- Conduit Bond Clamp
 - UL listed
 - Rated for direct burial

Locations served by United Illuminating (UI) or Wallingford Electric Division (WED)

Meter socket rated at 100 amps

Locations served by Eversource (formerly Connecticut Light and Power Co. [CL&P])

Meter socket rated at 200 amps

Enclosure capable of accepting a 3 inch (75 mm) rigid metal conduit (RMC)

Construction Methods:

Comply with the National Electric Code (NEC), Public Utility Regulatory Authority (PURA), and the serving power company requirements. Install a meter socket with associated equipment on the outside of the controller cabinet, as shown on the plans. Mount the enclosure approximately 54 inches (1.37 meters) above the ground. Install an expansion fitting in the RMC between the ground and the enclosure. Attach a direct-buried bond clamp to the service RMC below ground level, adjacent to the foundation. Bond the service conduit to the controller cabinet ground rod. Install a continuous nylon pull rope of at least 200 lbs (90 Kg) breaking strength in the conduit between the meter socket and the service source. Ensure all circuit breakers are off when service is connected by the utility company. The work must be inspected and approved by the Engineer or his designated representative prior to scheduling a service connection. Record the meter number and the date service is connected for billing purposes.

Service Request

- Traffic Signal on State Road: Contact the CT DOT Traffic Electrical office to complete the necessary service request forms.
- Traffic Signal on Town Road: Complete all necessary request forms and forward to the appropriate power company office.
- Incident Management Site: Complete all necessary request forms and forward to the appropriate power company office.

Locations served by United Illuminating

Contact the UI office to have a Job Number assigned. When the work is complete notify the Engineer to inspect and confirm that the work is according to the National Electric Code. Request that the Engineer contact the United Illuminating, Work in Progress office, to report the job number and to schedule a service connection.

Locations served by Wallingford Electric Division

Contact the Electric Division, Engineering Office to arrange for service and/or to schedule work by the Electric Division on utility poles above 10 feet (3 meters). When the work is complete notify the Engineer to inspect and confirm that the work is according to the National Electric Code. Request that the Engineer contact the Electric Division 24 hours prior to the desired connection date.

Locations served by Eversource and all other electric power providers

Contact the power company engineering representative for exact requirements of the service. All riser fees and any other installation charges required of an underground metered service are the responsibility of the Contractor. When the work is complete notify the Engineer to inspect and confirm that the work is according to the National Electric Code. Request that the Engineer contact the power company to schedule the connection.

Method of Measurement:

The installation of the Service (Metered) will be measured for payment by the number of metered electric services of the type specified, completed, with service connected, and accepted in place.

Basis of Payment:

This work will be paid for at the contract unit price each for "Service (Metered)" complete and accepted in place. The price shall include all material above ground such as the meter socket enclosure, surface conduit, expansion fitting, coupling, and load side service conductors. The price shall also include the direct-buried ground clamp, bonding wire, pull rope, all material, equipment, tools, labor and incidentals necessary.

The power company will provide the line-side conductors and the meter.

ITEM #1102002A – 8’ ALUMINUM PEDESTAL

M.16.03 – Pedestals:

Town of Westport: Int. No. 158-213

All pedestals, brackets and hardware shall be painted black by the manufacturer. The color shall be No. 37038, Federal Standard No. 595.

Paint samples and proposed painting procedures shall be submitted to:

Peter A. Ratkiewich, P.E.
Westport Town Engineer
Town of Westport, CT
110 Myrtle Avenue
Westport, CT 06880
pratkiewich@westport.ct.gov
(203)341-1131

Town of Fairfield: Int. No. 050-201, 050-207

All pedestals, brackets and hardware shall be painted black by the manufacturer. The color shall be No. 37038, Federal Standard No. 595.

Paint samples and proposed painting procedures shall be submitted to:

William Hurley
Engineering manager
Town of Fairfield, CT
725 Old Post Rd
Fairfield, CT 06824
whurly@fairfieldct.org
TEL. (203) 256-3015

ITEM #1102048A – 8’ ORNAMENTAL ALUMINUM PEDESTAL

11.02.01 - Description:

Madison – Site No. 4 - Intersection # 075-220

U.S. Rte. 1 (Boston Post Rd.) at Samson Rock Road and Wall Street.

Change to:

This item shall consist of furnishing and installing an 8’ fluted pedestal on a prepared foundation at locations and to the details shown on the plans, or as ordered, and in accordance with these specifications.

11.02.02 - Materials:

Change to:

The materials for this work shall consist of the following:

- (a) Shaft: The shaft shall be made of ASTM A595 GR. A steel shaft consisting of a 16 flat flute designation with a 6 inch outside diameter at the base and a 5.08 inch diameter at the top. The fluting shall begin 6 inches from the base of the pole. The height shall be 8 feet. The finish shall be consisting of a base coat, hot dip galvanize to ATSM A123, the finish coat shall be TGIC or Urethane Polyester Powder. The color shall be black No. 37038, Federal Standard No. 595. The pole shall contain decorative nut cover castings with self-tapping stainless steel screws for the anchor bolts.
- (b) The base shall conform to ASTM designation B108 Alloy 356.0 T6 and shall be of the dimensions on the shown on the plans. The base shall contain a door opening that is approximately, 8.5” x 9” x 11”. The base shall be connected to the pole by the means 4 connecting bolts – 2.75” O.D. x 0.50” thick. Hold down washers finished to ASTM: B695 Class 50 provided for installation under anchor bolt hex nuts. Connection washers to be 2.50” O.D. x 38” thick, finished to ASTM: B695 CLASS 50 provided for installation under the transformer base top plate as shown. The base shall conform to breakaway criteria of AASHTO standard specifications for structural support highway signs, luminaires and traffic signals 2nd edition (1985) and all subsequent editions. FHWA’s acceptance of the editions. FHWA’s acceptance of the base restricted to “within the range of conditions tested” as shown. . The finish shall be consisting of a base coat, hot dip galvanize to ATSM A123, the finish coat shall be TGIC or Urethane Polyester Powder. The color shall be black No. 37038, Federal Standard No. 595.

ITEM #1103022A – 30’ STEEL SPAN POLE**ITEM #1103023A – 32’ STEEL SPAN POLE****ITEM #1103024A – 34’ STEEL SPAN POLE****ITEM #1103002A – STEEL COMBINATION SPAN POLE****ITEM #1114102A – SPAN WIRE**

Description: Work under this item shall consist of designing, fabricating and installing a steel span pole to carry traffic appurtenances (such as traffic signals or signs), of the type specified, on a prepared foundation, in accordance with the details shown on the plans and as ordered by the Engineer. Work under this item shall also include designing and installing a steel span wire, at the locations indicated, in accordance with the details shown on the plans and as ordered by the Engineer.

Materials: The tubular components, such as the pole and luminaire arm shall be made of steel with a minimum yield stress of 35,000 psi.

The structural plate components, such as the baseplates and handhole frames shall be made of steel that conforms to the requirements of ASTM A572, Grade 50.

Anchorage plates shall conform to the requirements of ASTM A572, Grade 50.

The steel for pole members and structural plate components, such as the baseplates and handhole frames, shall meet Charpy V-notch impact testing requirements for non-fracture critical members in Zone 2 and the following:

Yield Strength	Thickness in.	Minimum Average Energy, ft.-lbf
$F_y \leq 36 \text{ ksi}$	≤ 4	15 at 40°F
$36 \text{ ksi} < F_y \leq 50 \text{ ksi}$	≤ 2	15 at 40°F
$36 \text{ ksi} < F_y \leq 50 \text{ ksi}$	$2 < t \leq 4$	20 at 40°F
$50 \text{ ksi} < F_y \leq 70 \text{ ksi}$	≤ 4	15 at -20°F
Charpy V-notch sampling and testing shall be in accordance with AASHTO T243, “H” piece frequency.		

The non-structural components, such as hand hole covers, caps and anchor bolt covers, shall be made of steel with minimum yield stress of 36,000 psi.

The filler metal shall have a matching strength relationship with the base metal.

All high strength bolts shall conform to ASTM A325, Type 1. Nuts shall conform to ASTM A563, Grade DH. Circular, flat, hardened steel washers shall conform to ASTM F436. The bolts, nuts and washers shall be galvanized in accordance with ASTM A153 or ASTM B695, Grade 50. The nuts shall be overtapped to the minimum amount required for the bolt assembly and all surfaces of the nuts shall be lubricated with a lubricant containing a visible dye of any color that contrasts with the color of the galvanizing. The high strength bolts shall conform to the requirements of Subarticle M.06.02-3.

The anchor bolts shall conform to ASTM F1554, Grade 105. The nuts shall conform to ASTM A563, Grade DH. The washers shall conform to ASTM F436. The bolts, nuts and washers shall be galvanized in accordance with ASTM A153. The nuts shall be overtapped to the minimum amount required for the bolt assembly and all surfaces of the nuts shall be lubricated with a lubricant containing a visible dye of any color that contrasts with the color of the galvanizing. Prior to shipping the anchor bolts, the nuts and washers shall be installed by hand on the anchor bolts to ensure that the nuts can be run on the threads. Only anchor bolts on which the nuts are free running shall be shipped. The anchor bolts shall be shipped with the nuts and washers on the threads.

All steel components, including anchor bolts, shall be completely hot-dip galvanized, after fabrication, in accordance with ASTM A123 or ASTM A153, as applicable. Repairs to damaged areas of the hot-dip galvanized coatings shall conform to the requirements of ASTM A780 amended as follows:

Paints containing zinc dust, if used for repairs, shall contain either between 65% to 69% metallic zinc by weight or greater than 92% metallic zinc by weight in dry film.

The silicone sealant shall be a 1-component, 100% silicone sealant recommended for use with galvanized steel.

Neoprene gasket material for the access openings shall conform to ASTM D1056, Grade 2A2 or 2A3. Other grades of neoprene approved by the Engineer may be used.

Closed cell elastomer for sealing the space between the foundation and base plate shall conform to ASTM D1056, Grade 2A2 or 2A3 and shall have a pressure-sensitive adhesive backing on one side for adhesion to steel. Closed cell elastomer contained within the anchor bolt pattern shall not interfere with the anchor bolt leveling nuts and shall not block the opening in the base plate.

Bare copper grounding conductor shall be #8 AWG stranded bare copper wire conforming to M.15.13. The grounding bolt shall be stainless steel with a hex head.

Steel span wire shall conform to Article M.16.15.

All materials used in the finished structure shall be new. The use of materials that have been previously used in a structure or salvaged from a structure is not permitted.

The Contractor shall submit Certified Test Reports and Materials Certificates in conformance with Article 1.06.07 for the steel used for span pole members and structural plate components, high-strength bolts (including nuts and washers) and anchor bolts (including nuts and washers). The Certified Test Reports shall include the following:

- a. Mill test reports that indicate the place where the material was melted and manufactured.
- b. High-strength bolt test results for proof load tests, wedge tests, and rotational-capacity tests that indicate where the tests were performed, date of tests, location where the components were manufactured and lot numbers.
- c. Galvanized material test results that indicate the thickness of the galvanizing.

Prior to incorporation into the work, the Contractor shall submit samples in conformance with Article 1.06.02 for the steel used for span pole members and components, high-strength bolts (including nuts and washers) and anchor bolts (including nuts and washers).

Construction Methods: The design and fabrication of the span pole, including its anchorage (into the foundation), and the design of the span wire shall conform to the requirements of the latest edition of the AASHTO Standard Specifications for Structural Supports for Highway Signs, Luminaires and Traffic Signals, including the latest interim specifications, available prior to the advertising date of the Contract, amended as follows:

1. The design wind speed shall be 120 mph. The calculation of wind pressures in accordance with Appendix C is not permitted.
2. The minimum design life shall be 50 years.
3. The wind importance factor, I_r , for wind pressure shall be 1.00.
4. The span pole and span wire shall be designed to support free swinging traffic signals and signs. The wind drag coefficient for traffic signals and luminaires shall be no less than 1.2.
5. The maximum stress ratio (the ratio of the computed stress to the allowable stress) or combined stress ratio (CSR) in any span pole component or in any span wire due to each group load shall not exceed 0.85. The purpose for limiting the stress ratio is to allow for future additional appurtenance configurations.
6. The span pole shall be designed to support a span wire with a sag no greater than 5% of the span. For definitions of sag and span, refer to Appendix A in the AASHTO Standard Specifications for Structural Supports for Highway Signs, Luminaires and Traffic Signals.

7. The span wire properties shall conform to Article M.16.15. All span wires in a span pole configuration shall be the same diameter
8. The maximum luminaire arm length shall be 20.0 ft.
9. The maximum diameter of the pole at the base shall be 18 in.
10. The minimum wall thickness of the pole shall be 0.3125 in. The wall thickness of the pole shall be uniform throughout its length. Joining 2 tubular members together with a circumferential weld to fabricate a pole is not permitted. The use of shop-fabricated stepped members is not permitted. The use of multiple plies (laminations) to obtain the required pole thickness is not permitted.
11. The span pole shall be a tubular member with either a round or multisided cross-section. Multisided tubular members with other than 8, 12 or 16 sides are not permitted. Multisided tubular members with fluted sides are not permitted. The pole shall be fabricated with a taper (change in diameter).
12. Multisided tubular members with diameters less than or equal to 13 in. shall have a minimum of 8 sides. Multisided tubular members with diameters greater than 13 in. and less than or equal to 18 in. shall have no less than 12 sides.
13. Multisided tubular members shall have a minimum internal bend radius of 5 times the tubular member thickness or 1 in., whichever is greater.
14. Slip-type field splices are not permitted in the pole.
15. The pole shall be fabricated with no more than 2 longitudinal seam welds.
16. The longitudinal seam welds within 6 in. of the member ends shall be complete joint penetration groove welds.
17. Non-destructively test 100% of partial joint penetration longitudinal seam welds in accordance with the magnetic particle method. Non-destructively test 100 % of complete joint penetration seam welds in accordance with the ultrasonic method.
18. All tubular member to transverse plate connections shall be made with a complete joint penetration groove weld with a backing ring attached to the plate with a continuous fillet weld. Non-destructively test 100% of the complete joint penetration groove welds by the ultrasonic method after fabrication and prior to galvanizing. Non-destructively test 100% of the complete joint penetration groove welds by the ultrasonic method for toe cracks after galvanizing. Non-destructively test 100% of backing ring fillet welds by the magnetic particle method after fabrication prior to galvanizing. After galvanizing, the joint between

the backing ring and tubular member shall be sealed with silicone sealant to prevent the ingress of moisture.

19. The strength of a connection made with a complete joint penetration groove weld shall be no greater than the strength of the base metal. In connections joining base metal with different yield strengths, the base metal with the lower yield strength shall govern the design.
20. The use of seal and tack welds is not permitted. No welding shall be performed after galvanizing.
21. The use of stiffeners at tubular member to transverse plate connections is not permitted.
22. The minimum base plate thickness shall be no less than 2.5 in. or at least as thick as the anchor bolt diameter, whichever is greater. The determination of the plate thickness in the tubular member to transverse plate connections shall consider the potential for the plate to warp due to the heat from welding. Consideration should be given to the use of thicker plates to allow for subsequent machining of warped plates to a flat surface so that removal of material will not compromise the required strength of the plate.
23. The opening in the base plate shall be sized to allow for proper galvanizing and allow conduits projecting from the foundation to pass through it. The size of the opening shall be kept to a minimum to reduce the flexibility of the baseplate.
24. The pole base plate anchor bolt circle diameter shall be 24 in.
25. The anchor bolt to base plate connection shall be designed as a double-nut connection with shear holes. The minimum distance from the center of the anchor bolt hole to the edge of the base plate shall be no less than 2 times the diameter of the anchor bolt. The anchor bolts shall use an embedded anchorage plate, 0.5 in. minimum thickness, to transmit loads from the pole base to the concrete foundation. The use of hooked anchor bolts is not permitted. The minimum number of anchor bolts shall be 8. The minimum anchor bolt diameter shall be 2 in. The minimum anchor bolt embedment, the distance from the top of the foundation to the top of the embedded anchorage plate, shall be 3.5 ft. or the tension development length of the vertical foundation reinforcement plus the end concrete cover, whichever is greater. Each anchor bolt shall be supplied with 4 nuts and 4 washers. Washers shall be placed on the top and bottom surfaces of the pole base plate and anchorage plate. Welding to the anchor bolts is not permitted. The use of lock washers with the anchor bolt assembly is not permitted.

26. The span wire pole clamp shall be designed to support a minimum tensile force of 12,000 pounds or 3 times the maximum calculated tensile force in the span wire, whichever is greater.

The span pole shall be designed for the load effects due to the span wire(s) attached to the poles and all the traffic appurtenances (signals, signs, luminaires, cameras, etc.) attached to the span wire and the pole. The load effect due to the span wire, resulting from the attached traffic appurtenances, will not be provided and shall be determined by the Contractor. The span pole and span wire shall also be designed for load effects from future traffic appurtenances arranged, positioned and located as shown on the plans. The span pole and span wire shall also be designed for load effects during all stages of construction that may exist during the Project under which the span pole is installed. The span pole and span wire shall be designed to support traffic appurtenances with properties no less than those tabulated on the plans.

The locations and dimensions of the span poles are shown on the traffic plans. The luminaire arm and pole lengths and the attachment heights shall be verified by the Contractor based on the finished grade at the site, top of foundation elevation, the locations of overhead utility cables and the traffic appurtenance mounting heights. If either the wire or pole length is inadequate, the Contractor shall notify the Engineer.

The minimum vertical clearance from the top of the finished road to the bottom of the traffic signals shall be 16.0 ft. The maximum vertical clearance from the top of the finished road to the bottom of the traffic signals shall be 18.0 ft. The traffic signals shall be installed so that the bottom of all the signals for each approach is at the same elevation.

Vent and drain holes shall be provided for galvanizing. The number, size and location of vent and drain holes shall be coordinated with the galvanizer prior to the submission of the working drawings and design calculations. The area of vent and drain holes at each end of a member shall be at least 30% of the inside area of the member for members with diameters 3 in. and greater and 45% of the inside area of the member for members with diameters less than 3 in. The vent and drain holes shall be strategically located for reducing stress and for proper galvanizing. The holes shall be made by drilling. Flame cut holes are not permitted. The edges of all holes shall be rounded by grinding. After galvanizing, exposed holes placed in the sign support components for galvanizing shall be sealed with neoprene plugs.

A J-hook shall be welded to the inside of the pole at the top for wire handling and support.

The span pole shall have a handhole, reinforced with a frame, located at the base of the pole. The handhole shall be located with a normal direction that is 90° to the plane formed by the pole and span wire. The minimum clear distance from the top of the baseplate to the outside face of the bottom of the handhole frame shall be no less than the diameter of the tubular member or 1.25 ft., whichever is greater. The handhole frame shall have a minimum 4 in. wide by minimum 6 in. high clear opening. The maximum width of the handhole opening, the clear opening plus twice the frame thickness, shall not be greater than 40% of the tubular member diameter at that section. The inside corners of the handhole frame shall be rounded to a radius of 30% to 50% of

the width of the clear opening. The minimum thickness of the handhole frame shall be no less than the thickness of the pole or 0.3125 in., whichever is greater. The handhole frame shall be connected to the pole with a partial joint penetration groove weld reinforced with a fillet weld. The handhole weld shall start and end at the point that is coincident with the longitudinal axis of symmetry of the tubular member and the longitudinal axis of symmetry of the handhole frame. Non-destructively test 100% of each handhole weld in accordance with the magnetic particle method. The handhole shall be provided with a cover connected to the frame with no less than 2 stainless steel screws. The cover shall be installed with a neoprene gasket matching the dimensions of the cover. The cover and the gasket and the handhole frame shall be in firm and continuous contact after tightening the fasteners. The cover shall also be attached to the frame with a 1.5 ft. long stainless steel chain. The inside bottom of the frame shall have a hole tapped for the stainless steel grounding bolt.

The span pole shall include wire entrance fittings. The number and size of the wire entrance fittings shall be as shown on the plans. The fittings shall be welded, all-around, to the pole at a 45-degree angle to the pole.

The span pole shall be supplied with a pole cap plate and anchor bolt covers. The cap plates shall be attached with fasteners. The joint between the tubular member and plate shall be sealed with a neoprene gasket matching the dimensions of the plate.

The luminaire arms shall be fabricated of pipe with a minimum thickness equal to schedule 40. Single arm luminaires shall be used for luminaires with arm lengths less than or equal to 8.0 ft. Truss type luminaires shall be used for luminaires with arm lengths greater than 8.0 ft. The truss type luminaires shall consist of upper and lower members joined with vertical members at the tip and midspan. To accommodate the luminaire fixture, the size of the pipe in the luminaire arm at the tip shall be 2 in. diameter, schedule 40. If necessary, a reducing tenon shall be installed at the tip of the arm to accommodate the luminaire fixture.

The luminaire arm(s) shall be connected to the pole with clamp connections. Each clamp connection shall use 4 high-strength bolts. The installed nuts shall be prevented from loosening while in service. The use of lock washers to meet this requirement is not permitted. The arms shall be fillet welded, all-around, to the clamp(s). The size of the weld shall be no less than 0.25 in. A hole shall be provided in the clamp, (upper arm clamp for truss type arms) and pole to allow for wires to pass from the pole to the luminaire arm. The sides of all holes in the connection shall be ground smooth and edges rounded by grinding to prevent the wires from chafing.

Prior to fabrication, the Contractor shall submit working drawings and design calculations, with all details and documents necessary for fabrication and erection of the structure and its components, for each **span wire structure configuration** for review in accordance with the "Notice To Contractor – Special Provision 1.05" and the special provision "Section 1.05 – Control Of Work".

The working drawings and design calculations for span poles and the calculations for the span wire shall conform to working drawing requirements for permanent construction. **A single set of working drawings with tabulated data for multiple span poles in span wire structure configuration is allowed.** Each span pole shall be referenced with an alpha-numeric identifier noted on the Contract documents. The working drawings and calculations shall be prepared in Customary U.S. units.

The span pole working drawing and calculation submittal shall include the following:

1. title sheet
2. table of contents
3. contact information for designer, fabricator and galvanizer – contact information shall include name and address of each firm and the name of contact person with phone number and email address
4. copy of the certificate of insurance
5. copy of fabricator's AISC certification
6. copy of the traffic signal control plan detailing the span wire structure configuration
7. span pole working drawings
8. span pole design calculations
9. span wire calculations
10. welding procedures
11. span pole installation procedure, including the method to plumb the pole

The working drawings shall include complete details of all span pole components. The drawings shall include, but not be limited to the following:

1. the Project number, town and span pole identification number
2. reference to the design specifications, including interim specifications
3. reference to the design specifications design criteria, such as design wind speed, minimum design life, vehicle speed, etc.
4. material specifications for all components

5. material designations for the pole, with an explanation of the alpha numeric characters (equivalent thickness, in inches, shall be provided for gage numbers)
6. non-destructive weld testing requirements
7. details of the location of the longitudinal seam weld(s) in the pole
8. vent and drain holes for galvanizing
9. a plan view of the anchor bolt layout relative to the orientation of the wire
10. anchor bolt dimensions, including embedment and projection
11. span pole installation procedure, including the method to plumb the pole, if procedure differs from that described in this specification

The design calculations shall include, but not be limited to the following:

1. the Project number, town and alpha-numeric span pole identifier
2. references to design specifications, including interim specifications, and the applicable code section and articles
3. description/documentation for all computer programs used in the design
4. drawings/models of the structure, components and connections, with dimensions, loads and references to the local and global coordinate systems used (as applicable), to facilitate review of the results
5. a tabulation of the section properties of the tubular members at each analyzed section. The tabulated values shall include:
 - a. the diameter, D (if round member)
 - b. effective width, b (if multisided member, AASHTO 5.5.2)
 - c. equivalent diameter (if multisided member, AASHTO 5.6)
 - d. wall thickness, t
 - e. inside bend radius, r_b (if multisided member, AASHTO 5.5.2)
 - f. cross-sectional area, A
 - g. moment of inertia, I
 - h. section modulus, S
 - i. radius of gyration, r

AASHTO Table B-1 may be used to determine the section properties. If Table B-1 is used, the radius measured to the mid-thickness of the wall shall also be provided.

6. coefficients and factors used in the design
7. results of all group loads and load combinations
8. stress ratios and combined stress ratios for all group loads and load combinations
9. horizontal due to Group Load Combinations I, II and III for dead, wind and ice loads

The span poles shall be fabricated in accordance with the latest edition of the AASHTO LRFD Bridge Construction Specifications, including the latest interim specifications, amended herein.

The steel fabricator shall be AISC certified for the fabrication to the Standard for Bridge and Highway Metal Component Manufacturers (CPT).

Fabrication of the span pole may begin only after the working drawings and design calculations have been reviewed. The Contractor shall submit to the Engineer, no less than 2 weeks prior to the start of fabrication, the name and location of the fabrication shop where the work will be done so that arrangements can be made for an audit of the facility and the assignment of the Department Quality Assurance (QA) inspector. No fabrication will be accepted unless the QA inspector is present during fabrication. No changes may be made during fabrication without prior written approval by the Department.

The Contractor shall furnish facilities for the inspection of material and workmanship in the shop by the Engineer. The Engineer and Department QA representative shall be allowed free access to the necessary parts of the premises.

The Engineer will provide QA inspection at the fabrication shop to assure that all applicable Quality Control plans and inspections are adequately adhered to and maintained by the Contractor during all phases of the fabrication. A thorough inspection of a random selection of elements at the fabrication shop may serve as the basis of this assurance.

Prior to shipment to the Project, each individual piece of steel shall be marked in a clear and permanent fashion by a representative of the fabricators' Quality Control (QC) Department to indicate complete final inspection by the fabricator and conformance to the Contract for that piece. The mark must be dated. A Materials Certificate in accordance with Article 1.06.07 may be used in lieu of individual stamps or markings, for all material in a single shipment. The Materials Certificate must list each piece within the shipment and accompany the shipment to the Project site.

Following the final inspection by the fabricator's QC personnel, the Engineer may select pieces of steel for re-inspection by the Department's QA inspector. Should non-conforming pieces be identified, all similar pieces must be re-inspected by the fabricator and repair procedure(s) submitted to the Engineer for approval. Repairs shall be made at the Contractor's expense.

The pieces selected for re-inspection and found to be in conformance, or adequately repaired pieces, may be marked by the QA inspector. Such markings indicate the Engineer takes no exception to the pieces being sent to the Project site. Such marking does not indicate acceptance or approval of the material by the Engineer.

All welding details, procedures and nondestructive testing shall conform to the requirements of AWS D1.1 Structural Welding Code - Steel.

Personnel performing the nondestructive testing shall be certified as a NDT Level II technician in accordance with the American Society for Non Destructive Testing (ASNT), Recommended Practice SNT-TC-1A and approved by the Engineer.

All nondestructive testing shall be witnessed by Engineer. Certified reports of all tests shall be submitted to the Engineer for examination. Each certified report shall identify the structure, member, and location of weld or welds tested. Each report shall also list the length and location of any defective welds and include information on the corrective action taken and results of all retests of repaired welds.

The Department reserves the right to perform additional testing as determined by the Engineer. Should the Engineer require nondestructive testing on welds not designated in the Contract, the cost of such inspection shall be borne by the Contractor if the testing indicates that any weld(s) are defective. If the testing indicates the weld(s) to be satisfactory, the actual cost of such inspection will be paid by the Department.

All members and components shall be hot-dip galvanized in a single dip. Double-dipping of members and components is not permitted. All exterior and interior surfaces of the span pole members and components, shall be completely galvanized.

Galvanized members and components shall be free from uncoated areas, blisters, flux deposits, and gross inclusions. Lumps, projections, globules, or heavy deposits of zinc which will interfere with the intended use of the material will not be permitted.

After galvanizing the joint between the backing ring and the tubular member shall be sealed with silicone sealant to prevent the ingress of moisture.

All damaged areas of the hot-dip galvanized surfaces shall be repaired in accordance with the requirements of ASTM A780. If paint containing zinc dust is used for repairs, the dry coating thickness shall be at least 50% greater than the thickness of the adjacent hot-dip galvanized coating, but no greater than 4.0 mils. The paint shall be brush applied. The use of aerosol spray

cans is not permitted. The color of the finished repair area shall match the color of the adjacent hot-dip galvanized surface at the time of the repair to the satisfaction of the Engineer.

Prior to shipping, all exterior and interior galvanized surfaces of the members and components shall be inspected, in the presence of the Engineer, to determine the acceptability of the galvanized coating. Galvanized coatings may be found acceptable by the Engineer if all surfaces of the members and components meet the galvanizing requirements herein. Only span pole members and components with acceptable galvanized coatings shall be shipped. If the galvanized coating on any member or component is found to be unacceptable, the Contractor shall submit a repair procedure to the Engineer for review.

After fabrication and prior to shipping, aluminum identification tags shall be attached to the span poles with self-tapping tamper resistant screws.

The finished members and components shall be protected with sufficient dunnage and padding to protect them from damage and distortion during transportation. Damage to any material during transportation, improper storage, faulty erection, or undocumented fabrication errors may be cause for rejection of said material at the Project Site. All costs associated with any corrective action will be borne by the Contractor.

Following delivery to the Project Site, the Engineer will perform a visual inspection of all material to verify shipping documents, fabricator markings, and that there was no damage to the material or coatings during transportation and handling.

The Engineer is not responsible for approving or accepting any fabricated materials prior to final erection and assembly at the Project Site.

High-strength bolts, nuts and washers shall be stored in accordance with Subarticle 6.03.03-4(f).

The span pole shall be erected, assembled and installed in accordance with these specifications and the procedures and methods submitted with the working drawings. The Contractor and the span pole designer are responsible to ensure that the erection and assembly procedures and methods in this specification are acceptable for use with the span pole. Changes to these method and procedures shall be submitted with the working drawings and calculations.

Prior to installation of the span pole, the exposed threads of all the embedded anchor bolts shall be cleaned of accumulated dirt and concrete and shall be lubricated. The threads and bearing surfaces of all the anchor bolt nuts shall be cleaned and lubricated. The anchor bolts and nuts are properly lubricated if the nuts can be turned by hand on the anchor bolt threads. The lubricant shall contain a visible dye of any color that contrasts with the color of the galvanizing. Re-lubricate the threads of the anchor bolts and nuts if more than 24 hours has elapsed since earlier lubrication, or if the anchor bolts and nuts have become wet since they were first lubricated.

Install (turn) the leveling nuts onto the anchor bolts and align the nuts to the same elevation or plane. The distance from the bottom of the leveling nuts to the top of the foundation shall not

exceed 1 in. Place a structural hardened washer on top of each leveling nut, 1 washer on each anchor bolt.

Prior to erecting the pole, place the closed cell elastomer ring within the anchor bolt pattern. The closed cell elastomer ring shall not interfere with the anchor bolt leveling nuts and shall not block the opening in the base plate.

The pole shall be erected so that the centerline of the pole will be plumb after the application of all the dead loads. The pole may be initially installed raked in the opposite direction of the overhead member to obtain the plumb condition. Raking the pole may be accomplished by installing the leveling nuts in a plane other than level.

Install the pole base plate atop the washers resting on the leveling nuts, place a structural hardened washer on each anchor bolt resting it on the top of the base plate, and install (turn) a top nut on each anchor bolt until the nut contacts the washer. The leveling nuts and washers shall be inspected, and if necessary the nuts turned, so that the washers are in full contact with the bottom surface of the base plate.

Tighten the top nuts to a snug tight condition in a star pattern. Snug tight is defined as the maximum rotation resulting from the full effort of one person using a 12 in. long wrench or equivalent. A star tightening pattern is one in which the nuts on opposite or near-opposite sides of the bolt circle are successively tightened in a pattern resembling a star (e.g., For an 8-bolt circle with bolt sequentially numbered 1 to 8, tighten nuts in the following bolt order: 1, 5, 7, 3, 8, 4, 6, 2.).

Tighten leveling nuts to a snug tight condition in a star pattern.

Before final tightening of the top nuts, mark the reference position of each top nut in a snug-tight condition with a suitable marking on 1 flat with a corresponding reference mark on the base plate at each bolt. Then incrementally turn the top nuts using a star pattern one-sixth of a turn beyond snug tight. Turn the nuts in at least two full tightening cycles (passes). After tightening, verify the top nut rotation. The top nuts shall have full thread engagement. The distance from the bottom of the leveling nuts to the top of the foundation shall not exceed 1 in.

After erecting the span pole, the span pole shall be electrically grounded by attaching the bare copper grounding conductor to the inside of the handhole frame with a stainless steel bolt and to the ground rod with a ground clamp. The rigid metal conduit shall be electrically grounded by attaching the bare copper grounding conductor to the insulated bonding bushing and to the ground rod with a ground clamp.

The installation of the span wire shall conform to Article 11.14.03. A span wire pole clamp shall be provided for each span wire connected to the pole. The traffic appurtenances shall be located and mounted on the wire as shown on the cross-sections.

After installation of the traffic appurtenances, the anchor bolt nuts (leveling and top anchor nut) and washers shall be in full contact with the top and bottom surfaces of the pole base plate and the centerline of the pole shall be plumb.

After installation of the traffic appurtenances, a survey shall be performed by the Contractor to confirm that the sag is no less than 5% of the span and to confirm that the minimum vertical clearances from the top of the finished road to the bottom of the traffic appurtenances have been met.

The last character of the span pole identification number shall be stenciled with black paint, unless otherwise specified, on the pole of each span pole. The character shall be 3 in. high and placed approximately 12 in. above the top of the base plate facing the centerline of the roadway.

For Fairfield Intersection #050-207, Route 1 at Ruane Street only.

All span pole assemblies, including all brackets and hardware, shall be factory painted after galvanization.

1. Surface preparation - SSPC-SP1 solvent clean, SSPC-SP16 abrasive brush blast, using DuPont Starblast, or equal, achieving 1-2 mill profile, maintaining H.D. Galvanizing minimum mills thicknesses per ASTM A123.
2. Apply Carboguard 893, or equal, 3-5 mdft, per manufacturer's recommendations.
3. Apply Carbothane 133LV, 3-5, or equal mdft, per manufacturer's recommendations.
4. Packaging - Wrap entire substrates with 1/8" foam and shrink wrap.

The color of the finish coat for steel span poles, anchor bolt covers, handhole covers, post caps, end caps, bolts, washers and nuts shall be Black. **The color of the finished coat shall be BLACK**, No. 37038, Federal Standard No. 595. The Contractor shall submit color samples to the Town of Fairfield Engineer for approval prior to fabrication.

Any coating damaged prior to or during the installation of shall be repaired. Areas to be repaired shall be clean, dry, free from grease, oil, corrosion products and other contamination. If contaminated, power wash or scrub with stiff brush and clean water. Repair areas may be brushed or sprayed as appropriate. If the Contractor elects to spray they must provide overspray containment. The minimum overspray containment shall conform to the requirements of SSPC Guide 6 for the Class 3A level.

All defective work shall be corrected by the Contractor at no cost to the Town or Department.

Compliance with Regulations: The Contractor is required to meet all OSHA and EPA as well as state and local government regulations regarding worker safety and protection, hazardous waste handling and disposal through the use of appropriate containment, engineering controls, respirators, monitors, etc.

Paint samples and proposed painting procedures shall be submitted to:

William Hurley

Engineering Manager
Town of Fairfield, CT
725 Old Post Rd,
Fairfield, CT 06824
whurley@fairfieldct.org
(203)256-3015

For Westport Intersection #158-213, Route 1 at Taylor Place and Main Street only.

All span pole assemblies, including all brackets and hardware, shall be factory painted after galvanization.

1. Surface preparation - SSPC-SP1 solvent clean, SSPC-SP16 abrasive brush blast, using DuPont Starblast, or equal, achieving 1-2 mill profile, maintaining H.D. Galvanizing minimum mills thicknesses per ASTM A123.
2. Apply Carboguard 893, or equal, 3-5 mdft, per manufacturer's recommendations.
3. Apply Carbothane 133LV, 3-5, or equal mdft, per manufacturer's recommendations.
4. Packaging - Wrap entire substrates with 1/8" foam and shrink wrap.

The color of the finish coat for steel span pole, anchor bolt covers, handhole covers, post caps, end caps, bolts, washers and nuts shall be Black. **The color of the finished coat shall be BLACK**, No. 37038, Federal Standard No. 595. The Contractor shall submit color samples to the Town of Westport Engineer for approval prior to fabrication.

Any coating damaged prior to or during the installation of shall be repaired. Areas to be repaired shall be clean, dry, free from grease, oil, corrosion products and other contamination. If contaminated, power wash or scrub with stiff brush and clean water. Repair areas may be brushed or sprayed as appropriate. If the Contractor elects to spray they must provide overspray containment. The minimum overspray containment shall conform to the requirements of SSPC Guide 6 for the Class 3A level.

All defective work shall be corrected by the Contractor at no cost to the Town or Department.

Compliance with Regulations: The Contractor is required to meet all OSHA and EPA as well as state and local government regulations regarding worker safety and protection, hazardous waste handling and disposal through the use of appropriate containment, engineering controls, respirators, monitors, etc.

Paint samples and proposed painting procedures shall be submitted to:

Peter A. Ratkiewich, P.E.
Westport Town Engineer
Town of Westport, CT
110 Myrtle Avenue
Westport, CT 06880
pratkiewich@westport.ct.gov
(203)341-1131

Method of Measurement: The work for span poles will be measured for payment by the number of span poles, of the type specified, completed and accepted in place. The work for span wires will be measured for payment by the actual number of linear feet of steel span wire installed and accepted in place.

Basis of Payment: The work for the span poles will be paid for at the Contract unit price each for "XX Steel Span Pole" or "Steel Combination Span Pole", of the type specified, complete in place, which price shall include all equipment, materials, tools and labor incidental to the design, fabrication and installation, of the span pole at the locations specified on the plans. The work for the span wire will be paid for at the Contract unit price per linear foot for "Span Wire", complete in place, which price shall include pole clamps, thimble eyebolts, nuts, washers, cable rings, and all equipment, materials, tools and labor incidental to the design and installation, at the locations shown on the plans.

<u>Pay Item</u>	<u>Pay Unit</u>
28' Steel Span Pole	ea.
30' Steel Span Pole	ea.
32' Steel Span Pole	ea.
34' Steel Span Pole	ea.
Steel Combination Span Pole	ea.
Span Wire	l.f.

ITEM #1104026A – 25’ STEEL MAST ARM ASSEMBLY**ITEM #1104028A – 30’ STEEL MAST ARM ASSEMBLY****ITEM #1104033A – 40’ STEEL MAST ARM ASSEMBLY****ITEM #1104038A – 50’ STEEL MAST ARM ASSEMBLY****ITEM #1104039A – 55’ STEEL MAST ARM ASSEMBLY**

Description: Work under this item shall consist of designing, fabricating and installing a mast arm assembly to carry traffic appurtenances (such as traffic signals, signs, antenna, etc.) of the type specified, on a prepared foundation, in accordance with the details shown on the plans and as ordered by the Engineer.

Materials: The tubular components, such as the pole, arm and luminaire arm shall be made of steel with a minimum yield stress of 35,000 psi.

The structural plate components, such as the baseplates, handhole frames, and the plates in the arm to pole ring stiffened, built-up box connection, shall be made of steel that conforms to the requirements of ASTM A572, Grade 50.

Anchorage plates shall conform to the requirements of ASTM A572, Grade 50.

The steel for arm and pole members; structural plate components, such as the baseplates, connection/flange plates, gusset plates, handhole frames and the plates in the arm to pole connection, shall meet Charpy V-notch impact testing requirements for non-fracture critical members in Zone 2 and the following:

Yield Strength	Thickness in.	Minimum Average Energy, ft.-lbf
$F_y \leq 36 \text{ ksi}$	≤ 4	15 at 40°F
$36 \text{ ksi} < F_y \leq 50 \text{ ksi}$	≤ 2	15 at 40°F
$36 \text{ ksi} < F_y \leq 50 \text{ ksi}$	$2 < t \leq 4$	20 at 40°F
$50 \text{ ksi} < F_y \leq 70 \text{ ksi}$	≤ 4	15 at -20°F
Charpy V-notch sampling and testing shall be in accordance with AASHTO T243, “H” piece frequency.		

The non-structural components, such as hand hole covers, caps and anchor bolt covers, shall be made of steel with minimum yield stress of 36,000 psi.

The filler metal shall have a matching strength relationship with the base metal.

All high strength bolts shall conform to ASTM A325, Type 1. Nuts shall conform to ASTM A563, Grade DH. Circular, flat, hardened steel washers shall conform to ASTM F436. The bolts, nuts and washers shall be galvanized in accordance with ASTM A153 or ASTM B695, Class 55. The nuts shall be overtapped to the minimum amount required for the bolt assembly and all surfaces of the nuts shall be lubricated with a lubricant containing a visible dye of any color that contrasts with the color of the galvanizing. The high strength bolts shall conform to the requirements of Subarticle M.06.02-3.

The anchor bolts shall conform to ASTM F1554, Grade 105. The nuts shall conform to ASTM A563, Grade DH. The washers shall conform to ASTM F436. The bolts, nuts and washers shall be galvanized in accordance with ASTM A153. The nuts shall be overtapped to the minimum amount required for the bolt assembly and all surfaces of the nuts shall be lubricated with a lubricant containing a visible dye of any color that contrasts with the color of the galvanizing. Prior to shipping the anchor bolts, the nuts and washers shall be installed by hand on the anchor bolts to ensure that the nuts can be run on the threads. Only anchor bolts on which the nuts are free running shall be shipped. The anchor bolts shall be shipped with the nuts and washers on the threads.

All steel components, including anchor bolts, shall be completely hot-dip galvanized, after fabrication, in accordance with ASTM A123 or ASTM A153, as applicable. Repairs to damaged areas of the hot-dip galvanized coatings shall conform to the requirements of ASTM A780 amended as follows:

Paints containing zinc dust, if used for repairs, shall contain either between 65% to 69% metallic zinc by weight or greater than 92% metallic zinc by weight in dry film.

The silicone sealant shall be a 1-component, 100% silicone sealant recommended for use with galvanized steel.

Neoprene gasket material for the access openings shall conform to ASTM D1056, Grade 2A2 or 2A3. Other grades of neoprene approved by the Engineer may be used.

Closed cell elastomer for sealing the space between the foundation and base plate shall conform to ASTM D1056, Grade 2A2 or 2A3 and shall have a pressure-sensitive adhesive backing on one side for adhesion to steel. Closed cell elastomer contained within the anchor bolt pattern shall not interfere with the anchor bolt leveling nuts and shall not block the opening in the base plate.

Bare copper grounding conductor shall be #8 AWG stranded bare copper wire conforming to M.15.13. The grounding bolt shall be stainless steel with a hex head.

All materials used in the finished structure shall be new. The use of materials that have been previously used in a structure or salvaged from a structure is not permitted.

The Contractor shall submit Certified Test Reports and Materials Certificates in conformance with Article 1.06.07 for the steel used in the mast arm members and components, high-strength bolts (including nuts and washers) and anchor bolts (including nuts and washers). The Certified Test Reports shall include the following:

- a. Mill test reports that indicate the place where the material was melted and manufactured.
- b. High-strength bolt test results for proof load tests, wedge tests, and rotational-capacity tests that indicate where the tests were performed, date of tests, location of where the components were manufactured and lot numbers.
- c. Galvanized material test results that indicate the thickness of the galvanizing.

Prior to incorporation into the work, the Contractor shall submit samples in conformance with Article 1.06.02 for the steel used in the mast arm members and components, high-strength bolts (including nuts and washers) and anchor bolts (including nuts and washers).

Construction Methods: The design and fabrication of the mast arm assembly, including its anchorage (into the foundation), shall conform to the requirements of the latest edition of the AASHTO Standard Specifications for Structural Supports for Highway Signs, Luminaires and Traffic Signals, including the latest interim specifications, available prior to the advertising date of the contract, amended as follows:

1. The design wind speed shall be 120 mph. The computation of wind pressures in accordance with Appendix C is not permitted.
2. The minimum design life shall be 50 years.
3. The wind importance factor, I_r , for wind pressure shall be 1.00.
4. The mast arms shall be designed to support fixed mounted traffic signals and signs. The wind drag coefficient for traffic signals and luminaires shall be 1.2.
5. The mast arms shall be designed for fatigue importance category I for cantilever structures. The mast arms shall be designed for the wind load effects due to galloping, natural wind gusts and truck-induced gusts. The luminaire arms shall be designed for the wind load effects due to natural wind gusts. The design pressure for the truck-induced gust shall be based on a truck speed of 65 mph. The design of the mast arms shall assume that vibration mitigation devices will not be installed.
6. The vertical deflection of the free end of the arm due to the wind load effects of galloping and truck-induced gusts shall not exceed 8 in.

7. The maximum stress ratio (the ratio of the computed stress to the allowable stress) or combined stress ratio in any mast arm component due to each group load shall not exceed 0.70. The purpose for limiting the stress ratio is to allow for future additional appurtenance configurations.
8. The maximum arm length shall be 40.0 ft., measured from the centerline of the pole to the tip of the arm.
9. The maximum luminaire arm length shall be 15.0 ft.
10. The maximum diameter of the pole at its base shall be 18 in.
11. The maximum diameter of the arm at the arm-pole connection shall be 15 in.
12. The minimum wall thickness of the arm at the pole connection and the pole shall be 0.3125 in. The wall thickness of the pole and arm component members shall be uniform throughout their lengths. The use of multiple plies (laminations) to obtain the required arm and pole thickness is not permitted. The use of shop-fabricated stepped members is not permitted.
13. The arm, luminaire arm and pole shall be tubular members with either round or multisided cross-sections. Multisided tubular members with other than 8, 12 or 16 sides are not permitted. Multisided tubular members with fluted sides are not permitted. The arm and luminaire arm shall be fabricated with a taper (change in diameter).
14. Multisided tubular members with diameters less than or equal to 13 in. shall have a minimum of 8 sides. Multisided tubular members with diameters greater than 13 in. and less than or equal to 18 in. shall have no less than 12 sides.
15. Multisided tubular members shall have a minimum internal bend radius of 5 times the tubular member thickness or 1 in., whichever is greater.
16. Joining 2 tubular members together with a circumferential weld to fabricate a pole is not permitted.
17. A maximum of 1 slip-type field splice is permitted in the arm. Slip-type field splices are not permitted in the pole.
18. A maximum of 1 longitudinal seam weld is permitted in the arm. A maximum of 2 longitudinal seam welds are permitted in the pole.
19. The longitudinal seam welds within 6 in. of the member ends shall be complete joint penetration groove welds.

20. Non-destructively test 100% of partial joint penetration longitudinal seam welds in accordance with the magnetic particle method. Non-destructively test 100 % of complete joint penetration seam welds in members less than 0.25 in. thick in accordance with the magnetic particle method on both the inside and outside surfaces. Non-destructively test 100% of complete joint penetration seam welds in members greater than or equal to 0.25 in. thick in accordance with the ultrasonic method in accordance with AWS D1.1 Annex S.
21. All tubular member to transverse plate connections shall be made with a complete joint penetration groove weld with a backing ring attached to the plate with a continuous fillet weld. Non-destructively test 100% of the complete joint penetration groove welds by the ultrasonic method after fabrication and prior to galvanizing. Non-destructively test 100% of the complete joint penetration groove welds by the ultrasonic method for toe cracks after galvanizing. Non-destructively test 100% of backing ring fillet welds by the magnetic particle method after fabrication prior to galvanizing. After galvanizing, the joint between the backing ring and tubular member shall be sealed with silicone sealant to prevent the ingress of moisture.
22. The strength of a connection made with a complete joint penetration groove weld shall be no greater than the strength of the base metal. In connections joining base metal with different yield strengths, the base metal with the lower yield strength shall govern the design.
23. The flange plate connection in the arm to pole in the ring stiffened, built-up box connection shall be designed as slip critical connections with standard holes. The minimum number of high-strength bolts in a flange splice shall be 8. Consideration should be given to the use of smaller diameter bolts since they require lower specified minimum bolt tensions.
24. The minimum flange plate thickness shall no less than 2 in. The determination of the plate thickness in the tubular member to transverse plate connections shall consider the potential for the plate to warp due to the heat from welding. Consideration should be given to the use of thicker plates to allow for subsequent machining of warped plates to a flat surface so that removal of material will not compromise the required strength of the plate.
25. The minimum thickness of the ring plates and gusset plates in the ring stiffened, built-up box connection shall be 0.5 in.
26. The size of fillet welds specified in designed connections shall be no less than 0.3125 in. The use of seal and tack welds is not permitted. No welding shall be performed after galvanizing.

27. The use of stiffeners at tubular member to transverse plate connections and at the arm to pole connection is not permitted.
28. The minimum base plate thickness shall be no less than 2.5 in. or at least as thick as the anchor bolt diameter, whichever is greater. The determination of the plate thickness in the tubular member to transverse plate connections shall consider the potential for the plate to warp due to the heat from welding. Consideration should be given to the use of thicker plates to allow for subsequent machining of warped plates to a flat surface so that removal of material will not compromise the required strength of the plate.
29. The opening in the base plate shall be sized to allow for proper galvanizing and allow conduits projecting from the foundation to pass through it. The size of the opening shall be kept to a minimum to reduce the flexibility of the baseplate.
30. The pole base plate anchor bolt circle diameter shall be 24 in.
31. The anchor bolt to base plate connection shall be designed as a double-nut connection with shear holes. The minimum distance from the center of the anchor bolt hole to the edge of the base plate shall be no less than 2 times the diameter of the anchor bolt. The anchor bolts shall use an embedded anchorage plate, 0.5 in. minimum thickness, to transmit loads from the pole base to the concrete foundation. The use of hooked anchor bolts is not permitted. The minimum number of anchor bolts shall be 8. The minimum anchor bolt diameter shall be 2 in. The minimum anchor bolt embedment, the distance from the top of the foundation to the top of the embedded anchorage plate, shall be 3.5 ft. or the tension development length of the vertical foundation reinforcement plus the end concrete cover, whichever is greater. Each anchor bolt shall be supplied with 4 nuts and 4 washers. Washers shall be placed on the top and bottom surfaces of the pole base plate and anchorage plate. Welding to the anchor bolts is not permitted. The use of lock washers with the anchor bolt assembly is not permitted.

The mast arm shall be designed for the load effects due to the actual traffic appurtenances (signals, signs, luminaires, cameras, etc.). The mast arm shall also be designed for load effects from future traffic appurtenances arranged, positioned and located as shown on the plans. The mast arm shall also be designed for load effects during all stages of construction that may exist during the Project under which the mast arm is installed. The mast arm shall be designed to support traffic appurtenances with properties no less than those tabulated on the plans.

The dimensions of the mast arm assemblies are shown on the traffic plans, elevations, cross-sections or in the special provisions. The arm, luminaire arm and pole lengths and the attachment heights shall be verified by the Contractor based on the finished grade at the site, top of foundation elevation, the locations of overhead utility cables and the traffic appurtenance

mounting heights. If either the arm or pole length is inadequate, the Contractor shall notify the Engineer.

The minimum vertical clearance from the top of the finished road to the bottom of the traffic signals shall be 16.0 ft. The maximum vertical clearance from the top of the finished road to the bottom of the traffic signals shall be 18.0 ft. The traffic signals shall be installed so that the bottom of all the signals for each approach is at the same elevation.

The arm to pole connection shall be made with a ring stiffened, built-up box. The luminaire arm to pole connection shall be made with either a built-up box or a ring stiffened built-up box. A minimum of 8 high-strength bolts shall be used to connect the arm flange plate to the built-up box connection plate. A minimum of 4 high-strength bolts shall be used to connect the luminaire arm flange plate to the built-up box connection plate. All fasteners and their components used in the each connection shall be visible. The use of tapped holes in the plates of each connection is not permitted. A hole(s) shall be provided in each connection to allow wires to pass from the pole to the arm and luminaire arm. The sides of all holes in each connection shall be ground smooth and the edges rounded by grinding to prevent the wires from chafing.

Vent and drain holes shall be provided for galvanizing. The number, size and location of vent and drain holes should be coordinated with the galvanizer prior to the submission of the working drawings and design calculations. The area of vent and drain holes at each end of a member shall be at least 30% of the inside area of the member for members with diameters 3 in. and greater and 45% of the inside area of the member for members with diameters less than 3 in. The vent and drain holes shall be strategically located for reducing stress and for proper galvanizing. The holes shall be made by drilling. Flame cut holes are not permitted. The edges of all holes shall be rounded by grinding. After galvanizing, exposed holes placed in the sign support components for galvanizing shall be sealed with neoprene plugs.

A J-hook shall be welded to the inside of the pole at the top for wire handling and support.

The mast arm shall have a handhole, reinforced with a frame, located at the base of the pole. The handhole shall be located with a normal direction that is 90° to the plane formed by the pole and arm. The clear distance from the top of the baseplate to the outside face of the bottom of the handhole frame shall be no less than the diameter of the tubular member plus 1 inch and no greater than the diameter of the tubular member plus 3 inches. The handhole frame shall have a minimum 4 in. wide by minimum 6 in. high clear opening. The maximum width of the handhole opening, the clear opening plus twice the frame thickness, shall not be greater than 40% of the tubular member diameter at that section. The inside corners of the handhole frame shall be rounded to a radius of 30% to 50% of the width of the clear opening. The minimum thickness of the handhole frame shall be no less than the thickness of the pole or 0.3125 in., whichever is greater. The handhole frame shall be connected to the pole with a partial joint penetration groove weld reinforced with a fillet weld. The handhole weld shall start and end at the point that is coincident with the longitudinal axis of symmetry of the tubular member and the longitudinal axis of symmetry of the handhole frame. 100% of the weld shall be non-destructively tested in accordance with the magnetic particle method. The handhole shall be provided with a cover

connected to the frame with no less than 2 stainless steel screws. The cover shall be installed with a neoprene gasket matching the dimensions of the cover. Cover and the gasket; and the gasket and the handhole frame shall be in firm and continuous contact after tightening the fasteners. The cover shall also be attached to the frame with a 1.5 ft. long stainless steel chain. The inside bottom of the frame shall have a hole tapped for the stainless steel grounding bolt.

The mast arm shall be supplied with a pole cap plate, arm cap plate, and anchor bolt covers. The cap plates shall be attached with fasteners. The joint between the tubular member and plate shall be sealed with a neoprene gasket matching the dimensions of the plate.

The luminaire arms shall be fabricated of pipe with a minimum thickness equal to schedule 40. Single arm luminaires shall be used for luminaires with arm lengths less than or equal to 8.0 ft. Truss type luminaires shall be used for luminaires with arm lengths greater than 8.0 ft. The truss type luminaires shall consist of an upper and lower members joined with vertical members at the tip and midspan. To accommodate the luminaire fixture, the size of the pipe in the luminaire arm at the tip shall be 2 in. diameter, schedule 40. If necessary, a reducing tenon shall be installed at the tip of the arm to accommodate the luminaire fixture.

The luminaire arm(s) shall be connected to the pole with clamp connections. Each clamp connection shall use 4 high-strength bolts. The installed nuts shall be prevented from loosening while in service. The use of lock washers to meet this requirement is not permitted. The arms shall be fillet welded, all-around, to the clamp(s). The size of the weld shall be no less than 0.25 in. A hole shall be provided in the clamp, (upper arm clamp for truss type arms) and pole to allow for wires to pass from the pole to the luminaire arm. The sides of all holes in the connection shall be ground smooth and edges rounded by grinding to prevent the wires from chafing.

Prior to fabrication, the Contractor shall submit working drawings and design calculations, with all details and documents necessary for fabrication and erection of the structure and its components, for each mast arm assembly for review in accordance with the "Notice To Contractor – Special Provision 1.05" and the special provision "Section 1.05 – Control Of Work".

The working drawings and design calculations for the mast arm assemblies shall conform to working drawing requirements for permanent construction. **A single set of drawings with tabulated data for multiple mast arm locations is not permitted.** Each mast arm shall be referenced with an alpha-numeric identifier noted on the Contract documents. The working drawings and calculations shall be prepared in Customary U.S. units.

1. title sheet
2. table of contents

3. contact information for designer, fabricator and galvanizer – contact information shall include name and address of each firm and the name of contact person with phone number and email address
4. copy of the certificate of insurance
5. copy of fabricator's AISC certification
6. copy of the traffic signal control plan detailing mast arm assembly
7. mast arm assembly working drawings
8. mast arm assembly design calculations
9. welding procedures
10. mast arm installation procedure, including the method to plumb the pole

The working drawings shall include complete details of all mast arm components. The drawings shall include, but not be limited to the following:

1. the Project number, town and mast arm identification number
2. reference to the design specifications, including interim specifications
3. reference to the design specifications design criteria, such as design wind speed, minimum design life, fatigue category, vehicle speed, etc.
4. material specifications for all components
5. material designations for the arm and pole, with an explanation of the alpha numeric characters (equivalent thickness, in inches, shall be provided for gage numbers)
6. non-destructive weld testing requirements
7. details of the location of the longitudinal seam welds in the arm, luminaire arm and pole
8. vent and drain holes for galvanizing
9. dead load and permanent camber
10. a plan view of the anchor bolt layout relative to the orientation of the arm

11. anchor bolt dimensions, including embedment and projection
12. mast arm installation procedure, including the method to plumb the pole

The design calculations shall include, but not be limited to the following:

1. the Project number, town and alpha-numeric mast arm identifier
2. references to design specifications, including interim specifications, and the applicable code section and articles
3. description/documentation for all computer programs used in the design
4. drawings/models of the structure, components and connections, with dimensions, loads and references to the local and global coordinate systems used (as applicable), to facilitate review of the results
5. a tabulation of the section properties of the tubular members at each analyzed section. The tabulated values shall include:
 - a. the diameter, D (if round member)
 - b. effective width, b (if multisided member, AASHTO 5.5.2)
 - c. equivalent diameter (if multisided member, AASHTO 5.6)
 - d. wall thickness, t
 - e. inside bend radius, r_b (if multisided member, AASHTO 5.5.2)
 - f. cross-sectional area, A
 - g. moment of inertia, I
 - h. section modulus, S
 - i. radius of gyration, r

AASHTO Table B-1 may be used to determine the section properties. If Table B-1 is used, the radius measured to the mid-thickness of the wall shall also be provided.

6. coefficients and factors used in the design
7. results of all group loads and load combinations
8. stress ratios and combined stress ratios for all group loads and load combinations
9. horizontal and vertical deflections due to Group Load Combinations I, II and III for dead, wind and ice loads
10. vertical deflection of the free end of the arm due to the wind load effects of galloping and truck-induced gusts

The mast arm assemblies shall be fabricated in accordance with the latest edition of the AASHTO LRFD Bridge Construction Specifications, including the latest interim specifications, amended herein.

The steel fabricator shall be AISC certified for the fabrication to the Standard for Bridge and Highway Metal Component Manufacturers (CPT).

Fabrication of the mast arm may begin only after the working drawings and design calculations have been reviewed. The Contractor shall submit to the Engineer, no less than 2 weeks prior to the start of fabrication, the name and location of the fabrication shop where the work will be done so that arrangements can be made for an audit of the facility and the assignment of the Department Quality Assurance (QA) inspector. No fabrication will be accepted unless the QA inspector is present during fabrication. No changes may be made during fabrication without prior written approval by the Department.

The Contractor shall furnish facilities for the inspection of material and workmanship in the shop by the Engineer. The Engineer and Department QA representative shall be allowed free access to the necessary parts of the premises.

The Engineer will provide QA inspection at the fabrication shop to assure that all applicable Quality Control plans and inspections are adequately adhered to and maintained by the Contractor during all phases of the fabrication. A thorough inspection of a random selection of elements at the fabrication shop may serve as the basis of this assurance.

Prior to shipment to the project, each individual piece of steel shall be marked in a clear and permanent fashion by a representative of the fabricators' Quality Control (QC) Department to indicate complete final inspection by the fabricator and conformance to the Project specifications for that piece. The mark must be dated. A Materials Certificate in accordance with Article 1.06.07 may be used in lieu of individual stamps or markings, for all material in a single shipment. The Materials Certificate must list each piece within the shipment and accompany the shipment to the Project site.

Following the final inspection by the fabricator's QC personnel, the Engineer may select pieces of steel for re-inspection by the Department's QA inspector. Should non-conforming pieces be identified, all similar pieces must be re-inspected by the fabricator and repair procedure(s) submitted to the Engineer for approval. Repairs shall be made at the Contractor's expense.

The pieces selected for re-inspection and found to be in conformance, or adequately repaired pieces, may be marked by the QA inspector. Such markings indicate the Engineer takes no exception to the pieces being sent to the Project site. Such marking does not indicate acceptance or approval of the material by the Engineer.

All welding details, procedures and nondestructive testing shall conform to the requirements of AWS D1.1 Structural Welding Code - Steel.

Personnel performing the nondestructive testing shall be certified as a NDT Level II technician in accordance with the American Society for Non Destructive Testing (ASNT), Recommended Practice SNT-TC-1A and approved by the Engineer.

All nondestructive testing shall be witnessed by Engineer. Certified reports of all tests shall be submitted to the Engineer for examination. Each certified report shall identify the structure, member, and location of weld or welds tested. Each report shall also list the length and location of any defective welds and include information on the corrective action taken and results of all retests of repaired welds.

The Department reserves the right to perform additional testing as determined by the Engineer. Should the Engineer require nondestructive testing on welds not designated in the contract, the cost of such inspection shall be borne by the Contractor if the testing indicates that any weld(s) are defective. If the testing indicates the weld(s) to be satisfactory, the actual cost of such inspection will be paid by the Department.

All members and components shall be hot-dip galvanized in a single dip. Double-dipping of members and components is not permitted. All exterior and interior surfaces of the mast arm members and components, including the interior of the ring-stiffened built-up box connection, shall be completely galvanized.

Galvanized members and components shall be free from uncoated areas, blisters, flux deposits, and gross inclusions. Lumps, projections, globules, or heavy deposits of zinc which will interfere with the intended use of the material will not be permitted.

After galvanizing the joint between the backing ring and the tubular member shall be sealed with silicone sealant to prevent the ingress of moisture.

All damaged areas of the hot-dip galvanized surfaces shall be repaired in accordance with the requirements of ASTM A780. If paint containing zinc dust is used for repairs, the dry coating thickness shall be at least 50% greater than the thickness of the adjacent hot-dip galvanized coating, but no greater than 4.0 mils. The paint shall be brush applied. The use of aerosol spray cans shall not be permitted. The color of the finished repair area shall match the color of the adjacent hot-dip galvanized surface at the time of the repair to the satisfaction of the Engineer.

Prior to shipping, all galvanized surfaces of the members and components shall be inspected, in the presence of the Engineer, to determine the acceptability of the galvanized coating. Galvanized coatings may be found acceptable by the Engineer if all surfaces of the members and components meet the galvanizing requirements herein. Only mast arm members and components with acceptable galvanized coatings shall be shipped. If the galvanized coating on any member or component is found to be unacceptable, the Contractor shall submit a repair procedure to the Engineer for review.

After fabrication, the arm to pole bolted connection shall be assembled in the fabricator's shop, in the presence of the Engineer, to determine the acceptability of the connection. The faying surfaces shall be free of dirt, loose scale, burrs, other foreign material and other defects that would prevent solid seating of the parts. Prior to assembly, the galvanized faying surfaces shall be scored by wire brushing. The faying surfaces of the connection plates shall be checked with a straight edge to ensure that the surfaces are not distorted and the entire faying surface of each plate will be in contact when assembled. The high-strength bolts, including nuts and washes, shall be installed and tensioned in accordance with Subarticle 6.03.03-4(f). A connection may be found acceptable by the Engineer if the faying surfaces of the flange (connection) plates are in firm, continuous contact after properly tensioning the bolts. Only mast arm assemblies with acceptable arm to pole bolted connections shall be shipped. If a bolted connection is found unacceptable, the Contractor shall submit a procedure to repair the connection to the Engineer for review. The use or installation of galvanized hardened steel washer between the faying surfaces of the connection is not permitted. Galvanized surfaces damaged by the repair procedure shall be hot dip galvanized. Repair of the damaged galvanized surfaces in accordance with the requirements of ASTM A780 or with a galvanizing repair stick is not permitted. Bolts, nuts and washers used for the trial shop fit-up shall not be reused in the final field assembly.

After fabrication and prior to shipping, aluminum identification tags shall be attached to the arm and pole members with self-tapping tamper resistant screws.

The finished members and components shall be protected with sufficient dunnage and padding to protect them from damage and distortion during transportation. Damage to any material during transportation, improper storage, faulty erection, or undocumented fabrication errors may be cause for rejection of said material at the Project site. All costs associated with any corrective action will be borne by the Contractor.

Following delivery to the Project site, the Engineer will perform a visual inspection of all material to verify shipping documents, fabricator markings, and that there was no damage to the material or coatings during transportation and handling.

The Engineer is not responsible for approving or accepting any fabricated materials prior to final erection and assembly at the Project site.

High-strength bolts, nuts and washers shall be stored in accordance with Subarticle 6.03.03-4(f).

The mast arm shall be erected, assembled and installed in accordance with these specifications and the procedures and methods submitted with the working drawings. The Contractor and the mast arm designer are responsible to ensure that the erection and assembly procedures and methods in this specification are acceptable for use with the mast arm assembly. Changes to these method and procedures shall be submitted with the working drawings and computations.

Prior to installation of the mast arm pole, the exposed threads of all the embedded anchor bolts shall be cleaned of accumulated dirt and concrete and shall be lubricated. The threads and bearing surfaces of all the anchor bolt nuts shall be cleaned and lubricated. The anchor bolts and

nuts are properly lubricated if the nuts can be turned by hand on the anchor bolt threads. The lubricant shall contain a visible dye of any color that contrasts with the color of the galvanizing. Re-lubricate the threads of the anchor bolts and nuts if more than 24 hours has elapsed since earlier lubrication, or if the anchor bolts and nuts have become wet since they were first lubricated.

Install (turn) the leveling nuts onto the anchor bolts and align the nuts to the same elevation or plane. The distance from the bottom of the leveling nuts to the top of the foundation shall not exceed 1 in. Place a structural hardened washer on top of each leveling nut, 1 washer on each anchor bolt.

Prior to erecting the pole, place the closed cell elastomer ring within the anchor bolt pattern. The closed sell elastomer ring shall not interfere with the anchor bolt leveling nuts and shall not block the opening in the base plate.

The pole shall be erected so that the centerline of the pole will be plumb after the application of all the dead loads. The pole may be initially installed raked in the opposite direction of the overhead member to obtain the plumb condition. Raking the pole may be accomplished by installing the leveling nuts in a plane other than level.

Install the pole base plate atop the washers resting on the leveling nuts, place a structural hardened washer on each anchor bolt resting it on the top of the base plate, and install (turn) a top nut on each anchor bolt until the nut contacts the washer. The leveling nuts and washers shall be inspected, and if necessary the nuts (turned), so that the washers are in full contact with the bottom surface of the base plate.

Tighten the top nuts to a snug tight condition in a star pattern. Snug tight is defined as the maximum rotation resulting from the full effort of one person using a 12 in. long wrench or equivalent. A star tightening pattern is one in which the nuts on opposite or near-opposite sides of the bolt circle are successively tightened in a pattern resembling a star (e.g., For an 8-bolt circle with bolt sequentially numbered 1 to 8, tighten nuts in the following bolt order: 1, 5, 7, 3, 8, 4, 6, 2.).

Tighten leveling nuts to a snug tight condition in a star pattern.

Before final tightening of the top nuts, mark the reference position of each top nut in a snug-tight condition with a suitable marking on 1 flat with a corresponding reference mark on the base plate at each bolt. Then incrementally turn the top nuts using a star pattern one-sixth of a turn beyond snug tight. Turn the nuts in at least two full tightening cycles (passes). After tightening, verify the top nut rotation. The top nuts shall have full thread engagement. The distance from the bottom of the leveling nuts to the top of the foundation shall not exceed 1 in.

High-strength bolts, including nuts and washes, shall be installed and tensioned in accordance with Subarticle 6.03.03-4(f). The arm shall be temporarily and fully supported while all the high-strength bolts are installed and tensioned. The temporary arm support shall not be removed until the

Engineer has confirmed that the faying surfaces of the flange (connection) plates are in firm, continuous contact and the high-strength bolts were properly installed and tensioned. All high-strength bolts in the arm to pole bolted connection shall be inspected (in accordance with Subarticle 6.03.03-4(f)) to confirm the high-strength bolts were properly tensioned. The use or installation of galvanized hardened steel washer between the faying surfaces of the connection is not permitted.

After erecting the mast arm, the mast arm shall be electrically grounded by attaching the bare copper grounding conductor to the inside of the handhole frame with a stainless steel bolt and to the ground rod with a ground clamp. The rigid metal conduit shall be electrically grounded by attaching the bare copper grounding conductor to the insulated bonding bushing and to the ground rod with a ground clamp.

After erection of the mast arm and before the installation of the traffic appurtenances, if the structure exhibits excessive vibration, oscillations or deflections as determined by the Engineer, the Contractor shall immediately stabilize the structure to the satisfaction of the Engineer. Stabilizing the structure may require the removal of a portion of the structure or the entire structure.

The traffic appurtenances shall be located and mounted on the arm as shown on the cross-sections. Holes, if required for wires, shall be located adjacent to the appurtenances and shall be drilled in the bottom of the arm. A rubber grommet shall be installed in each hole to protect the wires from chafing.

After installation of the traffic appurtenances, the anchor bolt nuts (leveling and top anchor nut) and washers shall be in full contact with the top and bottom surfaces of the pole base plate and the centerline of the pole shall be plumb.

After installation of the traffic appurtenances, if the structure exhibits excessive vibration, oscillations or deflections as determined by the Engineer, the Contractor shall design and construct devices to mitigate the movements. The Contractor is responsible for immediately stabilizing the structure to the satisfaction of the Engineer. Stabilizing the structure may require the removal of the traffic appurtenances or the entire structure. Prior to installation of any mitigation device, the Contractor shall submit drawings, design calculations other documentation to the Engineer for review in accordance with Article 1.05.02.

The last character of the mast arm identification number shall be stenciled with black paint, unless otherwise specified, on the pole of each mast arm. The character shall be 3 in. high and placed approximately 12 in. above the top of the base plate facing the centerline of the roadway.

For Fairfield Intersection #050-201, Route 1 at North Benson Rd. only.

All mast arm assemblies, including all brackets and hardware, shall be factory painted after galvanization.

1. Surface preparation - SSPC-SP1 solvent clean, SSPC-SP16 abrasive brush blast, using DuPont Starblast, or equal, achieving 1-2 mill profile, maintaining H.D. Galvanizing minimum mills thicknesses per ASTM A123.
2. Apply Carboguard 893, or equal, 3-5 mdft, per manufacturer's recommendations.
3. Apply Carbothane 133LV, 3-5, or equal mdft, per manufacturer's recommendations.
4. Packaging - Wrap entire substrates with 1/8" foam and shrink wrap.

The color of the finish coat for steel mast arms (shaft, arm, and base and camera arm), anchor bolt covers, handhole covers, post caps, end caps, bolts, washers and nuts shall be Black. **The color of the finished coat shall be BLACK**, No. 37038, Federal Standard No. 595. The Contractor shall submit color samples to the Town of Fairfield Engineer for approval prior to fabrication.

Any coating damaged prior to or during the installation of shall be repaired. Areas to be repaired shall be clean, dry, free from grease, oil, corrosion products and other contamination. If contaminated, power wash or scrub with stiff brush and clean water. Repair areas may be brushed or sprayed as appropriate. If the Contractor elects to spray they must provide overspray containment. The minimum overspray containment shall conform to the requirements of SSPC Guide 6 for the Class 3A level.

All defective work shall be corrected by the Contractor at no cost to the Town or Department.

Compliance with Regulations: The Contractor is required to meet all OSHA and EPA as well as state and local government regulations regarding worker safety and protection, hazardous waste handling and disposal through the use of appropriate containment, engineering controls, respirators, monitors, etc.

Paint samples and proposed painting procedures shall be submitted to:

William Hurley
Engineering Manager
Town of Fairfield, CT
725 Old Post Rd,
Fairfield, CT 06824
whurley@fairfieldct.org
(203)256-3015

Method of Measurement: This work will be measured for payment by the number of steel mast arm assemblies of the type specified, completed and accepted in place.

Basis of Payment: This work will be paid for at the Contract unit price each for "XX Steel Mast Arm Assembly" or "XX Steel Combination Mast Arm Assembly", of the type specified, complete in place, which price shall include all equipment, materials, tools and labor incidental to the design, fabrication and installation, including mitigation devices if required, of the mast arms at the locations specified on the plans.

<u>Pay Item</u>	<u>Pay Unit</u>
25' Steel Mast Arm Assembly	ea.
30' Steel Mast Arm Assembly	ea.
40' Steel Mast Arm Assembly	ea.
50' Steel Mast Arm Assembly	ea.
55' Steel Mast Arm Assembly	ea.

ITEM #1105001A – 1 WAY, 1 SECTION SPAN WIRE TRAFFIC SIGNAL

ITEM #1105003A – 1 WAY, 3 SECTION SPAN WIRE TRAFFIC SIGNAL

ITEM #1105101A – 1 WAY, 1 SECTION MAST ARM TRAFFIC SIGNAL

ITEM #1105103A – 1 WAY, 3 SECTION MAST ARM TRAFFIC SIGNAL

ITEM #1105180A – 1 WAY, 1 SECTION BI-COLORED ARROW

ITEM #1105203A – 1 WAY, 3 SECTION POLE MOUNTED TRAFFIC SIGNAL

ITEM #1105303A – 1 WAY, 3 SECTION PEDESTAL MOUNTED TRAFFIC SIGNAL

Article 11.05.03 – Construction Methods:

In the second paragraph, delete the last sentence (“A balance adjuster shall...”).

Add the following paragraphs:

Circular indications that have an identification mark (such as an arrow) on the top of the lens shall be installed with that mark at the 12 o'clock position.

Article 11.05.05 – Basis of Payment:

In the first sentence of the first paragraph, delete “balance adjuster,”.

Article M.16.06 - Traffic Signals

Sub Article 3 - Housing:

In the last sentence, between the words “housing” and “shall” add “and all internal hardware”.

Add the following after the last paragraph.

Each section of the housing shall be provided with a removable visor. The visor shall be the cap type, unless otherwise noted on the plan. The visor shall be a minimum .05 inch (.13 mm) thick. The visor shall be the twist on type and secured to the signal by four equidistant flat tabs screwed to the signal head.

ITEM #1105001A, 1105003A,
1105101A, 1105103A,
1105180A, 1105203A, 1105303A

Sub Article 4 - Brackets:

Add the following at the end of the last paragraph:

Backplates shall be 5” wide and louvered.

Install a 2” wide fluorescent yellow retroreflective strip (Type XI sheeting) along the perimeter of the face of the backplate.

Replace the last paragraph with the following:

When indicated on the plans, a backplate of dimensions, as shown on the plans, constructed of 5052-H32 aluminum alloy sheet between 0.050-in to 0.065-in thickness meeting the requirements of ASTM B209 shall be attached to the signal head housing. The front surface of backplate per MUTCD shall have a dull black finish to minimize light reflection and to increase contrast between the signal indication and its background.

Delete Sub Article 5 - Optical Unit and Sub Article 6 – Lamp Socket and replace with the following:

Optical Unit, Light Emitting Diode:

(a) General:

Only Optical Units that meet the requirements contained herein supplied by the below manufacturers that have been tested by the Department’s Signal Lab will be accepted. Final approval for model numbers will be done at the time of the catalog cut submittals.

Duralight
Trastar, Inc.
860 N. Dorothy Dr., Suite 600
Richardson, TX 75081

GE Lighting Solutions
Corporate Headquarters
1975 Noble Road Building 338E
East Cleveland, OH 44112-6300

Dialight
1501 Foute 34 South
Farmingdale, NJ 07727

Leotek
726 South Hillview Drive
Milpitas, CA 95035

The materials for Light Emitting Diode (LED), Optical Unit, circular and arrow, shall conform to the following:

ITEM #1105001A, 1105003A,
1105101A, 1105103A,
1105180A, 1105203A, 1105303A

- The ITE Performance Specification for Vehicle Traffic Control Signal Heads – Light Emitting Diode (LED) Circular Signal Supplement for circular indications dated June 27, 2005.
- The ITE Performance Specification for Vehicle Traffic Control Signal Heads – Light Emitting Diode (LED) Vehicle Arrow Traffic Signal Supplement for arrow indications dated July 1, 2007.

Section 4, Adjustable Traffic Signals and General Housing sections of the **Department of Transportation Functional Specifications for Traffic Control Equipment, current edition governs**. Where the Department of Transportation Functional Specifications conflict with this Special Provision or the 2005/2007 ITE Performance Specifications, this Special Provision and the 2005/2007 ITE Performance Specifications shall govern.

The Optical Unit shall have an Incandescent look and be made up of a smooth surfaced outer shell, multiple LED light sources, a filtered power supply and a back cover, assembled into a sealed unit. The Optical Unit shall be certified as meeting the 2005/2007 ITE Specifications by Intertek Testing Services, Inc. (ITSNA, formerly ETL) or another organization currently recognized by the Occupational Safety and Health Administration (OSHA) as a Nationally Recognized Testing Laboratory (NRTL.) The Optical Unit shall perform to the requirements of the ITE Specification for a minimum of 60 months.

A “Swing Test” will be performed by the Department to ensure no significant dimming or blanking occurs, until the lamp is obscured by the visor. All L.E.D Lamps will be subjected to further field testing for reliable operation.

The Arrow Optical Unit shall be “Omni-Directional” so that it may be oriented in a right, left or straight configuration without degradation of performance.

(b) Electrical Requirement:

Operating voltage:

80 to 135 Volts AC with cutoff voltage (no visible indication) below 35Volts AC.

Power requirements:

Circular Indications: 12”, (300 mm) – no more than 16 Watts

Circular Indications: 8”, (200mm) - no more than 16 Watts

Arrows Indications: 12”, (300mm) - no more than 16 Watts

Power Supply:

Fused and filtered to provide excess current protection and over voltage protection from electrical surges and transient voltages.

(c) Photometric Requirement:

ITEM #1105001A, 1105003A,
1105101A, 1105103A,
1105180A, 1105203A, 1105303A

Beam Color:

Meet 2005/2007 ITE Specifications

(d) Mechanical Requirements:

Diameter:

The Circular Optical Unit shall fit into standard 12” (300mm) or 8” (200mm) housing.
The Arrow Optical Unit shall fit 12” (300mm) housings only.

Enclosure:

UV (Ultraviolet) stabilized polycarbonate back cover.
Clear lens cover for all Red, Yellow and Green Circular Optical Units.
For Arrow Optical Units the arrow indication segment of the lens shall be clear.
Enclosure sealed and waterproofed to eliminate dirt contamination and be suitable for installation in all weather conditions.

Clearly mark on the housing the following information:

- Manufacturer & model number
- Date of manufacture (must be within one year of installation)

The model number shall end with the number of LEDs used to comprise the unit as the last digits of the model number. Example, if the unit comprised of 3 LEDs and the model is x12y, then the new model number shall read x12y3.

Operating temperature:

Meet 2005/2007 ITE Specification

Wiring: L.E.D. lamps shall have **color coded 16 AWG wires** for identification of heads as follows:

RED L.E.D. Lamps	RED with WHITE neutral
YELLOW L.E.D. Lamps	YELLOW with WHITE neutral
GREEN L.E.D. Lamps	GREEN or Brown with WHITE neutral
RED L.E.D. ARROWS	RED/WHITE with WHITE neutral
YELLOW L.E.D. ARROWS	YELLOW/WHITE with WHITE neutral
GREEN L.E.D. ARROWS	GREEN/WHITE or BROWN/WHITE with WHITE neutral
GREEN/YELLOW L.E.D. ARROWS	GREEN/WHITE or BROWN/WHITE, YELLOW/WHITE, with WHITE neutral

Wires shall be terminated with a Block Spade, 6-8 stud/ 16-14 wire size.

All Circular Optical Units shall be supplied with a minimum 40” pigtail and all Arrow Optical Units Supplied with a minimum 60” pigtail.

Sub Article 9 - Painting:

Town of Westport Only

ITEM #1105001A, 1105003A,
1105101A, 1105103A,
1105180A, 1105203A, 1105303A

Third coat: Replace with the following:

The housing, housing door, the back surface of the backplate, and all brackets and hardware shall be painted black by the manufacturer. The color shall be No. 37038, Federal Standard No. 595.

The outside of the visors shall have a dull black finish that meets Federal Specification TT-E-527.

The inside of the visors per MUTCD shall have a dull black finish to minimize light reflection and to increase contrast between the signal indication and its background. The dull black finish shall meet Federal Specification TT-E-527.

Paint samples and proposed painting procedures shall be submitted to:

Peter A. Ratkiewich, P.E.
Westport Town Engineer
Town of Westport, CT
110 Myrtle Avenue
Westport, CT 06880
pratkiewich@westport.ct.gov
(203)341-1131

Town of Fairfield Only

Third coat: Replace with the following:

The housing, housing door, the back surface of the backplate, and all brackets and hardware shall be painted black by the manufacturer. The color shall be No. 37038, Federal Standard No. 595.

The outside of the visors shall have a dull black finish that meets Federal Specification TT-E-527.

The inside of the visors per MUTCD shall have a dull black finish to minimize light reflection and to increase contrast between the signal indication and its background. The dull black finish shall meet Federal Specification TT-E-527.

Paint samples and proposed painting procedures shall be submitted to:

William Hurley
Engineering manager
Town of Fairfield, CT
725 Old Post Rd
Fairfield, CT 06824
whurly@fairfieldct.org
TEL. (203) 256-3015

ITEM #1105001A, 1105003A,
1105101A, 1105103A,
1105180A, 1105203A, 1105303A

All Other Locations

Third coat:

Replace with the following:

The housing, housing door, the back surface of the backplate, and all brackets and hardware shall be painted black by the manufacturer. The color shall be No. 17038, Federal Standard No. 595.

The outside of the visors shall have a dull black finish that meets Federal Specification TT-E-527.

The inside of the visors per MUTCD shall have a dull black finish to minimize light reflection and to increase contrast between the signal indication and its background. The dull black finish shall meet Federal Specification TT-E-527.

ITEM #1106001A – 1 WAY PEDESTRIAN SIGNAL POLE MOUNTED

ITEM #1106003A – 1 WAY PEDESTRIAN SIGNAL PEDESTAL MOUNTED

ITEM #1106004A – 2 WAY PEDESTRIAN SIGNAL PEDESTAL MOUNTED

Section 11.06.02 Pedestrian Signal, Materials

Section M.16.07 C. Optical Unit

Delete 2. LED: and replace with the following:

General

- Meet requirements of current MUTCD Section 4E.
- Meet current ITE specifications for Pedestrian Traffic Control Signal Indications - (PTCSI) Part 2: Light Emitting Diode (LED).
- Meet CT DOT, 2008 - 2010 Functional Specifications for Traffic Control Equipment; Section 5D, LED Pedestrian Signal with Countdown Timer.
- Meet EPA Energy Star® requirements for LED Pedestrian Signal Modules.

Operational

- Countdown display only during the flashing Pedestrian Clearance (Ped Clr) Interval. Timer goes blank at end of flashing ped clr even if countdown has not reached zero.

Physical

- Sealed optical module to prevent entrance of moisture and dust.
- Self-contained optical module, including necessary power supplies.
- Designed to securely fit into standard housing without the use of special tools or modifications to the housing.
- Identification information on module: manufacturer's name, model number, serial number, and date code.

Optical

- Multiple LED sources; capable of partial loss of LED's without loss of symbol or countdown message.
- Two complete self contained optical systems. One to display the walking person symbol (walk) and the hand symbol (don't walk). One to display the countdown timer digits.
- Visual Image similar to incandescent display; smooth, non-pixelated.
- Symbol and countdown digit size as shown on the plan.
- Solid hand/person symbol; outline display not allowed.
- Overlaid hand/person symbols and countdown digits arranged side by side.
- Countdown digit display color: Portland Orange in accordance with ITE requirements.
- Countdown digits comprised of two seven segments, each in a figure 8 pattern.
- Photometric Requirements: Luminance, Uniformity, and Distribution in accordance with ITE requirements.

- Color Uniformity in accordance with ITE requirements.
- Blank-Out design; symbols and digits illegible even in direct sunlight when not illuminated.

Electrical

- Operating voltage: 89 VAC to 135 VAC.
- Low Voltage Turn-Off: 35 VAC.
- Turn-On and Turn-Off times in accordance with ITE specifications.
- Combined Hand – Countdown Digits wattage: ≥ 20 Watts.
- Input impedance at 60 Hertz sufficient to satisfy Malfunction Management Unit (MMU) requirements.
- Two separate power supplies. One to power the walking person symbol. One to power the hand symbol and the countdown digits.
- Meet Federal Communication Commission (FCC) regulations concerning electronic noise.
- Filtered and protected against electrical transients and surges.

Warranty

- Five years from date ownership is accepted.

Section M.16.07 F. Painting:

Remove the 2nd and 3rd sentences referring to the color.

Town of Westport Only Int. No. 158-213

Third coat: Replace with the following:

The housing, housing door, and all brackets and hardware shall be painted black by the manufacturer. The color shall be No. 37038, Federal Standard No. 595.

The inside and outside of the visor shall have a dull black finish to minimize light reflection and to increase contrast between the signal indication and its background. The dull black finish shall meet Federal Specification TT-E-527.

Paint samples and proposed painting procedures shall be submitted to:

Peter A. Ratkiewich, P.E.
Westport Town Engineer
Town of Westport, CT
110 Myrtle Avenue
Westport, CT 06880
pratkiewich@westport.ct.gov
(203)341-1131

Town of Fairfield Only Int. No. 050-201 & Int. No. 050-207

Third coat: Replace with the following:

The housing, housing door, and all brackets and hardware shall be painted black by the manufacturer. The color shall be No. 37038, Federal Standard No. 595.

The inside and outside of the visor shall have a dull black finish to minimize light reflection and to increase contrast between the signal indication and its background. The dull black finish shall meet Federal Specification TT-E-527.

Paint samples and proposed painting procedures shall be submitted to:

William Hurley
Engineering Manager
Town of Fairfield, CT
725 Old Post Rd,
Fairfield, CT 06824
whurley@fairfieldct.org
(203)256-3015

All Other Locations

Third coat: Replace with the following:

The housing, housing door, and all brackets and hardware shall be painted black by the manufacturer. The color shall be No. 17038, Federal Standard No. 595.

The inside and outside of the visor shall have a dull black finish to minimize light reflection and to increase contrast between the signal indication and its background. The dull black finish shall meet Federal Specification TT-E-527.

ITEM #1107011A – ACCESSIBLE PEDESTRIAN SIGNAL AND DETECTOR (TYPE A)

Description:

Furnish and install an Accessible Pedestrian Signal and Detector (APS&D). The APS&D provides audio and tactile information to augment the visual pedestrian signal.

Type A provides a low frequency percussive tone or a speech message during the walk interval and is used where there is an exclusive or a concurrent pedestrian phase.

Material:

A. General:

- Conform to applicable sections of the current MUTCD Chapter 4E, Pedestrian Control Features as specified herein.
- All features fully operational when the traffic signal is in colors mode.
- All features non-operational when the traffic signal is in flash mode.
- Interchangeable with a non-accessible type pedestrian pushbutton with no modifications to the Controller Assembly (CA) or Controller Unit.
- Audible transducer integral with the APS&D housing, adjacent to the pushbutton.
- Operation programming method: Either or combination of:
 - Mechanically by dip switches or circuit board jumpers
 - Infrared remote-control hand-held device

B. Electrical:

- Metallic components either grounded or insulated to preclude an electrical hazard to pedestrians under all weather conditions.
- All features powered by the 110VAC Walk signal and the 110VAC Don't Walk signal so that additional conductors from the CA are not needed.

C. Audible Pushbutton Locator Tone

- Frequency: repeating tone at one (1) second intervals
- Tone duration: ≤ 0.15 seconds
- Volume:
 - Minimum setting of zero
 - Manually adjustable initial setting
 - Automatically adjusted after initial setting. Volume increased in response to a temporary increase in ambient noise and subsequently decreased with a decrease in ambient noise.
 - Maximum volume: 100 dBA which is the approximate sound pressure of a gasoline powered lawn mower nearby.
 - Automatic volume adjustment independent of other APS&Ds at the intersection.
 - May be disabled without affecting operation of other features.
- Silent only during walk interval. Active all other times.

D. Vibrotactile Arrow Pushbutton

- Pushbutton contained in a circular assembly which fits inside the housing and is attached to the housing with 4 screws.
- Actuation of pushbutton acknowledged by confirmation light.
- Actuation of pushbutton initiates speech message "Wait".

- ADA compliant: Size: $\geq 2.0''$ (50) diameter, Actuation force: ≤ 5 ft-lb (22.2 N)
- Shape: Circular, raised slightly above housing so that it may be actuated with the back of a hand
- Tamper-proof, vandal-proof, weatherproof, freeze-proof, impact-resistant design and construction.
- Operation: Vibrates only during the walk interval (when the walk indication is displayed).
- Tactile Arrow:
 - Attached to surface of the button assembly by a tamperproof method.
 - Raised slightly above surface of pushbutton, minimum $0.125''$ (0.3)
 - Size: Length $\geq 1.5''$ (38), Height $\geq 1.0''$ (25)
 - Color: Sharp contrast to background color of pushbutton and housing

E. Audible Walk Interval

1. General:

- Operation independent of other APS&Ds at intersection.
- Active only during the walk interval (when the walk indication is displayed).
- Volume:
 - Minimum setting of zero
 - Manually adjustable initial setting
 - Automatically adjusted after initial setting. Volume increased in response to a temporary increase in ambient noise and subsequently decreased with a decrease in ambient noise.
 - Automatic volume adjustment independent of other APS&Ds at the intersection.
 - Maximum volume: 100 dBA which is the approximate sound pressure of a gasoline powered lawn mower nearby.
- Duration:
 - Default method: Automatically set by the duration of the visual walk signal display.
 - When selected: Manually set when rest-in-walk is used for a concurrent pedestrian movement.
- Audible sounds that mimic any bird call are not allowed.

2. Percussive Tone where called for on the signal plan:

- Repeating tone at eight (8) to ten (10) ticks per second.
- Tone frequency: Multiple frequencies with a dominant component at 880 Hz which creates a "tick - tick - tick..." sound.

3. Speech Message where called for on the signal plan:

- Clearly enunciate the name of the travel way to be crossed and the message that the walk signal is on for that crossing.. See signal plan for specific message.

F. Pushbutton Housing/Sign Frame/Sign

Town of Westport Only Int. No. 158-213

- One piece die cast aluminum meeting requirements of ASTM B85.
- Sign frame designed to accept 9" x 15" (230 x 380) four-hole advisory sign.
- Flat back to facilitate surface mount.
- Available brackets to either pedestal top-mount or pole side-mount on pole diameter range of $3\frac{1}{2}''$ (89) to 15" (380).
- Available brackets to allow mounting two (2) APS&Ds to the same $3\frac{1}{2}''$ (89) pole, facing ≥ 60 degrees apart, at the same height.
- Available extension bracket of a size indicated on the plan – 18" maximum.

- Wire entrance through the rear.
- Stainless steel mounting hardware.
- Color: The color shall be black No. 37038, Federal Standard No. 595.
- Finish: Housing/Frame and all mounting brackets either:
 1. Painted with 3 coats of infrared oven-baked paint before assembly.
 - Primer: Baked iron oxide which meets or exceeds FS TT-P-636.
 - Second coat: Exterior-baking enamel, light gray, which meets or exceeds FS TT-E-527.
 - Third coat: Exterior-baking enamel, which meets or exceeds FS TT-E-489.
 2. Electrostatic powder coated after chemically cleaned.
- Sign: CT DOT Sign No. 31-0856

Paint samples and proposed painting procedures shall be submitted to:

Peter A. Ratkiewich, P.E.
Westport Town Engineer
Town of Westport, CT
110 Myrtle Avenue
Westport, CT 06880
pratkiewich@westport.ct.gov
(203)341-1131

Town of Fairfield Only Int. No. 050-201 & Int. No. 050-207

- One piece die cast aluminum meeting requirements of ASTM B85.
- Sign frame designed to accept 9" x 15" (230 x 380) four-hole advisory sign.
- Flat back to facilitate surface mount.
- Available brackets to either pedestal top-mount or pole side-mount on pole diameter range of 3½" (89) to 15" (380).
- Available brackets to allow mounting two (2) APS&Ds to the same 3½" (89) pole, facing ≥ 60 degrees apart, at the same height.
- Available extension bracket of a size indicated on the plan – 18" maximum.
- Wire entrance through the rear.
- Stainless steel mounting hardware.
- Color: The color shall be black No. 37038, Federal Standard No. 595.
- Finish: Housing/Frame and all mounting brackets either:
 1. Painted with 3 coats of infrared oven-baked paint before assembly.
 - Primer: Baked iron oxide which meets or exceeds FS TT-P-636.
 - Second coat: Exterior-baking enamel, light gray, which meets or exceeds FS TT-E-527.
 - Third coat: Exterior-baking enamel, which meets or exceeds FS TT-E-489.
 3. Electrostatic powder coated after chemically cleaned.
- Sign: CT DOT Sign No. 31-0856

Paint samples and proposed painting procedures shall be submitted to:

William Hurley
Engineering Manager
Town of Fairfield, CT
725 Old Post Rd,
Fairfield, CT 06824
whurley@fairfieldct.org
(203)256-3015

All Other Locations

- One piece die cast aluminum meeting requirements of ASTM B85.
- Sign frame designed to accept 9" x 15" (230 x 380) four-hole advisory sign.
- Flat back to facilitate surface mount.
- Available brackets to either pedestal top-mount or pole side-mount on pole diameter range of 3½" (89) to 15" (380).
- Available brackets to allow mounting two (2) APS&Ds to the same 3½" (89) pole, facing ≥ 60 degrees apart, at the same height.
- Available extension bracket of a size indicated on the plan – 18" maximum.
- Wire entrance through the rear.
- Stainless steel mounting hardware.
- Color: The color shall be black No. 17038, Federal Standard No. 595. At intersections at Merritt Parkway interchanges, all brackets and hardware shall be painted dark green by the manufacturer. The color shall be No. 14056, Federal Standard No. 595.
- Finish: Housing/Frame and all mounting brackets either:
 1. Painted with 3 coats of infrared oven-baked paint before assembly.
 - Primer: Baked iron oxide which meets or exceeds FS TT-P-636.
 - Second coat: Exterior-baking enamel, light gray, which meets or exceeds FS TT-E-527.
 - Third coat: Exterior-baking enamel, which meets or exceeds FS TT-E-489.
 2. Electrostatic powder coated after chemically cleaned.
- Sign: CT DOT Sign No. 31-0856

Construction Methods:

Install the APS&D according to the manufacturer's instructions. Position the APS&D so the plane of the sign face is parallel to the crossing (sign is facing perpendicular) and the arrow is pointing in the same direction as the crossing, not necessarily at the ramp. Notify the Engineer if there is any discrepancy or ambiguity between the plans and field conditions that prevent placement of the APS&D as shown on the plan. Set the minimum sound levels of the locator tone and the audible walk indication when there is little or no ambient noise as in night time operation. Set the volume of audible walk indications and pushbutton locator tones to a maximum of 5dBA louder than ambient sound. The locator tone should be audible 6' to 12' (1.8 m to 3.6 m) from the pushbutton or to the building line, whichever is less. Confirm the volume of both audible walk indication and the locator tone increases with an increase in ambient sound and subsequently decreases when the ambient noise decreases.

If programming method is remote, by an infrared hand-held device, provide one device and operation manual for each intersection where APS&D is installed.

Method of Measurement:

This work is measured by the number of APS&Ds of the type specified, installed, tested, fully operational, and accepted.

Basis of Payment:

Payment for this work is based on the installation, inspection, successful completion of the 30 day test period, and final acceptance of the Accessible Pedestrian Signal and Detector of the type specified. Payment includes the sign, mounting brackets for adjacent buttons on the same structure, extension brackets, all necessary cable, all incidental materials, labor, tools, and equipment necessary to complete the installation. Payment also includes the warrantee, installation manual, and operation manual.

If programming method is remote by an infrared hand-held device, the total bid price of all APS&Ds includes one remote programming device and accompanying operation manual for each intersection where APS&D is installed.

Pay Item	Pay Unit
Accessible Pedestrian Signal and Detector (Type A)	Each

ITEM #1108115A – FULL ACTUATED CONTROLLER 8 PHASE

Madison Intersection # 075-220 – U.S. Rte. 1 (Boston Post Rd.) at Samson Rock Road and Wall Street. Controller Cabinet at Site No. 4 (Intersection 075-220) shall be black No. 37038, Federal Standard No. 595.

Article 11.08.01 - Description: Delete the second paragraph and replace with the following:

This item shall consist of furnishing and installing an actuated controller, which shall be a completely digital solid state unit, for controlling the operation of the traffic signals.

The controller shall be completely furnished with the number of phases called for in the item. The cabinet to house the controller shall be completely wired and all sub-bases shall be complete with load switches and flash relays as specified in the **Functional Specifications For Traffic Control Equipment**. The cabinet shall also have all necessary auxiliary equipment required to provide the sequence and timing indicated on the plans. A time switch shall be installed in each cabinet.

Article 11.08.03 – Construction Methods: Delete the entire second paragraph.

Article M.16.09 - Controllers: Add the following sub-articles:

2. Actuated Controllers: The purpose of this sub-article is to set forth minimum design and operating requirements for the materials and components for a digitally timed actuated controller.

Ventilation:

For cabinets that will be painted other than Department-approved gray, the cabinet ventilation shall include two intakes, exhausts, filtrations, two fans, and one thermostat assembly. Each electric fan shall be equipped with ball or roller bearings and with a capacity of at least 100 cfm. The fans shall be mounted inside the front top of the cabinet ventilation holes. The fans shall be controlled by one manually adjustable thermostat.

The Connecticut Department of Transportation Functional Specifications for Traffic Control Equipment, current edition governs the material for the Controller Assembly. The Functional Specifications are advertised biennial for vendors to provide equipment to the State on a low bid basis. All underlined text indicates an addition or revision to these specifications from the previous version. The Functional Specifications are available on the Departments website.

The following sections of the **Notice to Bidders**, pages 1 - 10, shall apply to contract supplied traffic controllers: 12, 15, 16, 17, 18, & 19.

Item 1108115A – FULL ACTUATED CONTROLLER 8 PHASE shall conform to the requirements of Section 1, pages 11 – 94. The Controller Unit (CU) shall conform to the requirements of Item 1D1, CONTROLLER (PRE-EMPTION TYPE), pages 29 – 31. All cabinets shall conform to the specifications of the “D” CABINET REQUIREMENTS, pages 78 – 84.

Controllers in a closed loop system shall conform to the requirements of Section 27, INTERNAL CLOSED LOOP SYSTEM FOR EXISTING NAZTEC SYSTEM, pages 162 – 185, in addition to the above requirements.

The solid state time switch shall conform to Section 13. FOUR CIRCUIT SOLID STATE TIME CLOCK WITH TIME BASE COORDINATION OPTION TC/TBC, pages 140 - 143.

Traffic signal equipment which has not been previously approved to meet the requirements of the Functional Specifications for the above items, will not be approved for use on this contract.

Several parts of Item 1 of the Functional Specifications do not apply to contract supplied and developer supplied traffic controllers. The specifications which are to be disregarded are listed below.

- Item 1A-1 - Controller, Two Phase Microprocessor Keyboard Entry
 - Type 6 Conflict Monitor
- Item 1A-2 - Two Phase Type "A" Cabinet

Supplemental specifications listed below, have been added for material and controller operations which the Department of Transportation does not include in the Functional Specifications for Traffic Control Equipment.

- U.C.F. Time Switch Flash Command Procedure
- Time Clock/Time Base Installation Requirements
- 24 Volt Relay Type A
- 110 Volt Relay Type F
- Type G
- Time Delay Relay
- Non-Actuated Advance Green Phase
- Actuated Advance Green Phase
- Non-Actuated Clearance / Lag Green Phase
- Actuated Clearance / Lag Green Phase
- Flashing Stop Ahead Sign
- Max II Actuation By Pedestrian Call

UNIFORM CODE FLASH COMMAND PROCEDURE

1. Activate the **MINIMUM RECALL** input to the controller to ensure cycling prior to transferring to flashing operation.
2. Omit all non-actuated and actuated artery advance phases.
3. Omit phases 1 & 5 of all quad sequences.
4. Activate the **STOP TIME** input to the controller, upon entering flash, to prevent cycling.
5. Transfer to flash at the end of the last side street all red condition (at the point the artery **ON** output becomes active).
6. Special technical notes on the intersection plan supercede the above requirements.

TC/TBC INSTALLATION REQUIREMENTS

The following requirements are to be observed when engineering the installation of TC/TBC:

1.
 - a. Circuit 1 shall be designated FLASH and be reserved for night flash command.
 - b. Circuit 2 shall be designated MAX 2 and be reserved for Max 2 command.
 - c. Circuit 3 shall be designated COORD and shall select coordinated operation of the intersection.
 - d. Circuit 4 shall be the yield, and force off command to the controller.
2. All clock outputs shall be active to select the function specified. For example; If the TC/TBC were removed for repair, no inputs would be applied to the controller. The intersection will then operate non-coordinated, in Max 1. Programming the TC/TBC without cycle and offset is not an acceptable method to create a non-coordinated operation. Refer to the typical hookup diagram.
3. All TC/TBC clock installations shall be wired as detailed in figure 1. This method is used for both full and semi actuated operation.
4. Midnight resync shall occur at 12:00 AM.
5. A program card shall be completed indicating all input steps and settings. Four copies shall be provided. One copy left in the cabinet. Three delivered to the engineer along with the cabinet wiring diagrams.

TIME CLOCK / TIME BASE COORDINATION

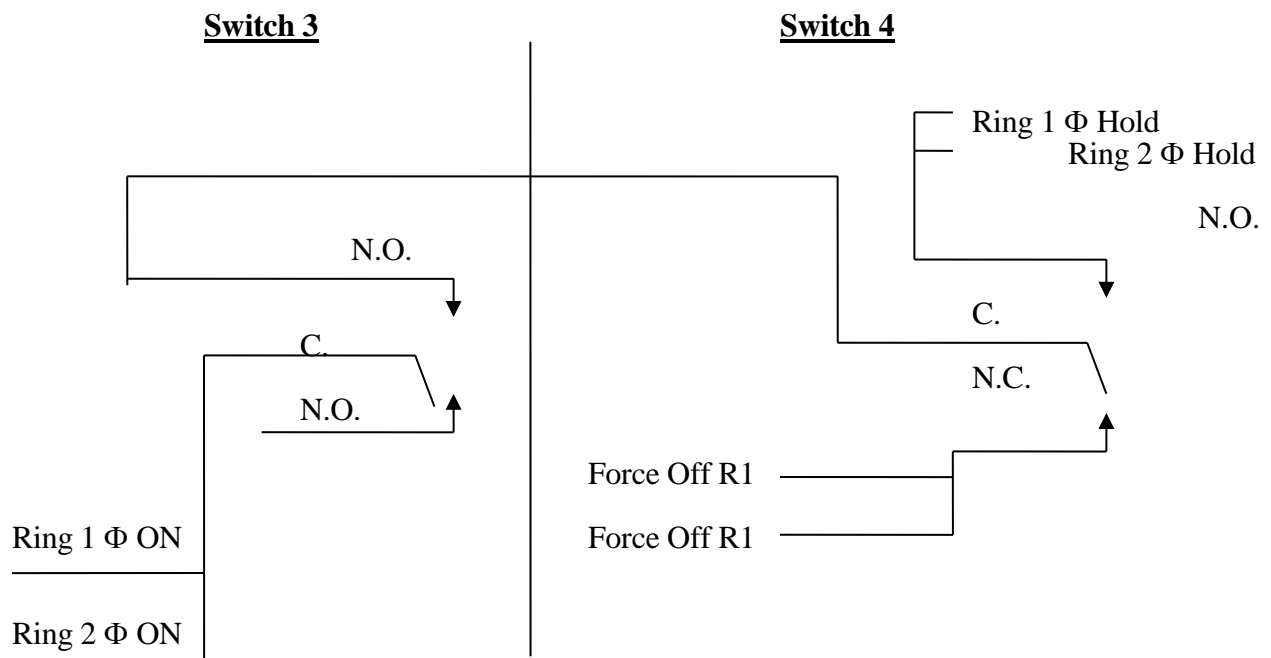


FIG. 1

24 VOLT RELAY

All 24 Volt relays shall meet the requirements of one of the following two types. Diodes shall be installed across the coils of all direct current relays to shunt the reverse voltage generated when the coil de-energizes. All diodes shall be general purpose ECG 125 1000prv @ 25A or equivalent, rated at least .5 amp forward biased. Diodes shall be external to the relay, not enclosed in the dust cover.

TYPE A: Midland Ross, Midtex 155-92 or equivalent.

DESCRIPTION:

This relay shall be enclosed in a clear polycarbonate removable dust cover. It shall have a mechanical life of more than 100,000 operations at rated load.

CONTACTS:


The contacts shall be 2 form C (D.P.D.T), U.L. rated at 5 amps 120 volts A.C. The contacts shall be pure fine silver (gold flash). There shall be no tungsten (lamp) load on the contacts of this relay.

COIL: The coil shall operate on 24 V.D.C. and have no less than 450 OHMS impedance.

SIZE: The relay shall be no larger than 65mm(2.5") H x 40mm(1.5") L x 40mm(1.5") W.

BASE: This relay shall have an eight pin octal plug-in base with the pin designation shown below:

1. Common (1)
2. Coil
3. Normally open (1)
4. Normally closed (1)
5. N.C. (2)
6. N.O. (2)
7. Coil (2)
8. Comm.

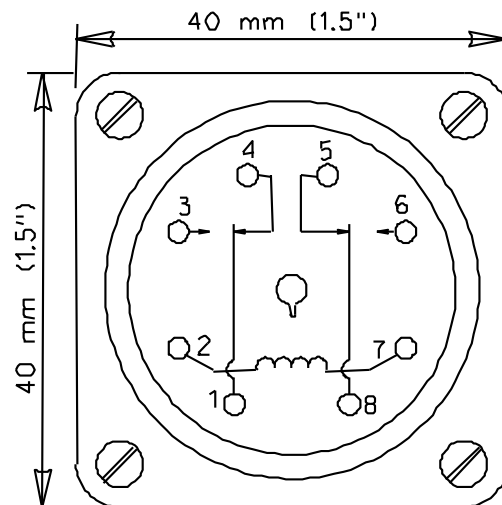

Bottom View And Wiring Diagram

SOCKET: The socket shall be a closed back, screw terminal type. The front mounted screws shall be 6-32 capable of accepting #14 AWG wire.

110 VOLT RELAY

All 110 volt relays shall meet the requirements of one of the following two types. Across the coil of each relay there shall be a molded suppressor rated at .1uf - 47 ohm @ 600V to suppress electrical noise created by the energization / de-energization of the relay.

TYPE F: Midland Ross, Midtex 136-62T3A1 or equivalent

DESCRIPTION:

Relays of this type shall function as flash transfer, power switching and signal drive. Other uses are acceptable, however, type G relays cannot be used for the above applications.

CONTACTS:

The contacts shall be in the D.P.D.T. form and consist of 10mm(3/8") diameter silver cadmium oxide, rated at 20 Amps @ 117 VAC resistive.

COIL:

The coil shall operate on 110 VAC. No semi-conductors will be allowed in the coil circuit of this relay.


SIZE:

The relay shall be enclosed in a clear plastic dust cover. The overall dimensions shall be no larger than 63mm(2 1/2") x 94mm(3 3/4") x 47mm(1 7/8") as illustrated below.

BASE:

This relay shall have an eight blade plug-in base, Ventron Beau Plug P-5408 or equivalent with the pin designations as shown below:

1. Coil
2. Coil
3. N.C. 1
4. N.C. 2
5. Comm. 1
6. Comm. 2
7. N.O. 1
8. N.O. 2

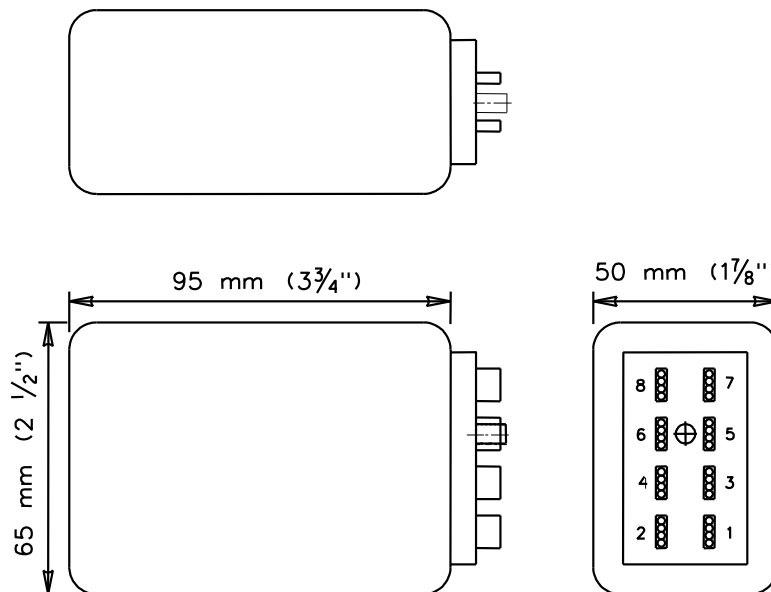

SOCKET:

The socket shall be Ventron Beau Plug S-5408 or equivalent, contacts rated at 15 Amps @ 1750 VRMS.

TYPE G: Magnecraft, W 88 ACXP-8 or equivalent

DESCRIPTION:

Relays of this type shall function in low current switching applications such as interconnect interface or pre-emption circuits. A clear polycarbonate plastic enclosure shall cover the relay mechanism.

CONTACTS:

The contacts shall be in the D.P.D.T. form and consist of 5mm (3/16") diameter gold flashed, silver alloy, rated at 10 Amps @ 120 VAC resistive.

COIL:

The coil shall operate on 120 Volts AC and require a nominal 3 VA.

SIZE:

Height, length and width dimensions shall be the same as the 24 volt relay Type A: 35mm (1 3/8") x 60mm (2 3/8") x 35mm (1 3/8").

BASE:

The base shall be an octal plug with the pin designations the same as the 24 volt relay Type A.

SOCKET:


The socket shall be the same as that for the 24 volt relay Type A.

TIME DELAY RELAY

120 VAC SSAC TDM120A or equivalent
24 VDC SSAC TDM24DL or equivalent


DESCRIPTION:

The time delay relays shall be self enclosed, plug-in, delay on operate type. They shall be digitally timed and adjustable by the use of dip switches located on the top of the case. The timing range shall be 1 to 1023 seconds in 1 second intervals. The time delay relays shall have an internal double pole double throw relay with form "C" contacts rated at 10 amps 120 volts AC. They shall operate accurately in a temperature range of -20 to +65 degrees C. A 120 volt AC input shall initiate timing of the 120 VAC TDR and a 24 VDC input shall initiate timing of the 24 VDC TDR. Removal of the input voltage shall reset the timer. Maximum dimensions of the case shall be as shown below.

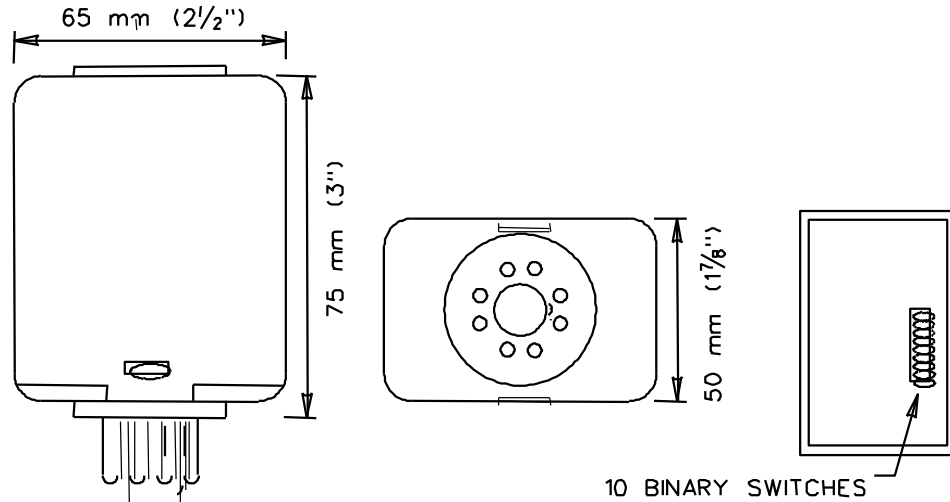

SOCKET:

The socket shall be a standard octal base (8 pin) with screw terminal connectors. The pin designation shall be as shown below.

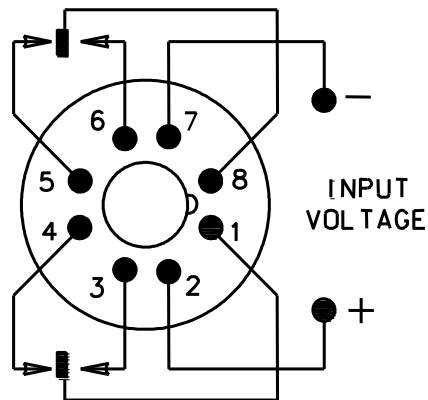


NON-ACTUATED ADVANCE GREEN PHASE

OCTAL (8 PIN) BASE

Where the timing and sequence indicates an advance green phase that always precedes the phase in recall (usually phase 2), and that either is fixed timed or is to be extended only, the following guidelines shall be in effect:

1. The parent phase ON output shall be diode connected to the advance phase OMIT input.
2. If the advance phase is to be extendable, it shall be in minimum recall. If the advance phase is fixed timed, it shall be in maximum recall. A different advance time may be selected by switching to maximum 2.


Example: Phase 1 is the advance phase (extendable), in minimum recall.
Phase 2 is the artery, in recall.
Phase 4 is the minor street, in non-lock.



Where the timing and sequence indicates an advance phase that is fixed timed (not extendable), and that always precedes either a phase other than phase 2 or a phase not in recall, the following guidelines shall be in effect:

1. The recall phase (usually Phase 2) ON output shall be diode connected to the advance phase's, parent phase OMIT input.
2. The parent phase CHECK output shall be diode connected to the advance phase vehicle detector input.
3. The advance phase ON output shall be diode connected to the following parent phase vehicle detector input. This is to insure a green indication on the parent phase.
4. The advance phase shall be in the non-lock mode. The advance time shall be selected from the maximum interval.

Example: Phase 2 is the artery, in recall.
Phase 3 is the advance for phase 4, in non-lock mode.
Phase 4 (parent phase) is the minor street, in non-lock mode.

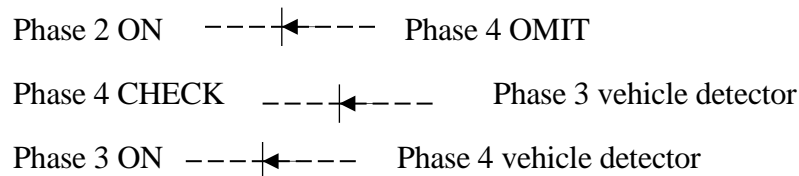


ACTUATED ADVANCE GREEN

Where the timing and sequence indicates an advance green phase that is to be extended only, and is to always precede either a phase other than phase 2 or a phase not in recall, the following guidelines shall be in effect:

1. The phase ON outputs of all phases that could precede the advance phase, shall be diode connected to the parent phase OMIT input.
2. The parent phase CHECK output shall be diode connected, through the normally closed contacts of a relay, to the advance phase vehicle detector input. The advance phase loop detector output shall be connected to the normally open contacts.
3. The relay coil shall be energized by the advance phase ON output, which in turn will switch the vehicle detector input from the parent phase CHECK circuit to the loop detector.
4. The advance phase ON output shall be diode connected to the following parent phase vehicle detector input. This is to insure a green indication from the parent phase.
5. The advance phase shall be in the non-lock mode.

Example: Phase 2 is the artery, in recall.
Phase 3 is the pedestrian phase.
Phase 4 is the advance for phase 5, in non-lock.
Phase 5 (parent phase) is the minor street, in non-lock.

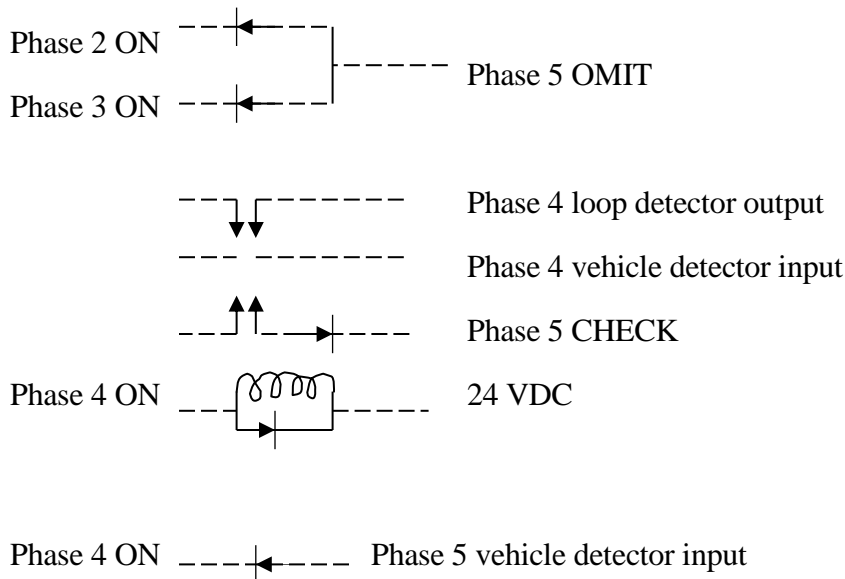

The 24 volt relay shall be Type C as previously described in these specifications.


NON-ACTUATED CLEARANCE PHASE

NON-ACTUATED LAG GREEN PHASE

Where the timing and sequence indicates a non-actuated clearance phase or a lagging green phase that always follows the phase in recall, the following guidelines shall be in effect:

1. The parent phase ON output shall be diode connected to all appropriate phase OMIT inputs except the clearance phase.
2. The remaining actuated phases shall have their CHECK outputs diode connected to the clearance phase vehicle detector input.
3. The clearance phase ON output shall be diode connected to the following phases vehicle detector input (if the phase is in non-lock mode). This will prevent the controller from returning to the parent phase from the clearance phase without servicing the minor street.
4. The clearance phase shall be in the non-lock mode.
5. The clearance, or lag green time shall be selected from the maximum interval.

Example: Phase 2 is the artery, in recall.
Phase 3 is the clearance phase, in non-lock.
Phase 4 is the pedestrian phase.
Phase 5 is the minor street, in non-lock.

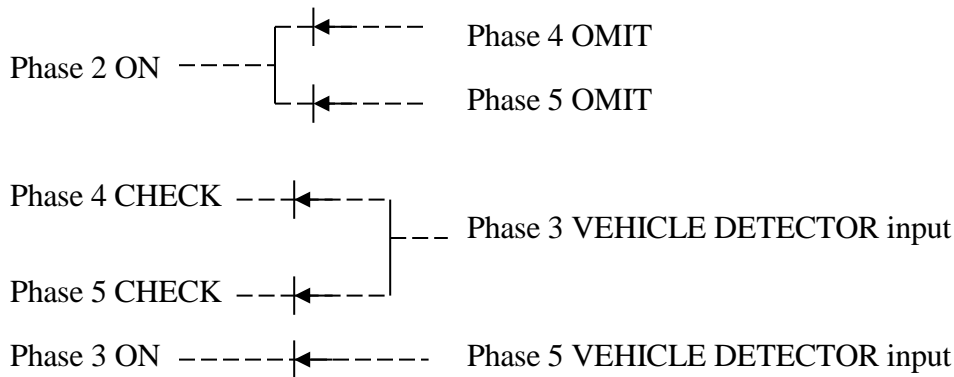

Where the timing and sequence shows a non-actuated clearance phase or lagging green phase following either a phase other than phase 2 or a phase not in recall, the following guidelines shall be in effect:

1. The parent phase ON output shall be diode connected to the following clearance phase vehicle detector input. This insures the clearance phase will always follow the parent phase.
2. The clearance phase shall be in the non-lock mode.
3. The clearance, or lag green time shall be selected from the minimum green interval.




ACTUATED CLEARANCE PHASE

ACTUATED LAG GREEN PHASE

Where the timing and sequence indicates an actuated lagging green phase that is to be extended only, and always follows another phase, the following guidelines shall be in effect:

1. The parent phase (usually phase 2) ON output shall be diode connected to the phase OMIT inputs of all phases that could follow the lag phase.
2. The CHECK outputs of all phases that could follow the lag phase shall be diode connected, through the normally closed contacts of a relay, to the lag phase vehicle detector input. The lag phase loop detector output shall be connected to the normally open contacts.
3. The relay coil shall be energized by the lag phase ON output which in turn will switch the phase detector input from the CHECK circuits to the loop detector.
4. The lag phase shall be in the non-lock mode.

Example: Phase 2 (parent phase) is the artery, in recall.
Phase 3 is the lag phase, in non-lock.
Phase 4 is the pedestrian phase.
Phase 5 is the minor street, in non-lock.

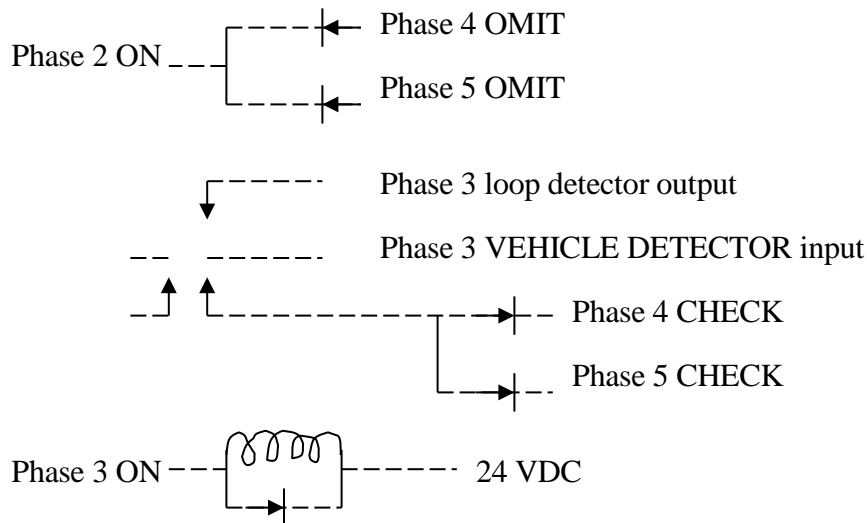


The 24 VDC relay shall be Type C as previously described in these specifications.

FLASHING STOP AHEAD SIGN


Where the timing and sequence indicates a flashing stop ahead sign, the clearance interval following the phase that the sign is off shall be timed by the following method.

The following phase shall be used for the clearance time. These phases shall be overlapped. The green indication will be maintained by the overlap feature and the following phase green time will be the stop ahead sign clearance.


The artery phase ON output shall be diode connected to all other phase OMIT inputs except the clearance phase and the artery phase. The CHECK outputs from the remaining phases (as needed) shall be diode connected to the sign clearance phase vehicle detector input. The clearance phase shall be in the non-lock mode.

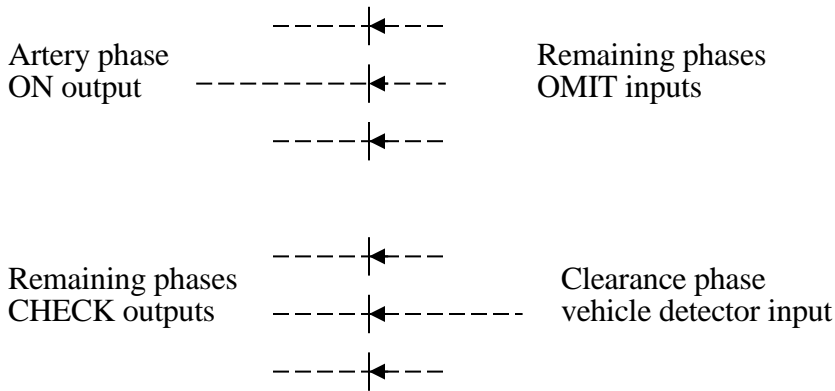

If the non-artery phases are in the non-lock mode, a call must be forced to the non-artery phase once the controller leaves the artery Hold interval (either artery walk or artery green). This prevents a false "Stop Ahead" indication if a vehicle turns right on red during the flashing sign clearance interval.



Unless otherwise shown on the plans, the 110 VAC flash power shall be from a spare load switch in the controller cabinet. The load switch input shall be driven with the flashing logic output from the controller. The flashing logic output shall be disconnected from the load switch during the intervals the sign is inactive.

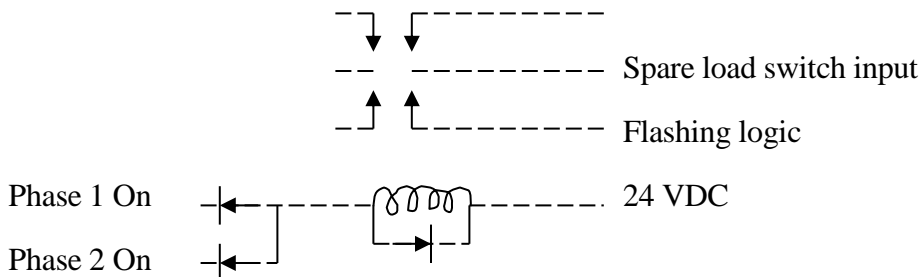

Typical drive circuit for "WHEN FLASHING STOP AHEAD" sign

TIME BASE COORDINATION MAX II ACTUATION BY PEDESTRIAN CALL


When the sum of the split times, including the walk and don't walk, exceed the background cycle length, the designer may choose to either allow a double cycle of the background timer or reduce the phase timings when the ped phase is called. Reduction of the phase timing by switching to MAX 2 avoids double cycling.

Where indicated on the plans the exclusive pedestrian phase will call MAX II. The minor movement max 2 times are set low so that the total phase times do not exceed the coordination cycle length.

Install a 24 volt relay connected to the inputs and outputs as shown on the following schematic.

Operation: When the controller advances to the exclusive pedestrian phase, the relay is actuated and latched. MAX II timing is selected for one complete cycle, until the relay is unlatched by the artery yellow (absence of red or green).

Example: Phase 2 is the artery. Phase 3 is the exclusive pedestrian phase.

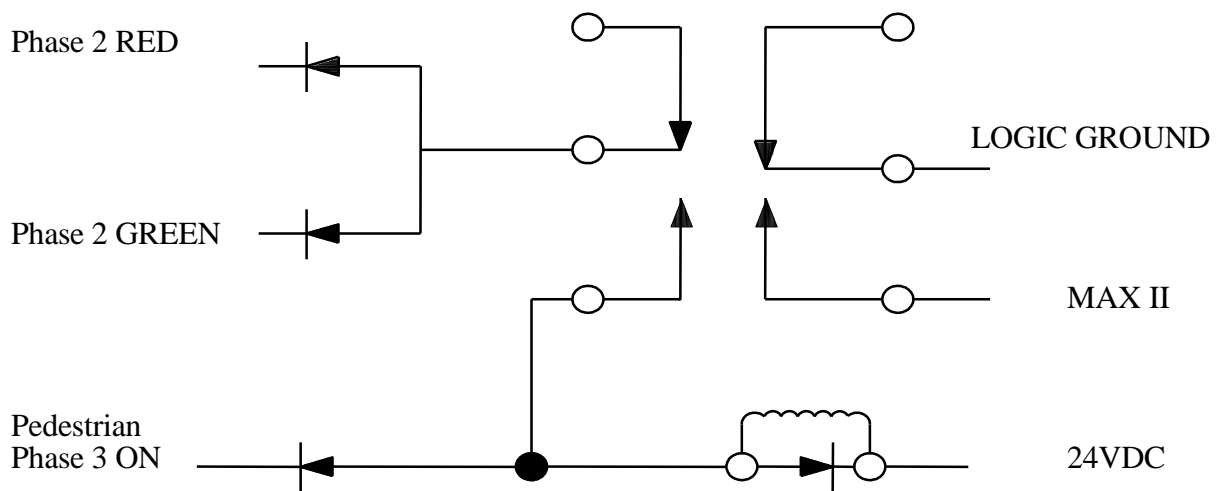

ITEM #1108163A – MODIFY EXISTING CONTROLLER

This item shall consist of modifying the existing traffic controller assembly to provide the revised operation as shown on the plans or as directed by the Engineer. The modification shall include, but not be limited to, revisions to the timing and sequence, cabinet wiring, coordination, pre-emption, field wiring and cabinet wiring diagrams.

MATERIAL

The material for this work shall conform to the requirements of the current edition of the Connecticut Department of Transportation Functional Specifications for Traffic Control Equipment. The material shall be compatible with the existing equipment. Any material in question shall be approved prior to installation by the Engineer or the Department of Transportation Signal Lab, 280 West Street, Rocky Hill. Contact Mr. Don Assard at (860) 258-0346 or Mr. Mark Zampini at (860) 258-0349 for approval.

CONSTRUCTION METHODS

All revisions to the cabinet wiring shall be neat and orderly. All additional wiring shall be from terminal to terminal. Splices will not be allowed. All changes, additions and deletions shall be documented, dated and drawn on the reproducible original or a reproducible copy of the original cabinet wiring diagram. Four paper copies shall be furnished to the Engineer upon completion of the revision.

METHOD OF MEASUREMENT

This item will be measured for payment as an "Each" item.

BASIS OF PAYMENT

This item will be paid for at the contract price each, for "Modify Existing Controller" which price shall include all necessary load switches, relays, components, hardware, tools, equipment, engineering and labor required to modify the existing controller as shown on the plan. This price shall also include four updated cabinet wiring diagrams.

<u>Pay Item</u>	<u>Pay Unit</u>
Modify Existing Controller	Ea.

ITEM #1108207A – INSTALL STATE FURNISHED TRAFFIC CONTROLLER AND CABINET

Description:

This item shall consist of installing a traffic controller cabinet, and related equipment, furnished by the State, Department of Transportation, on an existing, modified, or new foundation as indicated on the plans or as directed by the Engineer.

Material:

All material for this work shall be furnished by the State except for miscellaneous electrical hardware, such as spade connectors, electrical tape, and cable ties required to complete the installation.

Construction Methods:

The Contractor shall arrange a schedule to pick up the traffic controller, cabinet, and related material from the Department of Transportation, Signal Lab, located at 280 West Street in Rocky Hill. Contact Mr. Don Assard at (860) 258-0346 or Mr. Mark Zampini at (860) 258-0349, 45 days in advance to schedule pick up of the material. In addition, the Contractor shall telephone 24 hours prior to the scheduled date to confirm the location and time of pick up.

The Contractor shall sign a receipt, listing all material furnished by the State, for each location. All material provided by the State shall be transported, and stored if necessary, with care appropriate for microprocessor electronic equipment. It shall be the Contractor's responsibility from the time of pick up until the new controller is in operation according to plan, to repair or replace any material damaged during delivery or during installation.

The Contractor shall develop a schedule of the dates of the installation of each State furnished controller. The Contractor shall keep the Engineer advised of the schedule and any subsequent changes. The Engineer shall notify the D.O.T., District Electrical Maintenance Office and the D.O.T. Signal Lab of the schedule and all changes to the schedule.

It shall be the responsibility of the Contractor to determine the function of existing traffic signal, pedestrian signal and detector cables, which will be reused, so that correct connection to the new controller may be completed.

The cabinet shall be installed on the foundation in accordance with the plans or as directed by the Engineer. Prior to connection of the field wires to the new controller cabinet, the Contractor shall perform the following tests:

1. Flash out all traffic and pedestrian signal field wires. This shall consist of momentarily connecting each to a 110 VAC fused source. This will ensure the signals are connected to the correct wires and there are no shorts in the field wiring.

2. Voltage test all input circuits. This shall consist of measuring all other field wires, such as vehicle detector, pedestrian pushbutton and pre-emption cables with a volt meter to ensure there is no voltage present which will damage the electronic devices.

Only then will existing and new signal wires and detector cables be connected, as indicated in the signal hook up chart provided with each cabinet.

When secondary service is initially applied to a State furnished controller cabinet, the controller unit, conflict monitor, coordination unit and other electronic equipment shall be unplugged. After the signals are flashing, the controller, conflict monitor and other equipment shall be connected, and the intersection placed in automatic operation.

The following locations listed below shall be included in project 0173-0468 only for new cabinet installation on existing foundation as shown in plans.

<u>Location No.</u>	<u>Intersection Description</u>	<u>Town</u>
050-201	Rt. 1(Boston Post Road) at Rt. 135 (North Benson Rd.)	Fairfield
092-241	Rt. 80(Foxon Boulevard) at Rt. 103(Quinnipiac Ave.)	New Haven
092-242	Rt. 80(Foxon Boulevard) at Eastern Street	New Haven
156-212	Rt. 162(Saw Mill Road/Wagner Place) at Elm Street	West Haven
158-213	Rt. 1(Post Road East) at Taylor Place and Main Street	Westport

The following locations listed below shall be included in project 0173-0468 only for new cabinet installation on a new foundation as shown in plans.

<u>Location No.</u>	<u>Intersection Description</u>	<u>Town</u>
050-207	Rt. 1(Boston Post Road) at Ruane Street	Fairfield
138-201	Rt. 1(Boston Avenue) at Bruce Avenue	Stratford
138-250	Rt. 110(East Main St.) at Drive to Dock Shopping Center & Stratford Crossing	Stratford
138-276	Rt. 1(Barnum Ave.) at Soundview Avenue & Mary Avenue	Stratford

The following locations listed below shall be included in project 0138-0250 only for new cabinet installation on a new foundation as shown in plans.

<u>Location No.</u>	<u>Intersection Description</u>	<u>Town</u>
138-241	Rt. 1(Ferry Blvd. /Barnum Ave. Cutoff) at Riverview Bistro Drive	Stratford
138-242	Rt. 1(Barnum Ave. Cutoff) at Rt. 1(Ferry Blvd.)	Stratford

Method of Measurement:

This work shall be measured for payment by the number of traffic controllers, cabinets and related equipment for each, picked up, installed, operating and accepted in place.

Basis of Payment:

This work will be paid for at the contract unit price each for "INSTALL STATE FURNISHED TRAFFIC CONTROLLER AND CABINET" complete in place, which shall include transportation from the pick up source to the location, storage, all miscellaneous electrical hardware, tools and work incidental thereto.

ITEM #1108665A – 10/100/1000BASE - T ETHERNET SWITCH

DESCRIPTION:

This section involves the provision, installation and configuration of the 10/100/1000 Base-T Ethernet Switch. The Contractor shall install the proposed equipment in the traffic signal cabinet.

MATERIALS:

The 10/100/1000Base-T Ethernet Switch shall provide Ethernet data aggregation for all traffic signal cabinets.

The 10/100/1000Base-T Ethernet Switch shall comply with the following requirements:

1. Minimum of eight (8) 10/100/1000 Base-T Ethernet ports with RJ-45 jacks Institute of Electrical and Electrical Engineers (IEEE) 802.3u
2. At least one craft port for switch configuration
3. 10/100/1000Base-T with speed auto negotiation and full/half duplex mode
4. Packet forward and filtering rate of at least 14,880pps for 10Mbps; 148,800pps for 100Mbps; 11,900,000pps for 1000Mbps
5. 2M bits Frame buffer memory (minimum)
6. Store and forward with IEEE802.3x full duplex, non-blocking flow control
7. Support 8000 MAC address minimum and IEEE 802.1Q Virtual Lan (VLAN) Tagging
8. Support IEEE 802.1p (Quality of Service) for 4-level transmission priorities
9. Support internet protocol (IP) Multicast Filtering through Internet Group Management Protocol (IGMP) Snooping (v2) (RFC1112) and support user configurable static multicast groups
10. Support Simple Network Management Protocol (SNMP), v2 and v3 Web-based (https) management, and Secure Shell (SSH)
11. Support port-mirroring
12. Din rail mounting
13. Operating temp: -40°C - 75°C with no fans, meeting the following standards IEC61850-3, National Electrical Manufacturers Association (NEMA) TS-2, and IEC 60068.

14. Operating Humidity: 10% - 95% RH non-condensing
15. Storage Temp: -40°C - 85°C
16. Support Rapid Spanning Tree Protocol IEEE 802-1w and Multiple Spanning Tree Protocol IEEE 802.1s. The switch must support a minimum of six (6) simultaneous instances of multiple spanning tree protocol.
17. Minimum of twelve (12) selectable small form factor pluggable (SFP) 100/1000Mbps slots.
18. Minimum of six single mode 1000Mbps (SFP) optics utilizing 1310nm wavelength with a minimum rated distance of ten (10) kilometers. The optical budget for the 1000Mbps ports must be greater than or equal to 16dB at 1310nm wavelength. Optics shall be supplied in the SFP.
19. Circuit Board Conformal Coating
21. Switching Latency of seven (7) us or better
22. Port based network access control (802.1X)
23. Two redundant power supplies with no fans Din rail mounted.
24. Backplane Switching bandwidth of forty (40) Gbps or greater. (When all ports are populated)

Copper Cables and Connectors:

The Contractor shall furnish and install all necessary interface cabling and connectors including:

- Category 6 (CAT 6) cable to connect the equipment and patch panels.
- RJ 45 connectors.
- Power supply.

Manufacturer's Qualifications:

The Manufacturer of the 10/100/1000Base-T Ethernet switch shall have a minimum of five (5) years' experience in the design, manufacture, and testing of 10/100/1000Base-T Ethernet switches.

Warranty:

All equipment supplied under these items shall be warranted for parts by the Manufacturer against defects and failures, which may occur through normal use for a period of three (3) years from the date of acceptance. A copy of the warranty shall be presented to the Engineer before acceptance of the thirty (30) day test.

CONSTRUCTION METHODS:

All materials shall be new and approved by the Engineer. All equipment shall be the latest revision or product version under production by the equipment supplier. Obsolete, no-longer-supported, or no-longer-produced equipment shall not be acceptable.

Serial numbers and model numbers, if available, shall be permanently engraved on all removable components and hardware.

The Contractor shall preconfigure the switches and bench test them according to the fiber optic layout prior to installation.

The Contractor shall furnish and install din rail mounted hardware. Installation shall include all required interface cable types as specified in these special provisions.

The Contractor shall label all data and fiber cables which shall correspond to the As-built wiring diagrams.

Configuration and Testing:

The Contractor shall configure the switch according to Manufacturer's instructions and prior to installation; the Contractor shall demonstrate all required functions of the equipment and shall demonstrate complete operability with all connected equipment.

The newly installed 10/100/1000Base-T Ethernet Switch shall be configured to support rapid spanning tree protocol or multiple spanning tree protocol in a collapsed ring formation. Each individual collapsed ring shall have no more than six (6) Ethernet switches in a one (1) ring. Please reference the fiber optic layout plan for collapsed ring details.

All devices on the collapsed ring Ethernet network will be on one or more Virtual LAN (VLAN) with each device statically assigned a unique IP address. The Contractor shall request a range of usable IP addresses and subnet assignments from the Engineer. The Contractor will prepare IP address and subnet assignments and present them to the Engineer for approval prior to installation. The Contractor will be provided with the appropriate IP gateway assignment for communication back to the Department's Newington HQ and the Department's Rocky Hill Signal Lab.

The Contractor will demonstrate network resiliency and proper operation of the collapsed ring network by powering down the 10/100/1000Base-T Ethernet Switch separately in each

local traffic signal cabinet. The Contractor will then ensure communication to all remaining local traffic signal cabinets is unaffected and still accessible from the master traffic signal cabinet.

The Contractor will demonstrate network connectivity to the wireless cellular router connected in the master traffic signal cabinet to the collapsed ring Ethernet network. The contractor will also ensure all devices on the collapsed ring Ethernet network have network connectivity to the wireless router using the appropriate IP gateway address.

Cables and Connectors:

The Contractor shall furnish and install CAT 6 patch cables and connectors from the 10/100/1000Base T Ethernet switch to the signal controller, video detection processor, and wireless router. The Contractor shall provide the necessary patch cable lengths based on the distance and cable path between 10/100/1000Base-T Ethernet Switch and traffic signal cabinet equipment. Patch cables shall be neatly routed and secured.

Connections to Optical Fiber Termination Patch Panel (OFTPP):

The Contractor shall provide all termination fiber optic patch cords required from the optical fiber termination patch panel to the equipment described herein this specification.

The Contractor shall connect all 10/100/1000Base-T Ethernet Switches according to the fiber optic assignment on the Contract Drawings.

The complete end to end optical fiber path for each data link shall have been tested and verified in accordance with this Contract prior to connecting the 10/100/1000Base-T Ethernet Switch.

The Contractor shall provide to the Engineer a copy of all as-built assignments for the OFTPP.

The Contractor once all connections are made between the traffic signal cabinets will verify that light loss levels are within the proper optical budget range. If it is found that optical loss levels are too low or too high in relation to the Optical Time Domain Reflectometer (OTDR) fiber testing then the contractor will clean/replace dirty or damaged fiber patch cables for a low optical power condition and add optical attenuators for a high optical power condition.

Submittals:

As part of Section 1.06 "Control of Materials", the Contractor shall provide the following information as part of the shop drawing/catalog cut submittal:

- As-built Functional block diagrams, wiring diagrams, and point-to point wiring details.
- Detailed shop drawings, wiring diagrams, equipment cabinet front elevation drawings, and equipment installation drawings indicating supports and appurtenances required for proper installation.

- Product data, Operations and Maintenance manuals. Information regarding materials, finishes and accessories.

Delivery, Storage, and Handling:

- All materials shall be delivered in the Manufacturer's original unopened protective packages.
- All materials shall be stored in their protective packaging and protected against soiling, physical damage, or wetting before installation.
- All equipment shall be protected during transportation and until installation against damage and stains.
- All equipment and materials shall be stored in a clean, dry location free from construction dust, precipitation and excess moisture.
- Replace damaged materials and equipment, as determined by the Engineer, at no cost to the Department.

METHOD OF MEASUREMENT:

The work to be measured for payment under these items shall be the number of 10/100/100 Base-T Ethernet switches inclusive of all optics of the type specified, installed, completed, tested and accepted..

BASIS OF PAYMENT:

The work to be done under these items shall be paid at the Contract Price for each 10/100/100 Base-T Ethernet switch inclusive of all optics. This price shall include all equipment, materials, power supplies, cables, Cat 6 patch cords, fiber optic patch cords, connectors, installation, warranties, labor, shipping and incidental items required to satisfy these specifications.

Spare units to be furnished as described under Materials Section with all optics, power supplies, cables, connectors and materials as stated above will be paid for under Item 0097773A – Spare Parts.

Pay Items

10/100/100 Base-T Ethernet Switch

Pay Unit

Ea.

ITEM #1108725A – PHASE SELECTOR (MODIFIED)

ITEM #1112413A – DETECTOR (TYPE A) (MODIFIED)

ITEM #1112471A – PRE-EMPTION SYSTEM CHASSIS (MODIFIED)

ITEM #1113552A – DETECTOR CABLE (OPTICAL) (MODIFIED)

SYSTEM DESCRIPTION:

The emergency vehicle traffic signal priority control system shall enable designated vehicles to remotely cause the traffic signal controller to advance to and/or hold a desired traffic signal display by using existing controller functions. The control shall be effective for a distance of up to 2500 feet (762 m) along an unobstructed "line of sight" path. The control shall not terminate until the vehicle is within 40 feet (12.2m) of the detector or at the intersection.

The system shall consist of the following components:

- A. Vehicle Emitter (GTT (typ.) model 792) which shall be mounted on the emergency vehicle and shall transmit optical energy signals only in the forward direction.
- B. Phase Selector {GTT (typ.) model 762 (2 channel) or model 764 (4 channel)} which shall cause the signal controller to advance to and/or hold the desired traffic signal display for the emergency vehicle. A pre-emption system chassis (GTT (typ.) model 770) shall house one phase selector and pre-emption system chassis model 760 shall house one multimode phase selector model 764.
- C. Optical Detector which shall be mounted on or near a traffic signal and shall receive the optical energy signals generated by the Vehicle Emitter.

Detector (Type A) 1 Direction, 1 Channel (GTT (typ.) model 711)
- D. Detector Cable (Optical) (GTT (typ.) model 138)

System Operation:

- A. The operating sequence shall be initiated when the Optical Detector receives the required optical energy signal from the Vehicle Emitter.
- B. The Phase Selector shall cause the traffic signal controller to advance to and/or hold the desired traffic signal display for the emergency vehicle.
- C. The Phase Selector shall cause the controller to advance to and/or hold the desired traffic signal display even if the optical energy signals cease before the desired display is obtained.

- D. The Phase Selector shall allow the traffic signal controller to resume normal operation within ten seconds after optical energy signals cease if the optical energy signals cease after the desired traffic signal display is obtained.
- E. The Phase Selector shall not respond to optical energy signals from an emergency vehicle if it is already processing optical energy signals from another emergency vehicle.

System Components:

A. Optical Detector:

The optical detector receives the high intensity optical pulses produced by the emitter. These optical energy pulses are transformed by the detector into appropriate electrical signals which are transmitted to the phase selector. The optical detector is mounted at or near the intersection in a location which permits an unobstructed line of sight to vehicular approaches. The units may be mounted on signal span wires, mast arms or other appropriate structures.

1. Shall be of solid state construction.
2. Shall operate over an ambient temperature range of minus 30⁰ F. to plus 165⁰ F. (minus 34⁰ C to plus 74⁰ C.)
3. Shall have internal circuitry potted in a semi-flexible compound to ensure moisture resistance.
4. Shall operate in 5% to 95 % relative humidity.
5. Shall have a cone of detection of not more than 13 degrees. The detector and/or phase selector shall not sense a pre-emption signal from an emitter outside this cone.

B. Phase Selector

The Phase Selector utilizes solid state and relay circuitry to interface between the Optical Detector and the traffic signal controller. The Phase Selector supplies power to and receives electrical signals from the Optical Detector. When Detector signals are recognized as a valid call, the Phase Selector causes the signal controller to advance to and/or hold the desired traffic signal display. This is accomplished by utilizing Phase Selector circuitry in conjunction with normal internal controller functions, such as;

The phase selector is capable of assigning priority traffic movement to one of two channels on a first-come, first-serve basis. Each channel is connected to select a particular traffic movement from those normally available within the controller. Once a call is recognized, "commit to green" circuitry in the phase selector functions so that the desired green indication will be obtained even if optical communication is lost. After serving a priority traffic demand, the phase selector will release the controller to follow normal sequence operation.

1. Shall include an internal power supply to supply power to the optical detectors.

2. Shall have two channel operation with the capability of interfacing with an additional phase selector for expansion of channels of operation.
3. Shall have adjustable detector range controls for each channel of operation, from 40 feet (12m) to 2500 feet (762m).
4. Shall have solid state indicator lights for power on and channel called.
5. Shall operate over an ambient temperature range of minus30^o F. to plus 165^o F. (minus 34^o C to plus74C)
6. Shall operate in 5% to 95 % relative humidity.

C. Pre-emption System Chassis.

1. Opticom Model 760 and 770 card racks shall consist of a metal enclosure.
2. Dedicated card slot for one Opticom phase selector.
3. Front panel shall include a terminal strip for connecting the Opticom detectors and outputs to a gate operator as well as a 9-pin circular connector and harness to connect to 120 VAC.
4. Stable "on-shelf" mounting.
5. Easy-to-read terminal designations.
6. Relay Specifications:
 - a. Shall be designed to actuate gate opener circuit.
 - b. Shall be designed to switch AC or DC.
 - c. Shall include normally open and closed contacts.

D. Detector Cable (Optical).

1. 3 Conductor cable with shield and ground wire.
2. AWG #20 (7x28) stranded.
3. Individually tinned copper strands.
4. Conductor insulation: 600 volt, 167^o F. (75 deg. C).
5. 1 Conductor-yellow; 1 Conductor-blue; 1 Conductor-orange.
6. Aluminized mylar shield tape or equivalent.
7. AWG #20 (7x28) stranded uninsulated drain wire
8. DC resistance not to exceed 11.0 ohms per 1000 feet (305m).
9. Capacitance from one conductor to other two conductors and shield not to exceed 48 pf/ft. (157pf/m).
10. Jacket: 600 volts, 176^o F. (80 deg. C), minimum average wall thickness – 0.045" (1.14mm).
11. Finished O.D.: 0.3" (7.62mm) max.

System Interface:

System shall be capable of operating in a computerized traffic management system when appropriate interfacing is provided by the computer supplier.

General:

The Contractor shall furnish the manufacturer the phasing diagrams indicating controller sequence and timing.

The optical equipment manufacturer shall replace or repair without charge, any component parts that prove to be defective within five years from the date of shipment from manufacturer. Manufacturer shall certify upon request that all materials furnished will conform to this specification. The manufacturer or his designated representative shall be responsible for determining and setting all required range and emitter intensity for the emergency vehicle operation.

Construction Methods:

All equipment except the vehicle emitter assembly shall be installed and wired in a neat and orderly manner in conformance with the manufacturers' instructions. The vehicle emitter assembly shall be delivered to a designated town representative. Installation of the vehicle emitter assembly shall be the responsibility of the town.

Traffic signals owned and maintained by the State that have optical pre-emption equipment owned and maintained by the town shall have an Auxiliary Equipment Cabinet (AEC) attached to the controller cabinet. The optical preemption equipment shall be housed in the AEC. Traffic signals owned and maintained by the town do not require an AEC to house the pre-emption equipment.

Detector cables shall be installed continuous with no splices between the optical detector and the AEC.

Detector locations shown on the plan are for illustration purposes only. Exact location shall be determined by the manufacturer or the designated representative for the best possible line of sight.

If not present in an existing traffic controller cabinet, the following items shall be installed and connected, in conformance with the current Functional Specifications for Traffic Control Equipment, "D" Cabinet Requirements (Pre-emption Type):

- Controller "D" harness and adapter.
- Pre-emption termination panel with terminal block and relay bases.
- Pre-emption disconnect switch, mounted on the emergency switch panel (on inside of cabinet door).
- Pre-emption test buttons, mounted on the pre-emption termination panel.

All connections from the phase selector to the "D" harness and to the cabinet wiring shall be made at the termination panel. The termination panel shall have AC+ Lights, AC-, and a switched logic ground. The switched logic ground feeds all the pre-empt inputs to the phase selector. When switched off by the pre-emption disconnect switch, the traffic controller shall not be affected by pre-empt calls from the optical pre-emption system. A minimum of two test buttons shall be provided. If there are more than two pre-empt runs, a button for each shall be installed. A chart or print out, indicating the program steps and settings shall be provided along with the revised cabinet wiring diagrams.

Test the pre-emption system at the semi-final inspection according to the following guidelines:

1. Notify the system owner/user, such as the municipal fire chief or public works director, of the scheduled inspection

2. Request a fire department representative and an emergency vehicle, which has an emitter, to conduct the test. If not available, the contractor shall provide an emitter.
3. In the presence of the Engineer, and the municipal representative, test each pre-empted approach with the emergency vehicle. Test the following items of the system:
 - * Confirm the emitter activates the phase selector and the phase selector activates the correct pre-emption input to the controller.
 - * Confirm adequate range. The traffic signal must be pre-empted to green sufficiently in advance of the emergency vehicle arrival. The vehicle emitter shall initiate pre-emption at a minimum distance of 2500 FT. (760m).
 - * Confirm there are no false calls. Keep the emitter active as the emergency vehicle passes through the intersection. No other optical detectors shall sense the strobe.
4. Document the test. Provide the Engineer and, upon request, the municipality copies of the test results.

If a malfunction is found or the system needs adjustment (such as range, emitter intensity, or detector location), schedule a follow-up test. Repeat the above steps for all approaches that did not pass.

All adjustments such as emitter intensity, phase selector range, sensitivity, detector placement, shall be made at the intersection, by the contractor so that the optical pre-emption operates correctly with other major manufacturers' equipment currently owned by the town.

Method of Measurement:

Optical Detectors (modified), Phase Selectors (modified), System Chassis (modified) will be measured for payment by the number of each supplied, installed and accepted. Detector Cable (Optical) (modified) will be measured by the number of linear feet (meters) supplied, installed and accepted.

Basis of Payment:

Payment for Optical Detectors (modified), Phase Selector (modified), System Chassis (modified) and Detector Cable (Optical) (modified) will include the item unit cost, including all manufacturer's required mounting hardware and the cost of installation and supervision by the manufacturer or his designated representative, including travel and subsistence, and all materials, equipment and labor incidental thereto. Payment for termination panel, "D" harness, test buttons, program chart (or print out) and revised cabinet wiring diagrams shall be included in the item PRE-EMPTION SYSTEM CHASSIS (MODIFIED).

Pay Items =====	Pay Units =====
Detector (TYPE A) (MODIFIED)	Ea.
Phase Selector (MODIFIED)	Ea.
Detector Cable (Optical) (MODIFIED)	L.F. (m)
Pre-Emption System Chassis (MODIFIED)	Ea.

ITEM #1108808A – TRAINING

Description:

Training shall be arranged by the Contractor for the detection system included in the Contract.

Construction Methods:

Equipment Type:

- 360 Degree Video Detection System
- IP Video Detection Camera Assembly
- Thermal Video Detector Assembly

Training:

The Training shall be provided by the manufacturer's certified trainer. For each type of equipment listed above, provide a minimum of six (6) hours of training for up to sixteen (16) representatives from the offices of District Maintenance, Traffic Engineering and Highway Operations. Include three (3) hours of classroom instruction and three (3) hours of hands-on instruction focusing on the following:

- Theory of operation; Program and operation instructions; Circuit description
- Troubleshooting; Preventative maintenance; field diagnostics; field adjustments
- Proper installation techniques

Training sessions shall be scheduled at a mutually agreed time and location after installation of the equipment.

Method of Measurement: Training will be measured for payment as a lump sum at the completion of all training sessions.

Basis of Payment: The Contract lump sum price for "Training" shall include all necessary instruction manuals, maintenance manuals, schematics of all equipment, and instruction for all attendees of the training sessions.

Pay Item	Pay Unit
Training	1.s.

ITEM #1108826A – OPTICAL FIBER TERMINATION PATCH PANELS

DESCRIPTION:

This section specifies the requirements for furnishing and installing Optical Fiber Termination Patch Panels (OFTPP) for termination and connection of fiber optic cables at the locations shown on the Contract Drawings. Fiber optic patch cables shall be installed between the OPTPP and the optical communication equipment.

MATERIALS:

1. Optical Fiber Termination Patch Panels (OFTPP):

- 1.1 The OFTPP shall be manufactured by Corning Cable Systems, WCH Series or an approved equal. The OFTPP shall include a splice enclosure to protect the fused fibers as described herein this specification. Each interconnect panel shall be equipped with SC-type connector style jacks for attachment to fiber optic drop cables.
- 1.2 The OFTPP shall be wall mountable and have the capacity to terminate twenty four optical fibers into SC-type panel connectors. SC-type connectors shall be used for the termination of the trunkline optical fibers at the master traffic signal cabinet. 1.3 All patch panel connector positions used for connection of fiber optic transmission equipment shall be identified on a label permanently affixed to the cabinet door. The label shall show the connector position and the designated fiber optic transmission equipment.
- 1.4 The OFTPP shall include all cable strain-relief, splice trays, fan-out kits, splices, tools, equipment and labor necessary to complete this item as described in this specification and as shown on the Contract Drawings.
- 1.5 The OFTPP shall have a splice tray organizer capable of terminating twenty-four (24) fibers. The organizer shall provide access to and removal of individual splice trays and permit selective splicing to allow one (1) or more fibers to be cut and splice to branch cable without disrupting other fibers.
- 1.6 All splice trays shall have a contrasting background for splicing colored fibers or as approved by the Engineer. The splice trays shall include tie-wraps to secure the buffer or transport tubes to the tray. The splice trays shall be of adequate size to prevent induced attenuation due to fiber bending.
- 1.7 The OFTPP splice closure shall protect the fiber optic cable splices from mechanical damage, shall provide strain relief for the cable, and shall be manufactured of non-corroding materials.

1.8 Vinyl markers shall be supplied to identify each fiber to be spliced within the closure. Each splice (as required for testing) shall be individually mounted and mechanically protected on the splice tray.

1.9 Polyethylene tubes shall be supplied to protect exposed individual fibers within the closure.

1.10 The approximate size of the OFTPP shall not exceed 9.25”H x 13.25”W x 3.25”D.

1.11 The OFTPP shall include connector panels for twenty-four (24) SC style fiber optic connectors.

2.0 Environmental Requirements:

2.1 All equipment shall be certified to operate over a temperature range of -20° Celsius to +60° Celsius with a relative humidity of 10% to 95%, non-condensing.

2.2 Termination panels shall be equipped with suitable means for routing and securing of cables and pigtails to prevent damage to fibers during all regular operation and maintenance.

3.0 Fiber Optic Patch Cords:

3.1 Fiber Optic Patch Cords shall be furnished in sufficient length and quantity, and installed in the traffic signal cabinet to connect the optical fiber termination patch panel to the optical equipment.

3.2 All optical fibers, coatings, tubes, metals and jackets shall be free of roughness, porosity, blisters, splits and voids in accordance with good manufacturing practice.

3.3 The cable shall be suitable for operation over a temperature range of -20°C to +60°C.

3.4 The patch cords shall be rated for indoor/outdoor use. The patch cord connector type must match to the equipment it is intended. Patch cords will be of one type SC to LC.

3.4 Materials used in the cable shall not produce hydrogen in a concentration large enough to cause any degradation in the transmission performance of the optical fibers.

4.0 SC-type and LC Connectors:

4.1 SC-type and LC connectors shall have a ceramic insert.

4.2 The connector shall be of the LC and SC-type and fully compatible with the fiber optic cable utilized and the mating jacks to which they will be attached.

- 4.3 The connector shall be compatible with an ultra physical contact (UPC) finish. All connectors shall be polished to a UPC finish with a minimum thirty (30) dB connector return loss.
- 4.4 The connector mean loss shall not be greater than 0.2 dB with a standard deviation of not greater than 0.1 dB.
- 4.5 The connector loss shall not vary more than 0.1 dB after 500 repeated matings.
- 4.6 The connector shall withstand an axial load of 135 N.
- 4.7 The connectors shall be attached in accordance with the Manufacturer's recommended materials, equipment and practices.
- 4.8 The connector shall be suitable for the intended environment and shall meet the following environmental conditions:
- 4.8.1 Operating Temperature: -20 to +60° C
- 4.8.2 Storage Temperature: -30 to +60° C
- 4.9 The connector loss shall not vary more than 0.2 dB over the operating temperature range.
- 4.10 Connectors shall be protected before installation by a suitably installed waterproof protection cap.

5.0 Warranty:

- 5.1 All equipment supplied under these items shall be warranted for parts by the vendor against defects and failures, which may occur through normal use for a period of one (1) year from the date of Final Acceptance. A copy of the warranty shall be presented to the Engineer before installation of the equipment.

CONSTRUCTION METHODS:

1.0 Optical Fiber Termination Patch Panel (OFTPP):

- 1.1 The Contractor shall install and provide all splicing and termination required to connect field fiber cable to the equipment shown on the Contract Drawings and specified elsewhere in this project. The Contractor shall refer to Item 1112242A – Fiber Optic Cable Splice Enclosure (Signal) for splicing requirements.
- 1.2 The Contractor shall install the OFTPP at the locations shown on the plans and shall provide and install all fiber optic patch cords between the optical equipment and the OFTPP as shown on the Contract Drawings.

- 1.3 The OFTPP shall be mounted in the master traffic signal cabinet at the approximate location as shown on the Contract Drawings or the fiber distribution cabinets as directed by the Engineer. Sufficient lengths of cable between the patch panel and the optical equipment installed in the traffic cabinet shall be coiled in the equipment cabinet to allow the OFTPP to be removed from the cabinet for splicing.
- 1.4 Splices to the fiber optic cable used in this project shall be fabricated using modern, high quality fusion type splicing equipment.
- 1.5 The maximum loss introduced by any splice shall not exceed 0.2 dB.
- 1.6 The average splice loss shall not exceed 0.1 dB for any given span, with a standard deviation not greater than 0.07 dB.
- 1.7 Each splice shall be tested for tensile strength by applying a force of not less than 200 grams.
- 1.8 All splices shall be arranged neatly in splice trays, supported and protected with a suitable splice protector.
- 1.9 The optical fiber path shall be tested and verified in accordance with this Contract prior to the connection to the equipment.
- 1.10 The Contractor shall neatly train all optical patch cords and pigtailed together when routing them along the same path and shall neatly train them in the traffic signal cabinet.
- 1.11 No cables shall be installed with a bend radius less than the Manufacturer's minimum recommended bending radius.

2.0 Submittals:

The Contractor shall submit the following documentation:

- 2.1 Detailed shop drawings, wiring diagrams, equipment cabinet front elevation drawings, and equipment installation drawings indicating supports and appurtenances required for proper installation.
- 2.2 Product data and cut sheets, operating and maintenance manuals. Information regarding materials, finishes and accessories.
- 2.3 The Contractor shall submit four (4) copies of the "as-built" equipment manuals with the documentation for OFTPP installed. The equipment manuals shall include technical information, wiring diagrams and schematics, hookup prints, parts list and a troubleshooting guide.

3.0 Delivery, Storage, and Handling:

- 3.1 The Contractor shall deliver, store, handle and install all materials and equipment in such a manner as not to degrade quality, serviceability or appearance.
- 3.2 The Contractor shall be responsible for storage of the materials and equipment prior to installation in a clean, dry location free from construction dust, precipitation and excess moisture.
- 3.3 The Contractor shall be required to replace any damaged materials and equipment, as determined by the Engineer, at no additional cost to the Department.
- 3.4 All materials shall be delivered in the Manufacturer's original unopened protective packages.
- 3.5 All materials shall be stored in their original protective packaging and protected against soiling, physical damage, or wetting, before installation. All equipment shall be protected during transportation and until installation against damage and stains.

METHOD OF MEASUREMENT:

These items shall be measured for payment by the number of Optical Fiber Termination Patch Panels (OFTPP), with all required cabling, patch cords, connectors and other required appurtenances installed, completed, tested and accepted.

BASIS OF PAYMENT:

The work to be done under this Item shall be paid at the Contract Price each for the Optical Fiber Termination Patch Panels (OFTPP), which price shall include all equipment, materials, connectors, patch cords, splicing, tools, installation, labor, shipping and incidental items required to satisfy these specifications.

Pay Items
Optical Fiber Termination Patch Panels

Pay Unit
Ea.

ITEM #1111201A – TEMPORARY DETECTION (SITE NO. 1)

ITEM #1111202A – TEMPORARY DETECTION (SITE NO. 2)

ITEM #1111203A – TEMPORARY DETECTION (SITE NO. 3)

ITEM #1111204A – TEMPORARY DETECTION (SITE NO. 4)

ITEM #1111205A – TEMPORARY DETECTION (SITE NO. 5)

ITEM #1111206A – TEMPORARY DETECTION (SITE NO. 6)

ITEM #1111207A – TEMPORARY DETECTION (SITE NO. 7)

ITEM #1111208A – TEMPORARY DETECTION (SITE NO. 8)

ITEM #1111209A – TEMPORARY DETECTION (SITE NO. 9)

ITEM #1111210A – TEMPORARY DETECTION (SITE NO. 10)

ITEM #1111211A – TEMPORARY DETECTION (SITE NO. 11)

ITEM #1111212A – TEMPORARY DETECTION (SITE NO. 12)

ITEM #1111213A – TEMPORARY DETECTION (SITE NO. 13)

ITEM #1111214A – TEMPORARY DETECTION (SITE NO. 14)

ITEM #1111215A – TEMPORARY DETECTION (SITE NO. 15)

ITEM #1111216A – TEMPORARY DETECTION (SITE NO. 16)

ITEM #1111217A – TEMPORARY DETECTION (SITE NO. 17)

ITEM #1111201A, 1111202A, 1111203A, 1111204A
1111205A, 1111206A, 1111207A, 1111208A, 1111209A,
1111210A, 1111211A, 1111212A, 1111213A, 1111214A,
1111215A, 1111216A, 1111217A

Description:

Provide a Temporary Detection (TD) system at signalized intersections throughout the duration of construction, as noted on the contract plans or directed by the Engineer. TD is intended to provide an efficient traffic-responsive operation which will reduce unused time for motorists travelling through the intersection. A TD system shall consist of all material, such as pedestrian pushbutton, accessible pedestrian signal, conduit, handholes, cable, messenger, sawcut, loop amplifier, microwave detector, Video Image Detection System (VIDS), Self-Powered Vehicle Detector (SPVD), and any additional components needed to achieve an actuated traffic signal operation.

Materials:

Material used for TD is either owned by the Contractor and in good working condition, or existing material that will be removed upon completion of the contract. Approval by the Engineer is needed prior to using existing material that will be incorporated into the permanent installation. New material that will become part of the permanent installation is not included or paid for under TD.

Construction Methods:

The work for this item includes furnishing, installation, relocating, realigning, and maintaining the necessary detection systems as to provide vehicle and pedestrian detection during each phase of construction. If not shown on the plan, program the TD modes (pulse or presence) as the existing detectors or as directed by the Engineer. If the TD method is not specified elsewhere in the Contract, (loops, SPVD, microwave, VIDS, pushbutton, or other) it may be the Contractor's choice. The method chosen for TD must be indicated on the TD Plan submission.

The traffic signal plan-of-record, if not in the controller cabinet will be provided upon request. Ensure the controller phase mode (recall, lock, non-lock) and phase timing are correct for the TD. Adjust these settings as needed or as directed by the Engineer.

At least 30 days prior to implementation of each phase of construction submit a TD proposal to the Engineer for approval. Submit the TD proposal at the same time as the Temporary Signalization plan. Indicate the following information for each intersection approach:

- Phase Mode
- Temporary Detection Method
- Area of Detection
- Detector Mode

ITEM #1111201A, 1111202A, 1111203A, 1111204A
1111205A, 1111206A, 1111207A, 1111208A, 1111209A,
1111210A, 1111211A, 1111212A, 1111213A, 1111214A,
1111215A, 1111216A, 1111217A

Submit the proposed temporary phase timing settings and the TD installation schedule with the TD proposal. See the example below.

Example Proposed Temporary Detection and Timing

Site 1

Warren, Rt. 45 at Rt. 341, Location #149-201

Approach	Phase	Phase Mode	TD Method	Area of Detection	Det Mode
<i>Rt. 45 NB</i>	<i>2</i>	<i>Min Recall</i>	<i>VIDS</i>	<i>150' from Stop Bar</i>	<i>Presence</i>
<i>Rt. 45 SB</i>	<i>2</i>	<i>Min Recall</i>	<i>SPVD</i>	<i>150' from Stop Bar</i>	<i>Pulse</i>
<i>Rt. 341</i>	<i>4</i>	<i>Lock</i>	<i>Microwave</i>	<i>30' from Stop Bar</i>	<i>Pulse</i>
<i>Rt. 341</i>	<i>4</i>	<i>Lock</i>	<i>Pushbutton</i>	<i>At SE & SW corners</i>	<i>n/a</i>

Temporary Phase Timing Settings:

Phase	Min	Ped	Ped Clr	Ext	Max 1	Max2	Yel	Red
<i>2</i>	<i>20</i>	<i>0</i>	<i>0</i>	<i>6</i>	<i>45</i>	<i>60</i>	<i>4</i>	<i>1</i>
<i>4</i>	<i>14</i>	<i>7</i>	<i>9</i>	<i>3</i>	<i>27</i>	<i>35</i>	<i>3</i>	<i>1</i>

Scheduled TD: *July 4, 2017* **Site 2**

Scotland, Rt. 14 at Rt. 97, Location #123-201

Approach	Phase	Phase Mode	TD Method	Area of Detection	Det Mode
<i>Rt. 15 WB Left Turn</i>	<i>1</i>	<i>Non-Lock</i>	<i>VIDS</i>	<i>5' in front to 10' Behind Stop Bar</i>	<i>Presence</i>
<i>Rt. 14 EB</i>	<i>2</i>	<i>Min Recall</i>	<i>Existing Loop</i>	<i>150' from Stop Bar</i>	<i>Pulse</i>
<i>Ped Phase</i>	<i>3</i>	<i>Non-Lock</i>	<i>Pushbutton</i>	<i>At all corners</i>	<i>n/a</i>
<i>Rt. 14 WB</i>	<i>6</i>	<i>Min Recall</i>	<i>VIDS</i>	<i>150' from Stop Bar</i>	<i>Presence</i>
<i>Rt. 97</i>	<i>4</i>	<i>Lock</i>	<i>Loop, Pre-formed</i>	<i>20' from Stop Bar</i>	<i>Pulse</i>

ITEM #1111201A, 1111202A, 1111203A, 1111204A
1111205A, 1111206A, 1111207A, 1111208A, 1111209A,
1111210A, 1111211A, 1111212A, 1111213A, 1111214A,
1111215A, 1111216A, 1111217A

Temporary Phase Timing Settings:

Phase	Min	Ped	Ped Clr	Ext	Max 1	Max2	Yel	Red
<i>1</i>	<i>5</i>	<i>0</i>	<i>0</i>	<i>2</i>	<i>12</i>	<i>18</i>	<i>3</i>	<i>1</i>
<i>2 & 6</i>	<i>24</i>	<i>0</i>	<i>4</i>	<i>4</i>	<i>26</i>	<i>36</i>	<i>4</i>	<i>1</i>
<i>3</i>	<i>16</i>	<i>7</i>	<i>9</i>	<i>0</i>	<i>16</i>	<i>16</i>	<i>4</i>	<i>1</i>
<i>4</i>	<i>14</i>	<i>7</i>	<i>9</i>	<i>3</i>	<i>27</i>	<i>35</i>	<i>3</i>	<i>1</i>

Scheduled TD: *July 4, 2011*

When at any time during construction the existing vehicle or pushbutton detection becomes damaged, removed, or disconnected, install TD to actuate the affected approaches. Install and make TD operational prior to removing existing detection. TD must be operational throughout all construction phases.

Provide a list of telephone numbers of personnel who will be responsible for the TD to the Engineer. If the TD malfunctions or is damaged, notify the Engineer and place the associated phase on max recall. Respond to TD malfunctions by having a qualified representative at the site within three (3) hours. Restore detection to the condition prior to the malfunction within twenty-four (24) hours.

If the Engineer determines that the nature of a malfunction requires immediate attention and the Contractor does not respond within three (3) hours following the initial contact, then an alternative maintenance service will be called to restore TD. Expenses incurred by the State for alternative service will be deducted from monies due to the Contractor with a minimum deduction of \$500.00 for each service call. The alternate maintenance service may be the traffic signal owner or another qualified Contractor.

TD shall be terminated when the detection is no longer required. This may be either when the temporary signal is taken out of service or when the permanent detectors are in place and fully operational.

Any material and equipment supplied by the Contractor specifically for TD shall remain the Contractor's property. Existing material not designated as scrap or salvage shall become the property of the Contractor. Return and deliver to the owner all existing equipment used as TD that is removed and designated as salvage.

Method of Measurement:

Temporary Signalization (TS) shall be measured for payment as follows:

Fifty percent (50%) will be paid when Temporary Detection is initially set up, approved, and becomes fully operational.

Fifty percent (50%) will be paid when Temporary Detection terminates and all temporary equipment is removed to the satisfaction of the Engineer.

ITEM #1111201A, 1111202A, 1111203A, 1111204A
1111205A, 1111206A, 1111207A, 1111208A, 1111209A,
1111210A, 1111211A, 1111212A, 1111213A, 1111214A,
1111215A, 1111216A, 1111217A

Basis of Payment:

This work will be paid at the contract Lump Sum price for “Temporary Detection (Site No.)”. The price includes furnishing, installing, relocating, realigning, maintaining, and removing, the necessary detection systems and all incidental material, labor, tools, and equipment. This price also includes any detector mode setting changes, timing or program modifications to the controller that are associated with TD. All Contractor supplied material that will remain the Contractor’s property will be included in the contract Lump Sum price for “Temporary Detection (Site No.)”. Any items installed for TD that will become part of the permanent installation will not be paid for under this item but are paid for under the bid item for that work.

<u>Pay Item</u>	<u>Pay Unit</u>
Temporary Detection (Site No.)	L. S.

ITEM #1111201A, 1111202A, 1111203A, 1111204A
1111205A, 1111206A, 1111207A, 1111208A, 1111209A,
1111210A, 1111211A, 1111212A, 1111213A, 1111214A,
1111215A, 1111216A, 1111217A

ITEM #1111470A – TIME CLOCK

DESCRIPTION:

This item shall consist of furnishing and installing a Time Clock/Time Base Coordination (TC/TBC) unit within a traffic signal cabinet in conformity with these specifications.

MATERIALS:

The four circuit TC/TBC shall conform to the current requirements of the Department of Transportation Functional Specifications for Traffic Control Equipment, Four Circuit Solid State Time Clock With Time Base Coordination Option TC/TBC.

CONSTRUCTION METHODS:

The TC/TBC harness shall be connected into the controller cabinet wiring in a neat and orderly manner. Refer to the TC/TBC INSTALLATION REQUIREMENTS included in the special provisions to Item #1108115A - Full Actuated Controller 8 Phase. All connections shall be to terminals. Splices will not be allowed. The TC/TBC hookup complete with pin number, function and cabinet terminal number shall be recorded in the form of a hookup chart, on 216 mm x 280 mm (8.5"x11") paper. The location, location number, date of revision, project number, TC/TBC manufacturer and model number shall also be recorded on the hookup chart. A program card shall be completed indicating all input steps and settings. Four copies of the hookup chart and program card shall be furnished to the Engineer with one each left in the cabinet. Revise controller timings as shown on the plan.

METHOD OF MEASUREMENT:

This work will be measured for payment by the number of Time Clock/Time Base Coordinators installed; operating in a time base system as designed, and accepted.

BASIS OF PAYMENT:

This work shall be paid for at the contract price each for "Time Clock" which price shall include all materials, labor, tools, 4 copies each of the hookup chart and program card, controller timing changes, and all work incidental thereto.

S:\traffic\1406\signal specs\specs\111470A-time clock.doc

ITEM #1112242A – FIBER OPTIC SPLICE ENCLOSURE (SIGNAL)

Description:

This item shall consist of furnishing and installing splice enclosures to interconnect optical fibers between two (2) or more fiber optic cable segments.

Materials:

A. Applicable Publications

1. Publications listed below form a part of these specifications to the extent referenced. The publications are referred to in the text by basic designation. All Fiber Optic Communication System hardware shall be compliant with the following specifications: Electronics Industries Association (EIA):
 - a. TIA-526-3-89 Fiber Optic Terminal Equipment Receiver Sensitivity and Maximum Receiver Input.
 - b. TIA-455-32A-90/Fiber Optic Circuit Discontinuity.
 - c. EIA-310-C Racks, Panels, and Associated Equipment.
 - d. EIA-359-A Colors for Color Identification and Coding.
 - e. EIA-TIA-455-A Standard Test Procedures for Fiber Optic Fibers, Cable Transducer Sensors, Connecting and Terminating Devices and Other Fiber Optic Components.
 - f. EIA-455-6B Cable Retention Test Procedure for Fiber Optic Cable Interconnecting Devices.
 - g. TIA/EIA-598-A Optical Fiber Cable Color Coding.

B. Fiber Optic Splice Enclosure

1. The Splice Enclosures shall be manufactured by Corning, Inc. and accommodate from sixty (60) to 168 fiber splices. Each splice enclosure shall have a splice tray organizer capable of holding twelve (12) to eighteen (18) splice trays. The Organizer shall provide access to and removal of individual splice trays and permit selective splicing to allow one or more fibers to be cut and spliced to branch cable(s) without disrupting other fibers.
2. The Contractor shall install Splice Enclosures of a capacity that they are capable of handling of twenty-four (24) fibers more than the current fiber count at any given splice location as shown on the Contract Drawings.
3. The Splice Enclosure shall fit within the space allocated for it as shown on the Contract Drawings and to operate within the environment in which it is to be installed.

4. The Splice Enclosure shall protect the fiber optic cable splices from mechanical damage, shall provide strain relief for the cable, and shall be resistant to salt corrosion. The Splice Enclosure shall be waterproof and airtight, and shall be manufactured of non-corroding materials.
5. The Splice Enclosure shall be designed for a temperature range of -30°C (-22°F) to $+70^{\circ}\text{C}$ (158°F). The Splice Enclosure shall be capable of performing in a cable vault or handhole environment where total and continuous submersion in water is to be expected.
6. All materials in the Splice Enclosures shall be non-reactive and shall not support galvanic cell action. The outer enclosure shall be compatible with the other enclosure components, splice trays, and cables. The end plate shall consist of two sections and shall have the capacity for a minimum of two cable entries on each end.
7. All Splice Enclosures shall employ re-usable sealing materials allowing multiple re-entrances without replacing any component. Access to the Splice Enclosures shall be accomplished without the use of special tools or devices. The Splice Enclosure shall employ a latching mechanism for entrance to the internal components of the enclosure.
8. All environmentally exposed components of the Splice Enclosures shall be UV light resistant.
9. All splice trays shall be lined to provide a contrasting background for splicing colored fibers or as approved by the Engineer. The splice trays shall include clear snap-on covers and tie wraps to secure the buffer or transport tubes to the tray. The splice trays shall be of adequate size to prevent induced attenuation due to fiber bending.
10. Each splice tray shall be capable of accommodating a minimum of twelve (12) fusion splices for the single mode fiber cable of the type selected.
11. The splice tray shall have features that retain the fiber loops and control the bend radius. The splice tray cover shall be clear plastic to allow for inspection of the fibers without opening the tray.
12. Vinyl markers shall be supplied to identify each fiber to be spliced within the enclosure. Each splice shall be individually mounted and mechanically protected on the splice tray.

C. Cable Racking Hardware

1. Cable racking hardware shall be made of a high performance polymer: Each splice enclosure shall be supported in the handhole or pullbox by a medium duty rack capable of supporting a minimum load of 100 lbs (445 N). Racks shall not be less than six (6) inches (150mm) in length. Medium duty racks shall have four (4) inch (100mm) arms minimum. At splice points, the pullbox shall have a horizontal rack capable of supporting and holding securely in place, a splice closure.

D. Warranty

1. All equipment supplied for this shall be warranted for parts by the vendor against defects and failures, which may occur through normal use for a period of one (1) year from the date of installation. A copy of the warranty must be presented to the Engineer before installation of the equipment.

Construction Methods:

A. Installation

1. Splice Enclosures shall be installed as shown in the Contract Drawings or as directed by the Engineer. Unless otherwise specified, outdoor type Splice Enclosures shall be installed within vaults, pull boxes, handholes, or aerially located adjacent to traffic signal cabinets and at fiber optic cable reel-end splice locations as shown on the Contract Drawings.
2. The installations shall include all required components including sealing kits, cable racking hardware and mounting hardware to achieve an environmentally secure permanent installation.
3. The Contractor shall supply all materials, tools, equipment and labor including but not limited to fan out kits, connectors, trays, splice enclosures, and any other incidentals necessary to complete the installation of the Splice Enclosure.
4. The Splice Enclosure shall be secured to the interior of the cavity of the vault, pullbox, or hand hole on cable racking hardware using tie-wraps.
5. The Outdoor Splice Enclosure shall be mounted in such position to allow the cable to enter and exit the enclosure without exceeding the cables minimum bending radius. Sufficient cable shall be coiled in the vault or pull box to allow the Splice Enclosure to be removed from the vault for current and future splicing and cable repairs. The Contractor shall install mounting hardware within the pullbox or splice location to support the Splice Enclosure and the Splice

Enclosure shall be securely fastened in place. In no cases shall the Splice Enclosure be allowed to rest on the bottom of the pullbox, vault, or handhole.

6. After the splice trays are placed inside the enclosure, the enclosure shall be sealed using a procedure recommended by the manufacturer that will provide a waterproof environment for the splices. Encapsulant shall be used to ensure water resistance. The individual fibers shall be looped one full turn within the Splice Enclosure to avoid micro bending.
7. Care shall be taken at the cable entry points to ensure a tight salt resistant and waterproof seal is made which will not leak upon aging. It is acceptable to have multiple cables enter the Splice Enclosure through one port as long as all spaces between the cables are adequately sealed.
8. All splices shall be protected with a thermal shrink sleeve and shall be labeled in the splice tray with permanent vinyl markers. Butt ends shall also be labeled to identify the destination of the fiber.
9. The splices shall be fabricated using modern, high quality fusion type splicing equipment. All splicing equipment shall be in good working order, properly calibrated, and meeting all industry standards and safety regulations. Fiber Optic Cable preparation, Splice Enclosure installation, and splicing shall be accomplished in accordance with accepted and approved industry standards.
10. Optical fibers shall be spliced as noted on the plans using the fusion type and the maximum splice loss shall not exceed 0.10 dB per splice in each direction. The Contractor shall test all splices for signal loss.
11. Each splice shall be tested for tensile strength by applying a force of not less than 7 oz. (200 grams).
12. All splices shall be arranged neatly in splice trays, supported and protected with a suitable splice protector.
13. Only the fibers required to be spliced to fiber optic drop cables at the traffic signal cabinet locations shall be severed and spliced. Where required, the buffer tube splitting tool recommended by the Manufacturer shall be used to open the correct buffer tube. Unsevered fibers in an open buffer tube shall be coiled in the splice tray. When buffer tubes do not need to be opened, at least 4.0 m of unopened buffer tubes shall be coiled in the fiber optic Splice Enclosure.
14. Drop cable entrances to the Splice Enclosures shall adhere to the Manufacturer's recommendations for the type of cable.

15. In order to reduce the overall number of splices required, the cable shall be installed in the maximum continuous reel length provided by the Manufacturer, or as shown on the plans, or as approved by the Engineer. Factory splices will not be permitted. Prior to ordering the fiber optic cable, the Contractor shall be required to submit a detailed cable layout plan showing the proposed reel lengths and splice points.
16. Fiber identification shall be in accordance with the tables and schedules provided in the Contract Drawings.
17. Upon completion of the splicing operation, all waste material shall be deposited in suitable containers, removed from the job site, and disposed of in an environmentally acceptable manner.

B. Submittals

1. Submit:
 - a. Functional block diagrams, cable diagrams, and point to point cabling details.
 - b. Product data, installation manuals, materials, system configuration options and features, and accessories.
 - c. Shop Drawings shall be completely dimensioned and shall indicate the intended installation method and details.
 - d. Specifications for all assemblies and subassemblies (eg. High Density Frames, Splice Housings, Connector Panels, Underground Splice Enclosures and associated Splice Trays).
 - e. Installation and maintenance manuals for all equipment.

C. Testing

1. Testing shall be performed to demonstrate that all furnished and installed equipment complies with the requirements of each item, and shall be conducted using Manufacturer recommended procedures, materials and test equipment.

D. Delivery, Storage, and Handling

1. The Contractor shall deliver, store, handle and install all materials and equipment in such a manner as not to degrade quality, serviceability or appearance.
2. The Contractor shall be responsible for storage of the materials and equipment prior to installation in a clean, dry location free from construction dust, precipitation and excess moisture.
3. Contractor shall be required to replace any damaged materials and equipment, as determined by the Engineer, at no additional cost to the owner.

Method of Measurement:

Work under these items shall be measured for payment by the actual number of “Fiber Optic Splice Enclosures” of the type specified, installed, tested, operating and accepted in place.

Basis of Payment:

The work to be done under this item shall be paid at the Contract Price each for “Fiber Optic Splice Enclosure” which price shall include all materials, hardware, termination panels, labor, cables, connectors, tools, equipment and incidentals necessary to complete this work.

The Contractor shall note that the required racking in the pullboxes and the vaults is included in the splice enclosure item.

Pay Items
Fiber Optic Splice Enclosure (Signal)

Pay Unit
Ea.

ITEM #1112284A – VEHICLE DETECTION MONITOR

Description:

Furnish and install a Vehicle Detection Monitor with stand in the Controller Cabinet.

Materials:

All hardware shall be new, corrosion-resistant. All equipment shall be current production.

Physical:

- Compact and easily accessible stand-mounted LCD/ LED Flat Panel Display.
- Diagonal screen size minimum 10 inches and maximum 15 inches.
- Withstand temperatures ranging from -4 to 140°F (-20 to 60°C).
- Operating humidity: 10-90% non-condensing.
- Compatible stand for shelf-mounting or mounting hardware for cabinet rail mounting.

Functional:

- Compatible with Color or Monochrome Detection systems.
- Industrial-grade video panel.
- ANSI contrast ratio of 300:1 minimum.
- Minimum brightness level: 400 candelas per square meter (400 lux).
- Native resolutions: 1024 (horizontal) x 768 (vertical).
- Support both National Television Standards Committee (NTSC) and Phase Alternating Line (PAL) video formats with auto-sensing.
- Minimum viewing angle: 140 degrees horizontally, 120 degrees vertically.
- On-Screen Display (OSD) controls brightness, contrast, color as well as horizontal and vertical positioning.
- Compatible with video detection processor output and connectors. Adapters shall not be necessary.
- FCC, Voluntary Control Council for Interference (VCCI), Electromagnetic Compatibility (EMC), Consumer Electronics (CE) approved, UL listed and Energy Star efficient.
- MTBF Rating: 50,000 hours minimum.

Warranties and Guarantees:

Provide warranties and guarantees to the **Department of Transportation Office of Maintenance** in accordance with Article 1.06.08 of the Standard Specifications.

Warranties for all equipment furnished as part of this Contract are to cover a period of 24 months following successful completion of the entire intersection acceptance test.

Method of Measurement:

The Vehicle Detection Monitor will be measured for payment as the number of units furnished, installed, operational and accepted.

Basis of Payment:

This work will be paid at the Contract unit price for each accepted “Vehicle Detection Monitor,” which price shall include the Vehicle Detection Monitor, stand, documentation, warranty, labor, tools, and equipment incidental thereto.

Pay Item	Pay Unit
Vehicle Detection Monitor	ea.

ITEM #1112285A – THERMAL VIDEO DETECTOR ASSEMBLY

ITEM #1113901A – CAMERA CABLE

Description:

Furnish and install a Thermal Video Detector Assembly (TVDA) and Camera Cable as shown on the plans or as directed by the Engineer.

Materials:

All hardware shall be new, corrosion resistant. All equipment shall be current production.

Thermal Detector Assembly:

Thermal Imaging Sensor:

- Sensor Type: Focal Plane Array (FPA), Uncooled Vanadium Oxide Microbolometer
- Fixed mount pan and tilt unit bracket.
- Thermal Sensitivity: <75mk, <50 mK f/1.0 or lower.
- Active picture elements (pixels): 320(H) x 240(V), minimum. 25 micron pixel pitch.
- Thermal Output: Analog NTSC equivalent.
- Output impedance: 75 Ohms nominal.
- Operating Temperature Range: -50°C to 75°C (-58°F to 167°F)
- Lens Selection: Based on recommendation of manufacturer for each detector installed, per outcome of Site Survey.

Surge Protection

A thermal surge suppressor(s) shall be available for installation inside the traffic signal controller cabinet. The suppressor shall provide coaxial cable connection points to a Thomas Research CCTV-SP-NI or approved equal transient suppresser for each image sensor.

- Peak Surge Current (8 x 20 us) 20KA
- Technology Hybrid, Solid State
- Attenuation 0.1db @ 10Mhz
- Response Time <1 nanosecond
- Protection Line to Ground
- Shield to Ground (isolated shield modules)
- Clamp Voltage 6 volts
- Connectors BNC
- Impedance 75 Ohms
- Temperature -40 to +85 degrees C
- Humidity 0-95% non-condensing

- Dimensions 4.5" x 1.5" x 1.25"
- UL Listed UL 497B

Detector Enclosure:

- Tamper proof constructed of painted or powder coated aluminum of at least 0.06-inch (1.59-mm) thickness.
- Environmentally sealed housing. IP-66 Rating
- Adequate adjustable sunshield should be provided.
- Internal Heater, window defroster, and a thermostat to control both.
- The enclosure shall include grounding and surge protection.

Camera Cable:

- Supply the TVDA power and return the video signal to the VDP.
- Composite construction or as recommended by detector manufacturer.
 - Coaxial:
 - 20 AWG, solid conductor.
 - Polyethylene foam dielectric.
 - Minimum 95% bare copper braid shield.
 - Power/ Control:
 - 5 conductors 18 AWG, 7 strand conductor, shielded.
- Polyethylene or polyvinyl chloride jacket.
- Other type cable may be substituted at the request of the VDP manufacturer.
- Connectors:
 - Use compression type connectors with compression tool to make connections.

Documentation: (TVDA)

Provide to the **Department of Transportation Office of Maintenance** three (3) copies of equipment manuals furnished by the manufacturer, which includes the following:

- Installation and operation procedures.
- Performance specifications (functions, electrical, mechanical and environmental) of the unit.
- Schematic diagrams.
- Pictorial of component layout on circuit board.
- List of replaceable parts including names of vendors for parts not identified by universal part numbers such as JEDEC/RETMA or EIA.
- Troubleshooting, diagnostic and maintenance procedures.

Site Survey:

Perform a site survey with the TVDA manufacturer representative at all TVDA locations prior to the installations of the TVDA equipment. The purpose of the survey is to optimize the performance from the TVDA equipment when it is installed and insure that it will meet the accuracy requirements specified previously. Submit the results of this survey to the Engineer in a report, which lists all TVDA locations with any recommended changes to camera

locations, mounting adjustments, camera lens adjustments, and desired detection zone locations. This report shall be provided to the Engineer no later than the semi-final inspection.

Warranties and Guarantees: (TVDA)

Provide warranties and guarantees to the **Department of Transportation Office of Maintenance** in accordance with Article 1.06.08 of the Standard Specifications. Warranties for all equipment furnished as part of this Contract are to cover a period of 24 months following successful completion of the entire intersection acceptance test.

Construction Methods:

Install TVDA equipment in accordance with the manufacturer instructions and recommendations to achieve the detection zones as shown in the plans and accuracy as described in these specifications. Conduct the Site Survey as specified above. The location of the TVDA shown on the plan may be revised as a result of the Site Survey. Provide the Site Survey report to the Engineer and review proposed TVDA relocations prior to installation of TVDA equipment.

Method of Measurement:

The Thermal Video Detector Assembly will be measured for payment as the number of detectors furnished, installed operational and accepted.


Camera Cable will be measured for payment by the number of linear feet of cable furnished, installed and accepted.

Basis of Payment:

The unit bid price for Thermal Video Detector Assembly includes the detector, enclosure, surge protector, brackets used to attach the TVDA to a support structure or extension bracket, documentation, warrantee, labor, tools and equipment necessary to provide the specified video signal to the VDP.

The unit bid price per linear foot of “Camera Cable” shall include all connectors, labor, tools and equipment necessary to install the cable between the TVDA and the VDP.

<u>Pay Item</u>	<u>Pay Unit</u>
Thermal Video Detector Assembly	Ea.
Camera Cable	l.f.

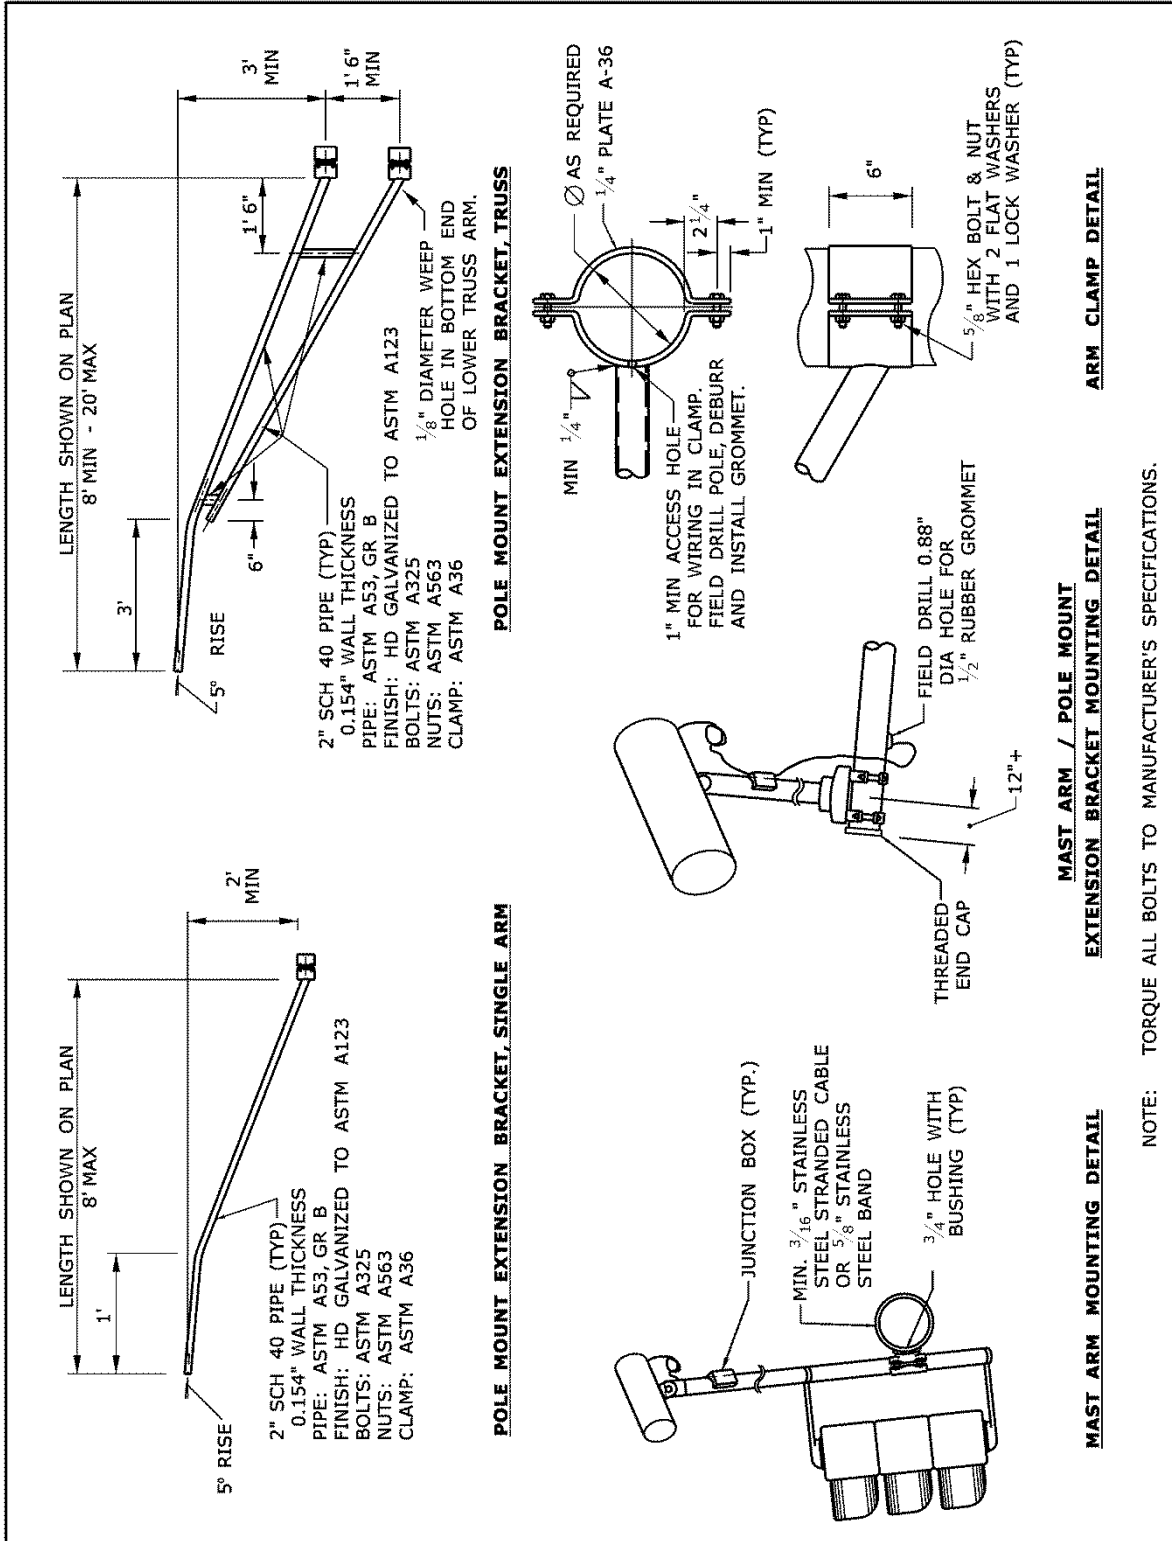

ITEM #1111600A – EXTENSION BRACKET

ITEM #1112286A – 360-DEGREE CAMERA ASSEMBLY

ITEM #1112287A – 360-DEGREE VIDEO DETECTION PROCESSOR

ITEM #1113725A – 23 AWG 4 TWISTED PAIR CATEGORY 6 CABLE

Description:

Furnish and install a 360 Degree Video Image Detection System (360VIDS) as shown on the plans or as directed by the Engineer. The 360VIDS consists of a 360 Degree Camera Assembly (360CA), 360 Degree Video Detection Processor (360VDP) and 23 AWG 4 Twisted Pair Category 6 Cable. The Extension Bracket will be included on a case-by-case basis.

Materials:

All hardware shall be new, corrosion resistant. All equipment shall be current production.

360 Degree Camera Assembly:

Camera:

- No-aim, no-focus camera
- Downward facing lens and camera shroud
- Single Power Over Ethernet (POE) connection for power and data collection.
- Color image camera with 360 degree point of view (POV)
- Active picture elements (pixels): 2560 (H) x 1920 (V), minimum.
- Signal to noise ratio : 55dB
- Heated camera
- IP addressable

Camera Enclosure:

- Tamper proof constructed of painted or powder coated aluminum of at least 0.25 inch (6.35-mm) thickness.
- IP66-rated camera housing.

Camera Mounting Hardware:

- Swivel bracket for dual plane adjustment for leveling
- Quick connect junction box
- Hybrid terminal junction box with surge.
- Astro-Brac banded bracket
- 90 degree vertical riser.(Use longer vertical riser for MAA installations only to avoid extra height on span pole)

Extension Bracket:

- Single arm [8' (2.5m) or less], or Truss type [8' (2.5m) or greater].
- Length shown on plan.
- Clamp-on attachment to pole shaft 1' (300mm) from top of pole.
- Designed to support minimum 30 lbs. (13.6 Kg), 2 sq. ft. (.2 sq. M) end load with minimal movement from wind.
- Schedule 40, 2" IPS galvanized pipe.
- Heavy duty galvanized finish
- Refer to detail drawing contained herein.

360 Degree Video Detection Processor:

Functional:

- Connectivity: Local Area Network (LAN), Wide Area Network (WAN), Camera interfaces.
- NEMA TS1/ TS2, Type 170 and 2070 ATC compatible
- Four (4) USB 3.0 expansion ports.
- Front panel LED indicators displays calls and light states.
- Twenty-four (24) optically isolated I/O interface.
- Two (2) camera ports – Up to two (2) 360 Degree Camera Assembly; or one (1) 360 Degree Camera Assembly and four (4) IP video detection camera assembly or thermal detector assembly; or eight (8) IP video detection camera assembly 1 or thermal detector assembly.
- Phase and detection display.
- Shall include at least a built-in 4g modem and be Wi-Fi capable
- Power – 110/220 VAC 50/60 Hz
- Point and click zone drawing feature
- Omni-directional vehicle tracking
- Zone level visibility monitoring
- Monitor phases and loops, generates calls to controllers
- Software required to support collection of data
- Environmental : -29F to +165F (-34C to +74C), 0-95% non-condensing
- Fail-safe in the event of loss of video from 360CA or loss of power to 360VDP.
- Shall be able to configure and adjust the detection zone with the cabinet mounted Vehicle Detection Monitor (VDM) or remotely.
- Shall be activated collect and report traffic data such as turning movements/volume counts, vehicle classification, speed, and red/green occupancy.
- Shall be configured to transmit collected traffic data and alarm events from field devices to remote desktop pc.

- Shall be configured to sync with a cloud network resource to allow for data backup including signal performance metrics data such as the Purdue coordination diagram.

Application Software:

- Shall be freely available for installation on any number of computers used to manage the 360VIDS.
- Shall be capable of point and click zone drawing
- Shall support the assignment of a detector output(s) to each zone. These assignments can be modified at any time through the software.
- Shall have the ability to digitally flatten CA image
- Shall feature the ability to mask objects that occlude the camera field of view and/or disrupt the camera automatic gain and exposure control.
- Shall store detection zone data non-volatile memory so that after recovery from power interruption, all parameters are returned to latest settings.
- Shall have the ability to import and export program database to notebook PC or remote desktop PC. The program database shall also be allowed to be transferred via an external storage device.
- Shall be capable of superimposing detection zone on real time video image from selected camera with time stamping capabilities.
- Shall be capable of monitoring real time video and adjusting zones in field or remotely while 360VDP is actuating the traffic controller.
- Shall provide visual confirmation of detection by highlighting detection zone symbols.
- Shall allow for remote display of site/camera status for all connected sites.
- Shall provide visual indication of the light state for each zone within the graphical user interface.
- Shall be capable of searching the network for other 360VDP.
- Shall be compatible with Windows operating system supported by the Department.
- Shall maintain a historical log of all configurations when site is modified
- Shall feature the ability to digitally pan, tilt, and zoom within the camera assembly's field of view without movement of the camera.
- Shall support quad view video monitoring.
- Shall be capable of syncing with a cloud network resource to allow for group site sharing of site program database information and historical traffic data report generation.
- Shall maintain a database of current and historical traffic data
- Shall allow users to create reports for turning movements/volume counts, vehicle classification, speed, red/green occupancy, and site alerts remotely via the software and online reports/performance measures via the web.
- Shall display data in a graph, chart, and table format.
- Shall display data in 15, 30, and 60-minute intervals.
- Shall provide a means by which alerts can be configured to be delivered to different individuals via email

- Report output formats shall include at minimum PDF, rich text format, and Microsoft Excel formats.

Physical:

- Either shelf mounted, stand-alone design or modular card rack design.
- Aluminum card rack frame capable of accepting four (4) 360VDP modules.
- TS1 harness cable.
- Standard Ethernet and USB connectors for video input and video output.
- Female metal shell connector with latching clamp for NEMA TS 1 detector outputs and inputs.
- LED indications to monitor all detector outputs.
- Side or rear mounted connectors and controls are not allowed on stand-alone units.
- NEMA FR-4 glass epoxy or equivalent circuit boards.

Antenna:

- Shall be mounted externally on top of traffic cabinet
- Shall be “Multiple-Input and Multiple-Output” (MIMO)
- Shall cover the Cellular, WIFI, DSRC, GPS, and Bluetooth networks
- Shall connect to the 360VDP

Ethernet Repeater:

- Utilize Ethernet repeater if CAT6 cable distance is over 300’.

Ethernet Switch:

- Power Over Ethernet (POE) switch
- Ports for up-to four (4) traditional or thermal cameras.
- Powder coated aluminum.
- Dual purpose LED port lights.
- RJ-45 CAT6 connectivity.
- Environmental: -29F to +165F (-34C to +74C).
- NEMA TS2 compliant.

Video Encoder:

- Power Over Ethernet (POE)
- Video: H.264 (MPEG-4 Part 10/AVC) Baseline and Main Profile
- Compression: Motion JPEG
- Resolutions: 176x120 to 720x576, 176x120 to 1536x1152 for quad view.
- Frame rate:
 - H.264: 25/30 (50/60 Hz) fps,
 - 15fps in quad view in full resolution,
 - Motion JPEG: 25/30 (50/60 Hz) fps,
 - 15fps in quad view in full resolution.

- Video Streaming: Multi-stream H.264 and Motion JPEG: One H.264 and one JPEG stream on each channel (8 streams in total) in full frame rate individually configured streams in max. resolution at 25/30 fps; more streams if identical or limited in frame rate/ resolution. Controllable frame rate and bandwidth; VBR/CBR H.264.
- Environmental: -40F to +167F (-40C to +75C), 10-95% non-condensing.
- NEMA TS2 compliant.

Ethernet Protection Module:

- Either shelf mounted or stand-alone design.
- Protect 360CA, IP video detection camera assembly, thermal cameras and 360VDP in the event of a surge or lightning.

Environmental:

- Comply with NEMA TS 2, Section 2 requirements for Controller Assembly.
- Pass following NEMA TS 2 tests and applicable test procedures.
 - Vibration: Section 3.13.3, Section 3.13.8.
 - Shock: Section 3.13.4, Section 3.13.9.
 - Transients, Temperature, Voltage and Humidity: Section 3.13.7.
 - Power Interruption: Section 3.13.10.

Peripherals:

- Separable Keypad & Joystick or Computer Mouse including all necessary cables for connectivity to 360VDP.

23 AWG 4 Twisted Pair Category 6 Cable:

- Supply the 360CA power and return the video signal to the 360VDP.
- Outdoor Aerial CAT6 cable with UV insulation.
- Rated for 48VDC
- 250MHZ, shielded, gel-filled (flooded core) direct burial grade.
- Shall be equipped with a drain wire.
- Terminate with compatible connector.
- Polyethylene insulation.
- Shall be installed continuous between the 360CA and 360VDP.
- Cable shall be installed according to TIA/EIA-568-B.
- Other type cable may be substituted at the request of the 360VDP manufacturer.

Documentation: (360VDP and 360CA)

Provide to the **Department of Transportation Office of Maintenance** three (3) copies of equipment manuals furnished by the manufacturer, which includes the following:

- Installation and operation procedures.
- Performance specifications (functions, electrical, mechanical and environmental) of the unit.
- Schematic diagrams (point to point wiring).

- Pictorial of component layout on circuit board.
- List of replaceable parts including names of vendors for parts not identified by universal part numbers such as JEDEC/RETMA or EIA.
- Troubleshooting, diagnostic and maintenance procedures.
- Testing results of grounding, voltage, and cable length measurements as indicated on the installation best practice verification at the end of this document.

Site Survey:

Perform a site survey with the 360VDP manufacturer representative at all 360VIDS locations prior to installation. The purpose of the survey is to optimize the performance from the 360VIDS equipment when it is installed and insure that it will meet the accuracy requirements specified previously. Prior to installation, submit the results of this survey to the Engineer in a report, which lists all 360VIDS locations with any recommended changes to camera locations, mounting adjustments, camera lens adjustments, and desired detection zone locations.

Warranties and Guarantees: (360VDP and 360CA)

Provide warranties and guarantees to the **Department of Transportation Office of Maintenance** in accordance with Article 1.06.08 of the Standard Specifications. Warranties for all equipment furnished as part of this Contract are to cover a period of 36 months following successful completion of the entire intersection acceptance test.

Construction Methods:

Install 360VIDS equipment in accordance with the manufacturer instructions. Detection zones shall be replicated as shown in the plans. The Contractor shall install vehicle-counting zones for each lanes as shown in the plans. The Contractor shall ensure the vehicle counting zones be as accurate as possible. The Contractor shall contact the Engineer to confirm detection zone and vehicle counting zone locations. The Contractor shall refer to the “Installation Best Practices Guide” attached below to this specification and the Intersection Design Guide located on the Manufacturer’s website Note that all references to “Cat5e cable” in the attached “Installation Best Practices Guide” shall refer to “23 AWG 4 Twisted Pair Category 6 Cable” as specified above in this specification. The location of the 360CA shown on the plan may be revised as a result of the Site Survey. Peripherals are to be furnished and fully installed in an easily accessible position within the controller cabinet. Leave proper clearance(s) surrounding video monitor to allow for accessible connections and space to utilize surrounding equipment.

The Contractor shall forward the configuration file in electronic format to the Traffic Signal Lab’s Mr. Don Assard at Donald.Assard@ct.gov or Mr. Mark Zampini at Mark.Zampini@ct.gov, immediately upon completion of configuration of the detection zones. The Contractor shall address any comments/corrections identified by the Traffic Signal Lab.

Method of Measurement:

The 360 degree Camera Assembly will be measured for payment as the number of 360 degree cameras furnished, installed operational and accepted.

The Extension Bracket will be measured for payment as the number of brackets furnished, installed and accepted.

The 360 degree Video Detection Processor will be measured for payment as the number of units including all additional work and materials listed in Basis of Payment, furnished, installed, operational and accepted.

23 AWG 4 Twisted Pair Category 6 Cable will be measured for payment as linear feet (meters), furnished, installed and accepted.

Basis of Payment:


The unit bid price for 360 degree Camera Assembly includes the 360 degree camera, enclosure, brackets used to attach the 360CA to a support structure or extension bracket, documentation, warrantee, labor, tools and equipment necessary to provide the specified video signal to the 360VDP.

The unit bid price for Extension Bracket includes all labor, tools and equipment necessary to attach the bracket to a pole shaft.


The unit bid price for 360 degree Video Detection Processor includes the manufacturers' site survey, unlimited number of any necessary 360VIDS configuration software and license, card rack frame, power supply, all miscellaneous hardware such as PC interface cable with connectors, necessary peripherals such as Ethernet repeater, Ethernet switch, video encoder, Ethernet protection module, documentation, warrantee, labor, tools and equipment necessary to make the 360VIDS fully operational.

The unit bid price for 23 AWG 4 Twisted Pair Category 6 Cable includes all connectors, labor, tools and equipment necessary to install the cable between the 360CA and the 360VDP.


<u>Pay Item</u>	<u>Pay Unit</u>
360 Degree Camera Assembly	Ea.
Extension Bracket	Ea.
360 Degree Video Detection Processor	Ea.
23 AWG 4 Twisted Pair Category 6 Cable	LF (M)

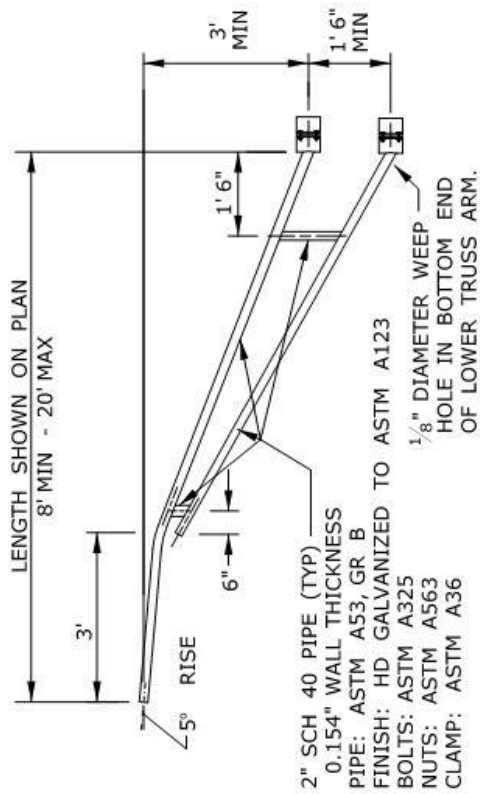


POLE MOUNT EXTENSION BRACKET, TRUSS

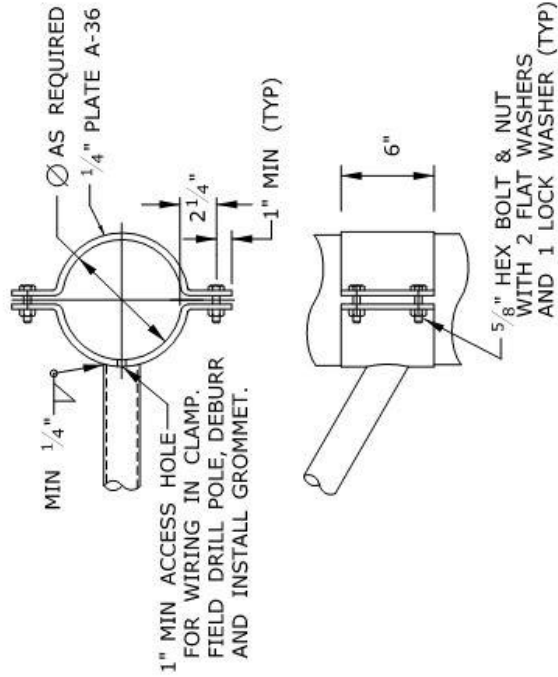

ARM CLAMP DETAIL

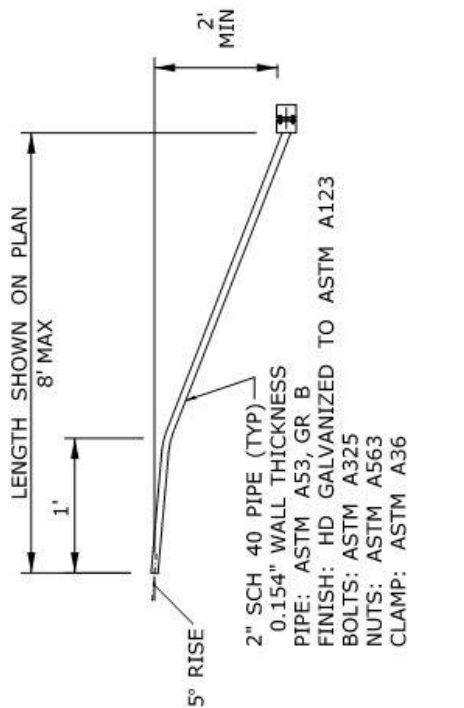


POLE MOUNT EXTENSION BRACKET, SINGLE ARM

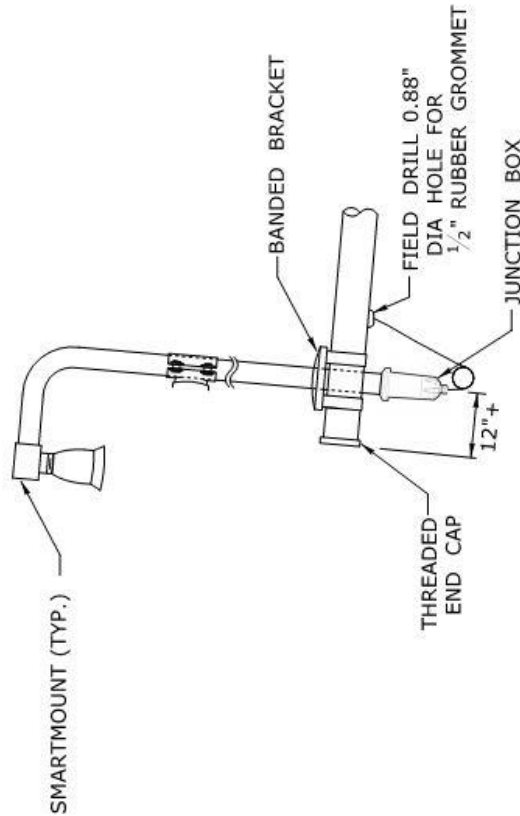

MAST ARM / POLE MOUNT EXTENSION BRACKET MOUNTING DETAIL

NOTE: TORQUE ALL BOLTS TO MANUFACTURER'S SPECIFICATIONS.


SYSTEM CONNECTIONS

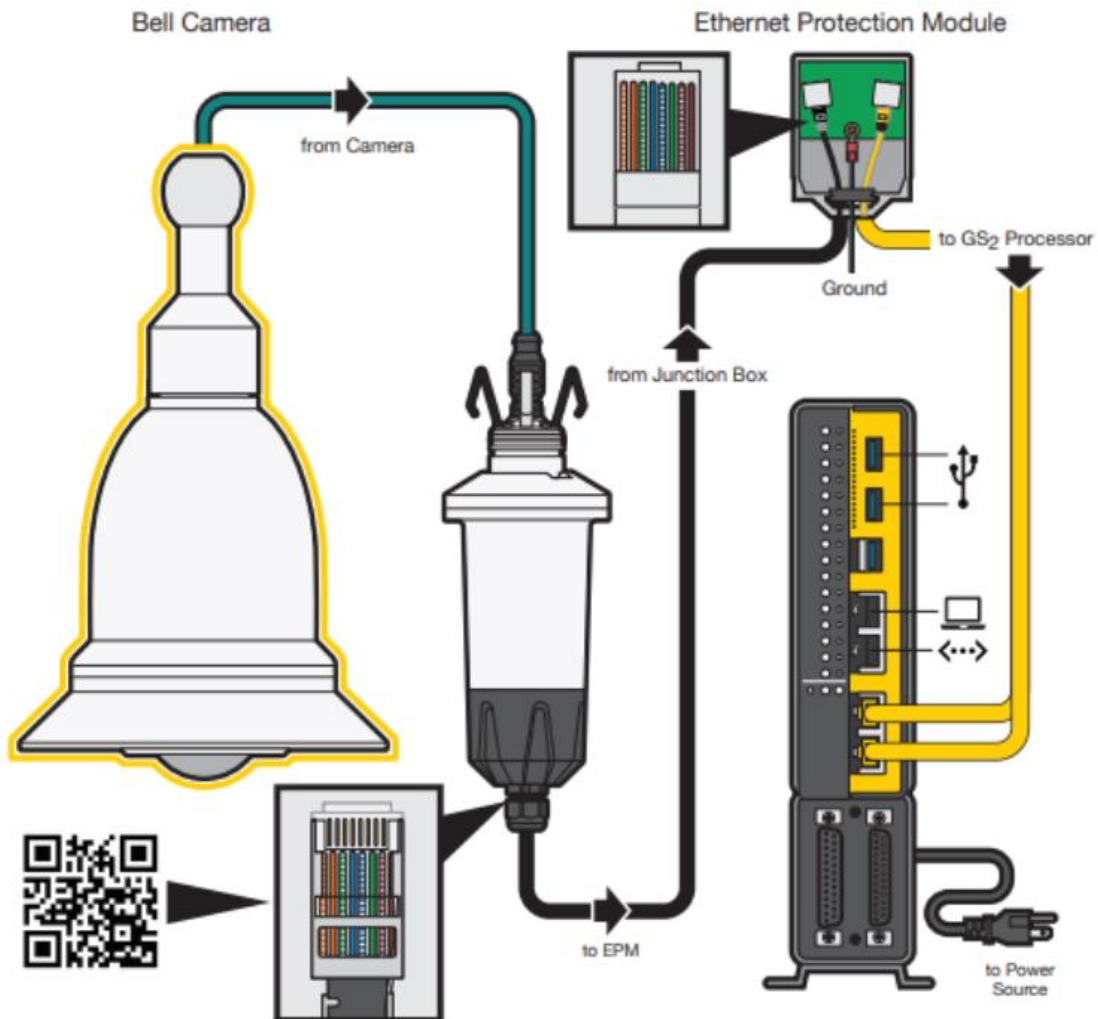

Pro Tips (Before Beginning Installation):

- Test Bell Camera (while still in foam packaging).
- Make sure unit is grounded correctly.
- Make sure Bell Camera is level and in front of stop bar.
- Check TS1 Wiring Harness Insert – TS1 connection.
- Check "Tool List" in installation guide.

SYSTEM OVERVIEW

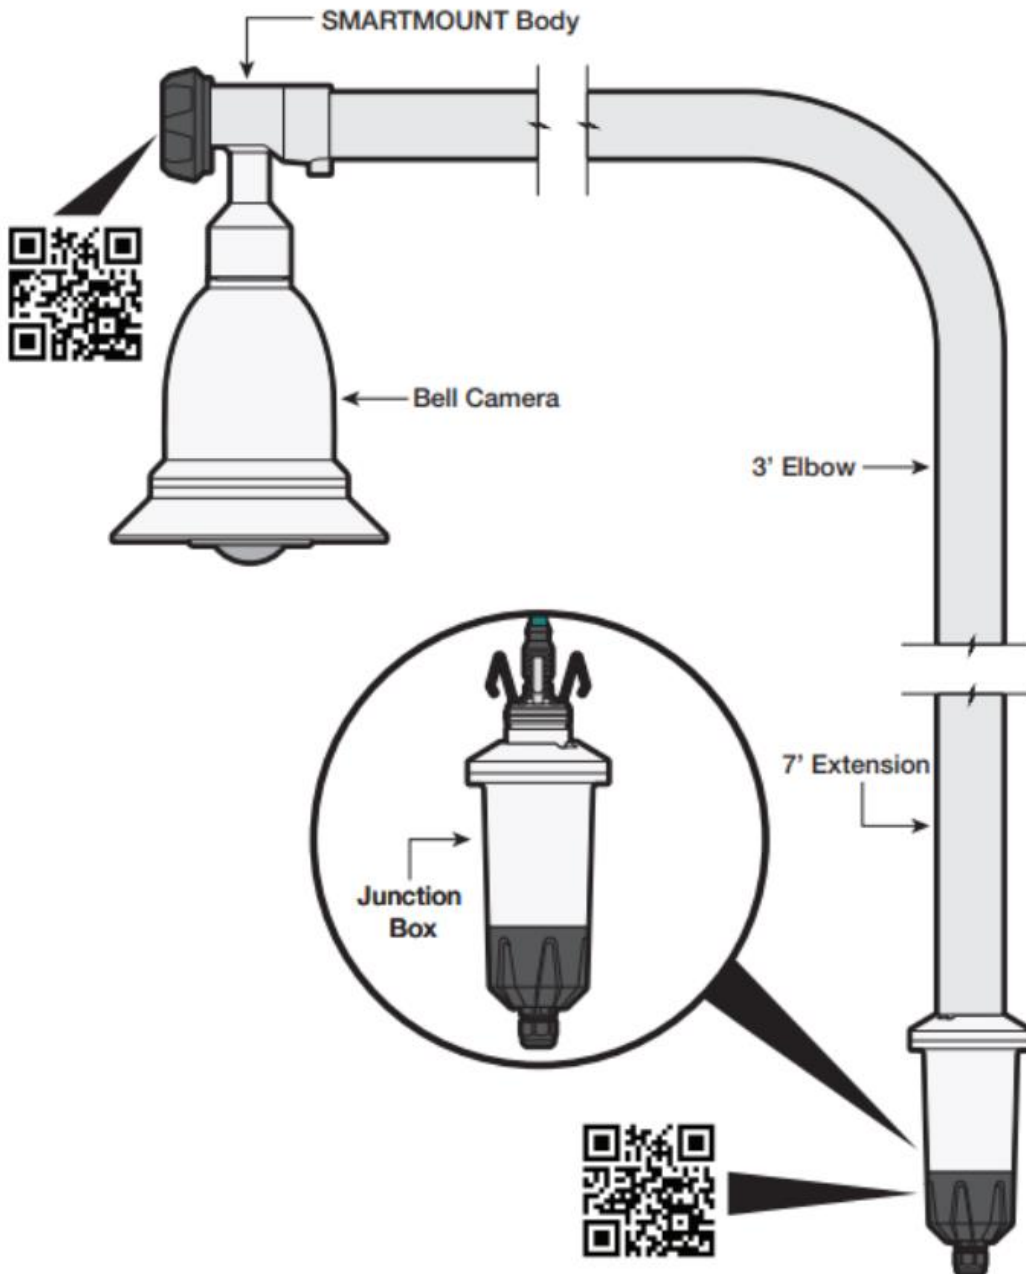

© 2018 GRIDSMART Technologies, Inc. | 10545 Hardin Valley Road, Knoxville, TN 37932 USA | August 2018
marketing@gridsmart.com | 1.866.652.5347 | GRIDSMART.com

GRIDSMART.

INSTALLATION GUIDE


TOOLS AND ITEMS NEEDED

- 7/16" Wrench
- 1/2" Wrench
- 3/4" Wrench
- 1/4" Wrench
- 3/32" Wrench
- 17 mm Wrench
- Utility knife
- Phillips screwdriver
- Flat-head screwdriver
- 1/2" Drill bit
- 5/32" Allen wrench (included)
- Mounting bracket
- CAT5e test cable
- 24AWG Shielded CAT5e cable
- RJ-45 Crimper
- Laptop (with GRIDSMART Client installed)
- EXO Crimp frame
- Ground wire clamp (included)
- USB flash drive
- Cable tester
- Hand level
- DLG Di-120b Tester




BEFORE INSTALLATION


Helpful tip: On your laptop, verify that the GRIDSMART Client is updated to the latest software version. Download the latest update from GRIDSMARTCloud.com.

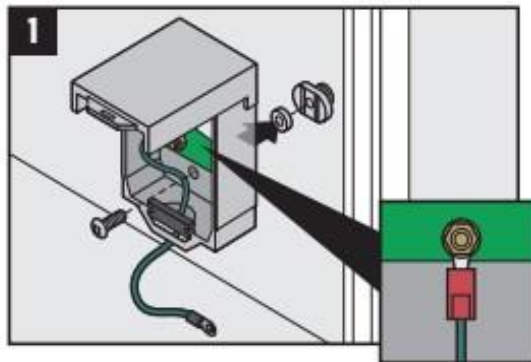


Install EPM onto cabinet DIN rail on opposite side from power distribution. Cut along rubber grommet "X". Connect 10AWG ground wire as close to ground rod as possible using ground wire clamp.

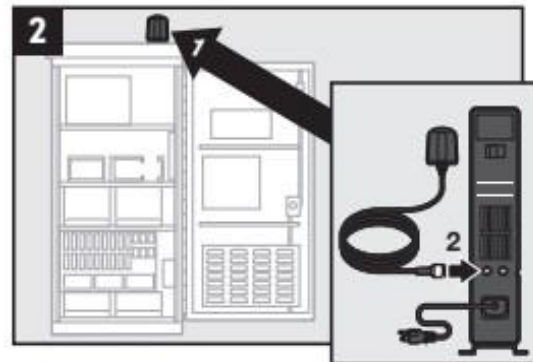

Mount Antenna to top of cabinet using 1/2" drill bit. Connect CELL Antenna lead to female connector on back of Processor.

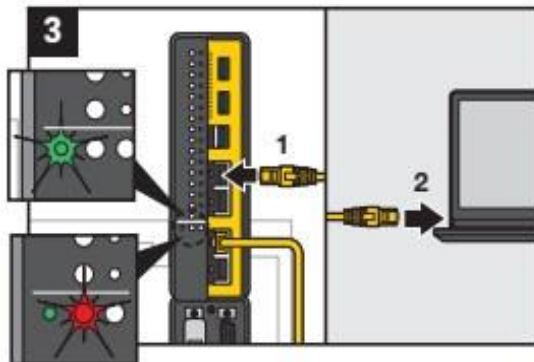


Connect Processor to power source and power on (status light turns green in 2-3 minutes). **DO NOT USE A GFCI TYPE OUTLET.** Connect laptop to "LAPTOP" port on Processor with a CAT5e cable.

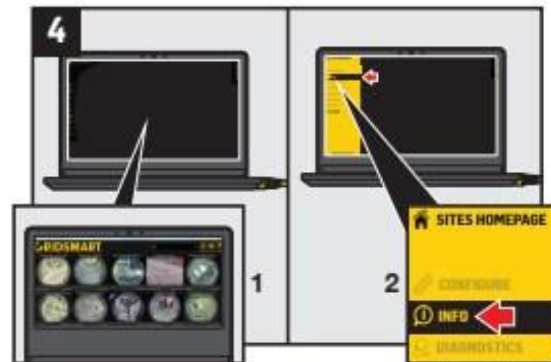

Launch GRIDSMART Client on laptop. Select factory default site card. Select "Info", verify "Site Info" version.

NOTE: The Bell Camera has not yet been connected, so there will be no Camera image.

BEFORE INSTALLATION (continued)

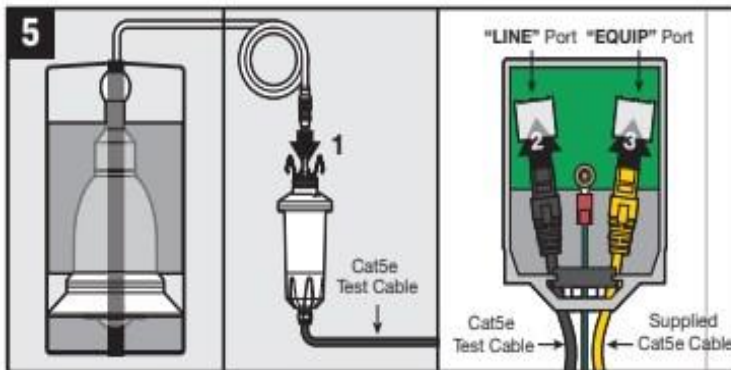


With Bell Camera in foam packaging, connect Camera cable to Junction Box upper connection. Connect one end of CAT5e test cable to Junction Box lower connection and remaining end to the EPM Module "LINE" port. Connect one end of supplied CAT5e cable to EPM Module "EQUIP" port and remaining end to Processor. Verify Bell Camera image. Camera status light turns green in 2-3 minutes.

After successful equipment test, disconnect cables to Junction Box, EPM, Processor and laptop. Leave cable connected to Bell Camera.



INSTALLATION

Helpful tip: Before proceeding, route 24 AWG gel-filled, shielded, burial grade CAT5e cable from traffic cabinet to the Bell Camera mounting location.

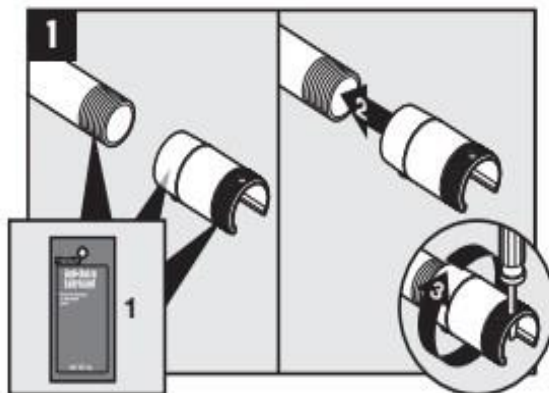


Apply anti-seize to 3' elbow and internal and external threads of SMARTMOUNT body. Install SMARTMOUNT body to upper end of 3' elbow turning clockwise to secure.

NOTE: SMARTMOUNT body opening must be facing down in final position. Tighten center set screw.

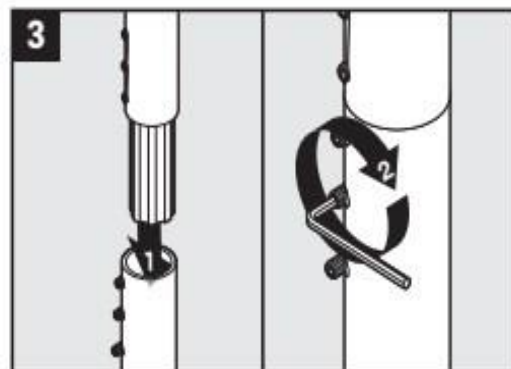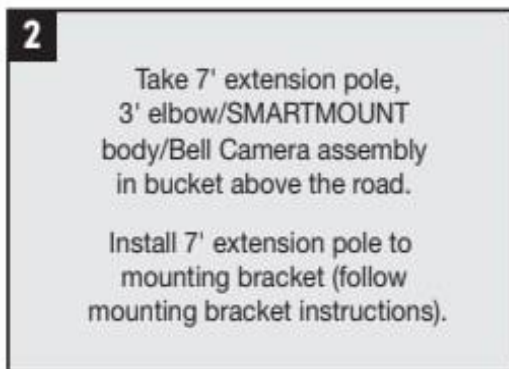


Insert 3' elbow connector into 7' extension using pole connector. Tighten screws with Allen wrench to secure.

INSTALLATION (continued)

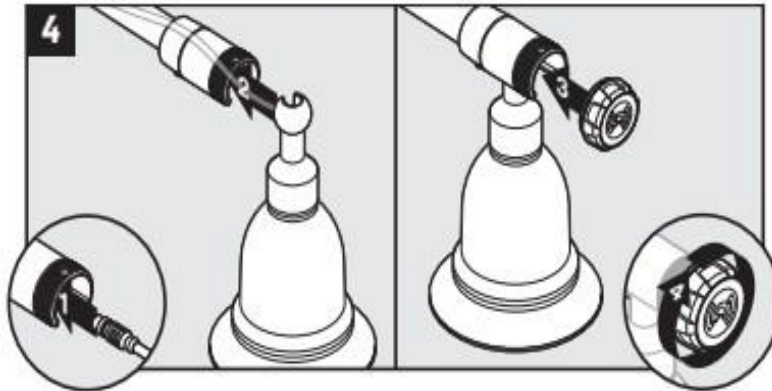


Feed Bell Camera cable through SMARTMOUNT body, 3' elbow and 7' pole extension. Slide Bell Camera ball joint into SMARTMOUNT body, being sure the ball joint opening is well aligned with body/pole opening so as not to damage cable.


Secure Bell Camera to SMARTMOUNT body with cap. Turn cap clockwise to tighten.

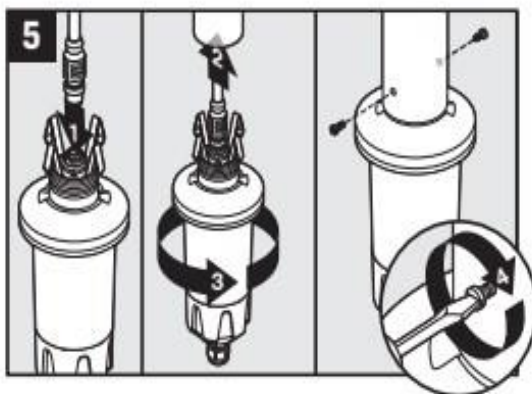

Connect Bell Camera cable from 7' extension to junction box upper connection. Insert Junction Box (turning counter clockwise up to three times to prevent kinking or binding of cable) into 7' extension pole. Install Junction Box set screws to 7' extension pole to secure Junction Box. Tighten with flathead or hexhead screwdriver.

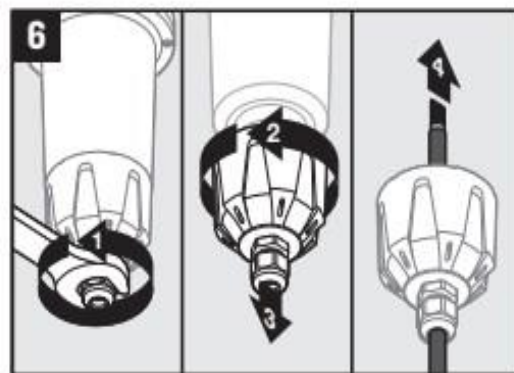


Using a 3/4" wrench, loosen cord grip from cap on bottom of Junction Box. Loosen cap and remove from Junction Box. Push unterminated field cable through cord grip and cap. **Do not tighten cord grip until step 7.** Terminate cable with RJ45, using standard 568B configuration color wiring.

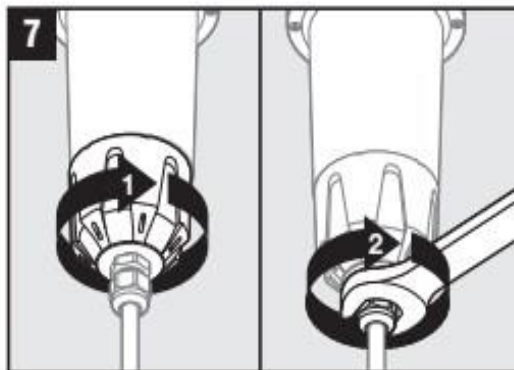

Connect the RJ45 to receptacle and replace cap onto Junction Box (hand-tighten) until fully closed. Tighten cord grip using a 3/4" wrench, to 30 in-lbs max torque.


INSTALLATION (continued)

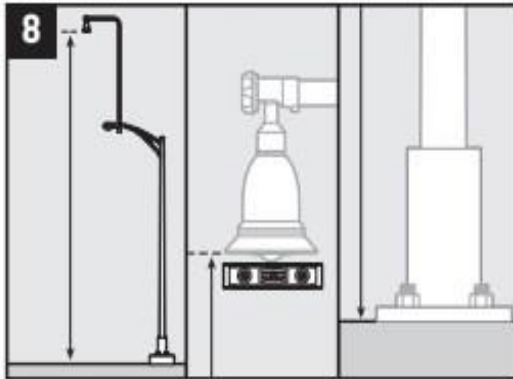


VERY IMPORTANT

Using a tape measure, measure height of Bell Camera. Record the height for use later to set up system. Orient the "G" logo away from area of consequence, level the Bell Camera and tighten the center set screw.


GROUNDING AND FINAL INSTALLATION

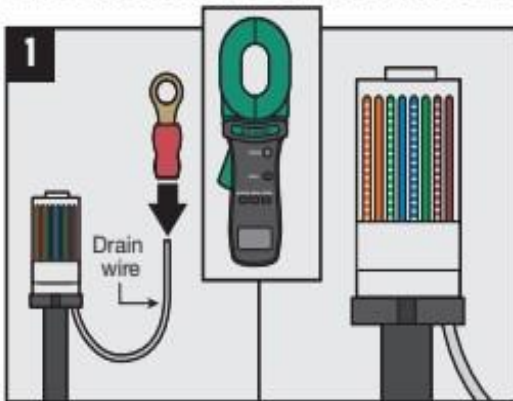

Crimp an RJ45 onto remaining end of field cable and verify with cable tester. Crimp the ring terminal to the CAT5e cable drain wire. Verify good crimp on drain wire ring terminal.

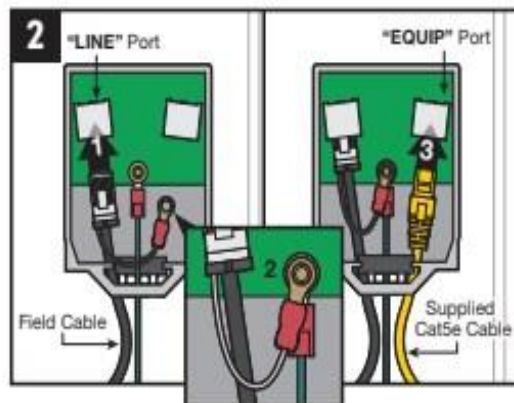

Connect field cable to EPM "LINE" port. Connect drain wire ring terminal to the EPM ground to eliminate signal noise and EMI. Connect supplied CAT5e cable EPM "EQUIP" port.

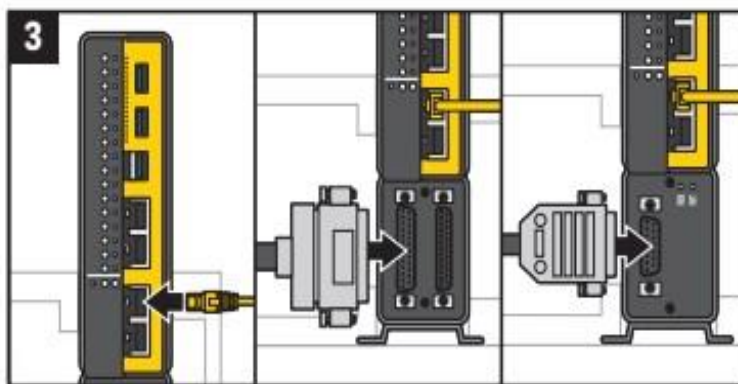

Connect supplied CAT5e to Processor "CAMERA" port. Reconnect the laptop to the "LAPTOP" port. Connect TS1, TS2 or ITS wiring harness to Processor.

GRIDSMART. QUALITY BEST PRACTICES

1 CABINET GROUNDING

A proper cabinet ground helps mitigate interference from electrical noise at the intersection.

- The U.S. National Electrical Code (NEC) recommends a maximum of 25 ohms for touch safety and telecommunications; PLC industry standards require a maximum of 5.0 ohms for logic reference purposes.
- Use a clamp-on ground meter to verify the cabinet ground.
- GRIDSMART requires the Diligent Instruments DLG Di-120b Tester (<http://www.diligentinstruments.com/di-120.html>).
- If the ground reading is higher than the recommended NEC value, check the connection between the cabinet ground wire and the ground rod for corrosion; clean if corrosion is present. If you are in an area with poor grounds, you may need to add a ground rod to the grounding system to improve the ground.


SPECIFICATION:	25 Ohms Max
MEASURED:	

2 AC POWER


Plug the GRIDSMART Processor into an outlet on the filtered side of the cabinet power. Do not use GFCI type outlet.

- The outlet needs to be checked to verify that all three connections for the outlet are properly connected.
- Using a digital voltmeter (DVM), check the ac voltage from the line to the neutral and the line to ground. Both readings should be ~ 120/240VAC.

SPECIFICATION:	HOT/NEU: 120/240VAC HOT/GND: 120/240VAC
MEASURED:	HOT/NEU: HOT/GND:

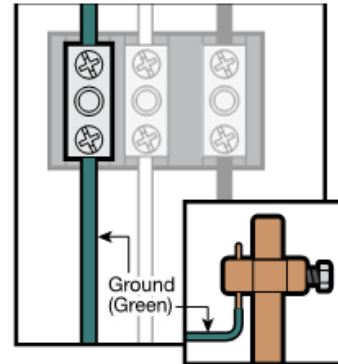

DLG Di-120b Tester

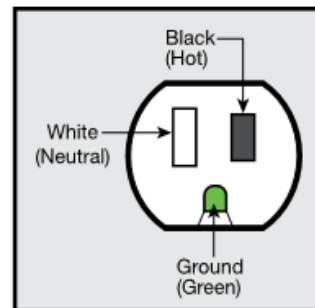


3 CABLE TYPE & LENGTH

All GRIDSMART installations require burial grade, shielded, gel filled, CAT5e cable with solid core 24 AWG conductors. The shield will protect the data signals from radiated noise which is present in most intersections. LED streetlights have been found to be very noisy electrically and as more streetlights are switched to LED lights, the level of radiated noise will increase. The cable that GRIDSMART supplies and requires for all installations is Vertical Cable part #059-487/S/CMXF.

- The maximum length that a segment of CAT5e can be is 300 feet. If the distance from the EPM to the camera is more than 300 feet, a repeater (RBA) must be used.
- When determining length of the cable, a cable tester that measures the length of the cable is required. Do not rely on sight distance or "walking off" the distance.
- Many times, there are service loops in the pull boxes and at the base of the pole, which will not be accounted for when you do not use a meter for measuring the cable length. GRIDSMART recommends the Triplet Real World Certifier (www.triplett.com/shop/real-world-certifier-rwc1000k/) for testing the cable. The tester will provide length measurements as well as cable quality measurements.

SPECIFICATION:	Cable Length: 300 Ft Max Real World Certification: 100 MB Min Cable Type: Vertical Cable part #059-487/S/CMXF
MEASURED:	Cable Length: Real World Certification: Cable Type:

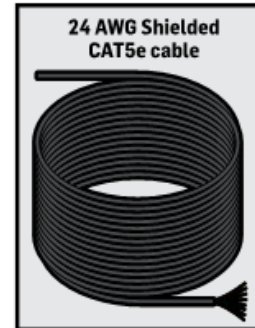

Triplet Real World Certifier




4 CONNECT DRAIN WIRE

The drain wire for the shielded CAT5e cable must be connected to the ground post in the EPM (Ethernet Protection Module). A crimp lug should be attached to the end of drain wire to attach it to the ground post. The drain should only be connected at the EPM end of the cable.

- If you are using an RBA, the drain must be spliced so the drain is continuous from the junction box to the EPM. A 10 AWG Wire is required to connect the EPM ground post to the traffic cabinet ground rod.
- Using a digital voltmeter, you should measure 0 Ohms between the EPM Ground Post and the traffic cabinet ground rod.

SPECIFICATION:	0 Ohms
MEASURED:	

Intersection:	
Camera Serial Number:	
GS₂ Processor Serial Number:	

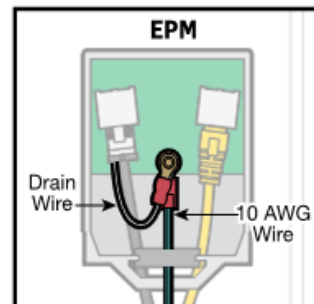

ITEM #1112288A – IP VIDEO DETECTION CAMERA ASSEMBLY

Description: Furnish and install an IP (Internet Protocol) Video Detection Camera Assembly (IPVDCA) as shown on the plans or as directed by the Engineer. The IPVDCA consists of an IP Video Detection Camera, lens, enclosure, mounting hardware and equipment necessary to provide the specified video signal to the video detection processor.

Materials: All hardware shall be new, corrosion resistant. All equipment shall be current production.

IP Video Detection Camera Assembly:

Camera:

- Use appropriate CS-mount lens to provide adequate detection
- Single Power Over Ethernet (POE) connection for power and data collection
- Active picture elements (pixels): 2560 (H) x 1920 (V), minimum
- Heated camera
- IP addressable

Camera Enclosure:

- Tamper proof constructed of aluminum
- IP66-rated camera housing

Camera Mounting Hardware:

- Swivel bracket for dual plane adjustment for leveling
- Hybrid terminal junction box with surge
- Astro-Bracket banded bracket

Environmental:

- Comply with NEMA TS 2, Section 2 requirements for Controller Assembly
- Pass the following NEMA TS 2 tests and applicable test procedures
 - Vibration: Section 3.13.3, Section 3.13.8
 - Shock: Section 3.13.4, Section 3.13.9
 - Transients, Temperature, Voltage and Humidity: Section 3.13.7
 - Power Interruption: Section 3.13.10

Construction Methods:

Site Survey: Perform a Site Survey with the IPVDCA manufacturer’s representative for all IPVDCA locations prior to installation. The purpose of the Survey is to optimize the performance of the IPVDCA equipment when it is installed and ensure that it will meet the accuracy requirements specified. Prior to installation, submit the results of the Site Survey to the Engineer in a report which lists all IPVDCA locations with any recommended changes to camera locations, mounting adjustments, camera lens adjustments, and desired detection zone locations.

Install IPVDCA equipment in accordance with the manufacturer’s instructions and the attached details to achieve the detection zones in the location(s) determined as a result of the Site Survey. Refer to the “Installation Best Practices Guide” attached below to this specification. Note that all references to “Cat5e cable” in the attached “Installation Best Practices Guide” shall refer to “23

AWG 4 Twisted Pair Category 6 Cable” as specified in “Item #1113725A – 23 AWG 4 Twisted Pair Category 6 Cable.”

Documentation: (IPVDCA)

Provide to CTDOT Office of Maintenance three (3) copies of equipment manuals furnished by the manufacturer, including the following:

- Installation and operation procedures
- Performance specifications (functions, electrical, mechanical and environmental) of the unit
- Schematic diagrams (point to point wiring)
- Pictorial of component layout on circuit board
- List of replaceable parts including names of vendors for parts not identified by universal part numbers such as JEDEC/RETMA or EIA
- Troubleshooting, diagnostic and maintenance procedures


Warranties and Guarantees: (IPVDCA)


Provide warranties and guarantees to the CTDOT Office of Maintenance in accordance with Article 1.06.08 of the Standard Specifications. Warranties for all equipment furnished as part of this Contract are to cover a period of 36 months following successful completion of the entire intersection acceptance test.

Method of Measurement: The IP Video Detection Camera Assembly will be measured for payment as the number of each assembly of IP video cameras, lenses, enclosures and mounting hardware furnished, installed, operational and accepted.

Basis of Payment: This item will be paid at the Contract unit price for each “IP Video Detection Camera Assembly” complete and accepted, which price shall include the Site Survey, IP video camera, lens, enclosure, brackets used to attach the IP video camera to a support structure or extension bracket, documentation, warrantee, labor, tools and equipment necessary to provide the specified video signal to the video detection processor.

Pay Item	Pay Unit
IP Video Detection Camera Assembly	ea.

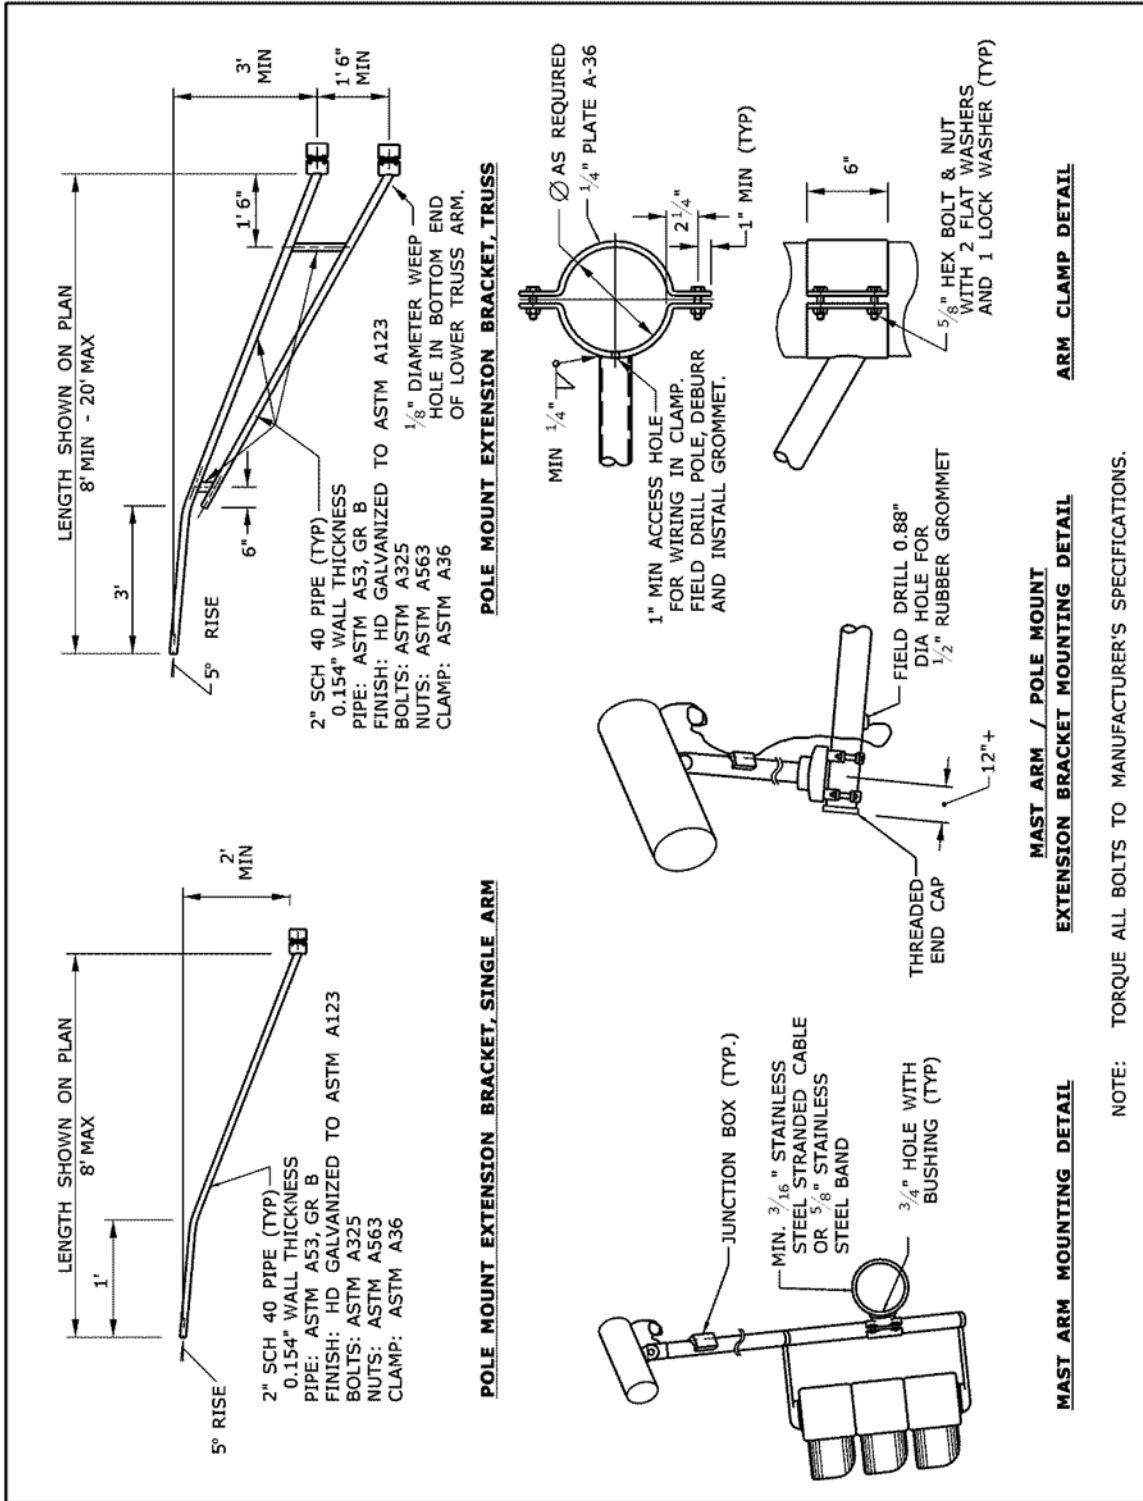

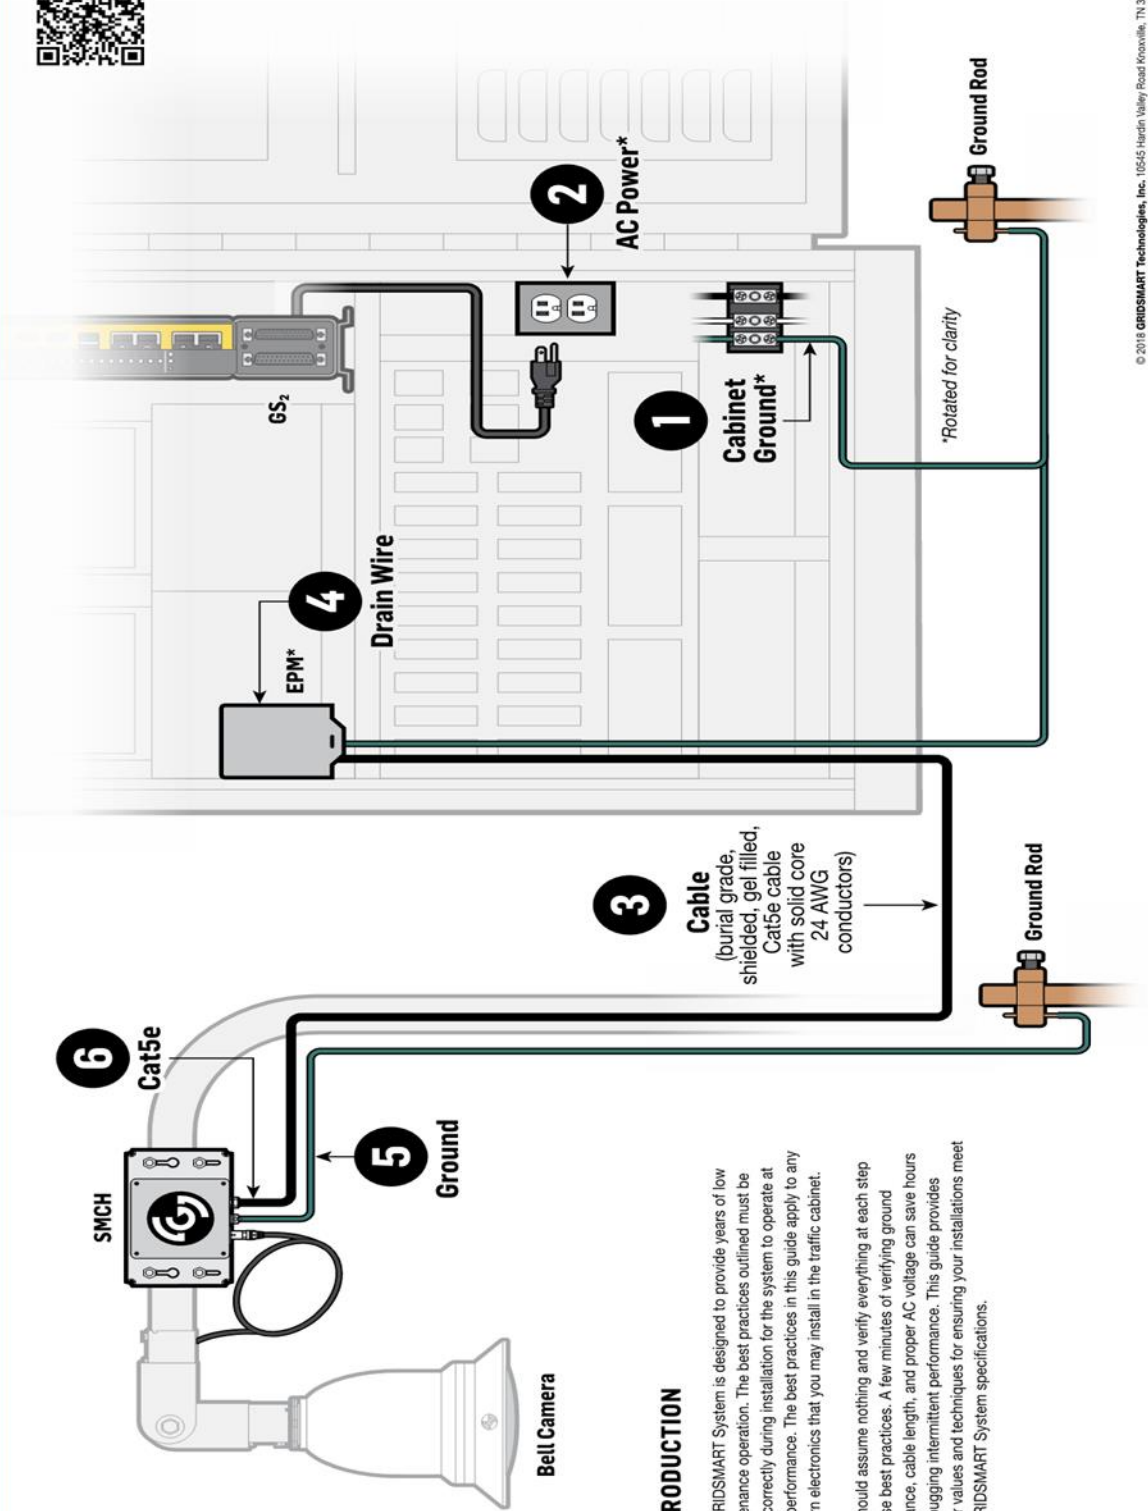

INTRODUCTION


The GRIDSMART System is designed to provide years of low maintenance operation. The best practices outlined must be done correctly during installation for the system to operate at peak performance. The best practices in this guide apply to any modern electronics that you may install in the traffic cabinet.

You should assume nothing and verify everything at each step in these best practices. A few minutes of verifying ground resistance, cable length, and proper AC voltage can save hours of debugging intermittent performance. This guide provides proper values and techniques for ensuring your installations meet the GRIDSMART System specifications.

1 CABINET GROUNDING

A proper cabinet ground helps mitigate interference from electrical noise at the intersection.

- The U.S. National Electrical Code (NEC) recommends a maximum of 25 ohms for touch safety and telecommunications; PLC industry standards require a maximum of 5.0 ohms for logic reference purposes.
- Use a clamp-on ground meter to verify the cabinet ground.
- GRIDSMART requires the Diligent Instruments DLG Di-120b Tester (<http://www.diligentinstruments.com/di-120.html>).
- If the ground reading is higher than the recommended NEC value, check the connection between the cabinet ground wire and the ground rod for corrosion; clean if corrosion is present. If you are in an area with poor grounds, you may need to add a ground rod to the grounding system to improve the ground.

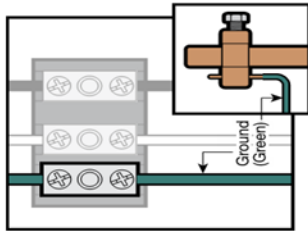

DLG Di-120b Tester




SPECIFICATION: 25 Ohms Max
MEASURED:

2 AC POWER

Plug the GRIDSMART Processor into an outlet on the filtered side of the cabinet power. Do not use GFCI type outlet.

- The outlet needs to be checked to verify that all three connections for the outlet are properly connected.
- Using a digital voltmeter (DVM), check the ac voltage from the line to the neutral and the line to ground. Both readings should be ~ 120/240VAC.



SPECIFICATION: HOT/NEU: 120/240VAC HOT/GND: 120/240VAC
MEASURED: HOT/NEU: HOT/GND:

3 CABLE TYPE & LENGTH

All GRIDSMART installations require burial grade, shielded, gel filled, Cat5e cable with solid core 24 AWG conductors. The shield will protect the data signals from radiated noise which is present in most intersections. LED streetlights have been found to be very noisy electrically and as more streetlights are switched to LED lights, the level of radiated noise will increase. The cable that GRIDSMART supplies and requires for all installations is Vertical Cable part #059-487/S/CMXF.

- The maximum length that a segment of Cat5e can be is 300 feet. If the distance from the EPM to the camera is more than 300 feet, a repeater (RBA) must be used.
- When determining length of the cable, a cable tester that measures the length of the cable is required. Do not rely on sight distance or "walking off" the distance.
- Many times, there are service loops in the pull boxes and at the base of the pole, which will not be accounted for when you do not use a meter for measuring the cable length. GRIDSMART recommends the Triplet Real World Certifier (www.triplett.com/shop/real-world-certifier-rwc1000k/) for testing the cable. The tester will provide length measurements as well as cable quality measurements.



Triplet Real World Certifier




SPECIFICATION: Cable Length: 300 Ft. Max Real World Certification: 100 MB Min Cable Type: Vertical Cable part #059-487/S/CMXF
MEASURED: Cable Length: Real World Certification: Cable Type:

4 CONNECT DRAIN WIRE

The drain wire for the shielded Cat5e cable must be connected to the ground post in the EPM (Ethernet Protection Module). A crimp lug should be attached to the end of drain wire to attach it to the ground post. The drain should only be connected at the EPM end of the cable.

- If you are using an RBA, the drain must be spliced so the drain is continuous from the junction box to the EPM. A 10 AWG Wire is required to connect the EPM ground post to the traffic cabinet ground rod.
- Using a digital voltmeter, you should measure 0 Ohms between the EPM Ground Post and the traffic cabinet ground rod.




SPECIFICATION: 0 Ohms
MEASURED:

5 GROUND CONNECTIONS AT THE SMCH

The SMCH provides lightning protection for the camera.

- Use a 10-AWG wire to connect the SMCH ground lug to a well-grounded structure or a ground rod.
- Verify the resistance to ground of the structure utilizing the clamp on ground tester.

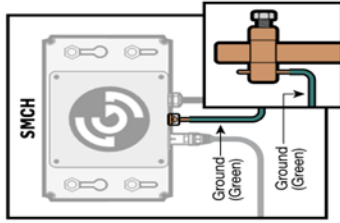


SPECIFICATION: 25 Ohms
MEASURED:

6 CAT5e AT SMCH

Proper terminal of the Cat5e to the SMCH Phoenix connector is required. Carefully implement the following requirements as shown.

- Remove no more than 1-1/2 inch of outer jacket from the end of the cable.
- No less than 1-1/2 inch of cable with outer jacket inside the SMCH.
- Pairs should be twisted as close as possible to the Phoenix connector.
- No more than 1/2 inch of untwisted conductors should be allowed. Strip 1/4 inch of the insulation from each conductor.

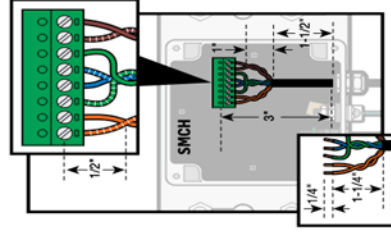

Intersection:
Camera Serial Number:
GS: Processor Serial Number:

ITEM #1113398A – CABLE CLOSURE (TYPE A)

Work under this item shall conform to the requirements of section 11.13 supplemented and amended as follows:

Article M.16.14 - Control Cable:

Subarticle M.16.14 - 5 - Cable Closure: After the only paragraph add the following: The cable closure installed on the figure 8 cable and used to terminate interconnect shall be designated as Type A. This closure shall be weather resistant, contain an inner shield bond and grounding continuity system. All external parts shall be stainless steel. The closure shall be provided with 3 or 4 entrances, dependent on the number of cables terminated in the closure. The main entrance shall accommodate cable with a diameter of 0.4"(10mm) to 1.0"(25mm) and the branch entrance shall accommodate a cable with a diameter of 0.4"(10mm) to 1.0"(25mm). The size of the closure shall be: length 17" (425mm) to 24" (610mm), width 3" (76mm) to 5" (127mm), height 5" (127mm) to 6.5" (165mm). Each closure shall be provided with a minimum of 24 terminals, either screw type or pressure type.

Article 11.13.03 - Construction Methods:

Subarticle 11.13.03 - 3 Cable Closures: After the only paragraph add the following: The Type A cable closures attached to the figure 8 cable shall be used for to provide an access for the 16/6 pair interconnect to the controller cabinet. The locations shall be as listed below and as shown on the plans.

<u>Intersection</u>	<u>Location No.</u>	<u>Pole No.</u>
Fairfield - U.S. Rte. 1 @ Rte. 135	050-201	UI #2001
Fairfield - U.S. Rte. 1 @ Ruane Street	050-207	UI #841
New Haven - Rte 80 @ Rte. 103	092-241	UI #7925
West Haven - Rte. 162 @ Elm Street	156-212	UI#1013
Stratford – U.S. Rte. 1 @ Bruce Avenue	138-201	UI#1149
Stratford – U.S. Rte. 1 @ Soundview Avenue	138-276	UI#48

Only the conductors designated as "Traffic Signal Interconnect Pairs" in the special provisions to the Communication Cable, shall be cut and terminated in these closures. Connection to traffic signal pairs shall be as shown in the Typical Cable Closure Illustration contained herein. The conductors designated as not used shall not be cut at these closures. The Type A Cable Closures shall be installed approximately 3 feet (0.9 m) from the indicated utility pole, unless otherwise directed by the Engineer.

S:\traffic\1406\signal specs\specs\1113398A-cable closure (type A).doc

ITEM #1113431A – #16 AWG, 6 TWISTED PAIR COMMUNICATION CABLE

Article M.16.14 - Control Cable

3 - Cable Add the following:

The communication cable shall be solid conductor, shielded, twisted pair with 600 V polyethylene insulation and polyethylene jacket. The 6 Pair Overhead cable shall be figure 8 type with 6650 lb. test, integral messenger and shall conform in all respects to IMSA Specification 20-4. The 6 Pair cable shall conform in all respects to IMSA Specification 20-2. The Contractor shall furnish a manufacturers warranty that the cable is resistant to damage and deterioration by sustained contact with greases and oil.

Article 11.13.03 - Construction Methods Add the following:

Communication cable shall be installed in new and existing conduit, handholes, attached to utility poles or supported on messenger as shown on the plans or as directed by the Engineer. Communication cable shall be installed continuously without splices from termination point to termination point. Cable termination shall be only on an approved termination panel inside the controller cabinet and on terminal blocks inside a cable closure (type A). All cable pairs that enter a controller cabinet and the cable closure shall be terminated as shown on the typical installation plan The pair numbers and colors for traffic signal interconnect are shown on the plans.

The 6 pair overhead cable shall be attached to utility poles indicated on the plans in accordance with the Communications Cable Attachment List. It shall be the Contractors responsibility to coordinate his activities on a continuing basis with each of the involved utility companies. A minimum of 12" (300mm) clearance shall be maintained above the highest existing communication cable (Frontier Communications [formerly AT&T] or CATV). A minimum of 40" (1000mm) clearance shall be maintained below the lowest power cable (Eversource [formerly Northeast Utilities] or United Illuminating) attachment.

The sag shall match that of the next lower communication cable. In no case shall the figure 8 communication cable be allowed to sag into or near existing cables. A Chicago Grip No.1659 or equivalent shall be used to grip the jacketed messenger when pulling and tensioning the figure 8 cable. At corners and ends, the strand shall be dead-ended with strandvises. At corners, the strand shall be cut and the polyethylene jacket removed from the strand. The ends of the strand coming through the chuck of both strandvises shall be overlapped and bonded together using a bolt guy clamp (J1061) or equivalent. At cable closure locations the strand shall be cut and the jacket removed from a sufficient length of strand. A strand vise shall be installed to reattach the strands. This will provide slack in the conductors to properly connect to the terminal blocks without the use of jumpers.

At closures where there is a full cable cut but no branch circuit, bond all the cable shields together.

At branch circuit closures bond the shields of all cables that enter cable closures and ground the shield in the cabinet as shown on the typical installation plan.

Where the support strand will be connected to a vertical grounding conductor and there is no closure near the pole, only the jacket of the strand shall be removed. The jacket around the shield shall

not be cut. At the end of each workday notify the electric company to complete the connection to the vertical ground.

Provisions shall be made such that in the event of a cabinet knockdown, wherein accidental overvoltage conditions could be produced in the interconnect cable; the location experiencing the problem will be isolated. No other location shall be damaged. In addition, protective devices shall be furnished and installed by the Contractor to positively isolate and protect the system against damage from lightning.

Article 11.13.04 - Method of Measurement: Add the following:

3. The quantity of communication cable to be paid for under these items shall be the actual number of linear feet (meters) of the cable specified, installed, tested, terminated at the points specified, and accepted in place.

Article 11.13.05 - Basis of Payment: Add the following:

3. Communication Cable shall be paid for at the contract unit price per linear foot (meter) for "#16 AWG, (Type), Communication Cable" which price shall include furnishing, installing, connecting and testing the communication cable of the type specified. The price shall also include standoff brackets; grounding and bonding hardware; overvoltage and lightning protection; furnishing all labor, tools, materials, equipment, storage, transportation and other incidentals necessary to complete the work.

<u>Pay Item</u>	<u>Pay Unit</u>
#16 AWG, (Type), Communication Cable	L.F. (m)

ITEM #1113550A – DETECTOR CABLE (OPTICAL)

SYSTEM DESCRIPTION:

The emergency vehicle traffic signal priority control system shall enable designated vehicles to remotely cause the traffic signal controller to advance to and/or hold a desired traffic signal display by using existing controller functions. The control shall be activated at a minimum distance of 1,800 feet (548.6m) along an unobstructed "line of sight" path. The control shall not terminate until the vehicle is within 40 feet (12.2m) of the detector or at the intersection.

The system shall consist of the following components:

- A. Vehicle Emitter which shall be mounted on the emergency vehicle and shall transmit optical energy signals only in the forward direction. If the municipality presently uses optical pre-emption, the emitters shall be of the same manufacture currently used by the Town.
- B. Phase Selector (minimum 2 channel) which shall cause the signal controller to advance to and/or hold the desired traffic signal display for the emergency vehicle. A pre-emption system chassis shall house two phase selectors.
- C. Optical Detector which shall be mounted on or near a traffic signal and shall receive the optical energy signals generated by the Vehicle Emitter.

Detector (Type A), 1 Direction, 1 Channel

- D. Detector Cable (Optical).

System Operation:

- A. The operating sequence shall be initiated when the optical detector receives the required optical energy signal from the Emitter.
- B. The phase selector shall cause the traffic signal controller to advance to and/or hold the desired traffic signal display for the emergency vehicle.
- C. The phase selector shall cause the controller to advance to and/or hold the desired traffic signal display even if the optical energy signals cease before the desired display is obtained.
- D. The phase selector shall allow the traffic signal controller to resume normal operation within ten seconds after optical energy signals cease if the optical energy signals cease after the desired traffic signal display is obtained.
- E. The phase selector shall not respond to optical energy signals from an emergency vehicle if it is already processing optical energy signals from another emergency vehicle.

System Components:

A. Optical Detector:

The optical detector receives the high intensity optical pulses produced by the emitter. These optical energy pulses are transformed by the detector into appropriate electrical signals which are transmitted to the phase selector. The optical detector is mounted at or near the intersection in a location which permits an unobstructed line of sight to vehicular approaches. The units may be mounted on signal span wires, mast arms or other appropriate structures.

1. Shall be of solid state construction.
2. Shall operate over an ambient temperature range of minus 30^o F. to plus 165^o F. (minus 34^o C to plus 74^o C)
3. Shall have internal circuitry potted in a semi-flexible compound to ensure moisture resistance.
4. Shall operate in 5 to 95 % humidity.
5. Shall have a cone of detection of not more than 13 degrees. The detector and/or phase selector shall not sense a pre-emption signal from an emitter outside this cone.

B. Phase Selector:

The phase selector supplies power to and receives electrical signals from the optical detector. When detector signals are recognized as a valid call, the phase selector causes the signal controller to advance to and/or hold the desired traffic signal display. This is accomplished by activating the pre-empt input to the controller.

The phase selector is capable of assigning priority traffic movement to one of two channels on a first-come, first-serve basis. Each channel is connected to select a particular traffic movement from those normally available within the controller. Once a call is recognized, "commit to green" circuitry in the phase selector functions so that the desired green indication will be obtained even if optical communication is lost. After serving a priority traffic demand, the phase selector will release the controller to follow normal sequence operation.

1. Shall include an internal power supply to supply power to the optical detectors.
2. Shall have minimum two-channel operation with the capability of interfacing with an additional phase selector for expansion of channels of operation.
3. Shall have adjustable detector range controls for each channel of operation, from 40 feet (12m) to 1800 feet (548m).
4. Shall have solid state indicator lights for power on and channel called.
5. Shall operate over an ambient temperature range of minus 30^o F. to plus 165^o F. (minus 34^o C to plus 74^o C)

6. Shall operate in 5 to 95 % humidity.

C. Pre -Emption System Chassis:

1. Card cage/slot shall provide all the necessary hardware and harnessing required to allow simple wiring of phase selector to detector outputs and controller inputs..
2. Shall have harness to carry 115VAC and card outputs.
3. Shall include terminal block/strip for connecting the detectors.

D. Detector Cable (Optical):

1. 3-Conductor cable with shield and ground wire.
2. AWG #20 (7x28) stranded.
3. Individually tinned copper strands.
4. Conductor insulation: 600 volt, 167⁰ F. (75 deg. C).
5. 1 Conductor-yellow; 1 Conductor-blue; 1 Conductor-orange.
6. Aluminized mylar shield tape or equivalent.
7. AWG #20 (7x28) stranded uninsulated drain wire
8. DC resistance not to exceed 11.0 ohms per 1000 feet (305m).
9. Capacitance from one conductor to other two conductors and shield not to exceed 48 pf/ft. (157pf/m).
10. Jacket: 600 volts, 176⁰ F. (80 deg. C), minimum average wall thickness – 0.045” (1.14mm).
11. Finished O.D.: 0.3” (7.62mm) max.

System Interface:

System shall be capable of operating in a computerized traffic management system when appropriate interfacing is provided by the computer supplier.

General:

The Contractor shall furnish the manufacturer the phasing diagrams indicating controller sequence and timing.

The Contractor shall secure from the manufacturer a guarantee for the equipment for a period of sixty (60) months, which time shall commence from the date of delivery. Manufacturer shall certify upon request that all materials furnished will conform to this specification. The manufacturer or his designated representative shall be responsible for determining and setting all required range and emitter intensity for the emergency vehicle operation.

Construction Methods:

All equipment except the vehicle emitter assembly shall be installed and wired in a neat and orderly manner in conformance with the manufacturers’ instructions. The vehicle emitter assembly shall be delivered to a designated town representative. Installation of the vehicle emitter assembly shall be the responsibility of the town.

Traffic signals owned and maintained by the State that have optical pre-emption equipment owned and maintained by the town shall have an Auxiliary Equipment Cabinet (AEC) attached to the controller cabinet. The optical pre-emption equipment shall be housed in the AEC. Traffic signals owned and maintained by the town do not require an AEC to house the pre-emption equipment.

Detector cables shall be continuous with no splices between the optical detector and the AEC.

Detector locations shown on the plan are for illustration purposes only. Exact location shall be determined by the contractor or the designated representative for the best possible line of sight.

If not present in an existing traffic controller cabinet, the following items shall be installed and connected, in conformance with the current Functional Specifications for Traffic Control Equipment, "D" Cabinet Requirements (Pre-emption Type):

- Controller "D" harness and adapter.
- Pre-emption termination panel with terminal block and relay bases.
- Pre-emption disconnect switch, mounted on the emergency switch panel (on inside of cabinet door).
- Pre-emption test buttons, mounted on the pre-emption termination panel.

All connections from the phase selector to the "D" harness and to the cabinet wiring shall be made at the termination panel. The termination panel shall have AC+ Lights, AC-, and a switched logic ground. The switched logic ground feeds all the pre-empt inputs to the phase selector. When switched off by the pre-emption disconnect switch, the traffic controller shall not be affected by pre-empt calls from the optical pre-emption system. A minimum of two test buttons shall be provided. If there are more than two pre-empt runs, a button for each shall be installed. A chart or print out indicating the program steps and settings shall be provided along with the revised cabinet wiring diagrams.

Test the Pre-emption System at the semi-final inspection According to the following Guidelines:

1. Notify the system owner/user, such as the municipal fire chief or public works director, of the scheduled inspection
2. Request a fire department representative and an emergency vehicle, which has an emitter to conduct the test. If not available, the contractor shall provide an emitter.
3. In the presence of the Engineer and the municipal representative, test each pre-empted approach with the emergency vehicle. Test the following items of the system:
 - * Confirm that the emitter activates the phase selector and the phase selector activates the correct pre-emption input to the controller.
 - * Confirm adequate range. The traffic signal must be pre-empted to green sufficiently in advance of the emergency vehicle arrival. The vehicle emitter shall initiate pre-emption at a minimum distance of 1800 FT. (548.6m).

- * Confirm there are no false calls. Keep the emitter active as the emergency vehicle passes through the intersection. No other optical detectors shall sense the strobe.
- 4. Document the test. Provide the Engineer and, upon request, the municipality copies of the test results.

If a malfunction is found or the system needs adjustment (such as range, emitter intensity, or detector location), schedule a follow-up test. Repeat the above steps for all approaches that did not pass.

All adjustments such as emitter intensity, phase selector range, sensitivity, detector placement, shall be made at the intersection by the contractor so that the optical pre-emption operates correctly with other major manufacturers' equipment currently owned by the town.

Method of Measurement:

Optical Detectors, Phase Selectors, System Chassis will be measured for payment by the number of each supplied, installed and accepted. Detector Cable (Optical) will be measured by the number of linear feet (meters) supplied, installed and accepted.

Basis of Payment:

Payment for Optical Detectors, Phase Selector, System Chassis and Detector Cable (Optical) will include the item unit cost, including all manufacturer's required mounting hardware and the cost of installation and supervision by the manufacturer or his designated representative, including travel and subsistence, and all materials, equipment and labor incidental thereto. Payment for termination panel, "D" harness, test buttons, program chart (or print out) and revised cabinet wiring diagrams shall be included in the item PRE-EMPTION SYSTEM CHASSIS.

<u>Pay Items</u>	<u>Pay Units</u>
Detector Cable (Optical)	L.F. (m)

ITEM #1113604A – OPTICAL FIBER CABLE, SINGLE MODE, LOOSE BUFFER TUBE CABLE, 6 FIBER

ITEM #1113618A – OPTICAL FIBER CABLE, SINGLE MODE, LOOSE BUFFER TUBE CABLE, 36 FIBER

Description:

This Item specifies the requirements for furnishing, installing in conduit or aerial between utility poles, splicing, and connectorizing fiber optic cables. As part of this item, the Contractor shall install a pull tape in specific conduits within the contract limits of work, as necessary to install the fiber optic cable. The specific areas where pull tape may be required are delineated in the Construction Methods section of this specification.

Materials:

A. General:

1. Outdoor fiber optic cable shall be installed in conduit or aerial between utility poles, spliced as required and terminated in traffic signal cabinets, as shown on the Drawings.
2. A six fiber drop cable shall be utilized to interconnect the thirty-six fiber trunkline cable. The six fiber drop cable shall be installed to all local traffic signal controller cabinets.
3. The fiber optic cable, splices, connectors and interconnect panels shall meet all requirements stated in this Specification.
4. **Optical fiber cable installed for this project shall be dielectric, dry-filled, loose-tubed, duct-type.**

B. Applicable Publications:

1. Publications listed below form a part of this specification to the extent referenced. The publications are referred to in the text by basic designation. All Fiber Optic Communication System hardware shall be compliant with the following specifications:

Electronics Industries Association (EIA):

- a. EIA-310-C Racks, Panels, and Associated Equipment.
- b. EIA-359-A Colors for Color Identification and Coding.
- c. EIA-422-A Electrical Characteristics of Balanced Voltage Digital Interface Circuits.

- d. EIA-TIA-455-A Standard Test Procedures for Fiber Optic Fibers, Cable Transducer Sensors, Connecting and Terminating Devices and Other Fiber Optic Components.
- e. EIA-455-6B Cable Retention Test Procedure for Fiber Optic Cable Interconnecting Devices.
- f. EIA-485 Standard for Electrical Characteristics of Generators and Receivers for use in Balanced Digital Multipoint Systems.
- g. TIA/EIA-598-A Optical Fiber Cable Color Coding.

2. USDA Rural Utilities Service (RUS) 7 CFR 1755.900.

3. ANSI/ICEA Standard for Fiber Optic Outside Plant Communications Cable, ANSI/ICEA S-87-640-1992.

4. UL-listed OFNR

5. CSA-listed FT-4

C. Outdoor Fiber Optic Cable Requirements:

1. The cable shall be an accepted product of the United States Department of Agriculture Rural Utilities Service (RUS) 7 CFR 1755.900 and meet the requirements of the ANSI-ICEA Standard for Fiber Optic Outside Plant Communications Cable, ANSI/ICEA S-87-640-1992.

2. The Outdoor Fiber Optic Cable shall be stranded loose tube cable with the required number of fibers as shown in the Contract Drawings.

3. The Contractor shall provide manufacturer's documentation certifying that the Outdoor Fiber Optic Cable complies with the following performance requirements:

a. When tested in accordance with FOTP-3, "Procedure to Measure Temperature Cycling Effects on Optical Fibers, Optical Cable, and Other Passive Fiber Optic Components," the change in attenuation at extreme operational temperatures of -40 °F and 158 °F (-40°C and +70°C) shall not exceed .24 dB/mile (0.15 dB/km) at 1550 nm for single mode fiber.

b. When tested in accordance with FOTP-82, "Fluid Penetration Test for Fluid-Blocked Fiber Optic Cable." a 3 foot (one-meter) length of unaged cable shall withstand a 3 foot (one-meter) static head or equivalent continuous pressure of water for cable end.

c. When tested in accordance with FOTP-81, "Compound Flow (Drip) Test for Filled Fiber Optic Cable", the cable shall exhibit no flow (drip or leak) of filling and/or flooding material at 158 °F (70°C).

d. When tested in accordance with FOTP-41, "Compressive Loading Resistance of Fiber Optic Cables," the cable shall withstand a minimum compressive load of 125 lbf/in (220 N/cm) applied uniformly over the length of the sample. The 125 lbf/in (220 N/cm) load

shall be applied at a rate of 0.1 inch (2.5 mm) per minute. The load shall be maintained for a period of 1 minute. The load shall then be decreased to 63 lbf/in (110 N/cm). Alternatively, it is acceptable to remove the 125 lbf/in (220 N/cm) load entirely and apply the 63 lbf/in (110 N/cm) load within five minutes at a rate of 0.1 inch (2.5 mm) per minute. The 63 lbf/in (110 N/cm) load shall be maintained for a period of 10 minutes. Attenuation measurements shall be performed before release of the 63 lbf/in (110 N/cm) load. The change in attenuation shall not exceed 0.15 dB at 1550 nm for single-mode fibers and 0.30 dB at 1300 nm for multimode fiber.

- e. When tested in accordance with FOTP-104, "Fiber Optic Cable Cyclic Flexing Test," the cable shall withstand 25 mechanical flexing cycles around a sheave diameter not greater than 20 times the cable diameter. The change in attenuation shall not exceed 0.15 dB at 1550 nm for single mode fiber.
- f. When tested in accordance with FOTP-25, "Repeated Impact Testing of Fiber Optic Cables and Cable Assemblies," except that the number of cycles shall be two at three locations along a 3 foot (one meter) cable length and the impact energy shall be at least 3.25 lb-ft (4.4 Nm) (in accordance with ICEA S-87-640)", the change in attenuation shall not exceed 0.15 dB at 1550 nm for single-mode fiber.
- g. When tested in accordance with FOTP-33, "Fiber Optic Cable Tensile Loading and Bending Test," using a maximum mandrel and sheave diameter of 22 inches (560 mm), the cable shall withstand a rated tensile load of 601 lbf (2670N) and residual load of 30% of the rated installation load. The axial fiber strain shall be $\leq 60\%$ of the fiber proof level after completion of 60 minute conditioning and while the cable is under the rated installation load. The axial fiber strain shall be $\leq 20\%$ of the fiber proof level after completion of 10 minute conditioning and while the cable is under the residual load. The change in attenuation at residual load and after load removal shall not exceed 0.15 dB at 1550 nm for single mode fiber and 0.30 dB at 1300 nm for multimode fiber.
- h. When tested in accordance with FOTP-85, "Fiber Optic Cable Twist Test," a length of cable no greater than 6 feet (2 meters) shall withstand 10 cycles of mechanical twisting. The change in attenuation shall not exceed 0.1 dB at 1550 nm for single mode fiber
- i. When tested in accordance with FOTP-181, "Lightning Damage Susceptibility Test for Optic Cables with Metallic Components," the cable shall withstand a simulated lightning strike with a peak value of the current pulse equal to 80 kA without loss of fiber continuity. A damped oscillatory test current shall be used with a maximum time-to-peak value of 15 μ s (which corresponds to a minimum frequency of 16.7 kHz) and a maximum frequency of 30 kHz. The time to half-value of the waveform envelope shall be from 40 - 70 μ s.

- j. When tested in accordance with FOTP-37, "Low or High Temperature Bend Test for Fiber Optic Cable," the cable shall withstand four full turns around a mandrel of ≤ 20 times the cable diameter after conditioning for four hours at test temperatures of $-22\text{ }^{\circ}\text{F}$ and $140\text{ }^{\circ}\text{F}$ (-30°C and $+60^{\circ}\text{C}$). Neither the inner or outer surfaces of the jacket shall exhibit visible cracks, splits, tears, or other openings. The change in attenuation shall not exceed 0.30 dB at 1550 nm for single mode fiber and 0.50 dB at 1300 nm for multimode fiber.
4. All optical fibers, coatings, tubes, metals and jackets shall be free of roughness, porosity, blisters, splits and voids in accordance with good manufacturing practice.
5. The color coding and position of fibers / buffer tubes within the cable shall be in accordance with TIA/EIA-598-A "Optical Fiber Cable Color Coding". Fibers shall be colored with ultraviolet curable ink. In buffer tubes containing multiple fibers, the colors shall be stable across the specified storage and operating temperature range and not subject to fading or smearing onto adjacent fibers or into the gel filing material. Color materials shall not cause fibers to stick together.
6. The buffer tubes shall be resistant to external forces and shall meet the buffer tube cold bend and shrinkback requirements of 7 CFR 1755.900.
7. The cable shall be suitable for operation over a temperature range of $-40\text{ }^{\circ}\text{F}$ to $158\text{ }^{\circ}\text{F}$ (-40°C to $+70^{\circ}\text{C}$) and shall be suitable for installation in outdoor ducts or installed aerial between wood poles.
8. The cable shall provide mechanical support and protection for the specified number of fibers.
9. The central anti-buckling member shall consist of a dielectric, glass reinforced plastic (GRP) rod. The GRP rod shall be coated with a black colored thermoplastic when required to achieve dimensional sizing to accommodate buffer tubes/fillers.
10. Each buffer tube shall contain a water-swellaable yarn for water-blocking protection. The water-swellaable yarn shall be non-nutritive to fungus, electrically non-conductive, and homogeneous. It shall also be free from dirt or foreign matter. This yarn will preclude the need for other water-blocking material; the buffer-tube shall be gel-free.
11. Buffer tubes shall be stranded around the dielectric central member using the reverse oscillation, or "S-Z", stranding process. Water blocking yarn(s) shall be applied longitudinally along the central member during stranding.
12. A water blocking tape shall be applied longitudinally around the outside of the stranded tubes/fillers. The tape shall be held in place by a single polyester binder yarn. The water blocking tape shall be non-nutritive to fungus and electrically non-conductive.

13. The cable shall be able to withstand a maximum pulling tension of 600 lb (2700 N) during installation without any resulting damage. Tensile strength shall be provided by dielectric yarns. The high tensile strength dielectric yarns shall be helically stranded evenly around the cable core.
14. Non-armored cables shall be sheathed with medium density polyethylene (MDPE). The minimum nominal jacket thickness shall be 0.055 inches (1.4 mm). Jacketing material shall be applied directly over the tensile strength members (as required) and water swellable tape. The polyethylene shall contain carbon black to provide ultraviolet light protection and shall not promote the growth of fungus. The MDPE jacket material shall be as defined by ASTM D1248, Type II, Class C, Category 4 and Grades J4, E7 and E8.
15. The cable shall contain at least one ripcord under the sheath (outer cable jacket) for easy sheath removal of all-dielectric cable.
16. Cable jackets shall be marked with the manufacturer's name, month and year of manufacture, sequential foot (meter) markings, a telecommunication handset symbol as required by Section 350G of the National Electrical Safety Code[□] (NESC[□]), fiber count, and fiber type. The actual length of the cable shall be within -0/+1% of the length markings. The print color shall be white, with the exception that cable jackets containing one or more coextruded white stripes, which shall be printed in light blue. The height of the marking shall be approximately 0.098 inches (2.5 mm).
17. Materials used in the cable shall not produce hydrogen in a concentration large enough to cause any degradation in the transmission performance of the optical fibers.
18. Materials used in the cable shall not support galvanic action.

D. Fiber Optic Trunk Cable:

1. This item consists of furnishing and installing optical fiber cables and connectors of the size and type specified at the locations shown on the Drawings or as indicated by the Engineer, in accordance with these Specifications.
2. Fiber Optic cable shall be installed in conduit, inner-duct, or aerial as shown on the Drawings by the Methods defined in this Specification. Fiber Optic cable shall be installed in the lowest available innerduct in the conduit, as specified below.
3. The Contractor shall provide multiple fiber, stranded, loose tube cable with single mode fiber that shall be suitable for placement in an aerial and underground environment as shown in the Drawings.
4. The Contractor shall provide a manufacturer's certification that the offered cable complies with all optical and mechanical requirements set forth in this Specification. Any deviation of

the offered cable from the specifications set forth herein shall be clearly noted in the Contractor's proposal.

E. Fiber Optic Drop Cables:

1. Drop cables are used for connecting traffic cabinets to the fiber optic trunk cable.
2. The Drop Cable shall consist of single mode fibers housed in a protective jacket. One end of the fiber shall be terminated at a patch panel within the traffic signal cabinet, the other end shall be spliced into a fiber optic trunk cable at an underground or areial Splice Closure within an adjacent handhole or above ground Splice Case attached to the nearest utility pole or wood pole.
3. The drop cables shall be suitable for operation over the temperature range of -40 °F to 158 °F (-40° C to +70° C).
4. Drop Cables shall be of length suitably long to be connected to the rack mounted fiber optic transmission equipment within the Camera Hub and the fiber optic cable splice case or splice enclosure in the adjacent pullbox. Sufficient slack shall be left at each end to allow removal of the Splice enclosure and trays.
5. The attenuation of Drop Cable after installation, not including the connector loss, shall not exceed 0.15 dB measured at 1310 nm and 1550 nm.
6. All optical fiber cable used for a drop cable shall comply with all other aspects of these Specifications for optical fiber cable as set forth. The drop cable shall be spliced and connected as shown in the Drawings and within these Specifications.

F. Single Mode Optical Fibers:

1. The Single Mode fiber shall consist of a doped silica core surrounded by a concentric silica cladding. The fiber shall be matched clad design.
2. The dispersion un-shifted or dispersion flattened single mode fiber shall conform to the following specifications:
 - a. The Single Mode fiber core shall have a diameter of between 8.2 to 9 μm inclusive with a tolerance of $\pm 1.3 \mu\text{m}$.
 - b. The Single Mode fiber cladding shall have an outer diameter of 125 μm with a tolerance of $\pm 0.7 \mu\text{m}$.
 - c. The core-to-cladding offset shall not be greater than 0.5 μm .
 - d. The cladding Non-Circularity shall not be greater than 0.7% defined as:
(Minimum Cladding Diameter/Maximum Cladding Diameter) x 100
 - e. The Single Mode fiber shall be coated with a protective polymer to preserve the strength of the fiber. The coating shall be removable by mechanical or chemical means. The coating shall retain its color when subject to the manufacturer's recommended fiber cleaning and splicing preparation methods.
 - f. The SM fiber shall have attenuation and bandwidth specified at two wavelength windows.
 - i. The first wavelength window shall be at and around 1310 nm.
 - ii. The second wavelength window shall be at and around 1550 nm.
3. The maximum optical attenuation at 1310 nm shall not be greater than 0.64 dB/mile (0.4 dB/km).
4. The maximum optical attenuation at 1550 nm shall not be greater than 0.48 dB/mile (0.3 dB/km).
5. The fiber attenuation shall not vary more than 0.32 dB/mile (0.2 dB/km) over the specified cable operational temperature range.
6. The zero dispersion wavelength shall be at a wavelength of $1310 \pm 10 \text{ nm}$.
7. The maximum dispersion at 1550 nm shall not exceed 18 ps / (nm-km).
8. The maximum dispersion in the wavelength range of 1285 to 1330 nm shall not exceed 3.2 ps / (nm-km).

G. Fiber Optic Connectors:

1. The connector shall have a ceramic ferrule with a nickel-plated nut and body.
2. The connector shall be of the SC-type and fully compatible with the fiber optic cable utilized and the mating jacks to which they will be attached.
3. The connector shall be compatible with an ultra physical contact (UPC) finish. All connectors shall be polished to a UPC finish with a minimum 30 dB connector return loss.
4. The connector mean loss shall not be greater than 0.2 dB with a standard deviation of not greater than 0.1 dB.
5. Index matching fluids or gels shall not be used.
6. The connector loss shall not vary more than 0.2 dB after 500 repeated matings.
7. The connector shall withstand an axial load of 11.2 lb (50 N) at 0° pull out angle with strength members and 0.5 lb (2.2 N) at 0° pull out angle without strength members.
8. The connectors shall be attached in accordance with the manufacturer's recommended materials, equipment and practices.
9. The connector shall be suitable for the intended environment and shall meet the following environmental conditions.
 - a. Operating Temperature: -4 °F to 122 °F (-20 to +50° C)
 - b. Storage Temperature: -22 °F to 140 °F (-30 to +60° C)
 - c. The connector loss shall not vary more than 0.2 dB over the operating temperature range.
 - d. Connectors shall be protected by a suitably installed waterproof protection cap.

H. Fiber Optic Cable Fabrication:

1. Packing and Shipment

- a. The cable shall be supplied on reels. Top and bottom end of the cable shall be available for testing. Both ends of the cable shall be sealed to prevent ingress of moisture.
- b. The optical cable shall be in one continuous length per reel with no factory splices in the fiber. Each reel shall be marked to indicate the direction the reel should be rolled to prevent loosening of the cable. Installation procedures and technical support shall be furnished upon request.
- c. Each reel shall have the following information clearly labeled on it:
 - i. Customer
 - ii. Customer order number
 - iii. Reel number
 - iv. Destination
 - v. Ship date
 - vi. Manufactured date
 - vii. Manufacturer's name
 - viii. Cable code
 - ix. Length of cable

I. Pull Tape

1. The pull tape shall be NEPTCO Part No. DP1250P, or approved equal, for cable sizes of less than 97 fibers.
2. The detectable pull tape shall have the following properties:
 - 1250 lb (5.56 kN) tensile strength
 - flat, not round, construction
 - printed foot markings
 - pre-lubricated for reduced pulling tension at start of cable pull
 - low susceptibility to absorption of moisture; moisture resistant

J. Warranty:

1. All equipment supplied for this shall be warranted for parts and labor by the vendor against defects and failures, which may occur through normal use for a period of one (1) year from the date of installation. A copy of the warranty must be presented to the Engineer before installation of the equipment.

K. Quality Assurance:

1. The Contractor shall have a Quality Assurance Program in place.
2. A minimum of ten (10) year's experience in the design, manufacture, and testing of Fiber Optic Cable and Connectors is required. The cable and connectors shall be designed and manufactured according to world-class quality standards. The manufacturer shall be ISO 9001 certified.

Construction Methods:

A. Submittals:

1. Submit:
 - a. Functional block diagrams, cabling diagrams, and point to point cabling details, including locations of all trunk cable splice points (both drop cable splices and reel-end splices.)
 - b. As built drawings including a cable route diagram indicating the actual cable route and "foot (meter) marks" for all interchanges, intersections, directional change points in the cable routing, and all termination points. The Contractor shall record these points during cable installation. Cable system "as-built" drawings showing the exact cable route shall be provided by the Contractor to ConnDOT. Information such as the location of slack cable and its quantity shall also be recorded in the cable route diagram.
 - c. Product data, manufacturer's test certifications, installation manuals, materials, system configuration options and features, and accessories.
 - d. Shop Drawings shall be completely dimensioned and shall indicate the intended installation method and details.
 - e. Specifications of cable, connectors, and fiber splice kits.
 - f. Operating and maintenance manuals for all equipment.
 - g. Vendor Optical Time Domain Reflectometer (OTDR) certification for each reel of fiber optic cable listing each specification compliant fiber by fiber color code and group color code.

B. Delivery, Storage, and Handling:

1. The Contractor shall deliver, store, handle and install all materials and equipment in such a manner as not to degrade quality, serviceability or appearance.

2. The Contractor shall be responsible for storage of the materials and equipment prior to installation in a clean, dry location free from construction dust, precipitation and excess moisture.
3. Contractor shall be required to replace any damaged materials and equipment, as determined by the Engineer, at no additional cost to the owner.
4. Cable shall be transported to site using cable reel trailers.
5. Care shall be taken at all times to avoid scraping, denting, or otherwise damaging the cable before, during or after installation. Damaged cable shall be replaced by the Contractor without additional compensation.
6. Sufficient slack shall be pulled to allow cable cutting and connection to communications equipment.

C. Installation in Ducts or Conduit:

1. Cable shall be installed in innerduct, duct or conduit in the field in accordance with the Contract Drawings.
2. The Contractor shall install cables in innerducts consistently throughout the project; crossover of a cable from one innerduct to another is not allowed.
3. Duct and conduit ends shall have all rough ends smoothed to prevent scraping the cable.
4. Where cable will be installed directly in new or existing conduit with no innerduct, a stiff bristle brush shall be pulled through each section of conduit before installing a pull tape. Once a pull tape is installed the contractor will then install the fiber optic cable.
5. The Contractor shall not exceed the manufacturer's recommended safe pulling tension and minimum bending radius during delivery and installation.
6. A manufacturer's recommended lubricant shall be applied to the cable to reduce friction between the cable and the duct.
7. A cable grip shall be attached to the cables so that no direct force is applied to the optical fiber. The cable grip shall have a ball bearing swivel to prevent the cable from twisting during pulling.
8. Cable rollers and feeders and winch cable blocks shall be used to guide the cable freely into the duct and at maintenance hole locations.
9. Mechanical aids and pulling cable or ropes shall be used as required.

10. The Contractor shall employ personnel at as many pull points as need be to achieve the longest continuous cable segment as possible to reduce the need for excessive main-line splices.
11. Personnel equipped with two-way radios shall be stationed at each maintenance hole, cabinet and communications vault at which the cable is to be pulled to observe and lubricate the cable.
12. Where mechanical pulling is required (i.e. all runs greater than 164 feet (50 m), a dynamometer shall be used to record installation tension and a tension limiting device shall be used to prevent exceeding the maximum pulling tension as defined by the cable manufacturer. The maximum pulling tension shall be recorded for each run of cable. The cable shall be taken up at intermediate pulling points with an intermediate cable take-up device as approved by the Engineer to prevent over tension on the cable. Cable pulls shall be continuous and steady between pull points and shall not be interrupted until the entire run of cable has been pulled.
13. Trunk fiber cable segment lengths shall be the maximum tolerable length within the maximum pulling tension defined by the manufacturer. The number of trunk cable reel-end splices shall be minimized. The Contractor shall provide a plan to the Engineer showing the reel-end splice point locations following a field investigation of the conduit and shall not install cable until receiving the Engineer's approval of the reel-end splice location plan. The Contractor shall obtain the Engineer's approval for all required changes to the reel-end splice point location plans. Cable segments installed with reel-end splices not approved by the Engineer will be replaced by the Contractor at no additional cost to the Department.
14. The Contractor shall be responsible for ensuring the cable length is sufficient to allow for connection between the communication equipment and the splice enclosures including provision for slack, vertical runs, cable necessary for splicing, wastage and cable to allow for the removal of the splice enclosure for future splicing.
15. Drop Cable fibers in the Camera Hub Cabinets shall be connectorized and the Active Fiber connected directly to the Optical Video/Data Transceiver. The Spare Fiber with Connector shall be safely and securely attached to the interior of the equipment rack with plastic ties. The cable shall not be stressed beyond the minimum bending radius at any time.
16. All cable ends, connectors, and fiber optic jacks shall be protected from moisture ingress by using properly sealed caps.
17. Following installation of the cable in the ducts or conduit, all duct and conduit entrances at pedestals and cabinets shall be sealed with duct sealing compound to prevent the ingress of moisture, foreign materials, and rodents.

18. 50 feet of cable going to and coming from each Splice Closure shall be coiled in the first maintenance hole on each side of each splice closure. In addition, 50 feet of cable shall be left coiled in the first maintenance hole for the fiber optic drop cable.
19. Where trunk cable terminations are left “dead ended”, 100 feet (30 m) of cable shall be left coiled.
20. All coiled cables shall be securely fastened in place with a minimum of four galvanized steel conduit straps.
21. At intermediate pulling points, to prevent over tension on the cable, the cable shall be either taken up with an intermediate cable take up device as approved by the Engineer, or all excess cable shall be laid out on the ground in a figure eight configuration before subsequent installation.
22. Following installation in duct, a label shall be affixed to each cable end in a pull box or cable vault and the label shall contain the following information:
 - Customer order number
 - Reel number
 - Ship date
 - Manufactured date
 - Manufacturer's name
 - Cable designation as shown on the Drawings
 - Length of cable to next reel-end splice point
 - Location of other end of cable (reel-end splice point)
 - Cable test data

D. Aerial Installation:

1. The Contractor shall provide the proper clearance between the aerial cable and the adjacent electric or telephone service cable. This is to assure the proper gain is attained between cables. The Contractor shall verify the proper clearance with the appropriate utility company.
2. Cables shall be double lashed to messenger supports.
3. Cables shall be attached to existing wood poles with 3-bolt suspension clamp with J-hooks. Cable lashings shall be provided on either side of the wood pole.
4. Cable guards shall be provided at bends to ensure proper termination of lashing wire and insertion of spacers at each pole location as shown on the plans.

5. 75 feet of cable going to and coming from each Splice Closure shall be coiled in an aerial snow shoe bracket on each side of each splice closure. In addition, 75 feet of cable shall be left coiled in the first maintenance handhole for the fiber optic drop cable.

E. Splicing:

1. Splicing of the cable shall only be permitted at splice enclosure, splice case or field fiber optic interconnect panel locations as indicated in the Drawings, unless authorized by the Engineer.
2. The Contractor shall prepare for splicing the designated fibers of the cable to the Drop Cables connecting the communications equipment located in the Camera cabinets. Sufficient cable shall be coiled in the pullbox/cabinet to allow for consumption during the splicing and to permit the splice closure to be removed from the pullbox/cabinet for future splicing.
3. At least 3 feet (1.0m) of each fiber shall be stored in the splice trays. The Contractor shall further splice all additional fibers provided in order to meet the fiber requirements specified in the Contract and including any fibers provided which are additional to the Contract requirements.
5. For aerial installations, the Contractor shall install splice cases constructed with a watertight cover assembly to prevent ingress of moisture. Splice cases shall be provided with clamp assemblies and end caps to securely fasten the splice trays.
6. Aerial splices shall only be done at existing wood poles. Splice cases shall be installed to one side of the wood pole to allow for the free movement of optical fiber cable from the splice case to the duct entrance of an adjacent conduit riser or to accommodate the direction change of a 12 Fiber drop cable.

F. Testing:

1. Test Documentation:
 - a. The Contractor shall be responsible for all testing and documentation required to establish approval and acceptance of this Item.
 - b. The Contractor shall submit test procedures and documented test results to the Engineer. The test procedures shall document the nature of test activities to be performed.
 - c. The test procedures shall be submitted to the Engineer prior to initiation of the testing. The procedures will be returned to the Contractor within two weeks indicating either “accepted” or “make corrections noted”. If corrections are required, the Contractor shall submit revisions within 1 week.

- d. Four copies of the final test procedures shall be submitted to the Engineer prior to commencement of testing.

2. Pre-Installation Testing:

- a. Reels of cable shall be tested for attenuation prior to installation in ducts. The Contractor shall measure and record the attenuation of 100% of the total single mode fibers on each reel. Attenuation shall meet or exceed the specified performance requirements in accordance with the Contract.
- b. The Contractor shall ensure that specifications for the fiber optic cable are met prior to installation.

3. Proof of Performance Testing:

- a. The Contractor shall measure the attenuation per mile (kilometer) of fiber in each length of cable after installation.
- b. The Contractor shall measure the attenuation of a randomly selected minimum of 10% of the total single mode fibers, which will be connected to equipment.
- c. All (100%) of optical fibers assigned to be spare or reserved shall be individually tested for optical attenuation.
- d. The Contractor shall sequence the fibers which are to be measured after each pull, such that the same fibers are not measured on consecutive lengths.
- e. The Contractor shall record the reel number from which the cable came, the identification of the fibers measured and the attenuation in dB/mile (dB/km) of the fibers measured.
- f. The Contractor shall measure and record the splice quality of each fusion splice performed. The Engineer shall be provided with access to interim results.

4. Optical Time Domain Reflectometer (OTDR) Testing:

- a. The Contractor shall perform Single Mode Fiber OTDR testing after each cable has been installed.
- b. The Contractor shall provide the Engineer with information regarding OTDR test equipment make and model with the equipment calibration procedures and certification dates prior to conducting the test routine.
- c. An OTDR shall be used for backscattered light measurements. The OTDR shall operate at a nominal wavelength of 1310 nm and 1550 nm and shall include all necessary hardware required to couple it with single mode fiber.

- d. The backscatter light measurement of each single mode fiber and each single mode optical link shall be measured in both directions and at both 1310 nm and 1550 nm wavelengths. Each single mode optical link shall be defined as being the total length of interconnected single mode fibers and the splices which form a continuous end-to-end optical link.
- e. The Contractor shall maintain a test result record of each single mode optical link and each single mode fiber by means of printer copy of the OTDR measured cable attenuation profile. Single mode optical links shall be identified in the test results by identifying the fiber under test and by identifying the cabinet site at which the OTDR was connected.
- f. The test results shall include the following measurements:
 - i. Total length of the single mode link
 - ii. Total attenuation of the single mode link
 - iii. Attenuation of each splice in the link under test
 - iv. Attenuation per mile (kilometer) of each interconnected fiber in the link under test
- g. Attenuation shall be measured in decibels referencing optical power.
- h. Each single mode fiber and splice tested shall be tested to meet the performance requirements in accordance with the Contract. Fiber strands failing this test shall be re-terminated and re-tested.

Method of Measurement:

Work under this item shall be measured for payment by the number of linear feet (meter) of "Optical Fiber Cable - SM, LB Tube Cable" of the type indicated, furnished and installed, as specified and shown on the Drawings.

Basis of Payment:

The work to be done under this item shall be paid at the Contract unit price for each foot (meter) of the Optical Fiber Cable - SM, LB Tube Cable" of the type indicated, furnished and installed as described in this Specification. This work shall include all cable, connectors, splicing, equipment, pull tape, materials and incidental items required to satisfy these Specifications.

Splice enclosures will be furnished and installed separately under Item 1112242A "Fiber Optic Cable Splice Enclosure (Signal)".

PAY ITEMS

Optical Fiber Cable – SM, LB Tube Cable, 6 Fiber
Optical Fiber Cable – SM, LB Tube Cable, 36 Fiber

PAY UNIT

LF (m)
LF (m)

ITEM #1114201A – AUXILIARY EQUIPMENT CABINET

Description:

Furnish and install an Auxiliary Equipment Cabinet (AEC), on a traffic control cabinet at the location shown on the plans and in accordance with the conditions set forth.

Materials:

- Conform to NEMA 3R enclosure specifications
- Type 5052-H32, 3.175mm (0.125") sheet aluminum
- Finish painted in accordance with the current D.O.T. specifications of Traffic Control Cabinets
- Seams continuously welded and ground smooth
- Dimensions as shown on D.O.T. Standard Sheets
- Door secured with Corbin lock - Ct. # 2.
- Continuous door hinge, 2.4mm (0.093") thick aluminum with 0.64mm (0.025") stainless steel hinge pin
- Door sealed with oil resistant gasket
- Back panel approximately 330mmH X 229mmW (13"H X 9"W)
- Rust and corrosion resistant mounting hardware
- Screened Vent

Construction Methods:

Mount the AEC on the left side of the controller cabinet, when facing the door. Confirm that the inside of the cabinet wall is clear, so that the installation of the AEC will not damage any equipment inside the controller cabinet. Drill a 25mm (1") hole in the back of the AEC and through the side of the controller cabinet. Install a close nipple through the 25mm (1") hole. Apply clear silicon caulk to both ends of the close nipple. Tighten lock-nuts and fiber bushings. Apply additional caulk if necessary to prevent moisture from entering controller cabinet and auxiliary equipment cabinet.

Method of Measurement:

This item shall be measured for payment by the actual number of Auxiliary Equipment Cabinets installed and accepted on traffic control cabinets.

Basis of Payment:

This item shall be paid for at the contract unit price each for "Auxiliary Equipment Cabinet" which price shall include mounting hardware, close nipple, insulated bushings, tools, and incidentals.

ITEM #1116110A – BLANK-OUT SIGN

Section 11.16 is amended as follows:

Article 11.16.02 - Materials:

Replace “M.16.18” with “M.16.17”.

Article M.16.17 - Illuminated Signs:

Replace with the following:

The sign shall be a blank-out type which shall display the legend shown on the plans. Shop drawings of the front panel showing the lettering and the type of visor shall be submitted for review.

The blank-out sign shall conform to the following requirements:

General:

- Text as shown on plan.
 - Text size: 6” series E with 4.5” vertical spacing.
- Comply with current MUTCD standards.
- Casing size: As shown on the plan.
- Weight: not more than 10 lbs./ square ft. including frame.
- Operational between -40 degrees F (-40 C) to 160 degrees F (74C).
- Capable of flash operation with no restrictions or degradation of performance.
- Manufacturer recommended mounting bracket and hardware.
- Warrantee:
 - Includes shipping to and from manufacturer.
 - Start date is final acceptance date.
 - Defects: 2 years.
 - LED light source: 5 years.
 - Power Supply: 2 years.

Housing:

- Body and door frame: Extruded 6063-T6 or 5052-H32 aluminum, 0.125” thick.
- All brackets and hardware shall be painted black by the manufacturer. The color shall be No. 17038, Federal Standard No. 595.
- Minimum 4 weep holes in bottom.
- Removable visor to prevent sun reflection. Outside powder coated to match frame. Inside powder coated flat black.
- All corners and seams shall be continuously welded and there shall be a neoprene gasket between the door and display lens to provide a fully weatherproof seal.

- Stainless steel external mounting hardware and internal hardware.
- Cable entrance designed to prevent entrance of dirt, moisture, & insects.
- Clearly stamp, etch or permanently mark on the housing the following information:
 - Manufacturer & model number.
 - Date of manufacture.
- Face: UV stabilized clear, vandal resistant, non-glare, polycarbonate.

Optical Unit:

- Blank out. Not legible when not illuminated.
- Clearly legible in direct sunlight when illuminated.
- LED light sources that comply with current CT Department of Transportation specifications and with current ITE specifications.
- Intensity degradation no more than 10% per year.
- Extended view. Visible cone not less than 20 degrees.
- Text and symbol size as shown on the plans.
- Symbol color: White, Yellow, or Red as required or as shown on plans.
- Text color: White against black background.
- Photocells shall include night-time dimming circuitry.

Electrical:

- Parallel circuit designed so loss of 5% of individual LED light sources does not compromise legend or message.
- Operating voltage: 12VDC.
- Maximum power requirement: 100 Watts.
- External power supply mounted in controller cabinet.
 - Off-the-shelf type with readily available replacement components.
 - Designed to protect LED's from electrical surges and transient voltages.
 - Sufficient VA rating to continuously operate minimum two signs.

Article 11.16.05 – Basis of Payment:

In the first sentence, after “Overhead Illuminated ‘Stop Ahead’ Sign” insert “, Blank-Out Sign”.

Add the following Pay Item and Pay Unit:

Blank-Out Sign Ea.

ITEM #1118012A – REMOVAL AND/OR RELOCATION OF TRAFFIC SIGNAL EQUIPMENT

Section 11.18: Replace the entire section with the following:

11.18.01 – Description:

Remove all abandoned traffic signal equipment. Restore the affected area. Where indicated on the plans remove and reinstall existing traffic signal equipment to the location(s) shown.

Lead paint is presumed present on the painted surface of all cabinets and structures located within project limits. Any activities performed by the contractor that results in a painted surface being impacted or altered, shall be performed in accordance OSHA Lead in Construction Standard 29CFR 1926.62, or the painted surface shall be tested prior to any paint being disturbed by a qualified third party hired by the contractor to confirm that no lead is present.

11.18.02 – Materials:

The related sections of the following specifications apply to all incidental and additional material required for the proper relocation of existing equipment and the restoration of any area affected by this work.

- Division III, “Materials Section” of the Standard Specifications.
- Current Supplemental Specifications to the Standard Specifications.
- Applicable Special Provisions to the Standard Specifications.
- Current Department of Transportation, Functional Specifications for Traffic Control Equipment.

Article 11.18.03 - Construction Methods:

Schedule/coordinate the removal and/or relocation of existing traffic signal equipment with the installation of new equipment to maintain uninterrupted traffic signal control. This includes but is not limited to vehicle signals and detectors, pedestrian signals and pushbuttons, co-ordination, and pre-emption.

Abandoned Equipment

The contract traffic signal plan usually does not show existing equipment that will be abandoned. Consult the existing traffic signal plan for the location of abandoned material especially messenger strand, conduit risers, and handholes that are a distance from the intersection. A copy of the existing plan is usually in the existing controller cabinet. If not, a plan is available from the Division of Traffic Engineering upon request.

Unless shown on the plans it is not necessary to remove abandoned conduit in-trench and conduit under-roadway

When a traffic signal support strand, rigid metal conduit, down guy, or other traffic signal equipment is attached to a utility pole, secure from the pole custodian permission to work on the pole. All applicable Public Utility Regulatory Authority (PURA) regulations and utility company requirements govern. Keep utility company apprised of the schedule and the nature of the work. Remove all abandoned hardware, conduit risers, and down guys, Remove anchor rods, to 6" (150mm) below grade.

When underground material is removed, backfill the excavation with clean fill material. Compact the fill to eliminate settling. Remove entirely the following material: pedestal foundation; controller foundation; handhole; pressure sensitive vehicle detector complete with concrete base. Unless otherwise shown on the plan, remove steel pole and mast arm foundation to a depth of 2 feet (600mm) below grade. Restore the excavated area to a grade and condition compatible with the surrounding area.

- If in an unpaved area apply topsoil and establish turf in accordance with Section 9.44 and Section 9.50 of the Standard Specifications.
- If in pavement or sidewalk, restore the excavated area in compliance with the applicable Sections of Division II, "Construction Details" of the Standard Specifications.

Relocated Equipment

In the presence of the Engineer, verify the condition of all material that will be relocated and reused at the site. Carefully remove all material, fittings, and attachments in a manner to safeguard parts from damage or loss. Replace at no additional cost, all material which becomes damaged or lost during removal, storage, or reinstallation.

Salvage Equipment

Salvage Material	Stock No.	Value
Controller Cabinet, Complete including but not limited to the following: Conflict Monitor Coordination Equipment Vehicle Detection Equipment	330-03-7010	\$ 500.00
Controller Unit	330-03-7005	\$ 500.00
Aluminum Pedestal		
8 foot (2.4 m)	330-16-7108	\$ 100.00
4 foot, 4 inch (1.3 m)	330-16-7112	\$ 100.00
Steel Span Pole, 30' (9.0 m)	330-16-7050	\$ 250.00
Steel Span Pole, all other lengths	330-16-7016	\$ 250.00

All material not listed as salvage becomes the property of the Contractor; which assumes all liabilities associated with material's final disposition.

In the presence of the Engineer, verify the condition and quantity of salvage material prior to removal. After removal transport and store the material protected from moisture, dirt, and other damage. Coil and secure copper cable separate from other cable such as galvanized support strand.

Within 4 working days of removal, return the State owned salvage material to the Department of Transportation Stores warehouse listed below. Supply all necessary manpower and equipment to load, transport, and unload the material. The condition and quantity of the material after unloading will be verified by the Engineer.

DOT Salvage Store #506
1640 Saybrook Rd.
Haddam, CT

Contact Materials Management Salvage Coordinator, at (860) 345-2558, at least 24 hours prior to delivery.

All other State owned Salvage material to be returned to the Department of Transportation Stores Warehouse listed below.

DOT Salvage Store #134
660 Brook Street
Rocky Hill, CT

Contact Materials Management Salvage Coordinator, at (860) 258-1980, at least 24 hours prior to delivery.

Municipal Owned Traffic Signal Equipment

Return all municipal owned material such as pre-emption equipment to the Town.

Article 11.18.04 – Method of Measurement:

This work will be measured as a Lump Sum.

Article 11.18.05 – Basis of Payment:

This work will be paid for at the contract lump sum price for “Removal and/or Relocation of Traffic Signal Equipment” which price shall include relocating signal equipment and associated hardware, all equipment, material, tools and labor incidental thereto. This price shall also include removing, loading, transporting, and unloading of signal equipment/materials designated for salvage and all equipment, material, tools and labor incidental thereto. This price shall also include removing and disposing of traffic signal equipment not to be salvaged and all equipment, material, tools and labor incidental thereto.

Payment is at the contract lump sum price for “Removal and/or Relocation of Traffic Signal Equipment” inclusive of all labor, vehicle usage, storage, and incidental material necessary for the complete removal of abandoned equipment/material and/or relocation of existing traffic signal equipment/material. Payment will also include the necessary labor, equipment, and material for the complete restoration of all affected areas.

A credit will be calculated and deducted from monies due the Contractor equal to the listed value of salvage material not returned or that has been damaged and deemed unsalvageable due to the Contractor's operations.

Pay Item	Pay Unit
Removal and/or Relocation of Traffic Signal Equipment	L.S. (L.S.)

s:\traffic1406\signal specs\specs\1118012A-REMO & RELO T S EQUIP-Projects

ITEM #1118051A – TEMPORARY SIGNALIZATION (SITE NO. 1)

ITEM #1118052A – TEMPORARY SIGNALIZATION (SITE NO. 2)

ITEM #1118053A – TEMPORARY SIGNALIZATION (SITE NO. 3)

ITEM #1118054A – TEMPORARY SIGNALIZATION (SITE NO. 4)

ITEM #1118055A – TEMPORARY SIGNALIZATION (SITE NO. 5)

ITEM #1118056A – TEMPORARY SIGNALIZATION (SITE NO. 6)

ITEM #1118057A – TEMPORARY SIGNALIZATION (SITE NO. 7)

ITEM #1118058A – TEMPORARY SIGNALIZATION (SITE NO. 8)

ITEM #1118059A – TEMPORARY SIGNALIZATION (SITE NO. 9)

ITEM #1118060A – TEMPORARY SIGNALIZATION (SITE NO. 10)

ITEM #1118071A – TEMPORARY SIGNALIZATION (SITE NO. 11)

ITEM #1118072A – TEMPORARY SIGNALIZATION (SITE NO. 12)

ITEM #1118073A – TEMPORARY SIGNALIZATION (SITE NO. 13)

ITEM #1118074A – TEMPORARY SIGNALIZATION (SITE NO. 14)

ITEM #1118075A – TEMPORARY SIGNALIZATION (SITE NO. 15)

ITEM #1118076A – TEMPORARY SIGNALIZATION (SITE NO. 16)

ITEM #1118077A – TEMPORARY SIGNALIZATION (SITE NO. 17)

ITEM #1118051A, 1118052A, 1118053A, 1118054A
1118055A, 1118056A, 1118057A, 1118058A, 1118059A,
1118060A, 1118071A, 1118072A, 1118073A, 1118074A,
1118075A, 1118076A, 1118077A

Description:

Work under this item shall consist of providing Temporary Signalization (TS) at the intersections shown on the plans

1. Existing Signalized Intersection: The Contractor shall keep each traffic signal completely operational at all times during construction through the use of existing signal equipment, temporary signal equipment, new signal equipment, or any combination thereof once TS has started as noted in the section labeled “Duration.”

2. Unsignalized Intersection: The Contractor shall provide TS during construction activities and convert the temporary condition to a permanent traffic signal upon project completion. The Contractor shall furnish, install, maintain, and relocate equipment to provide a complete temporary traffic signal, including but not limited to the necessary support structures, electrical connection and disconnection (if required) and energy supply, vehicle and pedestrian indications, vehicle and pedestrian detection (paid for under Item #11112XXA – Temporary Detection {Site No. X}), pavement markings, and signing.

Materials:

- Pertinent articles of the Standard Specifications
- Supplemental Specifications and Special Provisions contained in this contract

Construction Methods: The Contractor shall perform a Preliminary Inspection and submit a Temporary Signalization (TS) Plan as described herein. No physical work will be allowed at any location until the requirements of the Preliminary Inspection and Temporary Signalization (TS) Plan have been met.

1. Preliminary Inspection

Prior to beginning any physical work, the Contractor shall meet with the Engineer and a representative from the DOT Electrical Maintenance Office (Town representative for a Town owned signal), to inspect and document (for the Engineer’s concurrence) the existing traffic signal’s physical and operational condition prior to implementing any Temporary Signalization (TS.) The inspection shall include, but not be limited to, the condition of the following:

- Controller Assembly (CA)
 - Controller Unit (CU)
 - Detection Equipment
 - Pre-emption Equipment
 - Coordination Equipment
- Vehicle and Pedestrian Signals
- Vehicle and Pedestrian Detectors
- Emergency Vehicle Pre-emption System (EVPS) *
- Interconnect Cable and Splice Enclosures
- Support Structures

ITEM #1118051A, 1118052A, 1118053A, 1118054A
1118055A, 1118056A, 1118057A, 1118058A, 1110859A,
1110860A, 1110871A, 1110872A, 1110873A, 1110874A,
1110875A, 1110876A, 1110877A

- Handholes, Conduit and Cable

It may be necessary to repair or replace equipment that is missing, damaged, or malfunctioning. The Contractor shall prepare a list of items for replacement or repair. If authorized by the Engineer, this work will be considered “Extra Work” under Article 1.09.04.

* At a State owned signal the EVPS equipment is usually owned by the municipality. The Engineer will notify the municipality of the inspection schedule and information relating to its EVPS equipment as required.

The Preliminary Inspection meeting shall also include discussion of potential utility conflicts according to the *Utilities* section under *TS Plan* below.

2. Temporary Signalization (TS) Plan

At least 30 days prior to implementation of each stage, the Contractor shall submit a 1:40 (1:500 metric) scale TS plan in pdf format for each location to the Engineer for review and comment. This TS Plan shall include, but not be limited to the following:

- Survey Ties
- Dimensions of Lanes, Shoulders, and Islands
- Slope Limits
- Clearing and Grubbing Limits
- Signal Phasing and Timing
- Location of Signal Appurtenances such as Supports, Signal Heads, Pedestrian Push buttons, Pedestrian Signals
- Location of Signing and Pavement Markings (stop bars, lane lines, etc.)
- Location, method, and mode of Temporary Detection
- Location of utilities and potential conflicts

Review of the TS plan does not relieve the Contractor of ensuring the TS meets the requirements of the MUTCD. The existing traffic signal plan of record for State-owned traffic signals is available from the Division of Traffic Engineering upon request. The Contractor may request existing traffic signal plans for Town-owned traffic signals from the Town.

It is acceptable to use the existing traffic signal plan as the TS plan by marking up the existing plan to show any needed changes.

The Contractor shall not implement the TS plan until all review comments have been addressed.

The TS Plan shall also address the following elements:

Earthwork

The Contractor shall perform the necessary clearing and grubbing and the grading of slopes required for the installation, maintenance, and removal of the TS equipment. Upon termination of the TS, the Contractor shall restore the affected area to its prior condition and to the satisfaction of the Engineer.

ITEM #1118051A, 1118052A, 1118053A, 1118054A
1118055A, 1118056A, 1118057A, 1118058A, 1110859A,
1110860A, 1110871A, 1110872A, 1110873A, 1110874A,
1110875A, 1110876A, 1110877A

Maintenance and Protection of Traffic

The Contractor shall furnish, install, maintain, relocate, and remove signal-related signing (lane-use, signal ahead, NTOR, etc.), and pavement markings, as needed.

The Contractor shall install, relocate, or remove, equipment in a manner to cause no hazard to pedestrians, traffic or property. The Contractor shall maintain traffic as specified in the Special Provisions “Prosecution and Progress” and “Maintenance and Protection of Traffic” in the Contract.

Utilities

The Contractor shall verify that proposed temporary and/or relocated signal equipment will not conflict with proposed project utility relocations. The Contractor shall ensure that temporary span/temporary poles will not restrict the ability to shift utility cables off of the poles.

The Contractor shall coordinate its TS activities with all utility companies in the project area to ensure that the proposed temporary and/or relocated signal equipment will not be in conflict with existing utilities. The Contractor shall coordinate any utility work that may be needed prior to the Contractor implementing the TS plan.

Electrical Service and Telephone Service at Existing Signalized Intersections

The Contractor shall be responsible for relocating and changing any electrical service or telephone service source if required. Any arrangements with these companies and costs associated with any relocation or change shall be paid for by the Contractor. The Contractor shall ensure that the party previously responsible for the monthly payment of service shall continue to be responsible for that payment during TS.

Electrical Service for TS at Unsignalized Intersections

The Contractor shall be responsible for providing electrical service for TS at unsignalized intersections. All charges and all arrangements with the power company, including service requests, scheduling, and monthly bills in accordance with Section 10.00.12 and Section 10.00.13 of the Standard Specifications shall be the responsibility of the Contractor. The Contractor shall remove the service or leave the service if it will become permanent as shown on the plans or as directed by the Engineer.

Temporary Signalization

The Contractor shall furnish, install, maintain, relocate, and remove existing, temporary, and proposed traffic signal equipment and all necessary hardware; modifications to or furnishing of a new CA; and reprogramming of the CU phasing and timing; and any other incidentals related to this TS, as many times as necessary for each stage/phase of construction to maintain and protect traffic and pedestrian movements as shown on the plans or as directed by the Engineer.

Inspection

ITEM #1118051A, 1118052A, 1118053A, 1118054A
1118055A, 1118056A, 1118057A, 1118058A, 1118059A,
1118060A, 1118071A, 1118072A, 1118073A, 1118074A,
1118075A, 1118076A, 1118077A

When requested by the Engineer, the TS will be subject to a field review by a representative of the Division of Traffic Engineering and/or the Town, The Contractor shall revise the TS as needed to address comments.

Detection

The Contractor shall provide vehicle detection on the existing, temporary, and/or new roadway alignment for all intersection approaches that have existing detection, detection in the final condition as shown on the signal plan, or as directed by the Engineer. The Contractor shall keep existing pedestrian pushbuttons accessible and operational at all times during TS. Temporary Detection is described and is paid for under Item # 11112XXA - Temporary Detection (Site No. X)

Emergency Vehicle Pre-emption System (EVPS)

The Contractor shall furnish, install, maintain, relocate, and remove the equipment necessary to keep the existing EVPS operational as shown on the plan. The Contractor shall not disconnect or alter the EVPS without the knowledge and concurrence of the Engineer and the EVPS owner. The Contractor shall schedule all EVPS relocations so that the system is out of service only when the Contractor is actively working. The Contractor shall ensure EVPS is returned to service and is completely operational at the end of the work day and shall keep the EVPS owner apprised of all changes to the EVPS.

Coordination

The Contractor shall furnish, install, maintain, relocate, and remove the equipment necessary to keep the intersection coordinated to adjacent signals as shown on the plan. The Contractor shall not disconnect the interconnect without the approval of the Engineer.

- Closed Loop System: If it is necessary to disconnect the communication cable, the Contractor will notify the Engineer and the Bridgeport Operation Center (BOC) or the Newington Operation Center (NOC) prior to disconnect and also after it is reconnected.
- Time Base System: The Contractor shall program and synchronize all Time Clock/Time Base Coordination (TC/TBC) units as necessary.

Maintenance

Once TS is in effect, the Contractor shall assume all maintenance responsibilities of the entire installation in accordance with Section 1.07.12 of the Standard Specifications. The Contractor shall notify the Engineer for the project records the date that Temporary Signalization begins. The Contractor shall coordinate with the Engineer to notify the following parties that maintenance responsibility has been transferred to the Contractor:

Signal Owner
CT DOT Electrical Maintenance Office or
Town Representative
Local Police Department

ITEM #1118051A, 1118052A, 1118053A, 1118054A
1118055A, 1118056A, 1118057A, 1118058A, 1118059A,
1118060A, 1118071A, 1118072A, 1118073A, 1118074A,
1118075A, 1118076A, 1118077A

The Contractor shall provide the Engineer a list of telephone numbers of personnel who will be on-call during TS and shall respond to traffic signal malfunctions by having a representative at the site within three hours from the initial contact. Any traffic signal malfunction shall be made operational according to plan within twenty-four (24) hours.

If the Engineer determines that the nature of a malfunction requires immediate attention and/or the Contractor does not respond within three (3) hours, then an alternate maintenance service will be called to repair the signal. Expenses incurred by the alternate maintenance service for each call will be deducted from monies due to the Contractor with a minimum deduction of \$1,000. The alternate maintenance service may be the owner of the signal or another qualified electrical contractor.

Duration

Temporary Signalization shall commence when the Contractor begins physical work at a particular intersection.

- a) For intersections with a State furnished controller, TS terminates when the inspection of the permanent signal is complete and operational and is accepted by the Engineer.
- b) For intersections with a Contractor furnished controller, Temporary Signalization terminates at the beginning of the 30 day test period for the permanent signal.

Ownership

The Contractor shall remove and deliver any existing equipment that is designated as salvage to its original owner upon completion of use. Any temporary equipment supplied by the Contractor shall be removed by the Contractor unless noted otherwise.

Method of Measurement:

Temporary Signalization (TS) shall be measured for payment as follows:

Fifty percent (50%) shall be paid when the TS for that site is operational as shown on the plan and to the satisfaction of the Engineer.

Fifty percent (50%) shall be paid upon termination of the TS as described herein.

Basis of Payment:

This work shall be paid at the contract Lump Sum price for “Temporary Signalization (Site No.)” for each site. This price includes the preliminary inspection, TS plan for each stage/phase, furnishing, installing, maintaining, relocating and revising traffic signal equipment, controller assembly modifications, controller unit program changes such as phasing and timing, removing existing, temporary, and proposed traffic signal equipment, arrangements with utility companies, towns or cities including the fees necessary for electric and telephone service, clearing and grubbing, earthwork and grading, area restoration and all necessary hardware, materials, labor, and work incidental thereto.

ITEM #1118051A, 1118052A, 1118053A, 1118054A
1118055A, 1118056A, 1118057A, 1118058A, 1118059A,
1118060A, 1110871A, 1110872A, 1110873A, 1110874A,
1110875A, 1110876A, 1110877A

All material and work for signing and pavement markings is paid for under the appropriate Contract items.

All material and work necessary for vehicle and pedestrian detection for TS is paid for under item 11112XXA - Temporary Detection (Site No. X).

All Contractor supplied items that will remain the Contractor's property shall be included in the contract Lump Sum price for "Temporary Signalization."

Any items installed as part of the permanent installation will be paid for under those separate pay items in the Contract.

<u>Pay Item</u>	<u>Pay Unit</u>
Temporary Signalization (Site No.)	L.S.

ITEM #1118051A, 1118052A, 1118053A, 1118054A
1118055A, 1118056A, 1118057A, 1118058A, 1110859A,
1110860A, 1110871A, 1110872A, 1110873A, 1110874A,
1110875A, 1110876A, 1110877A

ITEM #1118303A – RELOCATE PRE-EMPTION SYSTEM (SITE NO. 3)

ITEM #1118304A – RELOCATE PRE-EMPTION SYSTEM (SITE NO. 4)

ITEM #1118305A – RELOCATE PRE-EMPTION SYSTEM (SITE NO. 5)

ITEM #1118306A – RELOCATE PRE-EMPTION SYSTEM (SITE NO. 6)

ITEM #1118310A – RELOCATE PRE-EMPTION SYSTEM (SITE NO. 10)

ITEM #1118311A – RELOCATE PRE-EMPTION SYSTEM (SITE NO. 11)

ITEM #1118312A – RELOCATE PRE-EMPTION SYSTEM (SITE NO. 12)

ITEM #1118313A – RELOCATE PRE-EMPTION SYSTEM (SITE NO. 13)

ITEM #1118316A – RELOCATE PRE-EMPTION SYSTEM (SITE NO. 16)

Description:

Relocate existing town owned emergency vehicle pre-emption system (EVPS) (either optical or siren) as shown on the plan or as directed by the Engineer. The EVPS equipment includes but is not limited to the following material:

- Optical Detectors
- Siren Detectors
- Phase Selectors
- System Chassis
- Auxiliary Equipment Cabinets (AEC)
- Confirmation Light
- Detector Cable (where practical)

Install new cable from the controller to the pre-emption detectors where the existing cable cannot be practically relocated.

Material:

All material is existing except for miscellaneous hardware necessary for reinstallation (e.g. changing detector attachment from span wire to mast arm) and the Detector Cable.

Miscellaneous Hardware:

1. Mounting hardware designed and manufactured specifically for use with the existing EVPS.
2. Corrosion and rust resistant.

Detector Cable (Optical):

1. 3-Conductor cable with shield and ground wire.
2. AWG #20 (7x28) stranded.
3. Individually tinned copper strands.
4. Conductor insulation: 600 volt, 167⁰ F (75 deg. C).

5. 1 Conductor-yellow; 1 Conductor-blue; 1 Conductor-orange.
6. Aluminized mylar shield tape or equivalent.
7. AWG #20 (7x28) stranded uninsulated drain wire
8. DC resistance not to exceed 11.0 ohms per 1000 feet (305M).
9. Capacitance from one conductor to other two conductors and shield not to exceed 157pf/M (48 pf./ft.).
10. Jacket: 600 volts, 176^o F (80 deg. C), minimum average wall thickness - 0.045" (1.14mm).
11. Finished O.D.: 0.3" (7.62mm) max.

Detector Cable (Audio):

1. 2-Conductor cable with shield and ground wire.
2. AWG #14.
3. IMSA Spec 50-2 Detector Lead-In.

Construction Methods:

Conduct an initial evaluation test before removal and a final test after reinstallation. Thirty days prior to disconnection and removal of the existing pre-emption equipment, test and verify that the system is operational as shown on the plan. The thirty days is intended to provide the EVPS owner an opportunity to correct and resolve any deficiencies identified during the test. If during the thirty days the owner repairs, replaces, or corrects any malfunctioning, disconnected, or missing components, re-test that feature prior to removal. The contractor is not responsible to correct any part of the EVPS that is found to be malfunctioning, disconnected, or missing during the initial test. If the contractor is to assume maintenance responsibility of the traffic signal during Temporary Signalization, the EVPS equipment will not be included. Maintenance responsibility remains with the owner.

EVPS Test Procedure

1. Notify the system owner/user, such as the municipal fire chief or public works director, of the scheduled inspection.
2. Request a fire department representative and an emergency vehicle, which has an activation device to conduct the test. If not available, the contractor shall provide an activation device.
3. In the presence of the Engineer and the municipal representative, test each pre-empted approach with the emergency vehicle. Test the following items of the system:
 - * Confirm that the emitter or siren activates the phase selector and the phase selector activates the correct pre-emption input to the controller.
 - * Confirm adequate range. The traffic signal must be pre-empted to green sufficiently in advance of the emergency vehicle arrival. The vehicle emitter or siren shall initiate pre-emption at a minimum distance of 548.6M (1800 feet).
Exception: An obstructed line-of-sight may reduce the minimum distance. Town concurrence is required.
 - * Confirm there are no false calls. Keep the emitter or siren active as the emergency vehicle passes through the intersection. No other detectors shall activate.
4. Document the test. Provide the Engineer and the municipality copies of the test results. Attached is a sample test procedure form.

Keep the appropriate fire department official apprised of when (day and time) the system is disconnected and taken out of operation.

Store all pre-emption equipment intended for re-installation in a suitable location to prevent damage from elements and construction activities. Return all pre-emption equipment not intended for re-installation to the Town.

Mount the AEC on the left side of the controller cabinet, when facing the door. Confirm that the inside of the cabinet wall is clear, so that the installation of the AEC will not damage any equipment inside the controller cabinet. Drill a 25mm (1") hole through the side of the controller cabinet. Install a close nipple through the 25mm (1") hole. Apply clear silicon caulk to both ends of the close nipple. Tighten lock-nuts and fiber bushings. Apply additional caulk if necessary to prevent moisture from entering the controller cabinet and the AEC.

Re-install and wire the pre-emption equipment in a neat and orderly manner, as shown on the plan or as directed by the Engineer. Pre-emption detector locations shown on the plan are for illustration purposes only. Field locate the detectors for the best possible line-of-sight. Install the detector cables continuous with no splices between the optical detector and the AEC. Make all connections from the phase selector to the "D" harness and to the cabinet wiring at the pre-emption termination panel.

Conduct a final test, identical to the initial test, to verify that the EVPS is as operational as before removal. If the initial test was not conducted, it is assumed the EVPS was fully operational as shown on the plan. The Contractor is then responsible for all damaged; faulty; missing; and replacement material necessary to restore the EVPS to fully operational.

If a malfunction is found other than identified during the initial test, or the system needs adjustment (such as range, emitter intensity, or detector location), schedule a follow-up test. Repeat the test procedure for all approaches that did not pass.

Notify the appropriate fire department official that the EVPS has been re-installed and is operational.

If not present in an existing traffic controller cabinet install a pre-emption disconnect switch. When switched off, the traffic controller shall not be affected by EVPS calls.

Method of Measurement:

Work under this item is measured as Lump-Sum per site. Detector Cable shall be measured by the number of linear feet (meters) supplied and installed.

Basis of Payment:

This work shall be paid at the contract Lump Sum price for "Relocate Pre-Emption System (Site No.)" for each site. This item shall include all prior testing, removal, storage, re-installation, final testing, any corrective adjustments, replacement components if necessary, documentation, disconnect switch if necessary, and all necessary hardware, materials, labor and work incidental thereto.

All material and work necessary for installing detector cable is paid for under item 111355XA – Detector Cable (Optical).

<u>Pay Item</u>	<u>Pay Unit</u>
Relocate Pre-emption System (Site No._)	L.S.

EVPS TEST PROCEDURE

Confirm that the emitter or siren activates the phase selector and the phase selector activates the correct pre-emption input to the controller.	
Confirm adequate range.	
Confirm there are no false calls.	

ITEM #1206023A – REMOVAL AND RELOCATION OF EXISTING SIGNS

Section 12.06 is supplemented as follows:

Article 12.06.01 – Description is supplemented with the following:

Work under this item shall consist of the removal and/or relocation of designated side-mounted extruded aluminum and sheet aluminum signs, sign posts, sign supports, and foundations where indicated on the plans or as directed by the Engineer. Work under this item shall also include furnishing and installing new sign posts and associated hardware for signs designated for relocation.

Article 12.06.03 – Construction Methods is supplemented with the following:

The Contractor shall take care during the removal and relocation of existing signs, sign posts, and sign supports that are to be relocated so that they are not damaged. Any material that is damaged shall be replaced by the Contractor at no cost to the State.

Foundations and other materials designated for removal shall be removed and disposed of by the Contractor as directed by the Engineer and in accordance with existing standards for Removal of Existing Signing.

Sheet aluminum signs designated for relocation are to be re-installed on new sign posts.

Article 12.06.04 – Method of Measurement is supplemented with the following:

Payment under Removal and Relocation of Existing Signs shall be at the contract lump sum price which shall include all extruded aluminum and sheet aluminum signs, sign posts, and sign supports designated for relocation, all new sign posts and associated hardware for signs designated for relocation, all extruded aluminum signs, sheet aluminum signs, sign posts and sign supports designated for scrap, and foundations and other materials designated for removal and disposal, and all work and equipment required.

Article 12.06.05 – Basis of Payment is supplemented with the following:

This work will be paid for at the contract lump sum price for “Removal and Relocation of Existing Signs” which price shall include relocating designated extruded aluminum and sheet aluminum signs, sign posts, and sign supports, providing new posts and associated hardware for relocated signs, removing and disposing of foundations and other materials, and all equipment, material, tools and labor incidental thereto. This price shall also include removing, loading, transporting, and unloading of extruded aluminum signs, sheet aluminum signs, sign posts, and sign supports designated for scrap and all equipment, material, tools and labor incidental thereto.

<u>Pay Item</u>	<u>Pay Unit</u>
Removal and Relocation of Existing Signs	L.S.

ITEM #1208931A – SIGN FACE - SHEET ALUMINUM (TYPE IX RETROREFLECTIVE SHEETING)

Section 12.08 is supplemented and amended as follows:

12.08.01—Description:

Add the following:

This item shall also include field testing of metal sign base posts as directed by the Engineer.

12.08.03—Construction Methods:

Delete the last sentence and add the following:

Metal sign base posts shall be whole and uncut. Sign base post embedment and reveal lengths shall be as shown on the plans. The Contractor shall drive the metal sign base posts by hand tools, by mechanical means or by auguring holes. If an obstruction is encountered while driving or placing the metal sign base post, the Contractor shall notify the Engineer who will determine whether the obstruction shall be removed, the sign base post or posts relocated, or the base post installation in ledge detail shall apply. Backfill shall be thoroughly tamped after the posts have been set level and plumb.

Field Testing of Metal Sign Posts: When the sign installations are complete, the Contractor shall notify the Engineer the Project is ready for field testing. Based on the number of posts in the Project, the Engineer will select random sign base posts which shall be removed by the Contractor for inspection and measurement by the Engineer. After such inspection is completed at each base post location, the Contractor shall restore or replace such portions of the work to the condition required by the Contract. Refer to the table in 12.08.05 for the number of posts to be field tested.

12.08.04—Method of Measurement:

Add the following:

The work required to expose and measure sign base post length and embedment depth using field testing methods, and restoration of such work, will not be measured for payment and shall be included in the general cost of the work.

12.08.05—Basis of Payment:

Replace the entire Article with the following:

This work will be paid for at the Contract unit price per square foot for “Sign Face - Sheet Aluminum” of the type specified complete in place, adjusted by multiplying by the applicable Pay Factor listed in the table below. The price for this work shall include the completed sign, metal sign post(s), span-mounted sign brackets and mast arm-mounted brackets, mounting hardware, including reinforcing plates, field testing, restoration and replacement of defective base post(s), and all materials, equipment, and work incidental thereto.

Pay Factor Scale: Work shall be considered defective whenever the base post length or base post embedment depth is less than the specified length by more than 2 inches. If the number of defects results in rejection, the Contractor shall remove and replace all metal sign base posts on the Project, at no cost to the Department.

Number of Posts to be Tested and Pay Factors (Based on Number of Defects)

Number of Posts in Project =>	51-100	101-250	251-1000	>1000
Sample Size=>	5 Posts	10 Posts	40 Posts	60 Posts
0 Defects	1.0	1.0	1.025	1.025
1 Defect	0.9	0.95	0.975	0.983
2 Defects	Rejection	0.9	0.95	0.967
3 Defects	Rejection	Rejection	0.925	0.95
4 Defects	Rejection	Rejection	0.9	0.933
5 Defects	Rejection	Rejection	Rejection	0.917
6 Defects	Rejection	Rejection	Rejection	0.9
7 or more Defects	Rejection	Rejection	Rejection	Rejection

Note: Projects with 50 or fewer posts will not include field testing

PERMITS AND/OR REQUIRED PROVISIONS

The following Permits and/or and Required Provisions follow this page are hereby made part of this Contract.

- **PERMITS AND/OR PERMIT APPLICATIONS**

No Permits are required for this contract.

- **Construction Contracts - Required Contract Provisions (FHWA Funded Contracts)**

**Construction Contracts - Required Contract Provisions
(FHWA Funded Contracts)**

Index

1. Federal Highway Administration (FHWA) Form 1273 (Revised May 1, 2012)
2. Title VI of the Civil Rights Act of 1964 / Nondiscrimination Requirements
3. Contractor Work Force Utilization (Federal Executive Order 11246) / Specific Equal Employment Opportunity
4. Requirements of Title 49, CFR, Part 26, Participation by DBEs
5. Contract Wage Rates
6. Americans with Disabilities Act of 1990, as Amended
7. Connecticut Statutory Labor Requirements
 - a. Construction, Alteration or Repair of Public Works Projects; Wage Rates
 - b. Debarment List - Limitation on Awarding Contracts
 - c. Construction Safety and Health Course
 - d. Awarding of Contracts to Occupational Safety and Health Law Violators Prohibited
 - e. Residents Preference in Work on Other Public Facilities (Not Applicable to Federal Aid Contracts)
8. Tax Liability - Contractor's Exempt Purchase Certificate (CERT – 141)
9. Executive Orders (State of CT)
10. Non Discrimination Requirement (pursuant to section 4a-60 and 4a-60a of the Connecticut General Statutes, as revised)
11. Whistleblower Provision
12. Connecticut Freedom of Information Act
 - a. Disclosure of Records
 - b. Confidential Information
13. Service of Process
14. Substitution of Securities for Retainages on State Contracts and Subcontracts
15. Health Insurance Portability and Accountability Act of 1996 (HIPAA)
16. Forum and Choice of Law
17. Summary of State Ethics Laws

18. Audit and Inspection of Plants, Places of Business and Records
19. Campaign Contribution Restriction
20. Tangible Personal Property
21. Bid Rigging and/or Fraud – Notice to Contractor
22. Consulting Agreement Affidavit
23. Federal Cargo Preference Act Requirements (46 CFR 381.7(a)-(b))

Index of Exhibits

- EXHIBIT A – FHWA Form 1273 (Begins on page 14)
- EXHIBIT B – Title VI Contractor Assurances (page 34)
- EXHIBIT C – Contractor Work Force Utilization (Federal Executive Order 11246) / Equal Employment Opportunity (page 36)
- EXHIBIT D – Health Insurance Portability and Accountability Act of 1996 (HIPAA) (page 43)
- EXHIBIT E - Campaign Contribution Restriction (page 51)
- EXHIBIT F – Federal Wage Rates (Attached at the end)
- EXHIBIT G - State Wage Rates (Attached at the end)

1. Federal Highway Administration (FHWA) Form 1273

The Contractor shall comply with the Federal Highway Administration (FHWA), Form 1273 attached at Exhibit A, as revised, which is hereby made part of this contract. The Contractor shall also require its subcontractors to comply with the FHWA – Form 1273 and include the FHWA – Form 1273 as an attachment to all subcontracts and purchase orders.

2. Title VI of the Civil Rights Act of 1964 / Nondiscrimination Requirements

The Contractor shall comply with Title VI of the Civil Rights Act of 1964 as amended (42 U.S.C. 2000 et seq.), all requirements imposed by the regulations of the United States Department of Transportation (49 CFR Part 21) issued in implementation thereof, and the Title VI Contractor Assurances attached hereto at Exhibit B, all of which are hereby made a part of this Contract.

3. Contractor Work Force Utilization (Federal Executive Order 11246) / Equal Employment Opportunity

- (a) The Contractor shall comply with the Contractor Work Force Utilization (Federal Executive Order 11246) / Equal Employment Opportunity requirements attached at Exhibit C and hereby made part of this Contract, whenever a contractor or subcontractor at any tier performs construction work in excess of \$10,000. These goals shall be included in each contract and subcontract. Goal achievement is calculated for each trade using the hours worked under each trade.
- (b) Companies with contracts, agreements or purchase orders valued at \$10,000 or more will develop and implement an Affirmative Action Plan utilizing the ConnDOT Affirmative Action Plan Guideline. This Plan shall be designed to further the provision of equal employment opportunity to all persons without regard to their race, color, religion, sex or national origin, and to promote the full realization of equal employment opportunity through a positive continuation program. Plans shall be updated as required by ConnDOT.

4. Requirements of Title 49, Code of Federal Regulations (CFR), Part 26, Participation by DBEs, as may be revised.

Pursuant to 49 CFR 26.13, the following paragraph is part of this Contract and shall be included in each subcontract the Contractor enters into with a subcontractor:

“The Contractor, subrecipient or subcontractor shall not discriminate on the basis of race, color, national origin, or sex in the performance of this contract. The Contractor shall carry out applicable requirements of 49 CFR Part 26, Participation by DBEs, in the award and administration of U.S. DOT-assisted contracts. Failure by the Contractor to carry out these requirements is a material breach of this Contract, which may result in the termination of this contract or such other remedy as ConnDOT (recipient) deems appropriate, which may include, but is not limited to: (1) Withholding monthly progress payments, (2) Assessing sanctions, (3) Liquidated damages; and/or, (4) Disqualifying the contractor from future bidding as non-responsible.”

5. Contract Wage Rates

The Contractor shall comply with:

The Federal and State wage rate requirements indicated in Exhibits F and G hereof, as revised, are hereby made part of this Contract. The Federal wage rates (Davis-Bacon Act) applicable to this Contract shall be the Federal wage rates that are current on the US Department of Labor website (<http://www.wdol.gov/dba.aspx>) as may be revised 10 days prior to bid opening. These applicable Federal wage rates will be physically incorporated in the final contract document executed by both parties. The Department will no longer physically include revised Federal wage rates in the bid documents or as part of addenda documents, prior to the bid opening date. During the bid advertisement period, bidders are responsible for obtaining the appropriate Federal wage rates from the US Department of Labor website.

To obtain the latest Federal wage rates go to the US Department of Labor website (link above). Under Davis-Bacon Act, choose "Selecting DBA WDs" and follow the instruction to search the latest wage rates for the State, County and Construction Type. Refer to the Notice to Contractor (NTC) - Federal Wage Determinations (Davis Bacon Act).

If a conflict exists between the Federal and State wage rates, the higher rate shall govern.

Prevailing Wages for Work on State Highways; Annual Adjustments. With respect to contracts for work on state highways and bridges on state highways, the Contractor shall comply with the provisions of Section 31-54 and 31-55a of the Connecticut General Statutes, as revised.

As required by Section 1.05.12 (Payrolls) of the State of Connecticut, Department of Transportation's Standard Specification for Roads, Bridges and Incidental Construction (FORM 816), as may be revised, every Contractor or subcontractor performing project work on a Federal aid project is required to post the relevant prevailing wage rates as determined by the United States Secretary of Labor. The wage rate determinations shall be posted in prominent and easily accessible places at the work site.

6. Americans with Disabilities Act of 1990, as Amended

This provision applies to those Contractors who are or will be responsible for compliance with the terms of the Americans with Disabilities Act of 1990, as amended (42 U.S.C. 12101 et seq.), (Act), during the term of the Contract. The Contractor represents that it is familiar with the terms of this Act and that it is in compliance with the Act. Failure of the Contractor to satisfy this standard as the same applies to performance under this Contract, either now or during the term of the Contract as it may be amended, will render the Contract voidable at the option of the State upon notice to the contractor. The Contractor warrants that it will hold the State harmless and indemnify the State from any liability which may be imposed upon the State as a result of any failure of the Contractor to be in compliance with this Act, as the same applies to performance under this Contract.

7. Connecticut Statutory Labor Requirements

(a) Construction, Alteration or Repair of Public Works Projects; Wage Rates. The Contractor shall comply with Section 31-53 of the Connecticut General Statutes, as revised. The wages paid on an hourly basis to any person performing the work of any mechanic, laborer or worker on the work herein contracted to be done and the amount of payment or contribution paid or payable on behalf of each such person to any employee welfare fund, as defined in subsection (i)

of section 31-53 of the Connecticut General Statutes, shall be at a rate equal to the rate customary or prevailing for the same work in the same trade or occupation in the town in which such public works project is being constructed. Any contractor who is not obligated by agreement to make payment or contribution on behalf of such persons to any such employee welfare fund shall pay to each mechanic, laborer or worker as part of such person's wages the amount of payment or contribution for such person's classification on each pay day.

(b) Debarment List. Limitation on Awarding Contracts. The Contractor shall comply with Section 31-53a of the Connecticut General Statutes, as revised.

(c) Construction Safety and Health Course. The Contractor shall comply with section 31-53b of the Connecticut General Statutes, as revised. The contractor shall furnish proof to the Labor Commissioner with the weekly certified payroll form for the first week each employee begins work on such project that any person performing the work of a mechanic, laborer or worker pursuant to the classifications of labor under section 31-53 of the Connecticut General Statutes, as revised, on such public works project, pursuant to such contract, has completed a course of at least ten hours in duration in construction safety and health approved by the federal Occupational Safety and Health Administration or, has completed a new miner training program approved by the Federal Mine Safety and Health Administration in accordance with 30 CFR 48 or, in the case of telecommunications employees, has completed at least ten hours of training in accordance with 29 CFR 1910.268.

Any employee required to complete a construction safety and health course as required that has not completed the course, shall have a maximum of fourteen (14) days to complete the course. If the employee has not been brought into compliance, they shall be removed from the project until such time as they have completed the required training.

Any costs associated with this notice shall be included in the general cost of the contract. In addition, there shall be no time granted to the contractor for compliance with this notice. The contractor's compliance with this notice and any associated regulations shall not be grounds for claims as outlined in Section 1.11 – "Claims".

(d) Awarding of Contracts to Occupational Safety and Health Law Violators Prohibited. The Contract is subject to Section 31-57b of the Connecticut General Statutes, as revised.

(e) Residents Preference in Work on Other Public Facilities. NOT APPLICABLE TO FEDERAL AID CONTRACTS. Pursuant to Section 31-52a of the Connecticut General Statutes, as revised, in the employment of mechanics, laborers or workmen to perform the work specified herein, preference shall be given to residents of the state who are, and continuously for at least six months prior to the date hereof have been, residents of this state, and if no such person is available, then to residents of other states

8. Tax Liability - Contractor's Exempt Purchase Certificate (CERT – 141)

The Contractor shall comply with Chapter 219 of the Connecticut General Statutes pertaining to tangible personal property or services rendered that is/are subject to sales tax. The Contractor is responsible for determining its tax liability. If the Contractor purchases materials or supplies pursuant to the Connecticut Department of Revenue Services' "Contractor's Exempt Purchase Certificate (CERT-141)," as may be revised, the Contractor acknowledges and agrees that title to such materials and supplies installed or placed in the project will vest in the State simultaneously with passage of title

from the retailers or vendors thereof, and the Contractor will have no property rights in the materials and supplies purchased.

Forms and instructions are available anytime by:

Internet: Visit the DRS website at www.ct.gov/DRS to download and print Connecticut tax forms; or Telephone: Call 1-800-382-9463 (Connecticut calls outside the Greater Hartford calling area only) and select Option 2 or call 860-297-4753 (from anywhere).

9. Executive Orders

This contract is subject to the provisions of Executive Order No. Three of Governor Thomas J. Meskill, promulgated June 16, 1971, concerning labor employment practices, Executive Order No. Seventeen of Governor Thomas J. Meskill, promulgated February 15, 1973, concerning the listing of employment openings and Executive Order No. Sixteen of Governor John G. Rowland promulgated August 4, 1999, concerning violence in the workplace, all of which are incorporated into and are made a part of the contract as if they had been fully set forth in it. The contract may also be subject to Executive Order No. 14 of Governor M. Jodi Rell, promulgated April 17, 2006, concerning procurement of cleaning products and services and to Executive Order No. 49 of Governor Dannel P. Malloy, promulgated May 22, 2015, mandating disclosure of certain gifts to public employees and contributions to certain candidates for office. If Executive Order No. 14 and/or Executive Order No. 49 are applicable, they are deemed to be incorporated into and are made a part of the contract as if they had been fully set forth in it. At the Contractor's request, the Department shall provide a copy of these orders to the Contractor.

10. Non Discrimination Requirement (pursuant to section 4a-60 and 4a-60a of the Connecticut General Statutes, as revised): References to "minority business enterprises" in this Section are not applicable to Federal-aid projects/contracts. Federal-aid projects/contracts are instead subject to the Federal Disadvantaged Business Enterprise Program.

(a) For purposes of this Section, the following terms are defined as follows:

- (1) "Commission" means the Commission on Human Rights and Opportunities;
- (2) "Contract" and "contract" include any extension or modification of the Contract or contract;
- (3) "Contractor" and "contractor" include any successors or assigns of the Contractor or contractor;
- (4) "Gender identity or expression" means a person's gender-related identity, appearance or behavior, whether or not that gender-related identity, appearance or behavior is different from that traditionally associated with the person's physiology or assigned sex at birth, which gender-related identity can be shown by providing evidence including, but not limited to, medical history, care or treatment of the gender-related identity, consistent and uniform assertion of the gender-related identity or any other evidence that the gender-related identity is sincerely held, part of a person's core identity or not being asserted for an improper purpose.
- (5) "good faith" means that degree of diligence which a reasonable person would exercise in the performance of legal duties and obligations;
- (6) "good faith efforts" shall include, but not be limited to, those reasonable initial efforts necessary to comply with statutory or regulatory requirements and additional or substituted efforts when it is determined that such initial efforts will not be sufficient to comply with such requirements;
- (7) "marital status" means being single, married as recognized by the state of Connecticut, widowed, separated or divorced;
- (8) "mental disability" means one or more mental disorders, as defined in the most recent edition of the American Psychiatric Association's "Diagnostic and Statistical Manual of Mental Disorders", or a record of or regarding a person as having one or more such disorders;

- (9) "minority business enterprise" means any small contractor or supplier of materials fifty-one percent or more of the capital stock, if any, or assets of which is owned by a person or persons: (1) who are active in the daily affairs of the enterprise, (2) who have the power to direct the management and policies of the enterprise, and (3) who are members of a minority, as such term is defined in subsection (a) of Connecticut General Statutes § 32-9n; and
- (10) "public works contract" means any agreement between any individual, firm or corporation and the State or any political subdivision of the State other than a municipality for construction, rehabilitation, conversion, extension, demolition or repair of a public building, highway or other changes or improvements in real property, or which is financed in whole or in part by the State, including, but not limited to, matching expenditures, grants, loans, insurance or guarantees.

For purposes of this Section, the terms "Contract" and "contract" do not include a contract where each contractor is (1) a political subdivision of the State of Connecticut, including, but not limited to municipalities, unless the contract is a municipal public works contract or quasi-public agency project contract, (2) any other state of the United States, including but not limited to, the District of Columbia, Puerto Rico, U.S. territories and possessions, and federally recognized Indian tribal governments, as defined in Connecticut General Statutes § 1-267, (3) the federal government, (4) a foreign government, or (5) an agency of a subdivision, state or government described in subdivision (1), (2), (3), or (4) of this subsection.

- (b) (1) The Contractor agrees and warrants that in the performance of the Contract such Contractor will not discriminate or permit discrimination against any person or group of persons on the grounds of race, color, religious creed, age, marital status, national origin, ancestry, sex, gender identity or expression, status as a veteran, intellectual disability, mental disability or physical disability, including, but not limited to, blindness, unless it is shown by such Contractor that such disability prevents performance of the work involved, in any manner prohibited by the laws of the United States or of the State of Connecticut; and the Contractor further agrees to take affirmative action to insure that applicants with job-related qualifications are employed and that employees are treated when employed without regard to their race, color, religious creed, age, marital status, national origin, ancestry, sex, gender identity or expression, status as a veteran, intellectual disability, mental disability or physical disability, including, but not limited to, blindness, unless it is shown by the Contractor that such disability prevents performance of the work involved; (2) the Contractor agrees, in all solicitations or advertisements for employees placed by or on behalf of the Contractor, to state that it is an "affirmative action-equal opportunity employer" in accordance with regulations adopted by the Commission; (3) the Contractor agrees to provide each labor union or representative of workers with which the Contractor has a collective bargaining agreement or other contract or understanding and each vendor with which the Contractor has a contract or understanding, a notice to be provided by the Commission, advising the labor union or workers' representative of the Contractor's commitments under this section and to post copies of the notice in conspicuous places available to employees and applicants for employment; (4) the Contractor agrees to comply with each provision of this Section and Connecticut General Statutes §§ 46a-68e and 46a-68f and with each regulation or relevant order issued by said Commission pursuant to Connecticut General Statutes §§ 46a-56, 46a-68e and 46a-68f; and (5) the Contractor agrees to provide the Commission on Human Rights and Opportunities with such information requested by the Commission, and permit access to pertinent books, records and accounts, concerning the employment practices and procedures of the Contractor as relate to the provisions of this Section and Connecticut General Statutes § 46a-56. If the contract is a public works contract, the Contractor agrees and warrants that he will make good faith efforts to employ minority business enterprises as subcontractors and suppliers of materials on such public works projects.

- (c) Determination of the Contractor's good faith efforts shall include, but shall not be limited to, the following factors: The Contractor's employment and subcontracting policies, patterns and practices; affirmative advertising, recruitment and training; technical assistance activities and such other reasonable activities or efforts as the Commission may prescribe that are designed to ensure the participation of minority business enterprises in public works projects.
- (d) The Contractor shall develop and maintain adequate documentation, in a manner prescribed by the Commission, of its good faith efforts.
- (e) The Contractor shall include the provisions of subsection (b) of this Section in every subcontract or purchase order entered into in order to fulfill any obligation of a contract with the State and such provisions shall be binding on a subcontractor, vendor or manufacturer unless exempted by regulations or orders of the Commission. The Contractor shall take such action with respect to any such subcontract or purchase order as the Commission may direct as a means of enforcing such provisions including sanctions for noncompliance in accordance with Connecticut General Statutes §46a-56; provided if such Contractor becomes involved in, or is threatened with, litigation with a subcontractor or vendor as a result of such direction by the Commission, the Contractor may request the State of Connecticut to enter into any such litigation or negotiation prior thereto to protect the interests of the State and the State may so enter.
- (f) The Contractor agrees to comply with the regulations referred to in this Section as they exist on the date of this Contract and as they may be adopted or amended from time to time during the term of this Contract and any amendments thereto.
- (g) (1) The Contractor agrees and warrants that in the performance of the Contract such Contractor will not discriminate or permit discrimination against any person or group of persons on the grounds of sexual orientation, in any manner prohibited by the laws of the United States or the State of Connecticut, and that employees are treated when employed without regard to their sexual orientation; (2) the Contractor agrees to provide each labor union or representative of workers with which such Contractor has a collective bargaining agreement or other contract or understanding and each vendor with which such Contractor has a contract or understanding, a notice to be provided by the Commission on Human Rights and Opportunities advising the labor union or workers' representative of the Contractor's commitments under this section, and to post copies of the notice in conspicuous places available to employees and applicants for employment; (3) the Contractor agrees to comply with each provision of this section and with each regulation or relevant order issued by said Commission pursuant to Connecticut General Statutes § 46a-56; and (4) the Contractor agrees to provide the Commission on Human Rights and Opportunities with such information requested by the Commission, and permit access to pertinent books, records and accounts, concerning the employment practices and procedures of the Contractor which relate to the provisions of this Section and Connecticut General Statutes § 46a-56.
- (h) The Contractor shall include the provisions of the foregoing paragraph in every subcontract or purchase order entered into in order to fulfill any obligation of a contract with the State and such provisions shall be binding on a subcontractor, vendor or manufacturer unless exempted by regulations or orders of the Commission. The Contractor shall take such action with respect to any such subcontract or purchase order as the Commission may direct as a means of enforcing such provisions including sanctions for noncompliance in accordance with Connecticut General Statutes § 46a-56; provided, if such Contractor becomes involved in, or is threatened with, litigation with a subcontractor or vendor as a result of such direction by the Commission, the Contractor may request the State of Connecticut to enter into any such litigation or negotiation prior thereto to protect the interests of the State and the State may so enter.

Please be aware the Nondiscrimination Certifications can be found at the Office of Policy and Management website:

<https://portal.ct.gov/OPM/Fin-PSA/Forms/Nondiscrimination-Certification>

11. Whistleblower Provision

The following clause is applicable if the Contract has a value of Five Million Dollars (\$5,000,000) or more.

Whistleblowing. This Contract may be subject to the provisions of Section 4-61dd of the Connecticut General Statutes. In accordance with this statute, if an officer, employee or appointing authority of the Contractor takes or threatens to take any personnel action against any employee of the Contractor in retaliation for such employee's disclosure of information to any employee of the contracting state or quasi-public agency or the Auditors of Public Accounts or the Attorney General under the provisions of subsection (a) of such statute, the Contractor shall be liable for a civil penalty of not more than five thousand dollars for each offense, up to a maximum of twenty per cent of the value of this Contract. Each violation shall be a separate and distinct offense and in the case of a continuing violation, each calendar day's continuance of the violation shall be deemed to be a separate and distinct offense. The State may request that the Attorney General bring a civil action in the Superior Court for the Judicial District of Hartford to seek imposition and recovery of such civil penalty. In accordance with subsection (f) of such statute, each large state contractor, as defined in the statute, shall post a notice of the provisions of the statute relating to large state contractors in a conspicuous place which is readily available for viewing by the employees of the Contractor.

12. Connecticut Freedom of Information Act

- (a) **Disclosure of Records.** This Contract may be subject to the provisions of section 1-218 of the Connecticut General Statutes. In accordance with this statute, each contract in excess of two million five hundred thousand dollars between a public agency and a person for the performance of a governmental function shall (a) provide that the public agency is entitled to receive a copy of records and files related to the performance of the governmental function, and (b) indicate that such records and files are subject to FOIA and may be disclosed by the public agency pursuant to FOIA. No request to inspect or copy such records or files shall be valid unless the request is made to the public agency in accordance with FOIA. Any complaint by a person who is denied the right to inspect or copy such records or files shall be brought to the Freedom of Information Commission in accordance with the provisions of sections 1-205 and 1-206 of the Connecticut General Statutes.
- (b) **Confidential Information.** The State will afford due regard to the Contractor's request for the protection of proprietary or confidential information which the State receives from the Contractor. However, all materials associated with the Contract are subject to the terms of the FOIA and all corresponding rules, regulations and interpretations. In making such a request, the Contractor may not merely state generally that the materials are proprietary or confidential in nature and not, therefore, subject to release to third parties. Those particular sentences, paragraphs, pages or sections that the Contractor believes are exempt from disclosure under the FOIA must be specifically identified as such. Convincing explanation and rationale sufficient to justify each exemption consistent with the FOIA must accompany the request. The rationale and explanation must be stated in terms of the prospective harm to the competitive position of the Contractor that would result if the identified material were to be released and the reasons why the materials are legally exempt from release pursuant to the FOIA. To the extent that any other provision or part of the Contract conflicts or is in any way inconsistent with this section, this section controls and shall apply and the conflicting provision or part shall not be given effect. If the Contractor indicates that certain documentation is submitted in confidence, by specifically and clearly marking the documentation as "CONFIDENTIAL," DOT will first review the Contractor's claim for consistency with the FOIA (that is, review that the documentation is actually a trade secret or commercial or financial information and not required by statute), and if

determined to be consistent, will endeavor to keep such information confidential to the extent permitted by law. See, *e.g.*, Conn. Gen. Stat. §1-210(b)(5)(A-B). The State, however, has no obligation to initiate, prosecute or defend any legal proceeding or to seek a protective order or other similar relief to prevent disclosure of any information that is sought pursuant to a FOIA request. Should the State withhold such documentation from a Freedom of Information requester and a complaint be brought to the Freedom of Information Commission, the Contractor shall have the burden of cooperating with DOT in defense of that action and in terms of establishing the availability of any FOIA exemption in any proceeding where it is an issue. In no event shall the State have any liability for the disclosure of any documents or information in its possession which the State believes are required to be disclosed pursuant to the FOIA or other law.

13. Service of Process

The Contractor, if not a resident of the State of Connecticut, or, in the case of a partnership, the partners, if not residents, hereby appoints the Secretary of State of the State of Connecticut, and his successors in office, as agent for service of process for any action arising out of or as a result of this Contract; such appointment to be in effect throughout the life of this Contract and six (6) years thereafter.

14. Substitution of Securities for Retainages on State Contracts and Subcontracts

This Contract is subject to the provisions of Section 3-112a of the General Statutes of the State of Connecticut, as revised.

15. Health Insurance Portability and Accountability Act of 1996 (HIPAA)

The Contractor shall comply, if applicable, with the Health Insurance Portability and Accountability Act of 1996 and, pursuant thereto, the provisions attached at Exhibit D, and hereby made part of this Contract.

16. Forum and Choice of Law

Forum and Choice of Law. The parties deem the Contract to have been made in the City of Hartford, State of Connecticut. Both parties agree that it is fair and reasonable for the validity and construction of the Contract to be, and it shall be, governed by the laws and court decisions of the State of Connecticut, without giving effect to its principles of conflicts of laws. To the extent that any immunities provided by Federal law or the laws of the State of Connecticut do not bar an action against the State, and to the extent that these courts are courts of competent jurisdiction, for the purpose of venue, the complaint shall be made returnable to the Judicial District of Hartford only or shall be brought in the United States District Court for the District of Connecticut only, and shall not be transferred to any other court, provided, however, that nothing here constitutes a waiver or compromise of the sovereign immunity of the State of Connecticut. The Contractor waives any objection which it may now have or will have to the laying of venue of any Claims in any forum and further irrevocably submits to such jurisdiction in any suit, action or proceeding.

17. Summary of State Ethics Laws

Pursuant to the requirements of section 1-101qq of the Connecticut General Statutes, the summary of State ethics laws developed by the State Ethics Commission pursuant to section 1-81b of the Connecticut General Statutes is incorporated by reference into and made a part of the Contract as if the summary had been fully set forth in the Contract.

18. Audit and Inspection of Plants, Places of Business and Records

- (a) The State and its agents, including, but not limited to, the Connecticut Auditors of Public Accounts, Attorney General and State's Attorney and their respective agents, may, at reasonable hours, inspect and examine all of the parts of the Contractor's and Contractor Parties' plants and places of business which, in any way, are related to, or involved in, the performance of this Contract. For the purposes of this Section, "Contractor Parties" means the Contractor's members, directors, officers, shareholders, partners, managers, principal officers, representatives, agents, servants, consultants, employees or any one of them or any other person or entity with whom the Contractor is in privity of oral or written contract and the Contractor intends for such other person or entity to Perform under the Contract in any capacity.
- (b) The Contractor shall maintain, and shall require each of the Contractor Parties to maintain, accurate and complete Records. The Contractor shall make all of its and the Contractor Parties' Records available at all reasonable hours for audit and inspection by the State and its agents.
- (c) The State shall make all requests for any audit or inspection in writing and shall provide the Contractor with at least twenty-four (24) hours' notice prior to the requested audit and inspection date. If the State suspects fraud or other abuse, or in the event of an emergency, the State is not obligated to provide any prior notice.
- (d) The Contractor shall keep and preserve or cause to be kept and preserved all of its and Contractor Parties' Records until three (3) years after the latter of (i) final payment under this Agreement, or (ii) the expiration or earlier termination of this Agreement, as the same may be modified for any reason. The State may request an audit or inspection at any time during this period. If any Claim or audit is started before the expiration of this period, the Contractor shall retain or cause to be retained all Records until all Claims or audit findings have been resolved.
- (e) The Contractor shall cooperate fully with the State and its agents in connection with an audit or inspection. Following any audit or inspection, the State may conduct and the Contractor shall cooperate with an exit conference.
- (f) The Contractor shall incorporate this entire Section verbatim into any contract or other agreement that it enters into with any Contractor Party.

19. Campaign Contribution Restriction

For all State contracts, defined in Conn. Gen. Stat. §9-612(f)(1) as having a value in a calendar year of \$50,000 or more, or a combination or series of such agreements or contracts having a value of \$100,000 or more, the authorized signatory to this contract expressly acknowledges receipt of the State Elections Enforcement Commission's notice advising state contractors of state campaign contribution and solicitation prohibitions, and will inform its principals of the contents of the notice, as set forth in "Notice to Executive Branch State Contractors and Prospective State Contractors of Campaign Contribution and Solicitation Limitations," a copy of which is attached hereto and hereby made a part of this contract, attached as Exhibit E.

20. Tangible Personal Property

- (a) The Contractor on its behalf and on behalf of its Affiliates, as defined below, shall comply with the provisions of Conn. Gen. Stat. §12-411b, as follows:
 - (1) For the term of the Contract, the Contractor and its Affiliates shall collect and remit to the State of Connecticut, Department of Revenue Services, any Connecticut use tax due under the provisions of Chapter 219 of the Connecticut General Statutes for items of tangible personal property sold by the Contractor or by any of its Affiliates in the same manner as if the Contractor and such Affiliates were engaged in the business of selling tangible personal property for use in Connecticut and had sufficient nexus under the provisions of Chapter 219 to be required to collect Connecticut use tax;

- (2) A customer's payment of a use tax to the Contractor or its Affiliates relieves the customer of liability for the use tax;
 - (3) The Contractor and its Affiliates shall remit all use taxes they collect from customers on or before the due date specified in the Contract, which may not be later than the last day of the month next succeeding the end of a calendar quarter or other tax collection period during which the tax was collected;
 - (4) The Contractor and its Affiliates are not liable for use tax billed by them but not paid to them by a customer; and
 - (5) Any Contractor or Affiliate who fails to remit use taxes collected on behalf of its customers by the due date specified in the Contract shall be subject to the interest and penalties provided for persons required to collect sales tax under chapter 219 of the general statutes.
- (b) For purposes of this section of the Contract, the word "Affiliate" means any person, as defined in section 12-1 of the general statutes, that controls, is controlled by, or is under common control with another person. A person controls another person if the person owns, directly or indirectly, more than ten per cent of the voting securities of the other person. The word "voting security" means a security that confers upon the holder the right to vote for the election of members of the board of directors or similar governing body of the business, or that is convertible into, or entitles the holder to receive, upon its exercise, a security that confers such a right to vote. "Voting security" includes a general partnership interest.
- (c) The Contractor represents and warrants that each of its Affiliates has vested in the Contractor plenary authority to so bind the Affiliates in any agreement with the State of Connecticut. The Contractor on its own behalf and on behalf of its Affiliates shall also provide, no later than 30 days after receiving a request by the State's contracting authority, such information as the State may require to ensure, in the State's sole determination, compliance with the provisions of Chapter 219 of the Connecticut General Statutes, including, but not limited to, §12-411b.

21. Bid Rigging and/or Fraud – Notice to Contractor

The Connecticut Department of Transportation is cooperating with the U.S. Department of Transportation and the Justice Department in their investigation into highway construction contract bid rigging and/or fraud.

A toll-free "HOT LINE" telephone number 800-424-9071 has been established to receive information from contractors, subcontractors, manufacturers, suppliers or anyone with knowledge of bid rigging and/or fraud, either past or current. The "HOT LINE" telephone number will be available during normal working hours (8:00 am – 5:00 pm EST). Information will be treated confidentially and anonymity respected.

22. Consulting Agreement Affidavit

The Contractor shall comply with Connecticut General Statutes Section 4a-81(a) and 4a-81(b), as revised. Pursuant to Public Act 11-229, after the initial submission of the form, if there is a change in the information contained in the form, a contractor shall submit the updated form, as applicable, either (i) not later than thirty (30) days after the effective date of such change or (ii) prior to execution of any new contract, whichever is earlier.

The Affidavit/Form may be submitted in written format or electronic format through the Department of Administrative Services (DAS) website.

23. Cargo Preference Act Requirements (46 CFR 381.7(a)-(b)) – Use of United States Flag Vessels

The Contractor agrees to comply with the following:

(a) ***Agreement Clauses.***

- (1) Pursuant to Pub. L. 664 ([43 U.S.C. 1241\(b\)](#)) at least 50 percent of any equipment, materials or commodities procured, contracted for or otherwise obtained with funds granted, guaranteed, loaned, or advanced by the U.S. Government under this agreement, and which may be transported by ocean vessel, shall be transported on privately owned United States-flag commercial vessels, if available.
- (2) Within 20 days following the date of loading for shipments originating within the United States or within 30 working days following the date of loading for shipments originating outside the United States, a legible copy of a rated, 'on-board' commercial ocean bill-of-lading in English for each shipment of cargo described in paragraph (a)(1) of this section shall be furnished to both the Contracting Officer (through the prime contractor in the case of subcontractor bills-of-lading) and to the Division of National Cargo, Office of Market Development, Maritime Administration, Washington, DC 20590.

(b) ***Contractor and Subcontractor Clauses.*** The contractor agrees—

- (1) To utilize privately owned United States-flag commercial vessels to ship at least 50 percent of the gross tonnage (computed separately for dry bulk carriers, dry cargo liners, and tankers) involved, whenever shipping any equipment, material, or commodities pursuant to this contract, to the extent such vessels are available at fair and reasonable rates for United States-flag commercial vessels.
- (2) To furnish within 20 days following the date of loading for shipments originating within the United States or within 30 working days following the date of loading for shipments originating outside the United States, a legible copy of a rated, 'on-board' commercial ocean bill-of-lading in English for each shipment of cargo described in paragraph (b) (1) of this section to both the Contracting Officer (through the prime contractor in the case of subcontractor bills-of-lading) and to the Division of National Cargo, Office of Market Development, Maritime Administration, Washington, DC 20590.
- (3) To insert the substance of the provisions of this clause in all subcontracts issued pursuant to this contract.

EXHIBIT A

FHWA-1273 -- Revised May 1, 2012

REQUIRED CONTRACT PROVISIONS FEDERAL-AID CONSTRUCTION CONTRACTS

- I. General
- II. Nondiscrimination
- III. Nonsegregated Facilities
- IV. Davis-Bacon and Related Act Provisions
- V. Contract Work Hours and Safety Standards Act Provisions
- VI. Subletting or Assigning the Contract
- VII. Safety: Accident Prevention
- VIII. False Statements Concerning Highway Projects
- IX. Implementation of Clean Air Act and Federal Water Pollution Control Act
- X. Compliance with Governmentwide Suspension and Debarment Requirements
- XI. Certification Regarding Use of Contract Funds for Lobbying

I. GENERAL

1. Form FHWA-1273 must be physically incorporated in each construction contract funded under Title 23 (excluding emergency contracts solely intended for debris removal). The contractor (or subcontractor) must insert this form in each subcontract and further require its inclusion in all lower tier subcontracts (excluding purchase orders, rental agreements and other agreements for supplies or services).

The applicable requirements of Form FHWA-1273 are incorporated by reference for work done under any purchase order, rental agreement or agreement for other services. The prime contractor shall be responsible for compliance by any subcontractor, lower-tier subcontractor or service provider.

Form FHWA-1273 must be included in all Federal-aid design-build contracts, in all subcontracts and in lower tier subcontracts (excluding subcontracts for design services, purchase orders, rental agreements and other agreements for supplies or services). The design-builder shall be responsible for compliance by any subcontractor, lower-tier subcontractor or service provider.

Contracting agencies may reference Form FHWA-1273 in bid proposal or request for proposal documents, however, the Form FHWA-1273 must be physically incorporated (not referenced) in all contracts, subcontracts and lower-tier subcontracts (excluding purchase orders, rental agreements and other agreements for supplies or services related to a construction contract).

2. Subject to the applicability criteria noted in the following sections, these contract provisions shall apply to all work performed on the contract by the contractor's own organization and with the assistance of workers under the contractor's immediate superintendence and to all work performed on the contract by piecework, station work, or by subcontract.

3. A breach of any of the stipulations contained in these Required Contract Provisions may be sufficient grounds for withholding of progress payments, withholding of final payment, termination of the contract, suspension / debarment or any other action determined to be appropriate by the contracting agency and FHWA.

4. Selection of Labor: During the performance of this contract, the contractor shall not use convict labor for any purpose within the limits of a construction project on a Federal-aid highway unless it is labor performed by convicts who are on parole, supervised release, or probation. The term Federal-aid highway does not include roadways functionally classified as local roads or rural minor collectors.

II. NONDISCRIMINATION

The provisions of this section related to 23 CFR Part 230 are applicable to all Federal-aid construction contracts and to all related construction subcontracts of \$10,000 or more. The provisions of 23 CFR Part 230 are not applicable to material supply, engineering, or architectural service contracts.

In addition, the contractor and all subcontractors must comply with the following policies: Executive Order 11246, 41 CFR 60, 29 CFR 1625-1627, Title 23 USC Section 140, the Rehabilitation Act of 1973, as amended (29 USC 794), Title VI of the Civil Rights Act of 1964, as amended, and related regulations including 49 CFR Parts 21, 26 and 27; and 23 CFR Parts 200, 230, and 633.

The contractor and all subcontractors must comply with: the requirements of the Equal Opportunity Clause in 41 CFR 60-1.4(b) and, for all construction contracts exceeding \$10,000, the Standard Federal Equal Employment Opportunity Construction Contract Specifications in 41 CFR 60-4.3.

Note: The U.S. Department of Labor has exclusive authority to determine compliance with Executive Order 11246 and the policies of the Secretary of Labor including 41 CFR 60, and 29 CFR 1625-1627. The contracting agency and the FHWA have the authority and the responsibility to ensure compliance with Title 23 USC Section 140, the Rehabilitation Act of 1973, as amended (29 USC 794), and Title VI of the Civil Rights Act of 1964, as amended, and related regulations including 49 CFR Parts 21, 26 and 27; and 23 CFR Parts 200, 230, and 633.

The following provision is adopted from 23 CFR 230, Appendix A, with appropriate revisions to conform to the U.S. Department of Labor (US DOL) and FHWA requirements.

1. Equal Employment Opportunity: Equal employment opportunity (EEO) requirements not to discriminate and to take affirmative action to assure equal opportunity as set forth under laws, executive orders, rules, regulations (28 CFR 35, 29 CFR 1630, 29 CFR 1625-1627, 41 CFR 60 and 49 CFR 27) and orders of the Secretary of Labor as modified by the provisions prescribed herein, and imposed pursuant to 23 U.S.C. 140 shall constitute the EEO and specific affirmative action standards for the contractor's project activities under this contract. The provisions of the Americans with Disabilities Act of 1990 (42 U.S.C. 12101 et seq.) set forth under 28 CFR 35 and 29 CFR 1630 are incorporated by reference in this contract. In the execution of this contract, the contractor agrees to comply with the following minimum specific requirement activities of EEO:

a. The contractor will work with the contracting agency and the Federal Government to ensure that it has made every good faith effort to provide equal opportunity with respect to all of its terms and conditions of employment and in their review of activities under the contract.

b. The contractor will accept as its operating policy the following statement:

"It is the policy of this Company to assure that applicants are employed, and that employees are treated during employment, without regard to their race, religion, sex, color, national origin, age or disability. Such action shall include: employment, upgrading, demotion, or transfer; recruitment or recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection for training, including apprenticeship, pre-apprenticeship, and/or on-the-job training."

2. EEO Officer: The contractor will designate and make known to the contracting officers an EEO Officer who will have the responsibility for and must be capable of effectively administering and promoting an active EEO program and who must be assigned adequate authority and responsibility to do so.

3. Dissemination of Policy: All members of the contractor's staff who are authorized to hire, supervise, promote, and discharge employees, or who recommend such action, or who are substantially involved in such action, will be made fully cognizant of, and will implement, the contractor's EEO policy and contractual responsibilities to provide EEO in each grade and classification of employment. To ensure that the above agreement will be met, the following actions will be taken as a minimum:

a. Periodic meetings of supervisory and personnel office employees will be conducted before the start of work and then not less often than once every six months, at which time the contractor's EEO policy and its implementation will be reviewed and explained. The meetings will be conducted by the EEO Officer.

b. All new supervisory or personnel office employees will be given a thorough indoctrination by the EEO Officer, covering all major aspects of the contractor's EEO obligations within thirty days following their reporting for duty with the contractor.

c. All personnel who are engaged in direct recruitment for the project will be instructed by the EEO Officer in the contractor's procedures for locating and hiring minorities and women.

d. Notices and posters setting forth the contractor's EEO policy will be placed in areas readily accessible to employees, applicants for employment and potential employees.

e. The contractor's EEO policy and the procedures to implement such policy will be brought to the attention of employees by means of meetings, employee handbooks, or other appropriate means.

4. Recruitment: When advertising for employees, the contractor will include in all advertisements for employees the notation: "An Equal Opportunity Employer." All such advertisements will be placed in publications having a large circulation among minorities and women in the area from which the project work force would normally be derived.

a. The contractor will, unless precluded by a valid bargaining agreement, conduct systematic and direct recruitment through public and private employee referral sources likely to yield qualified minorities and women. To meet this requirement, the contractor will identify sources of potential minority group employees, and establish with such identified sources procedures whereby minority and women applicants may be referred to the contractor for employment consideration.

b. In the event the contractor has a valid bargaining agreement providing for exclusive hiring hall referrals, the contractor is expected to observe the provisions of that agreement to the extent that the system meets the contractor's compliance with EEO contract provisions. Where implementation of

such an agreement has the effect of discriminating against minorities or women, or obligates the contractor to do the same, such implementation violates Federal nondiscrimination provisions.

c. The contractor will encourage its present employees to refer minorities and women as applicants for employment. Information and procedures with regard to referring such applicants will be discussed with employees.

5. Personnel Actions: Wages, working conditions, and employee benefits shall be established and administered, and personnel actions of every type, including hiring, upgrading, promotion, transfer, demotion, layoff, and termination, shall be taken without regard to race, color, religion, sex, national origin, age or disability. The following procedures shall be followed:

a. The contractor will conduct periodic inspections of project sites to insure that working conditions and employee facilities do not indicate discriminatory treatment of project site personnel.

b. The contractor will periodically evaluate the spread of wages paid within each classification to determine any evidence of discriminatory wage practices.

c. The contractor will periodically review selected personnel actions in depth to determine whether there is evidence of discrimination. Where evidence is found, the contractor will promptly take corrective action. If the review indicates that the discrimination may extend beyond the actions reviewed, such corrective action shall include all affected persons.

d. The contractor will promptly investigate all complaints of alleged discrimination made to the contractor in connection with its obligations under this contract, will attempt to resolve such complaints, and will take appropriate corrective action within a reasonable time. If the investigation indicates that the discrimination may affect persons other than the complainant, such corrective action shall include such other persons. Upon completion of each investigation, the contractor will inform every complainant of all of their avenues of appeal.

6. Training and Promotion:

a. The contractor will assist in locating, qualifying, and increasing the skills of minorities and women who are applicants for employment or current employees. Such efforts should be aimed at developing full journey level status employees in the type of trade or job classification involved.

b. Consistent with the contractor's work force requirements and as permissible under Federal and State regulations, the contractor shall make full use of training programs, i.e., apprenticeship, and on-the-job training programs for the geographical area of contract performance. In the event a special provision for training is provided under this contract, this subparagraph will be superseded as indicated in the special provision. The contracting agency may reserve training positions for persons who receive welfare assistance in accordance with 23 U.S.C. 140(a).

c. The contractor will advise employees and applicants for employment of available training programs and entrance requirements for each.

d. The contractor will periodically review the training and promotion potential of employees who are minorities and women and will encourage eligible employees to apply for such training and promotion.

7. Unions: If the contractor relies in whole or in part upon unions as a source of employees, the contractor will use good faith efforts to obtain the cooperation of such unions to increase opportunities for minorities and women. Actions by the contractor, either directly or through a contractor's association acting as agent, will include the procedures set forth below:

- a. The contractor will use good faith efforts to develop, in cooperation with the unions, joint training programs aimed toward qualifying more minorities and women for membership in the unions and increasing the skills of minorities and women so that they may qualify for higher paying employment.
- b. The contractor will use good faith efforts to incorporate an EEO clause into each union agreement to the end that such union will be contractually bound to refer applicants without regard to their race, color, religion, sex, national origin, age or disability.
- c. The contractor is to obtain information as to the referral practices and policies of the labor union except that to the extent such information is within the exclusive possession of the labor union and such labor union refuses to furnish such information to the contractor, the contractor shall so certify to the contracting agency and shall set forth what efforts have been made to obtain such information.
- d. In the event the union is unable to provide the contractor with a reasonable flow of referrals within the time limit set forth in the collective bargaining agreement, the contractor will, through independent recruitment efforts, fill the employment vacancies without regard to race, color, religion, sex, national origin, age or disability; making full efforts to obtain qualified and/or qualifiable minorities and women. The failure of a union to provide sufficient referrals (even though it is obligated to provide exclusive referrals under the terms of a collective bargaining agreement) does not relieve the contractor from the requirements of this paragraph. In the event the union referral practice prevents the contractor from meeting the obligations pursuant to Executive Order 11246, as amended, and these special provisions, such contractor shall immediately notify the contracting agency.

8. Reasonable Accommodation for Applicants / Employees with Disabilities: The contractor must be familiar with the requirements for and comply with the Americans with Disabilities Act and all rules and regulations established there under. Employers must provide reasonable accommodation in all employment activities unless to do so would cause an undue hardship.

9. Selection of Subcontractors, Procurement of Materials and Leasing of Equipment: The contractor shall not discriminate on the grounds of race, color, religion, sex, national origin, age or disability in the selection and retention of subcontractors, including procurement of materials and leases of equipment. The contractor shall take all necessary and reasonable steps to ensure nondiscrimination in the administration of this contract.

- a. The contractor shall notify all potential subcontractors and suppliers and lessors of their EEO obligations under this contract.
- b. The contractor will use good faith efforts to ensure subcontractor compliance with their EEO obligations.

10. Assurance Required by 49 CFR 26.13(b):

- a. The requirements of 49 CFR Part 26, and the State DOT's U.S. DOT-approved DBE program are incorporated by reference.

b. The contractor or subcontractor shall not discriminate on the basis of race, color, national origin, or sex in the performance of this contract. The contractor shall carry out applicable requirements of 49 CFR Part 26, in the award and administration of DOT-assisted contracts. Failure by the contractor to carry out these requirements is a material breach of this contract, which may result in the termination of this contract or such other remedy as the contracting agency deems appropriate.

11. Records and Reports: The contractor shall keep such records as necessary to document compliance with the EEO requirements. Such records shall be retained for a period of three years following the date of the final payment to the contractor for all contract work and shall be available at reasonable times and places for inspection by authorized representatives of the contracting agency and the FHWA.

a. The records kept by the contractor shall document the following:

(1) The number and work hours of minority and non-minority group members and women employed in each work classification on the project;

(2) The progress and efforts being made in cooperation with unions, when applicable, to increase employment opportunities for minorities and women; and

(3) The progress and efforts being made in locating, hiring, training, qualifying, and upgrading minorities and women;

b. The contractors and subcontractors will submit an annual report to the contracting agency each July for the duration of the project, indicating the number of minority, women, and non-minority group employees currently engaged in each work classification required by the contract work. This information is to be reported on [Form FHWA-1391](#). The staffing data should represent the project work force on board in all or any part of the last payroll period preceding the end of July. If on-the-job training is being required by special provision, the contractor will be required to collect and report training data. The employment data should reflect the work force on board during all or any part of the last payroll period preceding the end of July.

III. NONSEGREGATED FACILITIES

This provision is applicable to all Federal-aid construction contracts and to all related construction subcontracts of \$10,000 or more.

The contractor must ensure that facilities provided for employees are provided in such a manner that segregation on the basis of race, color, religion, sex, or national origin cannot result. The contractor may neither require such segregated use by written or oral policies nor tolerate such use by employee custom. The contractor's obligation extends further to ensure that its employees are not assigned to perform their services at any location, under the contractor's control, where the facilities are segregated. The term "facilities" includes waiting rooms, work areas, restaurants and other eating areas, time clocks, restrooms, washrooms, locker rooms, and other storage or dressing areas, parking lots, drinking fountains, recreation or entertainment areas, transportation, and housing provided for employees. The contractor shall provide separate or single-user restrooms and necessary dressing or sleeping areas to assure privacy between sexes.

IV. DAVIS-BACON AND RELATED ACT PROVISIONS

This section is applicable to all Federal-aid construction projects exceeding \$2,000 and to all related subcontracts and lower-tier subcontracts (regardless of subcontract size). The requirements apply to all projects located within the right-of-way of a roadway that is functionally classified as Federal-aid highway. This excludes roadways functionally classified as local roads or rural minor collectors, which are exempt. Contracting agencies may elect to apply these requirements to other projects.

The following provisions are from the U.S. Department of Labor regulations in 29 CFR 5.5 “Contract provisions and related matters” with minor revisions to conform to the FHWA-1273 format and FHWA program requirements.

1. Minimum wages

a. All laborers and mechanics employed or working upon the site of the work, will be paid unconditionally and not less often than once a week, and without subsequent deduction or rebate on any account (except such payroll deductions as are permitted by regulations issued by the Secretary of Labor under the Copeland Act (29 CFR part 3)), the full amount of wages and bona fide fringe benefits (or cash equivalents thereof) due at time of payment computed at rates not less than those contained in the wage determination of the Secretary of Labor which is attached hereto and made a part hereof, regardless of any contractual relationship which may be alleged to exist between the contractor and such laborers and mechanics.

Contributions made or costs reasonably anticipated for bona fide fringe benefits under section 1(b)(2) of the Davis-Bacon Act on behalf of laborers or mechanics are considered wages paid to such laborers or mechanics, subject to the provisions of paragraph 1.d. of this section; also, regular contributions made or costs incurred for more than a weekly period (but not less often than quarterly) under plans, funds, or programs which cover the particular weekly period, are deemed to be constructively made or incurred during such weekly period. Such laborers and mechanics shall be paid the appropriate wage rate and fringe benefits on the wage determination for the classification of work actually performed, without regard to skill, except as provided in 29 CFR 5.5(a)(4). Laborers or mechanics performing work in more than one classification may be compensated at the rate specified for each classification for the time actually worked therein: Provided, That the employer's payroll records accurately set forth the time spent in each classification in which work is performed. The wage determination (including any additional classification and wage rates conformed under paragraph 1.b. of this section) and the Davis-Bacon poster (WH-1321) shall be posted at all times by the contractor and its subcontractors at the site of the work in a prominent and accessible place where it can be easily seen by the workers.

b. (1) The contracting officer shall require that any class of laborers or mechanics, including helpers, which is not listed in the wage determination and which is to be employed under the contract shall be classified in conformance with the wage determination. The contracting officer shall approve an additional classification and wage rate and fringe benefits therefore only when the following criteria have been met:

(i) The work to be performed by the classification requested is not performed by a classification in the wage determination; and

(ii) The classification is utilized in the area by the construction industry; and

(iii) The proposed wage rate, including any bona fide fringe benefits, bears a reasonable relationship to the wage rates contained in the wage determination.

(2) If the contractor and the laborers and mechanics to be employed in the classification (if known), or their representatives, and the contracting officer agree on the classification and wage rate (including the amount designated for fringe benefits where appropriate), a report of the action taken shall be sent by the contracting officer to the Administrator of the Wage and Hour Division, Employment Standards Administration, U.S. Department of Labor, Washington, DC 20210. The Administrator, or an authorized representative, will approve, modify, or disapprove every additional classification action within 30 days of receipt and so advise the contracting officer or will notify the contracting officer within the 30-day period that additional time is necessary.

(3) In the event the contractor, the laborers or mechanics to be employed in the classification or their representatives, and the contracting officer do not agree on the proposed classification and wage rate (including the amount designated for fringe benefits, where appropriate), the contracting officer shall refer the questions, including the views of all interested parties and the recommendation of the contracting officer, to the Wage and Hour Administrator for determination. The Wage and Hour Administrator, or an authorized representative, will issue a determination within 30 days of receipt and so advise the contracting officer or will notify the contracting officer within the 30-day period that additional time is necessary.

(4) The wage rate (including fringe benefits where appropriate) determined pursuant to paragraphs 1.b.(2) or 1.b.(3) of this section, shall be paid to all workers performing work in the classification under this contract from the first day on which work is performed in the classification.

c. Whenever the minimum wage rate prescribed in the contract for a class of laborers or mechanics includes a fringe benefit which is not expressed as an hourly rate, the contractor shall either pay the benefit as stated in the wage determination or shall pay another bona fide fringe benefit or an hourly cash equivalent thereof.

d. If the contractor does not make payments to a trustee or other third person, the contractor may consider as part of the wages of any laborer or mechanic the amount of any costs reasonably anticipated in providing bona fide fringe benefits under a plan or program, Provided, That the Secretary of Labor has found, upon the written request of the contractor, that the applicable standards of the Davis-Bacon Act have been met. The Secretary of Labor may require the contractor to set aside in a separate account assets for the meeting of obligations under the plan or program.

2. Withholding

The contracting agency shall upon its own action or upon written request of an authorized representative of the Department of Labor, withhold or cause to be withheld from the contractor under this contract, or any other Federal contract with the same prime contractor, or any other federally-assisted contract subject to Davis-Bacon prevailing wage requirements, which is held by the same prime contractor, so much of the accrued payments or advances as may be considered necessary to pay laborers and mechanics, including apprentices, trainees, and helpers, employed by the contractor or any subcontractor the full amount of wages required by the contract. In the event of failure to pay any laborer or mechanic, including any apprentice, trainee, or helper, employed or working on the site of the work, all or part of the wages required by the contract, the contracting agency may, after written notice to the contractor, take such action as may be necessary to cause the suspension of any further payment, advance, or guarantee of funds until such violations have ceased.

3. Payrolls and basic records

a. Payrolls and basic records relating thereto shall be maintained by the contractor during the course of the work and preserved for a period of three years thereafter for all laborers and mechanics working at the site of the work. Such records shall contain the name, address, and social security number of each such worker, his or her correct classification, hourly rates of wages paid (including rates of contributions or costs anticipated for bona fide fringe benefits or cash equivalents thereof of the types described in section 1(b)(2)(B) of the Davis-Bacon Act), daily and weekly number of hours worked, deductions made and actual wages paid. Whenever the Secretary of Labor has found under 29 CFR 5.5(a)(1)(iv) that the wages of any laborer or mechanic include the amount of any costs reasonably anticipated in providing benefits under a plan or program described in section 1(b)(2)(B) of the Davis-Bacon Act, the contractor shall maintain records which show that the commitment to provide such benefits is enforceable, that the plan or program is financially responsible, and that the plan or program has been communicated in writing to the laborers or mechanics affected, and records which show the costs anticipated or the actual cost incurred in providing such benefits. Contractors employing apprentices or trainees under approved programs shall maintain written evidence of the registration of apprenticeship programs and certification of trainee programs, the registration of the apprentices and trainees, and the ratios and wage rates prescribed in the applicable programs.

b. (1) The contractor shall submit weekly for each week in which any contract work is performed a copy of all payrolls to the contracting agency. The payrolls submitted shall set out accurately and completely all of the information required to be maintained under 29 CFR 5.5(a)(3)(i), except that full social security numbers and home addresses shall not be included on weekly transmittals. Instead the payrolls shall only need to include an individually identifying number for each employee (e.g. , the last four digits of the employee's social security number). The required weekly payroll information may be submitted in any form desired. Optional Form WH-347 is available for this purpose from the Wage and Hour Division Web site at <http://www.dol.gov/esa/whd/forms/wh347instr.htm> or its successor site. The prime contractor is responsible for the submission of copies of payrolls by all subcontractors. Contractors and subcontractors shall maintain the full social security number and current address of each covered worker, and shall provide them upon request to the contracting agency for transmission to the State DOT, the FHWA or the Wage and Hour Division of the Department of Labor for purposes of an investigation or audit of compliance with prevailing wage requirements. It is not a violation of this section for a prime contractor to require a subcontractor to provide addresses and social security numbers to the prime contractor for its own records, without weekly submission to the contracting agency..

(2) Each payroll submitted shall be accompanied by a "Statement of Compliance," signed by the contractor or subcontractor or his or her agent who pays or supervises the payment of the persons employed under the contract and shall certify the following:

(i) That the payroll for the payroll period contains the information required to be provided under §5.5 (a)(3)(ii) of Regulations, 29 CFR part 5, the appropriate information is being maintained under §5.5 (a)(3)(i) of Regulations, 29 CFR part 5, and that such information is correct and complete;

(ii) That each laborer or mechanic (including each helper, apprentice, and trainee) employed on the contract during the payroll period has been paid the full weekly wages earned, without rebate, either directly or indirectly, and that no deductions have been made either directly or indirectly from the full wages earned, other than permissible deductions as set forth in Regulations, 29 CFR part 3;

(iii) That each laborer or mechanic has been paid not less than the applicable wage rates and fringe benefits or cash equivalents for the classification of work performed, as specified in the applicable wage determination incorporated into the contract.

(3) The weekly submission of a properly executed certification set forth on the reverse side of Optional Form WH-347 shall satisfy the requirement for submission of the "Statement of Compliance" required by paragraph 3.b.(2) of this section.

(4) The falsification of any of the above certifications may subject the contractor or subcontractor to civil or criminal prosecution under section 1001 of title 18 and section 231 of title 31 of the United States Code.

c. The contractor or subcontractor shall make the records required under paragraph 3.a. of this section available for inspection, copying, or transcription by authorized representatives of the contracting agency, the State DOT, the FHWA, or the Department of Labor, and shall permit such representatives to interview employees during working hours on the job. If the contractor or subcontractor fails to submit the required records or to make them available, the FHWA may, after written notice to the contractor, the contracting agency or the State DOT, take such action as may be necessary to cause the suspension of any further payment, advance, or guarantee of funds. Furthermore, failure to submit the required records upon request or to make such records available may be grounds for debarment action pursuant to 29 CFR 5.12.

4. Apprentices and trainees

a. Apprentices (programs of the USDOL).

Apprentices will be permitted to work at less than the predetermined rate for the work they performed when they are employed pursuant to and individually registered in a bona fide apprenticeship program registered with the U.S. Department of Labor, Employment and Training Administration, Office of Apprenticeship Training, Employer and Labor Services, or with a State Apprenticeship Agency recognized by the Office, or if a person is employed in his or her first 90 days of probationary employment as an apprentice in such an apprenticeship program, who is not individually registered in the program, but who has been certified by the Office of Apprenticeship Training, Employer and Labor Services or a State Apprenticeship Agency (where appropriate) to be eligible for probationary employment as an apprentice.

The allowable ratio of apprentices to journeymen on the job site in any craft classification shall not be greater than the ratio permitted to the contractor as to the entire work force under the registered program. Any worker listed on a payroll at an apprentice wage rate, who is not registered or otherwise employed as stated above, shall be paid not less than the applicable wage rate on the wage determination for the classification of work actually performed. In addition, any apprentice performing work on the job site in excess of the ratio permitted under the registered program shall be paid not less than the applicable wage rate on the wage determination for the work actually performed. Where a contractor is performing construction on a project in a locality other than that in which its program is registered, the ratios and wage rates (expressed in percentages of the journeyman's hourly rate) specified in the contractor's or subcontractor's registered program shall be observed.

Every apprentice must be paid at not less than the rate specified in the registered program for the apprentice's level of progress, expressed as a percentage of the journeymen hourly rate specified in the applicable wage determination. Apprentices shall be paid fringe benefits in accordance with the

provisions of the apprenticeship program. If the apprenticeship program does not specify fringe benefits, apprentices must be paid the full amount of fringe benefits listed on the wage determination for the applicable classification. If the Administrator determines that a different practice prevails for the applicable apprentice classification, fringes shall be paid in accordance with that determination.

In the event the Office of Apprenticeship Training, Employer and Labor Services, or a State Apprenticeship Agency recognized by the Office, withdraws approval of an apprenticeship program, the contractor will no longer be permitted to utilize apprentices at less than the applicable predetermined rate for the work performed until an acceptable program is approved.

b. Trainees (programs of the USDOL).

Except as provided in 29 CFR 5.16, trainees will not be permitted to work at less than the predetermined rate for the work performed unless they are employed pursuant to and individually registered in a program which has received prior approval, evidenced by formal certification by the U.S. Department of Labor, Employment and Training Administration.

The ratio of trainees to journeymen on the job site shall not be greater than permitted under the plan approved by the Employment and Training Administration.

Every trainee must be paid at not less than the rate specified in the approved program for the trainee's level of progress, expressed as a percentage of the journeyman hourly rate specified in the applicable wage determination. Trainees shall be paid fringe benefits in accordance with the provisions of the trainee program. If the trainee program does not mention fringe benefits, trainees shall be paid the full amount of fringe benefits listed on the wage determination unless the Administrator of the Wage and Hour Division determines that there is an apprenticeship program associated with the corresponding journeyman wage rate on the wage determination which provides for less than full fringe benefits for apprentices. Any employee listed on the payroll at a trainee rate who is not registered and participating in a training plan approved by the Employment and Training Administration shall be paid not less than the applicable wage rate on the wage determination for the classification of work actually performed. In addition, any trainee performing work on the job site in excess of the ratio permitted under the registered program shall be paid not less than the applicable wage rate on the wage determination for the work actually performed.

In the event the Employment and Training Administration withdraws approval of a training program, the contractor will no longer be permitted to utilize trainees at less than the applicable predetermined rate for the work performed until an acceptable program is approved.

c. Equal employment opportunity. The utilization of apprentices, trainees and journeymen under this part shall be in conformity with the equal employment opportunity requirements of Executive Order 11246, as amended, and 29 CFR part 30.

d. Apprentices and Trainees (programs of the U.S. DOT).

Apprentices and trainees working under apprenticeship and skill training programs which have been certified by the Secretary of Transportation as promoting EEO in connection with Federal-aid highway construction programs are not subject to the requirements of paragraph 4 of this Section IV. The straight time hourly wage rates for apprentices and trainees under such programs will be established by the particular programs. The ratio of apprentices and trainees to journeymen shall not be greater than permitted by the terms of the particular program.

5. Compliance with Copeland Act requirements. The contractor shall comply with the requirements of 29 CFR part 3, which are incorporated by reference in this contract.

6. Subcontracts. The contractor or subcontractor shall insert Form FHWA-1273 in any subcontracts and also require the subcontractors to include Form FHWA-1273 in any lower tier subcontracts. The prime contractor shall be responsible for the compliance by any subcontractor or lower tier subcontractor with all the contract clauses in 29 CFR 5.5.

7. Contract termination: debarment. A breach of the contract clauses in 29 CFR 5.5 may be grounds for termination of the contract, and for debarment as a contractor and a subcontractor as provided in 29 CFR 5.12.

8. Compliance with Davis-Bacon and Related Act requirements. All rulings and interpretations of the Davis-Bacon and Related Acts contained in 29 CFR parts 1, 3, and 5 are herein incorporated by reference in this contract.

9. Disputes concerning labor standards. Disputes arising out of the labor standards provisions of this contract shall not be subject to the general disputes clause of this contract. Such disputes shall be resolved in accordance with the procedures of the Department of Labor set forth in 29 CFR parts 5, 6, and 7. Disputes within the meaning of this clause include disputes between the contractor (or any of its subcontractors) and the contracting agency, the U.S. Department of Labor, or the employees or their representatives.

10. Certification of eligibility.

a. By entering into this contract, the contractor certifies that neither it (nor he or she) nor any person or firm who has an interest in the contractor's firm is a person or firm ineligible to be awarded Government contracts by virtue of section 3(a) of the Davis-Bacon Act or 29 CFR 5.12(a)(1).

b. No part of this contract shall be subcontracted to any person or firm ineligible for award of a Government contract by virtue of section 3(a) of the Davis-Bacon Act or 29 CFR 5.12(a)(1).

c. The penalty for making false statements is prescribed in the U.S. Criminal Code, 18 U.S.C. 1001.

V. CONTRACT WORK HOURS AND SAFETY STANDARDS ACT

The following clauses apply to any Federal-aid construction contract in an amount in excess of \$100,000 and subject to the overtime provisions of the Contract Work Hours and Safety Standards Act. These clauses shall be inserted in addition to the clauses required by 29 CFR 5.5(a) or 29 CFR 4.6. As used in this paragraph, the terms laborers and mechanics include watchmen and guards.

1. Overtime requirements. No contractor or subcontractor contracting for any part of the contract work which may require or involve the employment of laborers or mechanics shall require or permit any such laborer or mechanic in any workweek in which he or she is employed on such work to work in excess of forty hours in such workweek unless such laborer or mechanic receives compensation at a rate not less than one and one-half times the basic rate of pay for all hours worked in excess of forty hours in such workweek.

2. Violation; liability for unpaid wages; liquidated damages. In the event of any violation of the clause set forth in paragraph (1.) of this section, the contractor and any subcontractor responsible

therefor shall be liable for the unpaid wages. In addition, such contractor and subcontractor shall be liable to the United States (in the case of work done under contract for the District of Columbia or a territory, to such District or to such territory), for liquidated damages. Such liquidated damages shall be computed with respect to each individual laborer or mechanic, including watchmen and guards, employed in violation of the clause set forth in paragraph (1.) of this section, in the sum of \$10 for each calendar day on which such individual was required or permitted to work in excess of the standard workweek of forty hours without payment of the overtime wages required by the clause set forth in paragraph (1.) of this section.

3. Withholding for unpaid wages and liquidated damages. The FHWA or the contacting agency shall upon its own action or upon written request of an authorized representative of the Department of Labor withhold or cause to be withheld, from any moneys payable on account of work performed by the contractor or subcontractor under any such contract or any other Federal contract with the same prime contractor, or any other federally-assisted contract subject to the Contract Work Hours and Safety Standards Act, which is held by the same prime contractor, such sums as may be determined to be necessary to satisfy any liabilities of such contractor or subcontractor for unpaid wages and liquidated damages as provided in the clause set forth in paragraph (2.) of this section.

4. Subcontracts. The contractor or subcontractor shall insert in any subcontracts the clauses set forth in paragraph (1.) through (4.) of this section and also a clause requiring the subcontractors to include these clauses in any lower tier subcontracts. The prime contractor shall be responsible for compliance by any subcontractor or lower tier subcontractor with the clauses set forth in paragraphs (1.) through (4.) of this section.

VI. SUBLETTING OR ASSIGNING THE CONTRACT

This provision is applicable to all Federal-aid construction contracts on the National Highway System.

1. The contractor shall perform with its own organization contract work amounting to not less than 30 percent (or a greater percentage if specified elsewhere in the contract) of the total original contract price, excluding any specialty items designated by the contracting agency. Specialty items may be performed by subcontract and the amount of any such specialty items performed may be deducted from the total original contract price before computing the amount of work required to be performed by the contractor's own organization (23 CFR 635.116).

a. The term “perform work with its own organization” refers to workers employed or leased by the prime contractor, and equipment owned or rented by the prime contractor, with or without operators. Such term does not include employees or equipment of a subcontractor or lower tier subcontractor, agents of the prime contractor, or any other assignees. The term may include payments for the costs of hiring leased employees from an employee leasing firm meeting all relevant Federal and State regulatory requirements. Leased employees may only be included in this term if the prime contractor meets all of the following conditions:

- (1) the prime contractor maintains control over the supervision of the day-to-day activities of the leased employees;
- (2) the prime contractor remains responsible for the quality of the work of the leased employees;
- (3) the prime contractor retains all power to accept or exclude individual employees from work on the project; and

(4) the prime contractor remains ultimately responsible for the payment of predetermined minimum wages, the submission of payrolls, statements of compliance and all other Federal regulatory requirements.

b. "Specialty Items" shall be construed to be limited to work that requires highly specialized knowledge, abilities, or equipment not ordinarily available in the type of contracting organizations qualified and expected to bid or propose on the contract as a whole and in general are to be limited to minor components of the overall contract.

2. The contract amount upon which the requirements set forth in paragraph (1) of Section VI is computed includes the cost of material and manufactured products which are to be purchased or produced by the contractor under the contract provisions.

3. The contractor shall furnish (a) a competent superintendent or supervisor who is employed by the firm, has full authority to direct performance of the work in accordance with the contract requirements, and is in charge of all construction operations (regardless of who performs the work) and (b) such other of its own organizational resources (supervision, management, and engineering services) as the contracting officer determines is necessary to assure the performance of the contract.

4. No portion of the contract shall be sublet, assigned or otherwise disposed of except with the written consent of the contracting officer, or authorized representative, and such consent when given shall not be construed to relieve the contractor of any responsibility for the fulfillment of the contract. Written consent will be given only after the contracting agency has assured that each subcontract is evidenced in writing and that it contains all pertinent provisions and requirements of the prime contract.

5. The 30% self-performance requirement of paragraph (1) is not applicable to design-build contracts; however, contracting agencies may establish their own self-performance requirements.

VII. SAFETY: ACCIDENT PREVENTION

This provision is applicable to all Federal-aid construction contracts and to all related subcontracts.

1. In the performance of this contract the contractor shall comply with all applicable Federal, State, and local laws governing safety, health, and sanitation (23 CFR 635). The contractor shall provide all safeguards, safety devices and protective equipment and take any other needed actions as it determines, or as the contracting officer may determine, to be reasonably necessary to protect the life and health of employees on the job and the safety of the public and to protect property in connection with the performance of the work covered by the contract.

2. It is a condition of this contract, and shall be made a condition of each subcontract, which the contractor enters into pursuant to this contract, that the contractor and any subcontractor shall not permit any employee, in performance of the contract, to work in surroundings or under conditions which are unsanitary, hazardous or dangerous to his/her health or safety, as determined under construction safety and health standards (29 CFR 1926) promulgated by the Secretary of Labor, in accordance with Section 107 of the Contract Work Hours and Safety Standards Act (40 U.S.C. 3704).

3. Pursuant to 29 CFR 1926.3, it is a condition of this contract that the Secretary of Labor or authorized representative thereof, shall have right of entry to any site of contract performance to inspect or investigate the matter of compliance with the construction safety and health standards and to carry out

the duties of the Secretary under Section 107 of the Contract Work Hours and Safety Standards Act (40 U.S.C.3704).

VIII. FALSE STATEMENTS CONCERNING HIGHWAY PROJECTS

This provision is applicable to all Federal-aid construction contracts and to all related subcontracts.

In order to assure high quality and durable construction in conformity with approved plans and specifications and a high degree of reliability on statements and representations made by engineers, contractors, suppliers, and workers on Federal-aid highway projects, it is essential that all persons concerned with the project perform their functions as carefully, thoroughly, and honestly as possible. Willful falsification, distortion, or misrepresentation with respect to any facts related to the project is a violation of Federal law. To prevent any misunderstanding regarding the seriousness of these and similar acts, Form FHWA-1022 shall be posted on each Federal-aid highway project (23 CFR 635) in one or more places where it is readily available to all persons concerned with the project:

18 U.S.C. 1020 reads as follows:

"Whoever, being an officer, agent, or employee of the United States, or of any State or Territory, or whoever, whether a person, association, firm, or corporation, knowingly makes any false statement, false representation, or false report as to the character, quality, quantity, or cost of the material used or to be used, or the quantity or quality of the work performed or to be performed, or the cost thereof in connection with the submission of plans, maps, specifications, contracts, or costs of construction on any highway or related project submitted for approval to the Secretary of Transportation; or

Whoever knowingly makes any false statement, false representation, false report or false claim with respect to the character, quality, quantity, or cost of any work performed or to be performed, or materials furnished or to be furnished, in connection with the construction of any highway or related project approved by the Secretary of Transportation; or

Whoever knowingly makes any false statement or false representation as to material fact in any statement, certificate, or report submitted pursuant to provisions of the Federal-aid Roads Act approved July 1, 1916, (39 Stat. 355), as amended and supplemented;

Shall be fined under this title or imprisoned not more than 5 years or both."

IX. IMPLEMENTATION OF CLEAN AIR ACT AND FEDERAL WATER POLLUTION CONTROL ACT

This provision is applicable to all Federal-aid construction contracts and to all related subcontracts.

By submission of this bid/proposal or the execution of this contract, or subcontract, as appropriate, the bidder, proposer, Federal-aid construction contractor, or subcontractor, as appropriate, will be deemed to have stipulated as follows:

1. That any person who is or will be utilized in the performance of this contract is not prohibited from receiving an award due to a violation of Section 508 of the Clean Water Act or Section 306 of the Clean Air Act.

2. That the contractor agrees to include or cause to be included the requirements of paragraph (1) of this Section X in every subcontract, and further agrees to take such action as the contracting agency may direct as a means of enforcing such requirements.

X. CERTIFICATION REGARDING DEBARMENT, SUSPENSION, INELIGIBILITY AND VOLUNTARY EXCLUSION

This provision is applicable to all Federal-aid construction contracts, design-build contracts, subcontracts, lower-tier subcontracts, purchase orders, lease agreements, consultant contracts or any other covered transaction requiring FHWA approval or that is estimated to cost \$25,000 or more – as defined in 2 CFR Parts 180 and 1200.

1. Instructions for Certification – First Tier Participants:

a. By signing and submitting this proposal, the prospective first tier participant is providing the certification set out below.

b. The inability of a person to provide the certification set out below will not necessarily result in denial of participation in this covered transaction. The prospective first tier participant shall submit an explanation of why it cannot provide the certification set out below. The certification or explanation will be considered in connection with the department or agency's determination whether to enter into this transaction. However, failure of the prospective first tier participant to furnish a certification or an explanation shall disqualify such a person from participation in this transaction.

c. The certification in this clause is a material representation of fact upon which reliance was placed when the contracting agency determined to enter into this transaction. If it is later determined that the prospective participant knowingly rendered an erroneous certification, in addition to other remedies available to the Federal Government, the contracting agency may terminate this transaction for cause of default.

d. The prospective first tier participant shall provide immediate written notice to the contracting agency to whom this proposal is submitted if any time the prospective first tier participant learns that its certification was erroneous when submitted or has become erroneous by reason of changed circumstances.

e. The terms "covered transaction," "debarred," "suspended," "ineligible," "participant," "person," "principal," and "voluntarily excluded," as used in this clause, are defined in 2 CFR Parts 180 and 1200. "First Tier Covered Transactions" refers to any covered transaction between a grantee or subgrantee of Federal funds and a participant (such as the prime or general contract). "Lower Tier Covered Transactions" refers to any covered transaction under a First Tier Covered Transaction (such as subcontracts). "First Tier Participant" refers to the participant who has entered into a covered transaction with a grantee or subgrantee of Federal funds (such as the prime or general contractor). "Lower Tier Participant" refers any participant who has entered into a covered transaction with a First Tier Participant or other Lower Tier Participants (such as subcontractors and suppliers).

f. The prospective first tier participant agrees by submitting this proposal that, should the proposed covered transaction be entered into, it shall not knowingly enter into any lower tier covered transaction with a person who is debarred, suspended, declared ineligible, or voluntarily excluded from

participation in this covered transaction, unless authorized by the department or agency entering into this transaction.

g. The prospective first tier participant further agrees by submitting this proposal that it will include the clause titled "Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion-Lower Tier Covered Transactions," provided by the department or contracting agency, entering into this covered transaction, without modification, in all lower tier covered transactions and in all solicitations for lower tier covered transactions exceeding the \$25,000 threshold.

h. A participant in a covered transaction may rely upon a certification of a prospective participant in a lower tier covered transaction that is not debarred, suspended, ineligible, or voluntarily excluded from the covered transaction, unless it knows that the certification is erroneous. A participant is responsible for ensuring that its principals are not suspended, debarred, or otherwise ineligible to participate in covered transactions. To verify the eligibility of its principals, as well as the eligibility of any lower tier prospective participants, each participant may, but is not required to, check the Excluded Parties List System website (<https://www.epls.gov/>), which is compiled by the General Services Administration.

i. Nothing contained in the foregoing shall be construed to require the establishment of a system of records in order to render in good faith the certification required by this clause. The knowledge and information of the prospective participant is not required to exceed that which is normally possessed by a prudent person in the ordinary course of business dealings.

j. Except for transactions authorized under paragraph (f) of these instructions, if a participant in a covered transaction knowingly enters into a lower tier covered transaction with a person who is suspended, debarred, ineligible, or voluntarily excluded from participation in this transaction, in addition to other remedies available to the Federal Government, the department or agency may terminate this transaction for cause or default.

* * * * *

2. Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion – First Tier Participants:

a. The prospective first tier participant certifies to the best of its knowledge and belief, that it and its principals:

(1) Are not presently debarred, suspended, proposed for debarment, declared ineligible, or voluntarily excluded from participating in covered transactions by any Federal department or agency;

(2) Have not within a three-year period preceding this proposal been convicted of or had a civil judgment rendered against them for commission of fraud or a criminal offense in connection with obtaining, attempting to obtain, or performing a public (Federal, State or local) transaction or contract under a public transaction; violation of Federal or State antitrust statutes or commission of embezzlement, theft, forgery, bribery, falsification or destruction of records, making false statements, or receiving stolen property;

(3) Are not presently indicted for or otherwise criminally or civilly charged by a governmental entity (Federal, State or local) with commission of any of the offenses enumerated in paragraph (a)(2) of this certification; and

(4) Have not within a three-year period preceding this application/proposal had one or more public transactions (Federal, State or local) terminated for cause or default.

b. Where the prospective participant is unable to certify to any of the statements in this certification, such prospective participant shall attach an explanation to this proposal.

2. Instructions for Certification - Lower Tier Participants:

(Applicable to all subcontracts, purchase orders and other lower tier transactions requiring prior FHWA approval or estimated to cost \$25,000 or more - 2 CFR Parts 180 and 1200)

a. By signing and submitting this proposal, the prospective lower tier is providing the certification set out below.

b. The certification in this clause is a material representation of fact upon which reliance was placed when this transaction was entered into. If it is later determined that the prospective lower tier participant knowingly rendered an erroneous certification, in addition to other remedies available to the Federal Government, the department, or agency with which this transaction originated may pursue available remedies, including suspension and/or debarment.

c. The prospective lower tier participant shall provide immediate written notice to the person to which this proposal is submitted if at any time the prospective lower tier participant learns that its certification was erroneous by reason of changed circumstances.

d. The terms "covered transaction," "debarred," "suspended," "ineligible," "participant," "person," "principal," and "voluntarily excluded," as used in this clause, are defined in 2 CFR Parts 180 and 1200. You may contact the person to which this proposal is submitted for assistance in obtaining a copy of those regulations. "First Tier Covered Transactions" refers to any covered transaction between a grantee or subgrantee of Federal funds and a participant (such as the prime or general contract). "Lower Tier Covered Transactions" refers to any covered transaction under a First Tier Covered Transaction (such as subcontracts). "First Tier Participant" refers to the participant who has entered into a covered transaction with a grantee or subgrantee of Federal funds (such as the prime or general contractor). "Lower Tier Participant" refers any participant who has entered into a covered transaction with a First Tier Participant or other Lower Tier Participants (such as subcontractors and suppliers).

e. The prospective lower tier participant agrees by submitting this proposal that, should the proposed covered transaction be entered into, it shall not knowingly enter into any lower tier covered transaction with a person who is debarred, suspended, declared ineligible, or voluntarily excluded from participation in this covered transaction, unless authorized by the department or agency with which this transaction originated.

f. The prospective lower tier participant further agrees by submitting this proposal that it will include this clause titled "Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion-Lower Tier Covered Transaction," without modification, in all lower tier covered transactions and in all solicitations for lower tier covered transactions exceeding the \$25,000 threshold.

g. A participant in a covered transaction may rely upon a certification of a prospective participant in a lower tier covered transaction that is not debarred, suspended, ineligible, or voluntarily excluded from the covered transaction, unless it knows that the certification is erroneous. A participant is responsible for ensuring that its principals are not suspended, debarred, or otherwise ineligible to participate in covered transactions. To verify the eligibility of its principals, as well as the eligibility of any lower tier prospective participants, each participant may, but is not required to, check the Excluded Parties List System website (<https://www.epls.gov/>), which is compiled by the General Services Administration.

h. Nothing contained in the foregoing shall be construed to require establishment of a system of records in order to render in good faith the certification required by this clause. The knowledge and information of participant is not required to exceed that which is normally possessed by a prudent person in the ordinary course of business dealings.

i. Except for transactions authorized under paragraph e of these instructions, if a participant in a covered transaction knowingly enters into a lower tier covered transaction with a person who is suspended, debarred, ineligible, or voluntarily excluded from participation in this transaction, in addition to other remedies available to the Federal Government, the department or agency with which this transaction originated may pursue available remedies, including suspension and/or debarment.

* * * * *

Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion--Lower Tier Participants:

1. The prospective lower tier participant certifies, by submission of this proposal, that neither it nor its principals is presently debarred, suspended, proposed for debarment, declared ineligible, or voluntarily excluded from participating in covered transactions by any Federal department or agency.

2. Where the prospective lower tier participant is unable to certify to any of the statements in this certification, such prospective participant shall attach an explanation to this proposal.

* * * * *

XI. CERTIFICATION REGARDING USE OF CONTRACT FUNDS FOR LOBBYING

This provision is applicable to all Federal-aid construction contracts and to all related subcontracts which exceed \$100,000 (49 CFR 20).

1. The prospective participant certifies, by signing and submitting this bid or proposal, to the best of his or her knowledge and belief, that:

a. No Federal appropriated funds have been paid or will be paid, by or on behalf of the undersigned, to any person for influencing or attempting to influence an officer or employee of any Federal agency, a Member of Congress, an officer or employee of Congress, or an employee of a Member of Congress in connection with the awarding of any Federal contract, the making of any Federal grant, the making of any Federal loan, the entering into of any cooperative agreement, and the extension, continuation, renewal, amendment, or modification of any Federal contract, grant, loan, or cooperative agreement.

b. If any funds other than Federal appropriated funds have been paid or will be paid to any person for influencing or attempting to influence an officer or employee of any Federal agency, a Member of Congress, an officer or employee of Congress, or an employee of a Member of Congress in connection with this Federal contract, grant, loan, or cooperative agreement, the undersigned shall complete and submit Standard Form-LLL, "Disclosure Form to Report Lobbying," in accordance with its instructions.

2. This certification is a material representation of fact upon which reliance was placed when this transaction was made or entered into. Submission of this certification is a prerequisite for making or entering into this transaction imposed by 31 U.S.C. 1352. Any person who fails to file the required certification shall be subject to a civil penalty of not less than \$10,000 and not more than \$100,000 for each such failure.

3. The prospective participant also agrees by submitting its bid or proposal that the participant shall require that the language of this certification be included in all lower tier subcontracts, which exceed \$100,000 and that all such recipients shall certify and disclose accordingly.

EXHIBIT B**TITLE VI CONTRACTOR ASSURANCES
APPENDIX A**

During the performance of this contract, the contractor, for itself, its assignees and successors in interest (hereinafter referred to as the "contractor") agrees as follows:

1. **Compliance with Regulations:** The contractor (hereinafter includes consultants) will comply with the Regulations relative to Nondiscrimination in Federally-assisted programs of the United States Department of Transportation Federal Highway Administration, as they may be amended from time to time, which are herein incorporated by reference and made a part of this contract.
2. **Nondiscrimination:** The contractor, with regard to the work performed by it during the contract, will not discriminate on the grounds of race, color, national origin, sex, age, disability, income or Limited English Proficiency in the selection and retention of subcontractors, including procurements of materials and leases of equipment. The contractor will not participate directly or indirectly in the discrimination prohibited by the Acts and Regulations, including employment practices when the contract covers any activity, project, or program set forth in Appendix B of 49 CFR Part 21.
3. **Solicitations for Subcontracts, Including Procurements of Materials and Equipment:** In all solicitations, either by bidding, or negotiation made by the contractor for work to be performed under a subcontract, including procurements of materials, or leases of equipment, each potential subcontractor or supplier will be notified by the contractor of the contractor's obligations under this contract and Acts and the Regulations relative to Non-discrimination on the grounds of race, color, or national origin.
4. **Information and Reports:** The contractor will provide all information and reports required by the Acts, the Regulations, and directives issued pursuant thereto and will permit access to its books, records, accounts, other sources of information, and its facilities as may be determined by the Recipient or the Federal Highway Administration to be pertinent to ascertain compliance with such Acts, Regulations, and instructions. Where any information required of a contractor is in the exclusive possession of another who fails or refuses to furnish this information, the contractor will so certify to the Recipient or the Federal Highway Administration, as appropriate, and will set forth what efforts it has made to obtain the information.
5. **Sanctions for Non-compliance:** In the event of the contractor's non-compliance with the Non-discrimination provisions of this contract, the Recipient will impose such contract sanctions as it or the Federal Highway Administration may determine to be appropriate, including, but not limited to:
 - a. withholding contract payments to the contractor under the contract until the contractor complies; and/or
 - b. cancelling, terminating, or suspending a contract, in whole or in part.
6. **Incorporation of Provisions:** The contractor will include the provisions of paragraphs one through six in every subcontract, including procurements of materials and leases of equipment, unless exempt by the Acts, the Regulations and directives issued pursuant thereto. The contractor will take action with respect to any subcontract or procurement as the Recipient or the Federal Highway Administration may direct as a means of enforcing such provisions including sanctions for

noncompliance. Provided, that if the contractor becomes involved in, or is threatened with, litigation by a subcontractor, or supplier because of such direction, the contractor may request the Recipient to enter into any litigation to protect the interests of the Recipient. In addition, the contractor may request the United States to enter into the litigation to protect the interests of the United States.

TITLE VI CONTRACTOR ASSURANCES APPENDIX E

During the performance of this contract, the contractor, for itself, its assignees, and successors in interest (hereinafter referred to as the "contractor") agrees to comply with the following nondiscrimination statutes and authorities; including but not limited to:

- Title VI of the Civil Rights Act of 1964 (78 Stat. 252, 42 U.S.C. § 2000d et seq.), (prohibits discrimination on the basis of race, color, national origin), as implemented by 49 C.F.R. § 21.1 et seq. and 49 C.F.R. part 303;
- The Uniform Relocation Assistance and Real Property Acquisition Policies Act of 1970, (42 U.S.C. § 4601) (prohibits unfair treatment of persons displaced or whose property has been acquired because of Federal or Federal-aid programs and projects);
- Federal-Aid Highway Act of 1973 (23 U.S.C. § 324 et seq.) (prohibits discrimination on the basis of sex);
- Section 504 of the Rehabilitation Act of 1973, as amended (29 U.S.C. § 794 et seq.) (prohibits discrimination on the basis of disability); and 49 C.F.R. part 27;
- The Age Discrimination Act of 1975, as amended (42 U.S.C. § 6101 et seq.) (prohibits discrimination on the basis of age);
- Airport and Airway Improvement Act of 1982 (Pub. L. 97-248 (1982)), as amended (prohibits discrimination based on race, creed, color, national origin, or sex);
- The Civil Rights Restoration Act of 1987 (102 Stat. 28) (*" ... which restore[d] the broad scope of coverage and to clarify the application of Title IX of the Education Amendments of 1972, section 504 of the Rehabilitation Act of 1973, the Age Discrimination Act of 1975, and Title VI of the Civil Rights Act of 1964."*);
- Titles II and III of the Americans with Disabilities Act, which prohibit discrimination on the basis of disability in the operation of public entities, public and private transportation systems, places of public accommodation, and certain testing entities (42 U.S.C. §§ 12131 --12189), as implemented by Department of Justice regulations at 28 C.F.R. parts 35 and 36, and Department of Transportation regulations at 49 C.F.R. parts 37 and 38;
- The Federal Aviation Administration's Non-discrimination statute (49 U.S.C. § 47123) (prohibits discrimination on the basis of race, color, national origin, and sex);
- Executive Order 12898, Federal Actions to Address Environmental Justice in Minority Populations and Low-Income Populations, which ensures non-discrimination against minority populations by discouraging programs, policies, and activities with disproportionately high and adverse human health or environmental effects on minority and low-income populations;
- Executive Order 13166, Improving Access to Services for Persons with Limited English Proficiency, and resulting agency guidance, national origin discrimination includes discrimination because of limited English proficiency (LEP). To ensure compliance with Title VI, you must take reasonable steps to ensure that LEP persons have meaningful access to your programs (70 Fed. Reg. at 74087 to 74100);
- Title of the Education Amendments of 1972, as amended, which prohibits you from discriminating because of sex in education programs or activities (20 U.S.C. § 1681 et seq).

EXHIBIT C**CONTRACTOR WORKFORCE UTILIZATION (FEDERAL EXECUTIVE ORDER 11246) /
EQUAL EMPLOYMENT OPPORTUNITY
(Federal - FHWA)****1. Project Workforce Utilization Goals:**

These goals are applicable to all the Contractor's construction work (whether or not it is Federal or Federally assisted or funded) performed in the covered area. If the contractor performs construction work in a geographical area located outside of the covered area, it shall apply the goals established for the geographical area where the work is actually performed.

Whenever the Contractor, or any Subcontractor at any tier, subcontracts a portion of the work involving any construction trade, it shall physically include in each subcontract in excess of \$10,000 the provisions of these specifications which contain the applicable goals for minority and female participation.

The goals for minority and female utilization are expressed in percentage terms for the contractor's aggregate work-force in each trade on all construction work in the covered area, are referenced in the attached Appendix A.

2. Executive Order 11246

The Contractor's compliance with Executive Order 11246 and 41-CFR Part 60-4 shall be based on its implementation of the specific affirmative action obligations required by the specifications set forth in 41 CFR 60-4.3(A) and its efforts to meet the goals established for the geographical area where the contract is to be performed. The hours of minority and female employment and training must be substantially uniform throughout the length of the contract, and in each trade, and the contractor shall make a good faith effort to employ minorities and women evenly on each of its projects. The transfer of minority or female employees or trainees from contractor to contractor or from project to project for the sole purpose of meeting the contractor's goals shall be a violation of the contract, the Executive Order and the regulations in 41 CFR Part 60-4. Compliance with the goals will be measured against the total work hour performed.

If the Contractor is participating (pursuant to 41 CFR 60-4.5) in a Hometown Plan approved by the U.S. Department of Labor in the covered area either individually or through an association, its affirmative action obligations on all work in the Plan area (including goals and timetables) shall be in accordance with that Plan for those trades which have unions participating in the Plan. Contractors must be able to demonstrate their participation in and compliance with the provisions of any such Hometown Plan. Each Contractor or Subcontractor participating in an approved Plan is individually required to comply with its obligations under the EEO clause, and to make a good faith effort to achieve each goal under the Plan in each trade in which it has employees. The overall good faith performance by other Contractors or subcontractors toward a goal in an approved Pan does not excuse any covered Contractor's of subcontractor's failure to take good faith efforts to achieve the plan goals and timetables.

The Contractor shall implement the specific affirmative action standards provided in a through p of these specifications. The goals set forth in the solicitation from which this contract resulted are expressed as percentages of the total hours of employment and training of minority and female utilization the Contractor should reasonably be able to achieve in each construction trade in

which it has employees in the covered area. Covered Construction contractors performing construction work in geographical areas where they do not have a federal or federally assisted construction contract shall apply the minority and female goals established for the geographical area where the work is being performed. Goals are published periodically in the Federal Register in notice form and such notices may be obtained from any Office of Federal Contract Compliance Programs (OFCCP) Office or from Federal procurement contracting officers. The Contractor is expected to make substantially uniform progress in meeting its goals in each craft during the period specified.

Neither the provisions of any collective bargaining agreement, nor the failure by a union with whom the Contractor has a collective bargaining agreement, to refer either minorities or women shall excuse the Contractor's obligations under these specifications, Executive Order 11246, or the regulations promulgated pursuant hereto.

In order for the nonworking training hours of apprentices and trainees to be counted in meeting the goals, such apprentices and trainees must be employed by the Contractor during the training period, and the Contractor must have made a commitment to employ the apprentices and trainees at the completion of their training, subject to the availability of employment opportunities. Trainees must be trained pursuant to training programs approved by the U.S. Department of Labor.

The Contractor shall take specific affirmative actions to ensure equal employment opportunity. The evaluation of the Contractor's compliance with these specifications shall be based upon its effort to achieve maximum results from its actions. The Contractor shall document these efforts fully, and shall implement affirmative action steps at least as extensive as the following:

- a. Ensure and maintain a working environment free of harassment, intimidation, and coercion at all sites; and in all facilities at which the Contractor's employees are assigned to work. The Contractor, where possible, will assign two or more women to each construction project. The Contractor shall specifically ensure that all foremen, superintendents, and other on-site supervisory personnel are aware of and carry out the Contractor's obligation to maintain such a working environment, with specific attention to minority or female individuals working at such sites or in such facilities.
- b. Establish and maintain a current list of minority and female recruitment sources, provide written notification to minority and female recruitment sources and to community organizations when the Contractor or its unions have employment opportunities available, and maintain a record of the organizations' responses.
- c. Maintain a current file of the names, addresses and telephone numbers of each minority and female off the street applicant and minority or female referral from a union, a recruitment source or community organization and of what action was taken with respect to each such individual. If such individual was sent to the union hiring hall for referral and was not referred back to the Contractor by the union or, if referred, not employed by the Contractor, this shall be documented in the file with the reason thereafter; along with whatever additional actions the Contractor may have taken.
- d. Provide immediate written notification to the Director when the Union or Unions with which the Contractor has a collective bargaining agreement has not referred to the Contractor a minority person or women sent by the Contractor, or when the Contractor has other

information that the Union referral process has impeded the Contractor's efforts to meet its obligations.

- e. Develop on-the-job training opportunities and/or participate in training programs for the area which expressly include minorities and women, including upgrading programs and apprenticeship and trainee programs relevant to the Contractor's employment needs, especially those programs funded or approved by the Department of Labor. The Contractor shall provide notice of these programs to the sources compiled under b above.
- f. Disseminate the Contractor's EEO policy by providing notice of the policy to unions and training programs and requesting their cooperation in assisting the Contractor in meeting its EEO obligations; by including it in any policy manual and collective bargaining agreement; by publicizing it in the company newspaper, annual report, etc.; by specific review of the policy with all management personnel and with all minority and female employees at least once a year; and by posting the company EEO Policy on bulletin boards accessible to all employees at each location where construction work is performed.
- g. Review, at least annually, the company EEO Policy and affirmative action obligations under these specifications with all employees having any responsibility for hiring, assignment, layoff, termination or other employment, decisions including specific Foreman, etc. prior to the initiation of construction work at any job site. A written record shall be made and maintained identifying the time and place of these meetings, persons attending, subject matter discussed, and disposition of the subject matter.
- h. Disseminate the Contractor's EEO Policy externally by including it in any advertising in the news media, specifically including minority and female news media, and providing written notification to and discussing the Contractor's EEO policy with other Contractors and subcontractors with whom the Contractor does or anticipates doing business.
- i. Direct its recruitment efforts, both oral and written, to minority female and community organizations, to schools with minority and female students and to minority and female recruitment and training organizations serving the Contractor's recruitment area and employment needs. Not later than one month prior to the date for the acceptance of applications for apprenticeship or other training by any recruitment source, the contractor shall send written notification to organizations such as the above, describing the openings, screening procedures and tests to be used in the selection process.
- j. Encourage present minority and female employees to recruit other minority persons and women and, where reasonable, provide after school, summer and vacation employment to minority and female youth both on the site and in other areas of a Contractor's work-force.
- k. Validate all tests and other selection requirements where there is an obligation to do so under 41 CFR Part 60-3.
- l. Conduct, at least annually, an inventory and evaluation at least of all minority and female personnel for promotional opportunities and encourage these employees to seek or to prepare for, through appropriate training, etc., such opportunities.
- m. Ensure that seniority practices, job classifications, work assignments and other personnel practices, do not have a discriminatory effect by continually monitoring all personnel and

employment related activities to ensure that the EEO policy and the Contractor's obligations under these specifications are being carried out.

- n. Ensure that all facilities and company activities are non-segregated except that separate or single user toilet and necessary changing facilities shall be provided to assure privacy between the sexes.
- o. Document and maintain a record of all solicitations of offers for subcontracts from minority and female construction contractors and suppliers, including circulation of solicitations to minority and female contractor associations and other business associations.
- p. Conduct a review at least annually of all supervisors' adherence to and performance under the Contractor's EEO policies and affirmative action obligations.

Contractors are encouraged to participate in voluntary associations which assist in fulfilling one or more of their affirmative action obligations (a through p). The efforts of a contractor association, joint contractor union, contractor community, or other similar group of which the contractor is a member and participant, may be asserted as fulfilling any one or more of its obligations under a through p of these specifications provided that the contractor actively participates in the group, makes every effort to assure that the group has a positive impact on the employment of minorities and women in the industry, ensures that the concrete benefits of the program are reflected in the Contractor's minority and female work-force participation, makes a good faith effort to meet with individual goals and timetables, and can provide access to documentation which demonstrates the effectiveness of actions taken on behalf of the Contractor. The obligation to comply, however, is the Contractor's and failure of such a group to fulfill an obligation shall not be a defense for the Contractor's noncompliance.

A single goal for minorities and a separate single goal for women have been established. The Contractor, however, is required to provide equal employment opportunity and to take affirmative action for all minority groups, both male and female, and all women, both minority and non-minority. Consequently, the Contractor may be in violation of Executive Order 11246 if a particular group is employed in a substantially disparate manner, (for example, even though the Contractor has achieved its goals for women generally, the Contractor may be in violation of the Executive Order if a specific minority group of women is under utilized).

The Contractor shall not use the goals and timetables or affirmative action standards to discriminate against any person because of race, color, religion, sex, or national origin.

The Contractor shall not enter into any Subcontract with any person or firm debarred from Government contracts pursuant to Executive Order 11246.

The Contractor shall carry out such sanctions and penalties for violation of these specifications and of the Equal Opportunity Clause, including suspension, termination and cancellation of existing subcontracts as may be imposed or ordered pursuant to Executive Order 11246, as amended, and its implementing regulations by the Office of Federal Contract Compliance Programs. Any Contractor who fails to carry out such sanctions and penalties shall be in violation of these specifications and Executive Order 11246, as amended.

The Contractor, in fulfilling its obligations under these specifications, shall implement specific affirmative action steps, at least as extensive as those standards prescribed in these

specifications, so as to achieve maximum results from its efforts to ensure equal employment opportunity. If the Contractor fails to comply with the requirements of the Executive Order, the implementing regulations, or these specifications, the Director shall proceed in accordance with 41 CFR 60-4.8.

The Contractor shall designate a responsible official to monitor all employment related activity to ensure that the company EEO policy is being carried out, to submit reports relating to the provisions hereof as may be required by the Government and to keep records. Records shall at least include for each employee the name, address, telephone numbers, construction trade, union affiliation if any, employee identification number when assigned, social security number, race, sex, status, (e.g. mechanic, apprentice, trainee, helper, or laborer) dates of changes in status, hours worked per week in the indicated trade, rate of pay, and locations at which the work was performed. Records shall be maintained in an easily understandable and retrievable form; however, to the degree that existing records satisfy this requirement, contractors shall not be required to maintain separate records.

Nothing herein provided shall be construed as a limitation upon the application of their laws which establish different standards of compliance or upon the application of requirements for the hiring of local or other area residents (e.g. those under the Public Works Employment Act of 1977 and the Community Development Block Grant Program).

The Director of the Office of Federal Contract Compliance Programs, from time to time, shall issue goals and timetables for minority and female utilization which shall be based on appropriate workforce, demographic or other relevant data and which shall cover construction projects or construction contracts performed in specific geographical areas. The goals, which shall be applicable to each construction trade in a covered contractor's or timetables, shall be published as notices in the Federal Register, and shall be inserted by the Contracting officers and applicants, as applicable, in the Notice required by 41 CFR 60-4.2.

FEDERALLY FUNDED OR ASSISTED PROJECTS
APPENDIX A
(Labor Market Goals)

Standard Metropolitan Statistical Area (SMSA)

Female

Minority

Bridgeport – Stamford – Norwalk – Danbury	10.2%
6.9%	

Bethel	Bridgeport	Brookfield	Danbury
Darien	Derby	Easton	Fairfield
Greenwich	Milford	Monroe	New Canaan
New Fairfield	Newton	Norwalk	Redding
Shelton	Stamford	Stratford	Trumbull
Weston	Westport	Wilton	

Hartford – Bristol – New Britain	6.9%
6.9%	

Andover	Avon	Berlin	Bloomfield
Bolton	Bristol	Burlington	Canton
Colchester	Columbia	Coventry	Cromwell
East Granby	East Hampton	East Hartford	East Windsor
Ellington	Enfield	Farmington	Glastonbury
Granby	Hartford	Hebron	Manchester
Marlborough	New Britain	New Hartford	Newington
Plainville	Plymouth	Portland	Rocky Hill
Simsbury	South Windsor	Southington	Stafford
Suffield	Tolland	Vernon	West Hartford
Wethersfield	Willington	Windsor	Windsor Locks

New Haven – Waterbury – Meriden	9.0%
6.9%	

Beacon Falls	Bethany	Branford	Cheshire
Clinton	East Haven	Guilford	Hamden
Madison	Meriden	Middlebury	Naugatuck
New Haven	North Branford	North Haven	Orange
Prospect	Southbury	Thomaston	Wallingford
Waterbury	Watertown	West Haven	Wolcott
Woodbridge	Woodbury		

New London – Norwich	4.5%
6.9%	

Bozrah	East Lyme	Griswold	Groton
Ledyard	Lisbon	Montville	New London
Norwich	Old Lyme	Old Saybrook	Preston
Sprague	Stonington	Waterford	

Non SMSA

Female

Minority

Litchfield – Windham			5.9%
6.9%			
Abington	Ashford	Ballouville	Bantam
Barkhamsted	Bethlehem	Bridgewater	Brooklyn
Canaan	Canterbury	Central Village	Cahplin
Colebrook	Cornwall	Cornwall Bridge	Danielson
Dayville	East Canaan	East Killingly	East Woodstock
Eastford	Falls Village	Gaylordsville	Goshen
Grosvenor Dale	Hampton	Harwinton	Kent
Killigly	Lakeside	Litchfield	Moosup
Morris	New Milford	New Preston	New Preston Marble Dale
Norfolk	North Canaan	No. Grosvenordale	North Windham
Oneco	Pequabuck	Pine Meadow	Plainfield
Pleasant Valley	Pomfret	Pomfret Center	Putnam
Quinebaug	Riverton	Rogers	Roxbury
Salisbury	Scotland	Sharon	South Kent
South Woodstock	Sterling	Taconic	Terryville
Thompson	Torrington	Warren	Warrenville
Washington	Washington Depot	Wauregan	West Cornwall
Willimantic	Winchester	Winchester Center	Windham
Winsted	Woodstock	Woodstock Valley	

EXHIBIT D**Health Insurance Portability and Accountability Act of 1996 (“HIPAA”).**

- (a) If the Contactor is a Business Associate under the requirements of the Health Insurance Portability and Accountability Act of 1996 (“HIPAA”), the Contractor must comply with all terms and conditions of this Section of the Contract. If the Contractor is not a Business Associate under HIPAA, this Section of the Contract does not apply to the Contractor for this Contract.
- (b) The Contractor is required to safeguard the use, publication and disclosure of information on all applicants for, and all clients who receive, services under the Contract in accordance with all applicable federal and state law regarding confidentiality, which includes but is not limited to HIPAA, more specifically with the Privacy and Security Rules at 45 C.F.R. Part 160 and Part 164, subparts A, C, and E; and
- (c) The State of Connecticut Agency named on page 1 of this Contract (hereinafter the “Department”) is a “covered entity” as that term is defined in 45 C.F.R. § 160.103; and
- (d) The Contractor, on behalf of the Department, performs functions that involve the use or disclosure of “individually identifiable health information,” as that term is defined in 45 C.F.R. § 160.103; and
- (e) The Contractor is a “business associate” of the Department, as that term is defined in 45 C.F.R. § 160.103; and
- (f) The Contractor and the Department agree to the following in order to secure compliance with the HIPAA, the requirements of Subtitle D of the Health Information Technology for Economic and Clinical Health Act (hereinafter the HITECH Act), (Pub. L. 111-5, sections 13400 to 13423), and more specifically with the Privacy and Security Rules at 45 C.F.R. Part 160 and Part 164, subparts A, C, and E.
- (g) Definitions
 - (1) “Breach shall have the same meaning as the term is defined in section 13400 of the HITECH Act (42 U.S.C. §17921(1))
 - (2) “Business Associate” shall mean the Contractor.
 - (3) “Covered Entity” shall mean the Department of the State of Connecticut named on page 1 of this Contract.
 - (4) “Designated Record Set” shall have the same meaning as the term “designated record set” in 45 C.F.R. § 164.501.
 - (5) “Electronic Health Record” shall have the same meaning as the term is defined in section 13400 of the HITECH Act (42 U.S.C. §17921(5))

- (6) "Individual" shall have the same meaning as the term "individual" in 45 C.F.R. § 160.103 and shall include a person who qualifies as a personal representative as defined in 45 C.F.R. § 164.502(g).
 - (7) "Privacy Rule" shall mean the Standards for Privacy of Individually Identifiable Health Information at 45 C.F.R. part 160 and parts 164, subparts A and E.
 - (8) "Protected Health Information" or "PHI" shall have the same meaning as the term "protected health information" in 45 C.F.R. § 160.103, limited to information created or received by the Business Associate from or on behalf of the Covered Entity.
 - (9) "Required by Law" shall have the same meaning as the term "required by law" in 45 C.F.R. § 164.103.
 - (10) "Secretary" shall mean the Secretary of the Department of Health and Human Services or his designee.
 - (11) "More stringent" shall have the same meaning as the term "more stringent" in 45 C.F.R. § 160.202.
 - (12) "This Section of the Contract" refers to the HIPAA Provisions stated herein, in their entirety.
 - (13) "Security Incident" shall have the same meaning as the term "security incident" in 45 C.F.R. § 164.304.
 - (14) "Security Rule" shall mean the Security Standards for the Protection of Electronic Protected Health Information at 45 C.F.R. part 160 and parts 164, subpart A and C.
 - (15) "Unsecured protected health information" shall have the same meaning as the term as defined in section 13402(h)(1)(A) of HITECH. Act. (42 U.S.C. §17932(h)(1)(A)).
- (h) Obligations and Activities of Business Associates.
- (1) Business Associate agrees not to use or disclose PHI other than as permitted or required by this Section of the Contract or as Required by Law.
 - (2) Business Associate agrees to use appropriate safeguards to prevent use or disclosure of PHI other than as provided for in this Section of the Contract.
 - (3) Business Associate agrees to use administrative, physical and technical safeguards that reasonably and appropriately protect the confidentiality, integrity, and availability of electronic protected health information that it creates, receives, maintains, or transmits on behalf of the Covered Entity.
 - (4) Business Associate agrees to mitigate, to the extent practicable, any harmful effect that is known to the Business Associate of a use or disclosure of PHI by Business Associate in violation of this Section of the Contract.

- (5) Business Associate agrees to report to Covered Entity any use or disclosure of PHI not provided for by this Section of the Contract or any security incident of which it becomes aware.
- (6) Business Associate agrees to insure that any agent, including a subcontractor, to whom it provides PHI received from, or created or received by Business Associate, on behalf of the Covered Entity, agrees to the same restrictions and conditions that apply through this Section of the Contract to Business Associate with respect to such information.
- (7) Business Associate agrees to provide access, at the request of the Covered Entity, and in the time and manner agreed to by the parties, to PHI in a Designated Record Set, to Covered Entity or, as directed by Covered Entity, to an Individual in order to meet the requirements under 45 C.F.R. § 164.524.
- (8) Business Associate agrees to make any amendments to PHI in a Designated Record Set that the Covered Entity directs or agrees to pursuant to 45 C.F.R. § 164.526 at the request of the Covered Entity, and in the time and manner agreed to by the parties.
- (9) Business Associate agrees to make internal practices, books, and records, including policies and procedures and PHI, relating to the use and disclosure of PHI received from, or created or received by, Business Associate on behalf of Covered Entity, available to Covered Entity or to the Secretary in a time and manner agreed to by the parties or designated by the Secretary, for purposes of the Secretary determining Covered Entity's compliance with the Privacy Rule.
- (10) Business Associate agrees to document such disclosures of PHI and information related to such disclosures as would be required for Covered Entity to respond to a request by an Individual for an accounting of disclosures of PHI in accordance with 45 C.F.R. § 164.528 and section 13405 of the HITECH Act (42 U.S.C. § 17935) and any regulations promulgated thereunder.
- (11) Business Associate agrees to provide to Covered Entity, in a time and manner agreed to by the parties, information collected in accordance with clause h. (10) of this Section of the Contract, to permit Covered Entity to respond to a request by an Individual for an accounting of disclosures of PHI in accordance with 45 C.F.R. § 164.528 and section 13405 of the HITECH Act (42 U.S.C. § 17935) and any regulations promulgated thereunder. Business Associate agrees at the Covered Entity's direction to provide an accounting of disclosures of PHI directly to an individual in accordance with 45 C.F.R. § 164.528 and section 13405 of the HITECH Act (42 U.S.C. § 17935) and any regulations promulgated thereunder.
- (12) Business Associate agrees to comply with any state or federal law that is more stringent than the Privacy Rule.
- (13) Business Associate agrees to comply with the requirements of the HITECH Act relating to privacy and security that are applicable to the Covered Entity and with the requirements of 45 C.F.R. sections 164.504(e), 164.308, 164.310, 164.312, and 164.316.

- (14) In the event that an individual requests that the Business Associate (a) restrict disclosures of PHI; (b) provide an accounting of disclosures of the individual's PHI; or (c) provide a copy of the individual's PHI in an electronic health record, the Business Associate agrees to notify the covered entity, in writing, within two business days of the request.
- (15) Business Associate agrees that it shall not, directly or indirectly, receive any remuneration in exchange for PHI of an individual without (1) the written approval of the covered entity, unless receipt of remuneration in exchange for PHI is expressly authorized by this Contract and (2) the valid authorization of the individual, except for the purposes provided under section 13405(d)(2) of the HITECH Act,(42 U.S.C. § 17935(d)(2)) and in any accompanying regulations
- (16) Obligations in the Event of a Breach
- A. The Business Associate agrees that, following the discovery of a breach of unsecured protected health information, it shall notify the Covered Entity of such breach in accordance with the requirements of section 13402 of HITECH (42 U.S.C. 17932(b) and the provisions of this Section of the Contract.
- B. Such notification shall be provided by the Business Associate to the Covered Entity without unreasonable delay, and in no case later than 30 days after the breach is discovered by the Business Associate, except as otherwise instructed in writing by a law enforcement official pursuant to section 13402 (g) of HITECH (42 U.S.C. 17932(g)) . A breach is considered discovered as of the first day on which it is, or reasonably should have been, known to the Business Associate. The notification shall include the identification and last known address, phone number and email address of each individual (or the next of kin of the individual if the individual is deceased) whose unsecured protected health information has been, or is reasonably believed by the Business Associate to have been, accessed, acquired, or disclosed during such breach.
- C. The Business Associate agrees to include in the notification to the Covered Entity at least the following information:
1. A brief description of what happened, including the date of the breach and the date of the discovery of the breach, if known.
 2. A description of the types of unsecured protected health information that were involved in the breach (such as full name, Social Security number, date of birth, home address, account number, or disability code).
 3. The steps the Business Associate recommends that individuals take to protect themselves from potential harm resulting from the breach.
 4. A detailed description of what the Business Associate is doing to investigate the breach, to mitigate losses, and to protect against any further breaches.
 5. Whether a law enforcement official has advised either verbally or in writing the Business Associate that he or she has determined that notification or notice to

individuals or the posting required under section 13402 of the HITECH Act would impede a criminal investigation or cause damage to national security and; if so, include contact information for said official.

- D. Business Associate agrees to provide appropriate staffing and have established procedures to ensure that individuals informed by the Covered Entity of a breach by the Business Associate have the opportunity to ask questions and contact the Business Associate for additional information regarding the breach. Such procedures shall include a toll-free telephone number, an e-mail address, a posting on its Web site and a postal address. Business Associate agrees to include in the notification of a breach by the Business Associate to the Covered Entity, a written description of the procedures that have been established to meet these requirements. Costs of such contact procedures will be borne by the Contractor.
 - E. Business Associate agrees that, in the event of a breach, it has the burden to demonstrate that it has complied with all notifications requirements set forth above, including evidence demonstrating the necessity of a delay in notification to the Covered Entity.
- (i) Permitted Uses and Disclosure by Business Associate.
- (1) General Use and Disclosure Provisions Except as otherwise limited in this Section of the Contract, Business Associate may use or disclose PHI to perform functions, activities, or services for, or on behalf of, Covered Entity as specified in this Contract, provided that such use or disclosure would not violate the Privacy Rule if done by Covered Entity or the minimum necessary policies and procedures of the Covered Entity.
 - (2) Specific Use and Disclosure Provisions
 - (A) Except as otherwise limited in this Section of the Contract, Business Associate may use PHI for the proper management and administration of Business Associate or to carry out the legal responsibilities of Business Associate.
 - (B) Except as otherwise limited in this Section of the Contract, Business Associate may disclose PHI for the proper management and administration of Business Associate, provided that disclosures are Required by Law, or Business Associate obtains reasonable assurances from the person to whom the information is disclosed that it will remain confidential and used or further disclosed only as Required by Law or for the purpose for which it was disclosed to the person, and the person notifies Business Associate of any instances of which it is aware in which the confidentiality of the information has been breached.
 - (C) Except as otherwise limited in this Section of the Contract, Business Associate may use PHI to provide Data Aggregation services to Covered Entity as permitted by 45 C.F.R. § 164.504(e)(2)(i)(B).
- (j) Obligations of Covered Entity.

- (1) Covered Entity shall notify Business Associate of any limitations in its notice of privacy practices of Covered Entity, in accordance with 45 C.F.R. § 164.520, or to the extent that such limitation may affect Business Associate's use or disclosure of PHI.
 - (2) Covered Entity shall notify Business Associate of any changes in, or revocation of, permission by Individual to use or disclose PHI, to the extent that such changes may affect Business Associate's use or disclosure of PHI.
 - (3) Covered Entity shall notify Business Associate of any restriction to the use or disclosure of PHI that Covered Entity has agreed to in accordance with 45 C.F.R. § 164.522, to the extent that such restriction may affect Business Associate's use or disclosure of PHI.
- (k) Permissible Requests by Covered Entity. Covered Entity shall not request Business Associate to use or disclose PHI in any manner that would not be permissible under the Privacy Rule if done by the Covered Entity, except that Business Associate may use and disclose PHI for data aggregation, and management and administrative activities of Business Associate, as permitted under this Section of the Contract.
- (l) Term and Termination.
- (1) Term. The Term of this Section of the Contract shall be effective as of the date the Contract is effective and shall terminate when the information collected in accordance with clause h. (10) of this Section of the Contract is provided to the Covered Entity and all of the PHI provided by Covered Entity to Business Associate, or created or received by Business Associate on behalf of Covered Entity, is destroyed or returned to Covered Entity, or, if it is infeasible to return or destroy PHI, protections are extended to such information, in accordance with the termination provisions in this Section.
 - (2) Termination for Cause Upon Covered Entity's knowledge of a material breach by Business Associate, Covered Entity shall either:
 - (A) Provide an opportunity for Business Associate to cure the breach or end the violation and terminate the Contract if Business Associate does not cure the breach or end the violation within the time specified by the Covered Entity; or
 - (B) Immediately terminate the Contract if Business Associate has breached a material term of this Section of the Contract and cure is not possible; or
 - (C) If neither termination nor cure is feasible, Covered Entity shall report the violation to the Secretary.
 - (3) Effect of Termination
 - (A) Except as provided in (l)(2) of this Section of the Contract, upon termination of this Contract, for any reason, Business Associate shall return or destroy all PHI received from Covered Entity, or created or received by Business Associate on behalf of Covered Entity. Business Associate shall also provide the information collected in accordance with clause h. (10) of this Section of the Contract to the Covered Entity

within ten business days of the notice of termination. This provision shall apply to PHI that is in the possession of subcontractors or agents of Business Associate. Business Associate shall retain no copies of the PHI.

(B) In the event that Business Associate determines that returning or destroying the PHI is infeasible, Business Associate shall provide to Covered Entity notification of the conditions that make return or destruction infeasible. Upon documentation by Business Associate that return or destruction of PHI is infeasible, Business Associate shall extend the protections of this Section of the Contract to such PHI and limit further uses and disclosures of PHI to those purposes that make return or destruction infeasible, for as long as Business Associate maintains such PHI. Infeasibility of the return or destruction of PHI includes, but is not limited to, requirements under state or federal law that the Business Associate maintains or preserves the PHI or copies thereof.

(m) Miscellaneous Provisions.

- (1) Regulatory References. A reference in this Section of the Contract to a section in the Privacy Rule means the section as in effect or as amended.
- (2) Amendment. The Parties agree to take such action as is necessary to amend this Section of the Contract from time to time as is necessary for Covered Entity to comply with requirements of the Privacy Rule and the Health Insurance Portability and Accountability Act of 1996, Pub. L. No. 104-191.
- (3) Survival. The respective rights and obligations of Business Associate shall survive the termination of this Contract.
- (4) Effect on Contract. Except as specifically required to implement the purposes of this Section of the Contract, all other terms of the Contract shall remain in force and effect.
- (5) Construction. This Section of the Contract shall be construed as broadly as necessary to implement and comply with the Privacy Standard. Any ambiguity in this Section of the Contract shall be resolved in favor of a meaning that complies, and is consistent with, the Privacy Standard.
- (6) Disclaimer. Covered Entity makes no warranty or representation that compliance with this Section of the Contract will be adequate or satisfactory for Business Associate's own purposes. Covered Entity shall not be liable to Business Associate for any claim, civil or criminal penalty, loss or damage related to or arising from the unauthorized use or disclosure of PHI by Business Associate or any of its officers, directors, employees, contractors or agents, or any third party to whom Business Associate has disclosed PHI contrary to the provisions of this Contract or applicable law. Business Associate is solely responsible for all decisions made, and actions taken, by Business Associate regarding the safeguarding, use and disclosure of PHI within its possession, custody or control.

(7) Indemnification. The Business Associate shall indemnify and hold the Covered Entity harmless from and against any and all claims, liabilities, judgments, fines, assessments, penalties, awards and any statutory damages that may be imposed or assessed pursuant to HIPAA, as amended or the

HITECH Act, including, without limitation, attorney's fees, expert witness fees, costs of investigation, litigation or dispute resolution, and costs awarded thereunder, relating to or arising out of any violation by the Business Associate and its agents, including subcontractors, of any obligation of Business Associate and its agents, including subcontractors, under this section of the contract, under HIPAA, the HITECH Act, the Privacy Rule and the Security Rule.

**Notice to Executive Branch State Contractors and Prospective State
Contractors of Campaign Contribution and Solicitation Limitations**

This notice is provided under the authority of Connecticut General Statutes §9-612 (f) (2) and is for the purpose of informing state contractors and prospective state contractors of the following law (italicized words are defined on the reverse side of this page).

CAMPAIGN CONTRIBUTION AND SOLICITATION LIMITATIONS

No *state contractor, prospective state contractor, principal of a state contractor or principal of a prospective state contractor*, with regard to a *state contract or state contract solicitation* with or from a state agency in the executive branch or a quasi-public agency or a holder, or principal of a holder, of a valid prequalification certificate, shall make a contribution to (i) an exploratory committee or candidate committee established by a candidate for nomination or election to the office of Governor, Lieutenant Governor, Attorney General, State Comptroller, Secretary of the State or State Treasurer, (ii) a political committee authorized to make contributions or expenditures to or for the benefit of such candidates, or (iii) a party committee (which includes town committees).

In addition, no holder or principal of a holder of a valid prequalification certificate, shall make a contribution to (i) an exploratory committee or candidate committee established by a candidate for nomination or election to the office of State senator or State representative, (ii) a political committee authorized to make contributions or expenditures to or for the benefit of such candidates, or (iii) a party committee.

On and after January 1, 2011, no state contractor, prospective state contractor, principal of a state contractor or principal of a prospective state contractor, with regard to a state contract or state contract solicitation with or from a state agency in the executive branch or a quasi-public agency or a holder, or principal of a holder of a valid prequalification certificate, shall **knowingly solicit** contributions from the state contractor's or prospective state contractor's employees or from a *subcontractor or principals of the subcontractor* on behalf of (i) an exploratory committee or candidate committee established by a candidate for nomination or election to the office of Governor, Lieutenant Governor, Attorney General, State Comptroller, Secretary of the State or State Treasurer, (ii) a political committee authorized to make contributions or expenditures to or for the benefit of such candidates, or (iii) a party committee.

DUTY TO INFORM

State contractors and prospective state contractors are required to inform their principals of the above prohibitions, as applicable, and the possible penalties and other consequences of any violation thereof.

PENALTIES FOR VIOLATIONS

Contributions or solicitations of contributions made in violation of the above prohibitions may result in the following civil and criminal penalties:

Civil penalties—Up to \$2,000 or twice the amount of the prohibited contribution, whichever is greater, against a principal or a contractor. Any state contractor or prospective state contractor which fails to make reasonable efforts to comply with the provisions requiring notice to its principals of these prohibitions and the possible consequences of their violations may also be subject to civil penalties of up to \$2,000 or twice the amount of the prohibited contributions made by their principals.

Criminal penalties—Any knowing and willful violation of the prohibition is a Class D felony, which may subject the violator to imprisonment of not more than 5 years, or not more than \$5,000 in fines, or both.

CONTRACT CONSEQUENCES

In the case of a state contractor, contributions made or solicited in violation of the above prohibitions may result in the contract being voided.

In the case of a prospective state contractor, contributions made or solicited in violation of the above prohibitions shall result in the contract described in the state contract solicitation not being awarded to the prospective state contractor, unless the State Elections Enforcement Commission determines that mitigating circumstances exist concerning such violation.

The State shall not award any other state contract to anyone found in violation of the above prohibitions for a period of one year after the election for which such contribution is made or solicited, unless the State Elections Enforcement Commission determines that mitigating circumstances exist concerning such violation.

Additional information may be found on the website of the State Elections Enforcement Commission, www.ct.gov/seec. Click on the link to "Lobbyist/Contractor Limitations."

DEFINITIONS

“State contractor” means a person, business entity or nonprofit organization that enters into a state contract. Such person, business entity or nonprofit organization shall be deemed to be a state contractor until December thirty-first of the year in which such contract terminates. “State contractor” does not include a municipality or any other political subdivision of the state, including any entities or associations duly created by the municipality or political subdivision exclusively amongst themselves to further any purpose authorized by statute or charter, or an employee in the executive or legislative branch of state government or a quasi-public agency, whether in the classified or unclassified service and full or part-time, and only in such person's capacity as a state or quasi-public agency employee.

“Prospective state contractor” means a person, business entity or nonprofit organization that (i) submits a response to a state contract solicitation by the state, a state agency or a quasi-public agency, or a proposal in response to a request for proposals by the state, a state agency or a quasi-public agency, until the contract has been entered into, or (ii) holds a valid prequalification certificate issued by the Commissioner of Administrative Services under section 4a-100. “Prospective state contractor” does not include a municipality or any other political subdivision of the state, including any entities or associations duly created by the municipality or political subdivision exclusively amongst themselves to further any purpose authorized by statute or charter, or an employee in the executive or legislative branch of state government or a quasi-public agency, whether in the classified or unclassified service and full or part-time, and only in such person's capacity as a state or quasi-public agency employee.

“Principal of a state contractor or prospective state contractor” means (i) any individual who is a member of the board of directors of, or has an ownership interest of five per cent or more in, a state contractor or prospective state contractor, which is a business entity, except for an individual who is a member of the board of directors of a nonprofit organization, (ii) an individual who is employed by a state contractor or prospective state contractor, which is a business entity, as president, treasurer or executive vice president, (iii) an individual who is the chief executive officer of a state contractor or prospective state contractor, which is not a business entity, or if a state contractor or prospective state contractor has no such officer, then the officer who duly possesses comparable powers and duties, (iv) an officer or an employee of any state contractor or prospective state contractor who has *managerial or discretionary responsibilities with respect to a state contract*, (v) the spouse or a *dependent child* who is eighteen years of age or older of an individual described in this subparagraph, or (vi) a political committee established or controlled by an individual described in this subparagraph or the business entity or nonprofit organization that is the state contractor or prospective state contractor.

“State contract” means an agreement or contract with the state or any state agency or any quasi-public agency, let through a procurement process or otherwise, having a value of fifty thousand dollars or more, or a combination or series of such agreements or contracts having a value of one hundred thousand dollars or more in a calendar year, for (i) the rendition of services, (ii) the furnishing of any goods, material, supplies, equipment or any items of any kind, (iii) the construction, alteration or repair of any public building or public work, (iv) the acquisition, sale or lease of any land or building, (v) a licensing arrangement, or (vi) a grant, loan or loan guarantee. “State contract” does not include any agreement or contract with the state, any state agency or any quasi-public agency that is exclusively federally funded, an education loan, a loan to an individual for other than commercial purposes or any agreement or contract between the state or any state agency and the United States Department of the Navy or the United States Department of Defense.

“State contract solicitation” means a request by a state agency or quasi-public agency, in whatever form issued, including, but not limited to, an invitation to bid, request for proposals, request for information or request for quotes, inviting bids, quotes or other types of submittals, through a competitive procurement process or another process authorized by law waiving competitive procurement.

“Managerial or discretionary responsibilities with respect to a state contract” means having direct, extensive and substantive responsibilities with respect to the negotiation of the state contract and not peripheral, clerical or ministerial responsibilities.

“Dependent child” means a child residing in an individual's household who may legally be claimed as a dependent on the federal income tax of such individual.

“Solicit” means (A) requesting that a contribution be made, (B) participating in any fundraising activities for a candidate committee, exploratory committee, political committee or party committee, including, but not limited to, forwarding tickets to potential contributors, receiving contributions for transmission to any such committee, serving on the committee that is hosting a fundraising event, introducing the candidate or making other public remarks at a fundraising event, being honored or otherwise recognized at a fundraising event, or bundling contributions, (C) serving as chairperson, treasurer or deputy treasurer of any such committee, or (D) establishing a political committee for the sole purpose of soliciting or receiving contributions for any committee. Solicit does not include: (i) making a contribution that is otherwise permitted by Chapter 155 of the Connecticut General Statutes; (ii) informing any person of a position taken by a candidate for public office or a public official, (iii) notifying the person of any activities of, or contact information for, any candidate for public office; or (iv) serving as a member in any party committee or as an officer of such committee that is not otherwise prohibited in this section.

“Subcontractor” means any person, business entity or nonprofit organization that contracts to perform part or all of the obligations of a state contractor's state contract. Such person, business entity or nonprofit organization shall be deemed to be a subcontractor until December thirty first of the year in which the subcontract terminates. “Subcontractor” does not include (i) a municipality or any other political subdivision of the state, including any entities or associations duly created by the municipality or political subdivision exclusively amongst themselves to further any purpose authorized by statute or charter, or (ii) an employee in the executive or legislative branch of state government or a quasi-public agency, whether in the classified or unclassified service and full or part-time, and only in such person's capacity as a state or quasi-public agency employee.

“Principal of a subcontractor” means (i) any individual who is a member of the board of directors of, or has an ownership interest of five per cent or more in, a subcontractor, which is a business entity, except for an individual who is a member of the board of directors of a nonprofit organization, (ii) an individual who is employed by a subcontractor, which is a business entity, as president, treasurer or executive vice president, (iii) an individual who is the chief executive officer of a subcontractor, which is not a business entity, or if a subcontractor has no such officer, then the officer who duly possesses comparable powers and duties, (iv) an officer or an employee of any subcontractor who has managerial or discretionary responsibilities with respect to a subcontract with a state contractor, (v) the spouse or a dependent child who is eighteen years of age or older of an individual described in this subparagraph, or (vi) a political committee established or controlled by an individual described in this subparagraph or the business entity or nonprofit organization that is the subcontractor.

EXHIBIT F

(Federal wage rate package will be inserted here for final executed contract only. Refer to NTC – Federal Wage Determinations)

EXHIBIT G

(State wages will be inserted here)

Project: Project No. 173-468 & 138-250; Revision And Replacement Of Traffic Control Signal With APS Upgrades

**Minimum Rates and Classifications
for Heavy/Highway Construction**

**Connecticut Department of Labor
Wage and Workplace Standards Division**

ID#: H 26645

By virtue of the authority vested in the Labor Commissioner under provisions of Section 31-53 of the General Statutes of Connecticut, as amended, the following are declared to be the prevailing rates and welfare payments and will apply only where the contract is advertised for bid within 20 days of the date on which the rates are established. Any contractor or subcontractor not obligated by agreement to pay to the welfare and pension fund shall pay this amount to each employee as part of his/her hourly wages.

Project Number: 173-468/ 138-250

Project Town: New Haven

FAP Number:

State Number:

Project: Project No. 173-468 & 138-250; Revision And Replacement Of Traffic Control Signal With APS Upgrades

CLASSIFICATION	Hourly Rate	Benefits
1) Boilermaker	33.79	34% + 8.96
1a) Bricklayer, Cement Masons, Cement Finishers, Plasterers, Stone Masons	34.72	32.15
2) Carpenters, Piledrivermen	33.53	25.66
2a) Diver Tenders	33.53	25.66

As of: Tuesday, October 22, 2019

Project: Project No. 173-468 & 138-250; Revision And Replacement Of Traffic Control Signal With APS Upgrades		
3) Divers	41.99	25.66
03a) Millwrights	34.04	26.09
4) Painters: (Bridge Construction) Brush, Roller, Blasting (Sand, Water, etc.), Spray	51.00	21.80
4a) Painters: Brush and Roller	34.62	21.80
4b) Painters: Spray Only	36.62	21.80
4c) Painters: Steel Only	35.62	21.80
4d) Painters: Blast and Spray	37.62	21.80

Project: Project No. 173-468 & 138-250; Revision And Replacement Of Traffic Control Signal With APS Upgrades		
4e) Painters: Tanks, Tower and Swing	36.62	21.80
5) Electrician (Trade License required: E-1,2 L-5,6 C-5,6 T-1,2 L-1,2 V-1,2,7,8,9)	38.50	28.61+3% of gross wage
6) Ironworkers: Ornamental, Reinforcing, Structural, and Precast Concrete Erection	36.67	35.77 + a
7) Plumbers (Trade License required: (P-1,2,6,7,8,9 J-1,2,3,4 SP-1,2) and Pipefitters (Including HVAC Work) (Trade License required: S-1,2,3,4,5,6,7,8 B-1,2,3,4 D-1,2,3,4 G-1, G-2, G-8, G-9)	43.62	32.06
----LABORERS-----		
8) Group 1: Laborer (Unskilled), Common or General, acetylene burner, concrete specialist	30.75	20.84
9) Group 2: Chain saw operators, fence and guard rail erectors, pneumatic tool operators, powdermen	31.00	20.84

Project: Project No. 173-468 & 138-250; Revision And Replacement Of Traffic Control Signal With APS Upgrades		
10) Group 3: Pipelayers	31.25	20.84
11) Group 4: Jackhammer/Pavement breaker (handheld); mason tenders (cement/concrete), catch basin builders, asphalt rakers, air track operators, block paver, curb setter and forklift operators	31.25	20.84
12) Group 5: Toxic waste removal (non-mechanical systems)	32.75	20.84
13) Group 6: Blasters	32.50	20.84
Group 7: Asbestos/lead removal, non-mechanical systems (does not include leaded joint pipe)	31.75	20.84
Group 8: Traffic control signalmen	18.00	20.84
Group 9: Hydraulic Drills	29.30	18.90

As of: Tuesday, October 22, 2019

Project: Project No. 173-468 & 138-250; Revision And Replacement Of Traffic Control Signal With APS
Upgrades

----LABORERS (TUNNEL CONSTRUCTION, FREE AIR). Shield Drive and
Liner Plate Tunnels in Free Air.----

13a) Miners, Motormen, Mucking Machine Operators, Nozzle Men, Grout Men, Shaft & Tunnel Steel & Rodmen, Shield & Erector, Arm Operator, Cable Tenders	32.98	20.84 + a
---	-------	-----------

13b) Brakemen, Trackmen	32.01	20.84 + a
-------------------------	-------	-----------

----CLEANING, CONCRETE AND CAULKING TUNNEL----

14) Concrete Workers, Form Movers, and Strippers	32.01	20.84 + a
--	-------	-----------

15) Form Erectors	32.34	20.84 + a
-------------------	-------	-----------

----ROCK SHAFT LINING, CONCRETE, LINING OF SAME AND TUNNEL
IN FREE AIR:----

As of: Tuesday, October 22, 2019

Project: Project No. 173-468 & 138-250; Revision And Replacement Of Traffic Control Signal With APS Upgrades		
16) Brakemen, Trackmen, Tunnel Laborers, Shaft Laborers	32.01	20.84 + a
17) Laborers Topside, Cage Tenders, Bellman	31.90	20.84 + a
18) Miners	32.98	20.84 + a
----TUNNELS, CAISSON AND CYLINDER WORK IN COMPRESSED AIR: ----		
18a) Blaster	39.47	20.84 + a
19) Brakemen, Trackmen, Groutman, Laborers, Outside Lock Tender, Gauge Tenders	39.27	20.84 + a
20) Change House Attendants, Powder Watchmen, Top on Iron Bolts	37.29	20.84 + a

Project: Project No. 173-468 & 138-250; Revision And Replacement Of Traffic Control Signal With APS
Upgrades

21) Mucking Machine Operator	40.06	20.84 + a
------------------------------	-------	-----------

----TRUCK DRIVERS----(*see note below)

Two axle trucks	29.51	24.52 + a
-----------------	-------	-----------

Three axle trucks; two axle ready mix	29.62	24.52 + a
---------------------------------------	-------	-----------

Three axle ready mix	29.67	24.52 + a
----------------------	-------	-----------

Four axle trucks, heavy duty trailer (up to 40 tons)	29.72	24.52 + a
--	-------	-----------

Four axle ready-mix	29.77	24.52 + a
---------------------	-------	-----------

Project: Project No. 173-468 & 138-250; Revision And Replacement Of Traffic Control Signal With APS Upgrades		
Heavy duty trailer (40 tons and over)	29.98	24.52 + a
Specialized earth moving equipment other than conventional type on-the road trucks and semi-trailer (including Euclids)	29.77	24.52 + a
----POWER EQUIPMENT OPERATORS----		
Group 1: Crane handling or erecting structural steel or stone, hoisting engineer (2 drums or over), front end loader (7 cubic yards or over), Work Boat 26 ft. & Over, Tunnel Boring Machines. (Trade License Required)	40.97	24.80 + a
Group 2: Cranes (100 ton rate capacity and over); Excavator over 2 cubic yards; Piledriver (\$3.00 premium when operator controls hammer); Bauer Drill/Caisson. (Trade License Required)	40.64	24.80 + a
Group 3: Excavator/Backhoe under 2 cubic yards; Cranes (under 100 ton rated capacity), Gradall; Master Mechanic; Hoisting Engineer (all types of equipment where a drum and cable are used to hoist or drag material regardless of motive power of operation), Rubber Tire Excavator (Drott-1085 or similar); Grader Operator; Bulldozer Fine Grade (slopes, shaping, laser or GPS, etc.). (Trade License Required)	39.88	24.80 + a
Group 4: Trenching Machines; Lighter Derrick; Concrete Finishing Machine; CMI Machine or Similar; Koehring Loader (Skooper)	39.48	24.80 + a

Project: Project No. 173-468 & 138-250; Revision And Replacement Of Traffic Control Signal With APS Upgrades		
Group 5: Specialty Railroad Equipment; Asphalt Paver; Asphalt Spreader; Asphalt Reclaiming Machine; Line Grinder; Concrete Pumps; Drills with Self Contained Power Units; Boring Machine; Post Hole Digger; Auger; Pounder; Well Digger; Milling Machine (over 24" Mandrell)	38.87	24.80 + a
Group 5 continued: Side Boom; Combination Hoe and Loader; Directional Driller.	38.87	24.80 + a
Group 6: Front End Loader (3 up to 7 cubic yards); Bulldozer (rough grade dozer).	38.55	24.80 + a
Group 7: Asphalt Roller; Concrete Saws and Cutters (ride on types); Vermeer Concrete Cutter; Stump Grinder; Scraper; Snooper; Skidder; Milling Machine (24" and Under Mandrel).	38.20	24.80 + a
Group 8: Mechanic, Grease Truck Operator, Hydroblaster, Barrier Mover, Power Stone Spreader; Welder; Work Boat under 26 ft.; Transfer Machine.	37.79	24.80 + a
Group 9: Front End Loader (under 3 cubic yards), Skid Steer Loader regardless of attachments (Bobcat or Similar); Fork Lift, Power Chipper; Landscape Equipment (including hydroseeder).	37.34	24.80 + a
Group 10: Vibratory Hammer, Ice Machine, Diesel and Air Hammer, etc.	35.24	24.80 + a

As of:

Tuesday, October 22, 2019

Project: Project No. 173-468 & 138-250; Revision And Replacement Of Traffic Control Signal With APS Upgrades		
Group 11: Conveyor, Earth Roller; Power Pavement Breaker (whiphammer), Robot Demolition Equipment.	35.24	24.80 + a
Group 12: Wellpoint Operator.	35.18	24.80 + a
Group 13: Compressor Battery Operator.	34.58	24.80 + a
Group 14: Elevator Operator; Tow Motor Operator (Solid Tire No Rough Terrain).	33.41	24.80 + a
Group 15: Generator Operator; Compressor Operator; Pump Operator; Welding Machine Operator; Heater Operator.	32.99	24.80 + a
Group 16: Maintenance Engineer/Oiler	32.32	24.80 + a
Group 17: Portable asphalt plant operator; portable crusher plant operator; portable concrete plant operator.	36.76	24.80 + a

Project: Project No. 173-468 & 138-250; Revision And Replacement Of Traffic Control Signal With APS
Upgrades

Group 18: Power Safety Boat; Vacuum Truck; Zim Mixer; Sweeper; 34.26 24.80 + a
(minimum for any job requiring CDL license).

**NOTE: SEE BELOW

----LINE CONSTRUCTION----(Railroad Construction and Maintenance)----

20) Lineman, Cable Splicer, Technician 48.19 6.5% + 22.00

21) Heavy Equipment Operator 42.26 6.5% + 19.88

22) Equipment Operator, Tractor Trailer Driver, Material Men 40.96 6.5% + 19.21

23) Driver Groundmen 26.50 6.5% + 9.00

As of: Tuesday, October 22, 2019

Project: Project No. 173-468 & 138-250; Revision And Replacement Of Traffic Control Signal With APS
Upgrades

23a) Truck Driver	40.96	6.5% + 17.76
-------------------	-------	--------------

----LINE CONSTRUCTION----

24) Driver Groundmen	30.92	6.5% + 9.70
----------------------	-------	-------------

25) Groundmen	22.67	6.5% + 6.20
---------------	-------	-------------

26) Heavy Equipment Operators	37.10	6.5% + 10.70
-------------------------------	-------	--------------

27) Linemen, Cable Splicers, Dynamite Men	41.22	6.5% + 12.20
---	-------	--------------

28) Material Men, Tractor Trailer Drivers, Equipment Operators	35.04	6.5% + 10.45
--	-------	--------------

Project: Project No. 173-468 & 138-250; Revision And Replacement Of Traffic Control Signal With APS
Upgrades

01) Asbestos/Toxic Waste Removal Laborers: Asbestos removal and encapsulation (except its removal from mechanical systems which are not to be scrapped), toxic waste removers, blasters. ****See Laborers Group 5 and 7****

Project: Project No. 173-468 & 138-250; Revision And Replacement Of Traffic Control Signal With APS Upgrades

Welders: Rate for craft to which welding is incidental.

**Note: Hazardous waste removal work receives additional \$1.25 per hour for truck drivers.*

***Note: Hazardous waste premium \$3.00 per hour over classified rate*

ALL Cranes: When crane operator is operating equipment that requires a fully licensed crane operator to operate he receives an extra \$4.00 premium in addition to the hourly wage rate and benefit contributions:

- 1) Crane handling or erecting structural steel or stone; hoisting engineer (2 drums or over)***
- 2) Cranes (100 ton rate capacity and over) Bauer Drill/Caisson***
- 3) Cranes (under 100 ton rated capacity)***

Crane with 150 ft. boom (including jib) - \$1.50 extra
Crane with 200 ft. boom (including jib) - \$2.50 extra
Crane with 250 ft. boom (including jib) - \$5.00 extra
Crane with 300 ft. boom (including jib) - \$7.00 extra
Crane with 400 ft. boom (including jib) - \$10.00 extra

All classifications that indicate a percentage of the fringe benefits must be calculated at the percentage rate times the "base hourly rate".

Apprentices duly registered under the Commissioner of Labor's regulations on "Work Training Standards for Apprenticeship and Training Programs" Section 31-51-d-1 to 12, are allowed to be paid the appropriate percentage of the prevailing journeymen hourly base and the full fringe benefit rate, providing the work site ratio shall not be less than one full-time journeyman instructing and supervising the work of each apprentice in a specific trade.

~~Connecticut General Statute Section 31-55a: Annual Adjustments to wage rates by contractors doing state work ~~

The Prevailing wage rates applicable to this project are subject to annual adjustments each July 1st for the duration of the project.

Each contractor shall pay the annual adjusted prevailing wage rate that is in effect each July 1st, as posted by the Department of Labor.

It is the contractor's responsibility to obtain the annual adjusted prevailing wage rate increases directly from the Department of Labor's website.

The annual adjustments will be posted on the Department of Labor's Web page: www.ct.gov/dol.

The Department of Labor will continue to issue the initial prevailing wage rate schedule to the Contracting Agency for the project.

All subsequent annual adjustments will be posted on our Web Site for contractor access.

Contracting Agencies are under no obligation pursuant to State labor law to pay any increase due to the annual adjustment provision.

As of: Tuesday, October 22, 2019

Project: Project No. 173-468 & 138-250; Revision And Replacement Of Traffic Control Signal With APS Upgrades

Effective October 1, 2005 - Public Act 05-50: any person performing the work of any mechanic, laborer, or worker shall be paid prevailing wage

All Person who perform work ON SITE must be paid prevailing wage for the appropriate mechanic, laborer, or worker classification.

All certified payrolls must list the hours worked and wages paid to All Persons who perform work ON SITE regardless of their ownership i.e.: (Owners, Corporate Officers, LLC Members, Independent Contractors, et. al)

Reporting and payment of wages is required regardless of any contractual relationship alleged to exist between the contractor and such person.

~~Unlisted classifications needed for work not included within the scope of the classifications listed may be added after award only as provided in the labor standards contract clause (29 CFR 5.5 (a) (1) (ii)).

Please direct any questions which you may have pertaining to classification of work and payment of prevailing wages to the Wage and Workplace Standards Division, telephone (860)263-6790.

Connecticut Department of Labor
Wage and Workplace Standards Division
FOOTNOTES

Please Note: If the “Benefits” listed on the schedule for the following occupations includes a letter(s) (+ a or + a+b for instance), refer to the information below.

Benefits to be paid at the appropriate prevailing wage rate for the listed occupation.

If the “Benefits” section for the occupation lists only a dollar amount, disregard the information below.

Bricklayers, Cement Masons, Cement Finishers, Concrete Finishers, Stone Masons
(Building Construction) and
(Residential- Hartford, Middlesex, New Haven, New London and Tolland Counties)

- a. Paid Holiday: Employees shall receive 4 hours for Christmas Eve holiday provided the employee works the regularly scheduled day before and after the holiday. Employers may schedule work on Christmas Eve and employees shall receive pay for actual hours worked in addition to holiday pay.

Elevator Constructors: Mechanics

- a. Paid Holidays: New Year’s Day, Memorial Day, Independence Day, Labor Day, Veterans’ Day, Thanksgiving Day, Christmas Day, plus the Friday after Thanksgiving.
- b. Vacation: Employer contributes 8% of basic hourly rate for 5 years or more of service or 6% of basic hourly rate for 6 months to 5 years of service as vacation pay credit.

Glaziers

- a. Paid Holidays: Labor Day and Christmas Day.

Power Equipment Operators
(Heavy and Highway Construction & Building Construction)

- a. Paid Holidays: New Year’s Day, Good Friday, Memorial day, Independence Day, Labor Day, Thanksgiving Day and Christmas Day, provided the employee works 3 days during the week in which the holiday falls, if scheduled, and if scheduled, the working day before and the working day after the holiday. Holidays falling on Saturday may be observed on Saturday, or if the employer so elects, on the preceding Friday.

Ironworkers

- a. Paid Holiday: Labor Day provided employee has been on the payroll for the 5 consecutive work days prior to Labor Day.

Laborers (Tunnel Construction)

- a. Paid Holidays: New Year's Day, Memorial Day, Independence Day, Labor Day, Thanksgiving Day and Christmas Day. No employee shall be eligible for holiday pay when he fails, without cause, to work the regular work day preceding the holiday or the regular work day following the holiday.

Roofers

- a. Paid Holidays: July 4th, Labor Day, and Christmas Day provided the employee is employed 15 days prior to the holiday.

Sprinkler Fitters

- a. Paid Holidays: Memorial Day, July 4th, Labor Day, Thanksgiving Day and Christmas Day, provided the employee has been in the employment of a contractor 20 working days prior to any such paid holiday.

Truck Drivers

(Heavy and Highway Construction & Building Construction)

- a. Paid Holidays: New Year's Day, Memorial Day, Independence Day, Labor Day, Thanksgiving Day, Christmas day, and Good Friday, provided the employee has at least 31 calendar days of service and works the last scheduled day before and the first scheduled day after the holiday, unless excused.

Information Bulletin ***Occupational Classifications***

The Connecticut Department of Labor has the responsibility to properly determine "job classification" on prevailing wage projects covered under C.G.S. Section 31-53(d).

Note: This information is intended to provide a sample of some occupational classifications for guidance purposes only. It is not an all-inclusive list of each occupation's duties. This list is being provided only to highlight some areas where a contractor may be unclear regarding the proper classification. If unsure, the employer should seek guidelines for CTDOL.

Below are additional clarifications of specific job duties performed for certain classifications:

- **ASBESTOS WORKERS**

Applies all insulating materials, protective coverings, coatings and finishes to all types of mechanical systems.

- **ASBESTOS INSULATOR**

Handle, install apply, fabricate, distribute, prepare, alter, repair, dismantle, heat and frost insulation, including penetration and fire stopping work on all penetration fire stop systems.

- **BOILERMAKERS**

Erects hydro plants, incomplete vessels, steel stacks, storage tanks for water, fuel, etc. Builds incomplete boilers, repairs heat exchanges and steam generators.

- **BRICKLAYERS, CEMENT MASONS, CEMENT FINISHERS, MARBLE MASONS, PLASTERERS, STONE MASONS, PLASTERERS. STONE MASONS, TERRAZZO WORKERS, TILE SETTERS**

Lays building materials such as brick, structural tile and concrete cinder, glass, gypsum, terra cotta block. Cuts, tools and sets marble, sets stone, finishes concrete, applies decorative steel, aluminum and plastic tile, applies cements, sand, pigment and marble chips to floors, stairways, etc.

- **CARPENTERS, MILLWRIGHTS. PILEDRIVERMEN. LATHERS. RESILEINT FLOOR LAYERS, DOCK BUILDERS, DIKERS, DIVER TENDERS**

Constructs, erects, installs and repairs structures and fixtures of wood, plywood and wallboard. Installs, assembles, dismantles, moves industrial machinery. Drives piling into ground to provide foundations for structures such as buildings and bridges, retaining walls for earth embankments, such as cofferdams. Fastens wooden, metal or rockboard lath to walls, ceilings and partitions of buildings, acoustical tile layer, concrete form builder. Applies firestopping materials on fire resistive joint systems only. Installation of curtain/window walls only where attached to wood or metal studs. Installation of insulated material of all types whether blown, nailed or attached in other ways to walls, ceilings and floors of buildings. Assembly and installation of modular furniture/furniture systems. Free-standing furniture is not covered. This includes free standing: student chairs, study top desks, book box desks, computer furniture, dictionary stand, atlas stand, wood shelving, two-position information access station, file cabinets, storage cabinets, tables, etc.

- **LABORER, CLEANING**

- The clean up of any construction debris and the general (heavy/light) cleaning, including sweeping, wash down, mopping, wiping of the construction facility and its furniture, washing, polishing, and dusting.

- **DELIVERY PERSONNEL**

- If delivery of supplies/building materials is to one common point and stockpiled there, prevailing wages are not required. If the delivery personnel are involved in the distribution of the material to multiple locations within the construction site then they would have to be paid prevailing wages for the type of work performed: laborer, equipment operator, electrician, ironworker, plumber, etc.

- An example of this would be where delivery of drywall is made to a building and the delivery personnel distribute the drywall from one "stockpile" location to further sub-locations on each floor. Distribution of material around a construction site is the job of a laborer or tradesman, and not a delivery personnel.

- **ELECTRICIANS**

Install, erect, maintenance, alteration or repair of any wire, cable, conduit, etc., which generates, transforms, transmits or uses electrical energy for light, heat, power or other purposes, including the Installation or maintenance of telecommunication, LAN wiring or computer equipment, and low voltage wiring. ****License required per Connecticut General Statutes: E-1,2 L-5,6 C-5,6 T-1,2 L-1,2 V-1,2,7,8,9.***

- **ELEVATOR CONSTRUCTORS**

Install, erect, maintenance and repair of all types of elevators, escalators, dumb waiters and moving walks. **License required by Connecticut General Statutes: R-1,2,5,6.*

- **FORK LIFT OPERATOR**

Laborers Group 4) Mason Tenders - operates forklift solely to assist a mason to a maximum height of nine (9) feet only.

Power Equipment Operator Group 9 - operates forklift to assist any trade, and to assist a mason to a height over nine (9) feet.

- **GLAZIERS**

Glazing wood and metal sash, doors, partitions, and 2 story aluminum storefronts. Installs glass windows, skylights, store fronts and display cases or surfaces such as building fronts, interior walls, ceilings and table tops and metal store fronts. Installation of aluminum window walls and curtain walls is the "joint" work of glaziers and ironworkers, which require equal composite workforce.

- **IRONWORKERS**

Erection, installation and placement of structural steel, precast concrete, miscellaneous iron, ornamental iron, metal curtain wall, rigging and reinforcing steel. Handling, sorting, and installation of reinforcing steel (rebar). Metal bridge rail (traffic), metal bridge handrail, and decorative security fence installation. Installation of aluminum window walls and curtain walls is the "joint" work of glaziers and ironworkers which require equal composite workforce.

- **INSULATOR**

- Installing fire stopping systems/materials for "Penetration Firestop Systems": transit to cables, electrical conduits, insulated pipes, sprinkler pipe penetrations, ductwork behind radiation, electrical cable trays, fire rated pipe penetrations, natural polypropylene, HVAC ducts, plumbing bare metal, telephone and communication wires, and boiler room ceilings.

- **LABORERS**

Acetylene burners, asphalt rakers, chain saw operators, concrete and power buggy operator, concrete saw operator, fence and guard rail erector (except metal bridge rail (traffic), decorative security fence (non-metal).

installation.), hand operated concrete vibrator operator, mason tenders, pipelayers (installation of storm drainage or sewage lines on the street only), pneumatic drill operator, pneumatic gas and electric drill operator, powermen and wagon drill operator, air track operator, block paver, curb setters, blasters, concrete spreaders.

- **PAINTERS**

Maintenance, preparation, cleaning, blasting (water and sand, etc.), painting or application of any protective coatings of every description on all bridges and appurtenances of highways, roadways, and railroads. Painting, decorating, hardwood finishing, paper hanging, sign writing, scenic art work and drywall hhg for any and all types of building and residential work.

- **LEAD PAINT REMOVAL**

- Painter's Rate

1. Removal of lead paint from bridges.
2. Removal of lead paint as preparation of any surface to be repainted.
3. Where removal is on a Demolition project prior to reconstruction.

- Laborer's Rate

1. Removal of lead paint from any surface NOT to be repainted.
2. Where removal is on a *TOTAL* Demolition project only.

- **PLUMBERS AND PIPEFITTERS**

Installation, repair, replacement, alteration or maintenance of all plumbing, heating, cooling and piping. ****License required per Connecticut General Statutes: P-1,2,6,7,8,9 J-1,2,3,4 SP-1,2 S-1,2,3,4,5,6,7,8 B-1,2,3,4 D-1,2,3,4.***

- **POWER EQUIPMENT OPERATORS**

Operates several types of power construction equipment such as compressors, pumps, hoists, derricks, cranes, shovels, tractors, scrapers or motor graders, etc. Repairs and maintains equipment. ****License required, crane operators only, per Connecticut General Statutes.***

- **ROOFERS**

Covers roofs with composition shingles or sheets, wood shingles, slate or asphalt and gravel to waterproof roofs, including preparation of surface. (demolition or removal of any type of roofing and or clean-up of any and all areas where a roof is to be relaid.)

- **SHEETMETAL WORKERS**

Fabricate, assembles, installs and repairs sheetmetal products and equipment in such areas as ventilation, air-conditioning, warm air heating, restaurant equipment, architectural sheet metal work, sheetmetal roofing, and aluminum gutters. Fabrication, handling, assembling, erecting, altering, repairing, etc. of coated metal material panels and composite metal material panels when used on building exteriors and interiors as soffits, fascia, louvers, partitions, canopies, cornice, column covers, awnings, beam covers, cladding, sun shades, lighting troughs, spires, ornamental roofing, metal ceilings, mansards, copings, ornamental and ventilation hoods, vertical and horizontal siding panels, trim, etc. The sheet metal classification also applies to the vast variety of coated metal material panels and composite metal material panels that have evolved over the years as an alternative to conventional ferrous and non-ferrous metals like steel, iron, tin, copper, brass, bronze, aluminum, etc. Fabrication, handling, assembling, erecting, altering, repairing, etc. of architectural metal roof, standing seam roof, composite metal roof, metal and composite bathroom/toilet partitions, aluminum gutters, metal and composite lockers and shelving, kitchen equipment, and walk-in coolers. To include testing and air –balancing ancillary to installation and construction.

- **SPRINKLER FITTERS**

Installation, alteration, maintenance and repair of fire protection sprinkler systems.

****License required per Connecticut General Statutes: F-1,2,3,4.***

- **TILE MARBLE AND TERRAZZO FINISHERS**

Assists and tends the tile setter, marble mason and terrazzo worker in the performance of their duties.

- **TRUCK DRIVERS**

~How to pay truck drivers delivering asphalt is under REVISION~

Truck Drivers are required to be paid prevailing wage for time spent "working" directly on the site. These drivers remain covered by the prevailing wage for any time spent transporting between the actual construction location and facilities (such as fabrication, plants, mobile factories, batch plant, borrow pits, job headquarters, tool yards, etc.) dedicated exclusively, or nearly so, to performance of the contract or project, which are so located in proximity to the actual construction location that it is reasonable to include them. ****License required, drivers only, per Connecticut General Statutes.***

For example:

- Material men and deliverymen are not covered under prevailing wage as long as they are not directly involved in the construction process. If, they unload the material, they would then be covered by prevailing wage for the classification they are performing work in: laborer, equipment operator, etc.
- Hauling material off site is not covered provided they are not dumping it at a location outlined above.
- Driving a truck on site and moving equipment or materials on site would be considered covered work, as this is part of the construction process.

➤ *Any questions regarding the proper classification should be directed to:*
Public Contract Compliance Unit
Wage and Workplace Standards Division
Connecticut Department of Labor
200 Folly Brook Blvd, Wethersfield, CT 06109
(860) 263-6543.

Statute 31-55a

Last Updated: June 02, 2008

You are here: [DOL Web Site](#) ▶ [Wage and Workplace Issues](#) ▶ Statute 31-55a

- Special Notice -

To All State and Political Subdivisions, Their Agents, and Contractors

Connecticut General Statute 31-55a - Annual adjustments to wage rates by contractors doing state work.

Each contractor that is awarded a contract on or after October 1, 2002, for (1) the construction of a state highway or bridge that falls under the provisions of section 31-54 of the general statutes, or (2) the construction, remodeling, refinishing, refurbishing, rehabilitation, alteration or repair of any public works project that falls under the provisions of section 31-53 of the general statutes shall contact the Labor Commissioner on or before July first of each year, for the duration of such contract, to ascertain the prevailing rate of wages on an hourly basis and the amount of payment or contributions paid or payable on behalf of each mechanic, laborer or worker employed upon the work contracted to be done, and shall make any necessary adjustments to such prevailing rate of wages and such payment or contributions paid or payable on behalf of each such employee, effective each July first.

- The prevailing wage rates applicable to any contract or subcontract awarded on or after October 1, 2002 are subject to annual adjustments each July 1st for the duration of any project which was originally advertised for bids on or after October 1, 2002.
- Each contractor affected by the above requirement shall pay the annual adjusted prevailing wage rate that is in effect each July 1st, as posted by the Department of Labor.
- It is the *contractor's* responsibility to obtain the annual adjusted prevailing wage rate increases directly from the Department of Labor's Web Site. The annual adjustments will be posted on the Department of Labor Web page: www.ctdol.state.ct.us. For those without internet access, please contact the division listed below.
- The Department of Labor will continue to issue the initial prevailing wage rate schedule to the Contracting Agency for the project. All subsequent annual adjustments will be posted on our Web Site for contractor access.

Any questions should be directed to the Contract Compliance Unit, Wage and Workplace

Standards Division, Connecticut Department of Labor, 200 Folly Brook Blvd.,
Wethersfield, CT 06109 at (860)263-6790.

[Workplace Laws](#)

Published by the Connecticut Department of Labor, Project Management Office

November 29, 2006

Notice
To All Mason Contractors and Interested Parties
Regarding Construction Pursuant to Section 31-53 of the
Connecticut General Statutes (Prevailing Wage)

The Connecticut Labor Department Wage and Workplace Standards Division is empowered to enforce the prevailing wage rates on projects covered by the above referenced statute.

Over the past few years the Division has withheld enforcement of the rate in effect for workers who operate a forklift on a prevailing wage rate project due to a potential jurisdictional dispute.

The rate listed in the schedules and in our Occupational Bulletin (see enclosed) has been as follows:

Forklift Operator:

- **Laborers (Group 4) Mason Tenders** - operates forklift solely to assist a mason to a maximum height of nine feet only.
- **Power Equipment Operator (Group 9)** - operates forklift to assist any trade and to assist a mason to a height over nine feet.

The U.S. Labor Department conducted a survey of rates in Connecticut but it has not been published and the rate in effect remains as outlined in the above Occupational Bulletin.

Since this is a classification matter and not one of jurisdiction, effective January 1, 2007 the Connecticut Labor Department will enforce the rate on each schedule in accordance with our statutory authority.

Your cooperation in filing appropriate and accurate certified payrolls is appreciated.

Informational Bulletin

THE 10-HOUR OSHA CONSTRUCTION SAFETY AND HEALTH COURSE

(applicable to public building contracts entered into *on or after July 1, 2007*, where the total cost of all work to be performed is at least \$100,000)

- (1) This requirement was created by Public Act No. 06-175, which is codified in Section 31-53b of the Connecticut General Statutes (pertaining to the prevailing wage statutes);
- (2) The course is required for public building construction contracts (projects funded in whole or in part by the state or any political subdivision of the state) entered into on or after July 1, 2007;
- (3) It is required of private employees (not state or municipal employees) and apprentices who perform manual labor for a general contractor or subcontractor on a public building project where the total cost of all work to be performed is at least \$100,000;
- (4) The ten-hour construction course pertains to the ten-hour Outreach Course conducted in accordance with federal OSHA Training Institute standards, and, for telecommunications workers, a ten-hour training course conducted in accordance with federal OSHA standard, 29 CFR 1910.268;
- (5) The internet website for the federal OSHA Training Institute is http://www.osha.gov/fso/ote/training/edcenters/fact_sheet.html;
- (6) The statutory language leaves it to the contractor and its employees to determine who pays for the cost of the ten-hour Outreach Course;
- (7) Within 30 days of receiving a contract award, a general contractor must furnish proof to the Labor Commissioner that all employees and apprentices performing manual labor on the project will have completed such a course;
- (8) Proof of completion may be demonstrated through either: (a) the presentation of a *bona fide* student course completion card issued by the federal OSHA Training Institute; *or* (2) the presentation of documentation provided to an employee by a trainer certified by the Institute pending the actual issuance of the completion card;
- (9) Any card with an issuance date more than 5 years prior to the commencement date of the construction project shall not constitute proof of compliance;

- (10) Each employer shall affix a copy of the construction safety course completion card to the certified payroll submitted to the contracting agency in accordance with Conn. Gen. Stat. § 31-53(f) on which such employee's name first appears;
- (11) Any employee found to be in non-compliance shall be subject to removal from the worksite if such employee does not provide satisfactory proof of course completion to the Labor Commissioner by the fifteenth day after the date the employee is determined to be in noncompliance;
- (12) Any such employee who is determined to be in noncompliance may continue to work on a public building construction project for a maximum of fourteen consecutive calendar days while bringing his or her status into compliance;
- (13) The Labor Commissioner may make complaint to the prosecuting authorities regarding any employer or agent of the employer, or officer or agent of the corporation who files a false certified payroll with respect to the status of an employee who is performing manual labor on a public building construction project;
- (14) The statute provides the minimum standards required for the completion of a safety course by manual laborers on public construction contracts; any contractor can exceed these minimum requirements; and
- (15) Regulations clarifying the statute are currently in the regulatory process, and shall be posted on the CTDOL website as soon as they are adopted in final form.
- (16) Any questions regarding this statute may be directed to the Wage and Workplace Standards Division of the Connecticut Labor Department via the internet website of <http://www.ctdol.state.ct.us/wgwkstnd/wgemenu.htm>; or by telephone at (860)263-6790.

THE ABOVE INFORMATION IS PROVIDED EXCLUSIVELY AS AN EDUCATIONAL RESOURCE, AND IS NOT INTENDED AS A SUBSTITUTE FOR LEGAL INTERPRETATIONS WHICH MAY ULTIMATELY ARISE CONCERNING THE CONSTRUCTION OF THE STATUTE OR THE REGULATIONS.

Sec. 31-53b. Construction safety and health course. Proof of completion required for employees on public building projects. Enforcement. Regulations. (a) Each contract entered into on or after July 1, 2007, for the construction, remodeling, refinishing, refurbishing, rehabilitation, alteration or repair of any public building project by the state or any of its agents, or by an political subdivision of the state or any of its agents, where the total cost of all work to be performed by all contractors and subcontractors in connection with the contract is at least one hundred thousand dollars, shall contain a provision requiring that, not later than thirty days after the date such contract is awarded, each contractor furnish proof to the Labor Commissioner that all employees performing manual labor on or in such public building, pursuant to such contract, have completed a course of at least ten hours in duration in construction safety and health approved by the federal Occupational Safety and Health Administration or, in the case of telecommunications employees, have completed at least ten hours of training in accordance with 29 CFR 1910.268.

(b) Any employee required to complete a construction safety and health course required under subsection (a) of this section who has not completed the course shall be subject to removal from the worksite if the employee does not provide documentation of having completed such course by the fifteenth day after the date the employee is found to be in noncompliance. The Labor Commissioner or said commissioner's designee shall enforce this section.

(c) Not later than January 1, 2007, the Labor Commissioner shall adopt regulations, in accordance with the provisions of chapter 54, to implement the provisions of subsections (a) and (b) of this section. Such regulations shall require that the ten-hour construction safety and health courses required under subsection (a) of this section be conducted in accordance with federal Occupational Safety and Health Administration Training Institute standards, or in accordance with 29 CFR 1910.268, as appropriate. The Labor Commissioner shall accept as sufficient proof of compliance with the provisions of subsection (a) or (b) of this section a student course completion card issued by the federal Occupational Safety and Health Administration Training Institute, or such other proof of compliance said commissioner deems appropriate, dated no earlier than five years before the commencement date of such public works project.

(d) For the purposes of this section, "public building" means a structure, paid for in whole or in part with state funds, within a roof and within exterior walls or fire walls, designed for the housing, shelter, enclosure and support or employment of people, animals or property of any kind, including, but not limited to, sewage treatment plants and water treatment plants, "Public building" does not include site work, roads or bridges, rail lines, parking lots or underground water, sewer or drainage systems including pump houses or other utility systems.

CONNECTICUT DEPARTMENT OF LABOR
WAGE AND WORKPLACE STANDARDS DIVISION

CONTRACTORS WAGE CERTIFICATION FORM

I, _____ of _____
Officer, Owner, Authorized Rep. Company Name

do hereby certify that the _____
Company Name

Street

City

and all of its subcontractors will pay all workers on the

Project Name and Number

Street and City

the wages as listed in the schedule of prevailing rates required for such project (a copy of which is attached hereto).

Signed

Subscribed and sworn to before me this _____ day of _____, 2004.

Notary Public

 Return to:

Connecticut Department of Labor
Wage & Workplace Standards Division
200 Folly Brook Blvd.
Wethersfield, CT 06109