


# SOUTHERN CONNECTICUT STATE UNIVERSITY

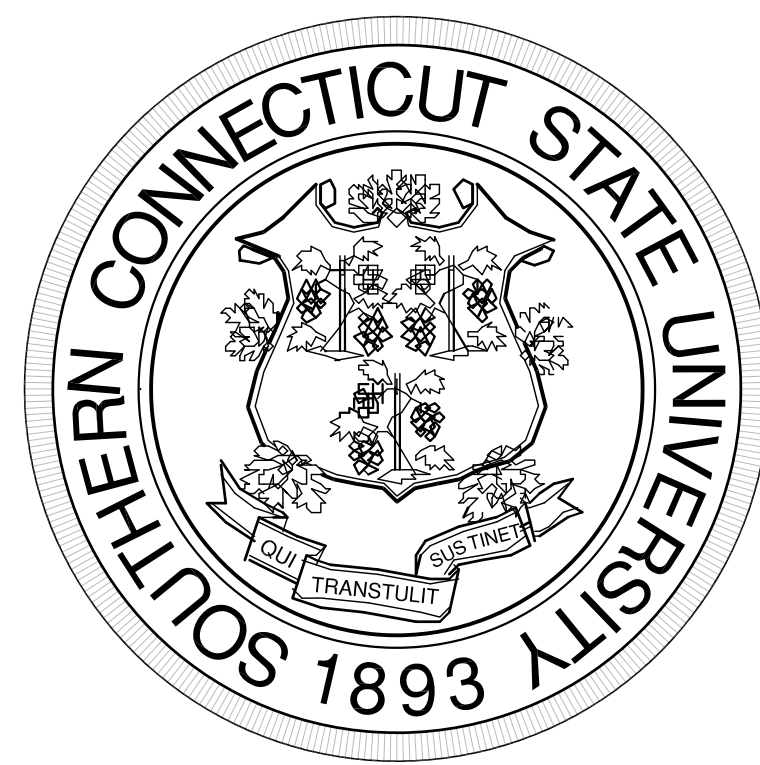


**DR. JOSEPH A. BERTOLINO**  
**PRESIDENT**

## NORTH CAMPUS TOWNHOUSE UNITS RENOVATIONS 2020

**PROJECT NO. SCSU-2020-04**

### LOCATION MAP

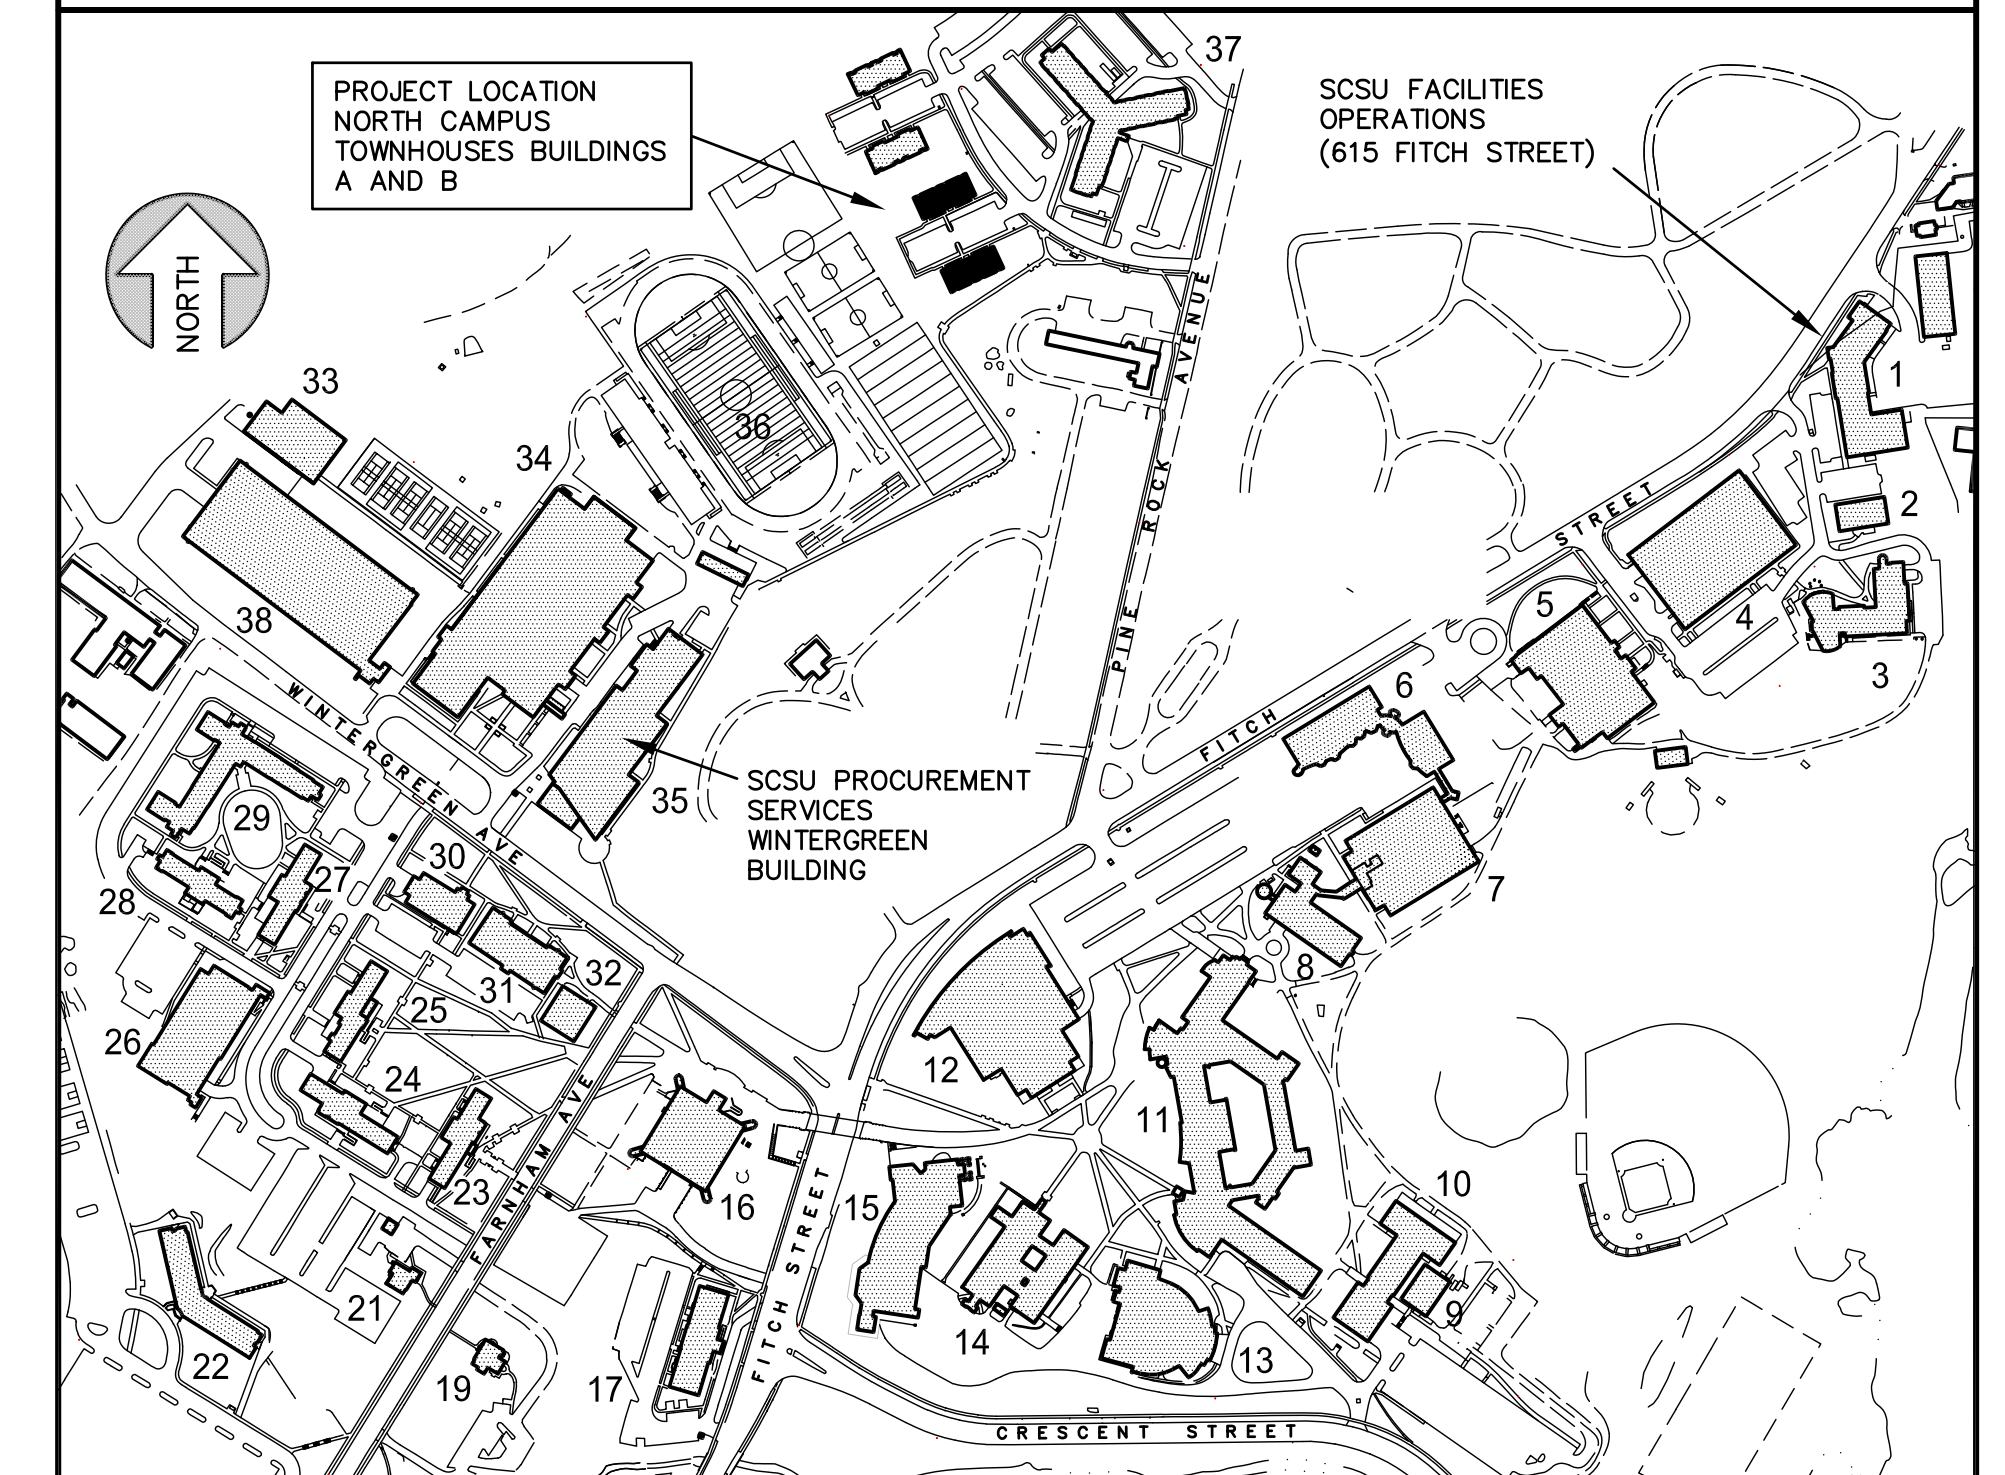

### BUILDING NUMBER LEGEND

- |  |  |
|--|--|
| 1 FACILITIES OPERATIONS                        | 22 BROWNELL HALL – RESIDENCE HALL                      |
| 2 NURSING CLASSROOM BUILDING                   | 23 FARNHAM HALL – RESIDENCE HALL                       |
| 3 DAVIS HALL                                   | 24 WILKINSON HALL – RESIDENCE HALL                     |
| 4 FITCH STREET PARKING GARAGE                  | 25 CHASE HALL – RESIDENCE HALL                         |
| 5 PELZ GYMNASIUM                               | 26 WEST CAMPUS PARKING GARAGE                          |
| 6 ACADEMIC SCIENCE AND LABORATORY BUILDING     | 27 HICKERSON HALL – RESIDENCE HALL                     |
| 7 JENNINGS HALL                                | 28 NEFF HALL – RESIDENCE HALL                          |
| 8 MORRILL HALL                                 | 29 WEST CAMPUS RESIDENCE COMPLEX                       |
| 9 TE-8 – CLASSROOM BUILDING 8                  | 30 UNIVERSITY POLICE AND GRANOFF STUDENT HEALTH CENTER |
| 10 SCHOOL OF BUSINESS                          | 31 OFFICE BUILDING 1                                   |
| 11 ENGLEMAN HALL                               | 32 TE-6 TEMPORARY BUILDING 6                           |
| 12 BULEY LIBRARY                               | 33 ENERGY CENTER                                       |
| 13 LYMAN CENTER FOR THE PERFORMING ARTS        | 34 MOORE FIELD HOUSE                                   |
| 14 EARL HALL15 EARL HALL                       | 35 WINTERGREEN BUILDING                                |
| 15 ADANTI STUDENT CENTER                       | 36 JESS DOW FIELD                                      |
| 16 CONNECTICUT HALL – FOOD SERVICE             | 37 NORTH CAMPUS RESIDENCE COMPLEX                      |
| 17 SCHWARTZ HALL – RESIDENCE HOUSING OFFICE    | 38 WINTERGREEN AVENUE PARKING GARAGE                   |
| 18 ETHNIC HERITAGE CENTER                      |  |
| 19 ALUMNI HOUSE                                |  |
| 20 LANG HOUSE – DEPARTMENT OF SOCIAL WORK      |  |
| 21 ORLANDO HOUSE – DEPARTMENT OF PUBLIC HEALTH |  |

**SALAMONE  
&  
ASSOCIATES, P.C.**  
CONSULTING ENGINEERS

118 North Plains Industrial Road  
Wallingford, Connecticut 06492  
Phone: (203) 281-6895 Fax: (203) 287-8728

SOUTHERN CONNECTICUT STATE UNIVERSITY FACILITIES PLANNING DEPARTMENT, OFFICE OF FACILITIES OPERATIONS , 615 FITCH STREET, HAMDEN, CT 06514 UNIVERSITY REPRESENTATIVE: PETER J. VISENTIN A.I.A TEL (203) 392-6055 FAX (203) 392-6058

#### GENERAL NOTES

- THE CONTRACTOR IS RESPONSIBLE FOR VERIFYING ALL EXISTING CONDITIONS AND DIMENSIONS. ANY DISCREPANCIES MUST BE REPORTED AND REVIEWED BY THE CONTRACTOR AND THE UNIVERSITY REPRESENTATIVE PRIOR TO CONSTRUCTION.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL FIELD VERIFICATIONS AND COORDINATION REQUIRED FOR SHOP DRAWING ACCEPTANCE.
- EXISTING CONSTRUCTION TO REMAIN, WHICH IS REMOVED AND/OR ALTERED IN ORDER TO FACILITATE OR ACCESS OTHER WORK, SHALL BE REPAIRED AND FINISHED TO ITS ORIGINAL CONDITION PRIOR TO THOSE ALTERATIONS.
- PATCH ALL EXISTING FINISHES TO REMAIN THAT ARE DAMAGED AS A RESULT OF THE CONSTRUCTION WORK.
- THE CONTRACTOR IS RESPONSIBLE FOR COORDINATING ALL ABOVE CEILING WORK AND SHALL REVIEW THE COMPLETE PLANS IN ORDER TO ANTICIPATE AND RESOLVE POTENTIAL CONFLICTS WITH SYSTEMS AND STRUCTURE (NEW AND EXISTING) PRIOR TO THEIR INSTALLATION.
- AT ALL FLOOR AREAS TO RECEIVE NEW FINISHES, PROVIDE FLOOR FILLER FOR 100 PERCENT OF AREA, SEE SPECIFICATIONS.
- DEMOLISH ABANDONED TELEPHONE AND NETWORK CABLING ABOVE CEILINGS IN ALL AREAS (TO BE IDENTIFIED BY OWNER).
- PATCH HOLES WHERE FASTENINGS HAVE BEEN REMOVED AS PART OF THE DEMOLITION AT LOCATIONS WHERE THESE HOLES WILL REMAIN EXPOSED. PATCH TO MATCH ADJACENT EXISTING FINISH OR MATERIAL.
- FIRE-STOP ELECTRICAL CONDUIT PENETRATIONS OF RATED FLOOR AND WALL ASSEMBLIES. INSTALLATION ASSEMBLY SHALL PROVIDE AN APPROVED THROUGH PENETRATION THAT HAS BEEN LISTED IN ACCORDANCE WITH ASTM E814. SEAL AROUND CONDUIT WITH UL LISTED FIRE-STOPPING MATERIAL WITH A RATING EQUAL OR GREATER THAN THAT OF THE FLOOR CONSTRUCTION.

#### BUILDING INFORMATION

**EXISTING BUILDING INFORMATION:**  
EXISTING OCCUPANCY CLASSIFICATION: GROUP GROUP R-3 (SEPARATED 2-UNIT TOWNHOUSES)  
BUILDING HEIGHT AND AREA: HEIGHT: 2 STOREY, 32 FEET  
TOTAL FLOOR AREA PER BUILDING: 9,165 SQ. FT.  
FLOOR AREA PER FLOOR 4,582 SQ. FT.  
CONSTRUCTION DATE: ORIGINAL 1986 – FIRE PROTECTION & ELECTRICAL UPGRADES 2005 WINDOW RENOVATIONS 2009  
CONSTRUCTION TYPE: TYPE VB (1 HOUR CMU FIRE PARTITION WALL SEPARATING DUPLEX UNITS, 1 HOUR HORIZONTAL SEPARATION BETWEEN FIRST FLOOR AND SECOND FLOOR UNITS)  
FIRE PROTECTION AND ALARM: EXISTING AUTOMATIC FIRE DETECTION AND ALARM SYSTEM EXISTING NFPA 13R AUTOMATIC SPRINKLER SYSTEM

**LEVEL 1 ALTERATIONS WORK AREA INFORMATION:**  
WORK AREA: APPROX. 8,190 SQ. FT. TOTAL FLOOR AREA PER BUILDING  
WORK AREA USE GROUP: GROUP R-3 – NO CHANGE  
WORK AREA OCCUPANT COUNT: 32 PERSONS (BASED ON BEDROOM OCCUPANCY) TOTAL BUILDING

#### BUILDING CODE INFORMATION

**APPLICABLE CODES:**  
2018 CONNECTICUT STATE FIRE SAFETY CODE (AS AMENDED)  
2015 INTERNATIONAL FIRE CODE  
2015 NFPA 101 LIFE SAFETY CODE  
2018 STATE BUILDING CODE, STATE OF CONNECTICUT (AS AMENDED)  
2015 INTERNATIONAL BUILDING CODE  
2015 INTERNATIONAL EXISTING BUILDING CODE


**APPLICABLE CODE SCOPE:**  
CONNECTICUT STATE BUILDING CODE (CSBC)  
CONNECTICUT STATE FIRE SAFETY CODE (CSFSC)  
2015 INTERNATIONAL BUILDING CODE (IBC) WITH CT AMENDMENT  
101.2 SCOPE EXCEPTION 2 – EXISTING BUILDINGS UNDERGOING ALTERATIONS PERMITTED TO COMPLY WITH THE INTERNATIONAL EXISTING BUILDING CODE PORTION OF 2018 CSBC  
2015 INTERNATIONAL EXISTING BUILDING CODE (IEBC)  
(AMD2018) 101.4.2 – LEGALLY OCCUPIED EXISTING BUILDINGS SHALL BE PERMITTED TO CONTINUE WITHOUT CHANGE EXCEPT AS SPECIFICALLY COVERED IN THE IEBC OR THE 2018 CONNECTICUT STATE FIRE SAFETY CODE (CSFSC)  
(AMD2018) 101.10 MEANS OF EGRESS – MEANS OF EGRESS IN EXISTING BUILDINGS SHALL MEET THE REQUIREMENTS OF THE PROVISIONS OF PART IV OF THE CSFSC (NFPA 101 LIFE SAFETY CODE 2015) FOR THE PROPOSED OCCUPANCY

2015 INTERNATIONAL MECHANICAL CODE  
2015 INTERNATIONAL PLUMBING CODE  
2015 INTERNATIONAL ENERGY CONSERVATION CODE  
ICC/ANSI A117.1-2009 ACCESSIBLE AND USABLE BUILDINGS AND FACILITIES  
2017 NATIONAL ELECTRICAL CODE (NFPA-70)

ALTERATIONS – LEVEL 1:  
701.2 CONFORMANCE – ALTERATIONS SHALL NOT RESULT IN LESS SAFE CONDITIONS THAN THOSE CONDITIONS PRIOR TO THE ALTERATIONS  
702.1, 702.2, 702.3 BUILDING ELEMENTS AND MATERIALS INTERIOR FINISHES – NEW FINISHES SHALL COMPLY WITH CHAPTER 8 OF THE IBC.  
(AMD2018) 704.2 MINIMUM STANDARDS – MEANS OF EGRESS IN EXISTING BUILDINGS SHALL MEET THE REQUIREMENTS OF THE PROVISIONS OF PART IV OF THE 2018 CSFSC (NFPA 101 LIFE SAFETY CODE 2015)  
702.6 (IEBC) MATERIALS AND METHODS – ALL NEW WORK SHALL COMPLY WITH THE REQUIREMENTS IN THE IBC, IECC, IMC AND IPC  
804.4.2 (IBC) INTERIOR FLOOR FINISH – NEW FLOOR FINISH SHALL COMPLY WITH THE DOC FF-1 "PILL TEST"

#### LIST OF DRAWINGS

- |       |  |
|-------|--|
| C1    | COVER SHEET, CODE SCOPE, LOCATION MAP, AND GENERAL NOTES           |
| A1    | SITE AND OVERALL BUILDING PLANS                                    |
| A2    | FIRST AND SECOND FLOOR TYPICAL UNIT DEMOLITION PARTIAL PLANS       |
| A3    | FIRST AND SECOND FLOOR TYPICAL UNIT NEW WORK PARTIAL PLANS         |
| A4    | DOOR AND FINISH SCHEDULES, ELEVATIONS AND DETAILS                  |
| A5    | BATHROOM AND KITCHEN TYPICAL UNIT ELEVATIONS, CASEWORK AND DETAILS |
| A6    | PARTIAL FIRST AND SECOND FLOOR PLANS EXISTING PHOTOS               |
| DPME1 | PARTIAL PLUMBING / MECHANICAL / ELECTRICAL DEMOLITION PLANS        |
| PFF1  | PARTIAL FIRST AND SECOND FLOOR PLUMBING PLANS                      |
| PFF2  | PLUMBING SCHEDULES, NOTES, SYMBOLS AND ABBREVIATIONS               |
| M1    | PARTIAL FIRST AND SECOND FLOOR MECHANICAL PLANS                    |
| M2    | PARTIAL ATTIC MECHANICAL PLANS                                     |
| M3    | MECHANICAL SCHEDULES, NOTES, DETAILS AND ABBREVIATIONS             |
| E1    | PARTIAL FIRST AND SECOND FLOOR ELECTRICAL PLANS                    |
| E2    | ELECTRICAL SCHEDULES, DETAILS, SYMBOLS, NOTES AND ABBREVIATIONS    |

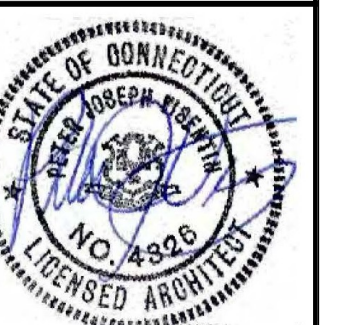

SET NO.






DATE:  
MAY 27, 2020

SHEET NO.

C1



24X36 Scale X" = XX'  
12X18 Scale X" = XX'

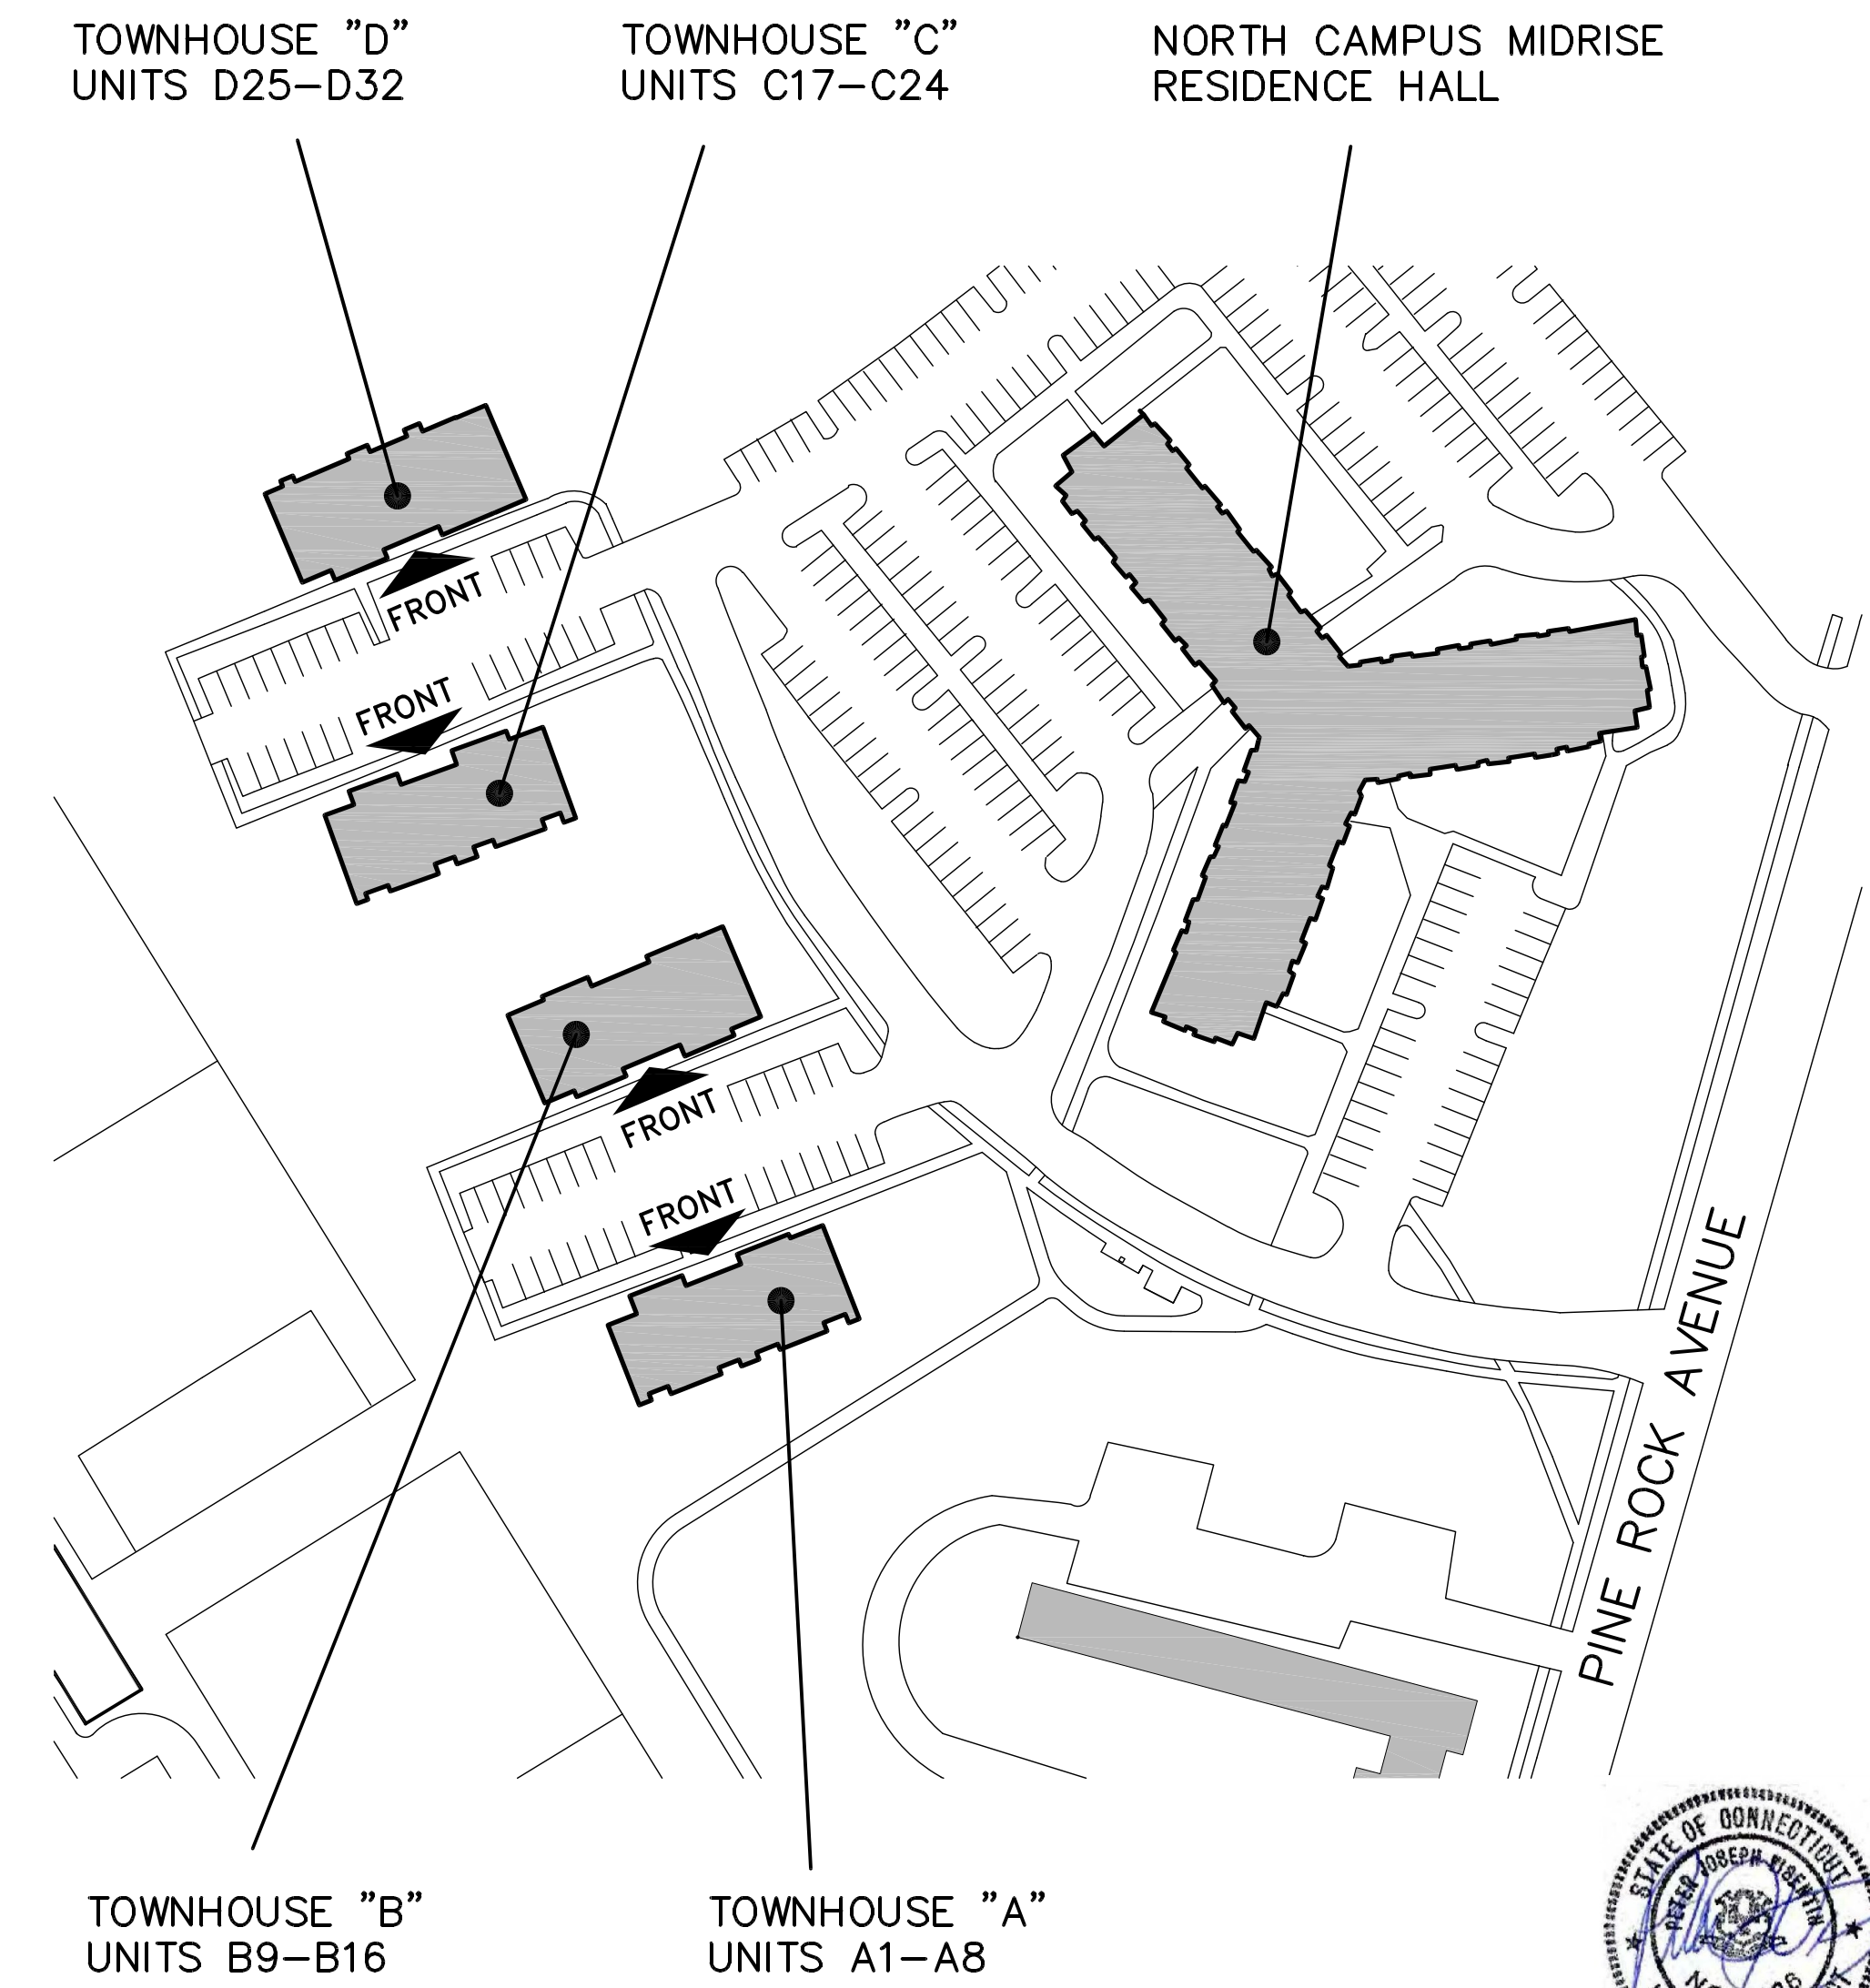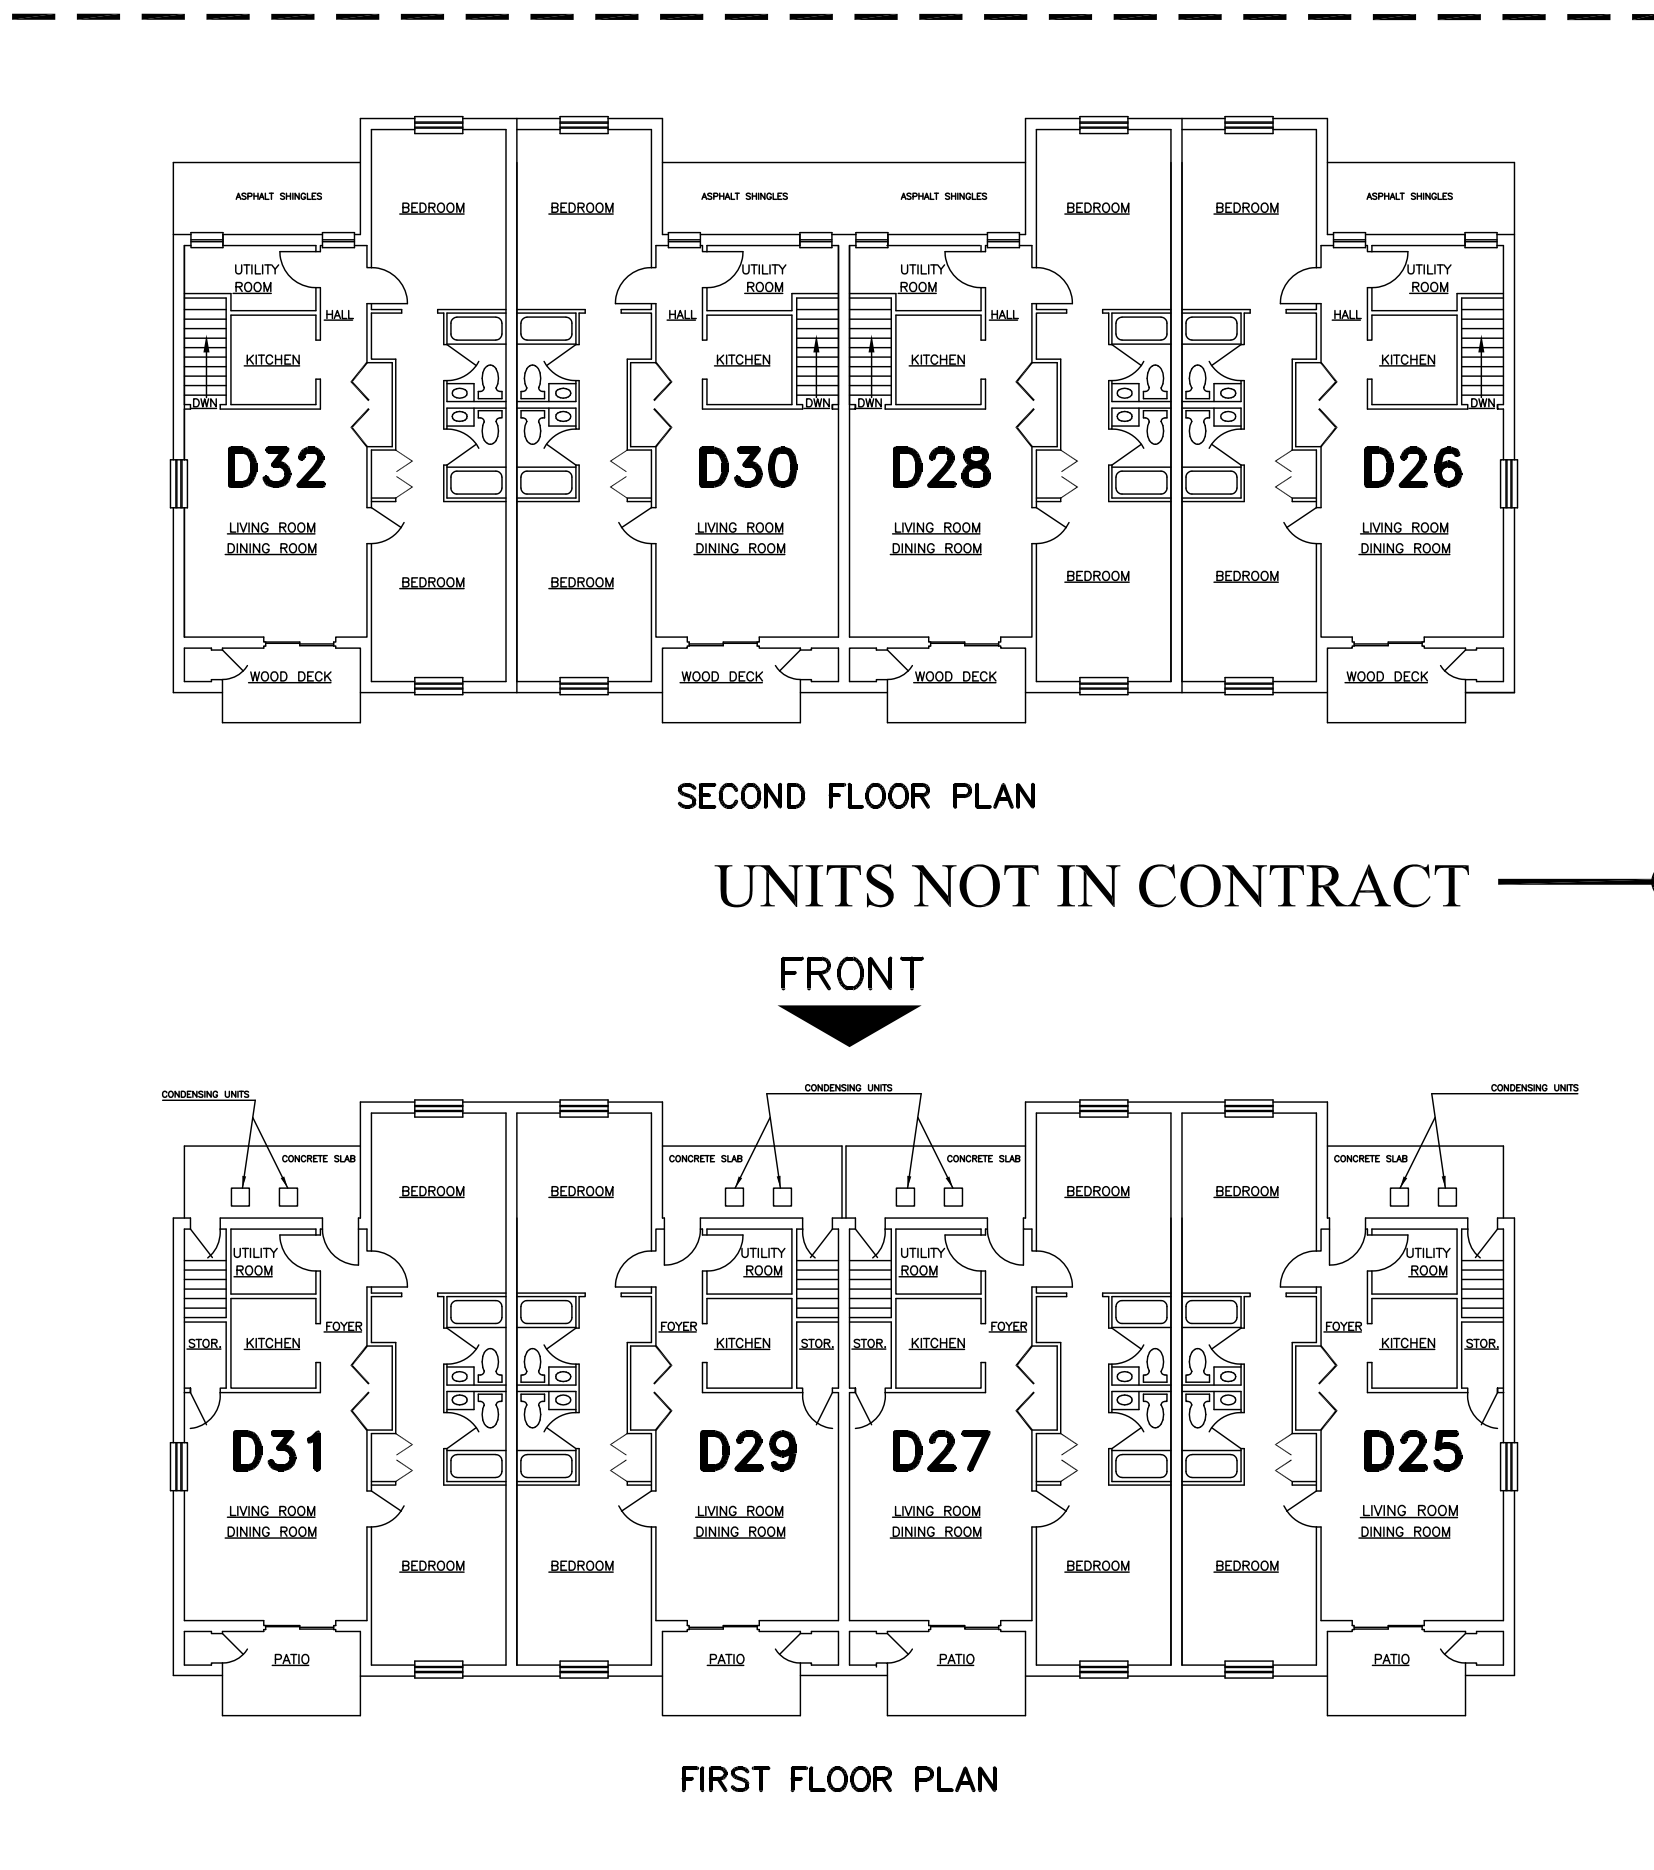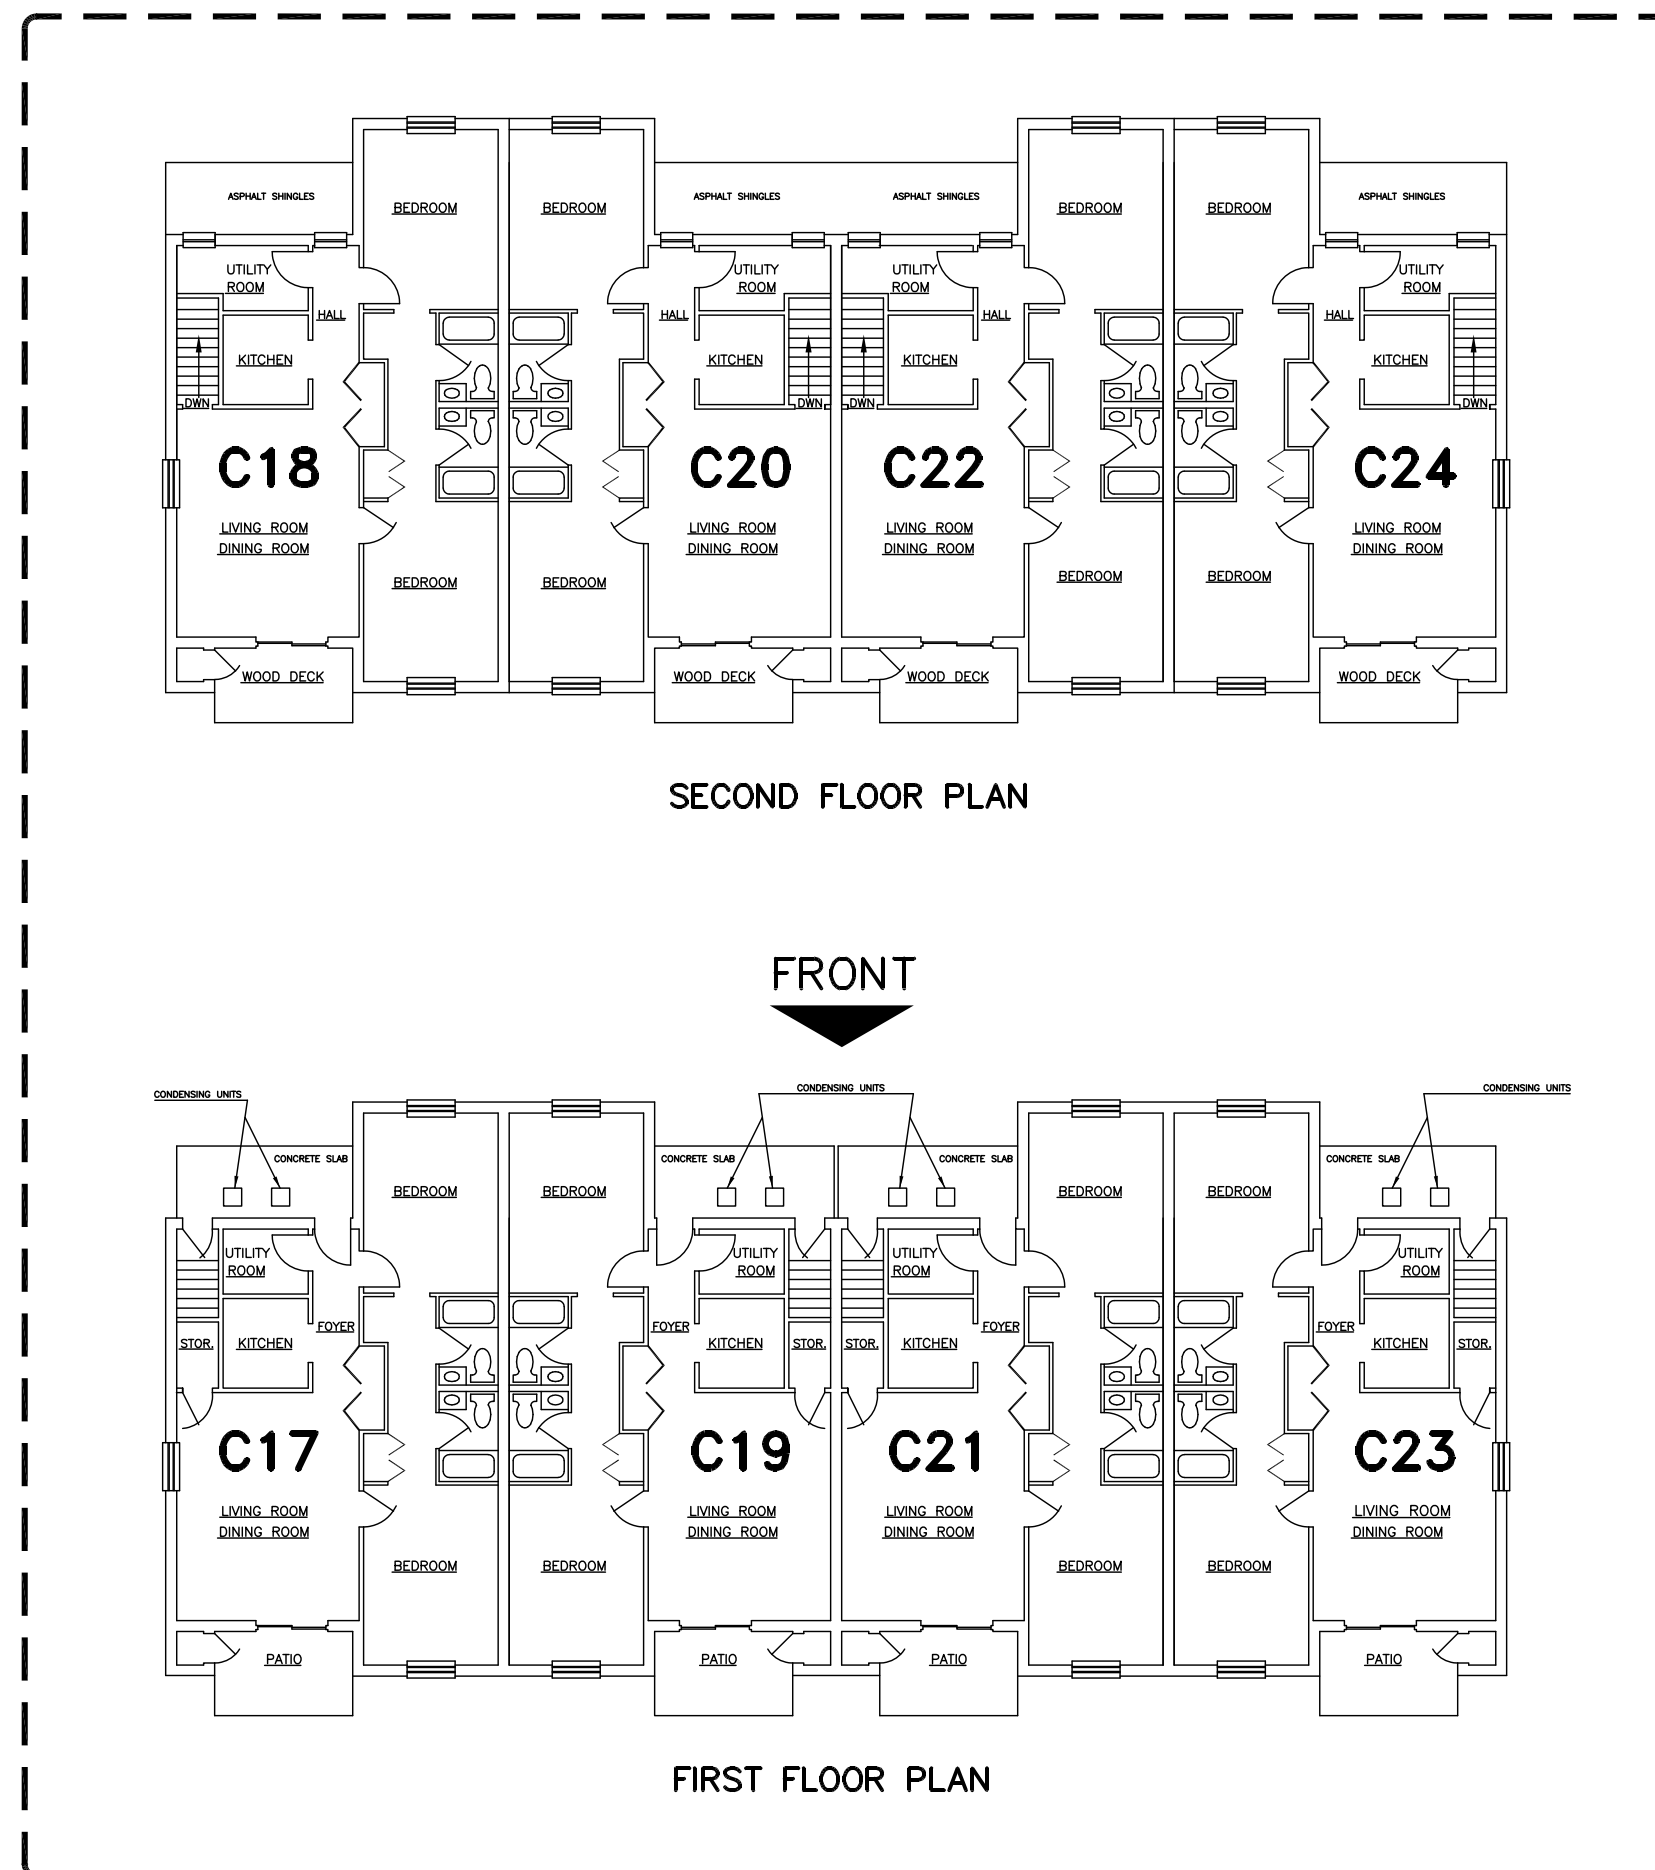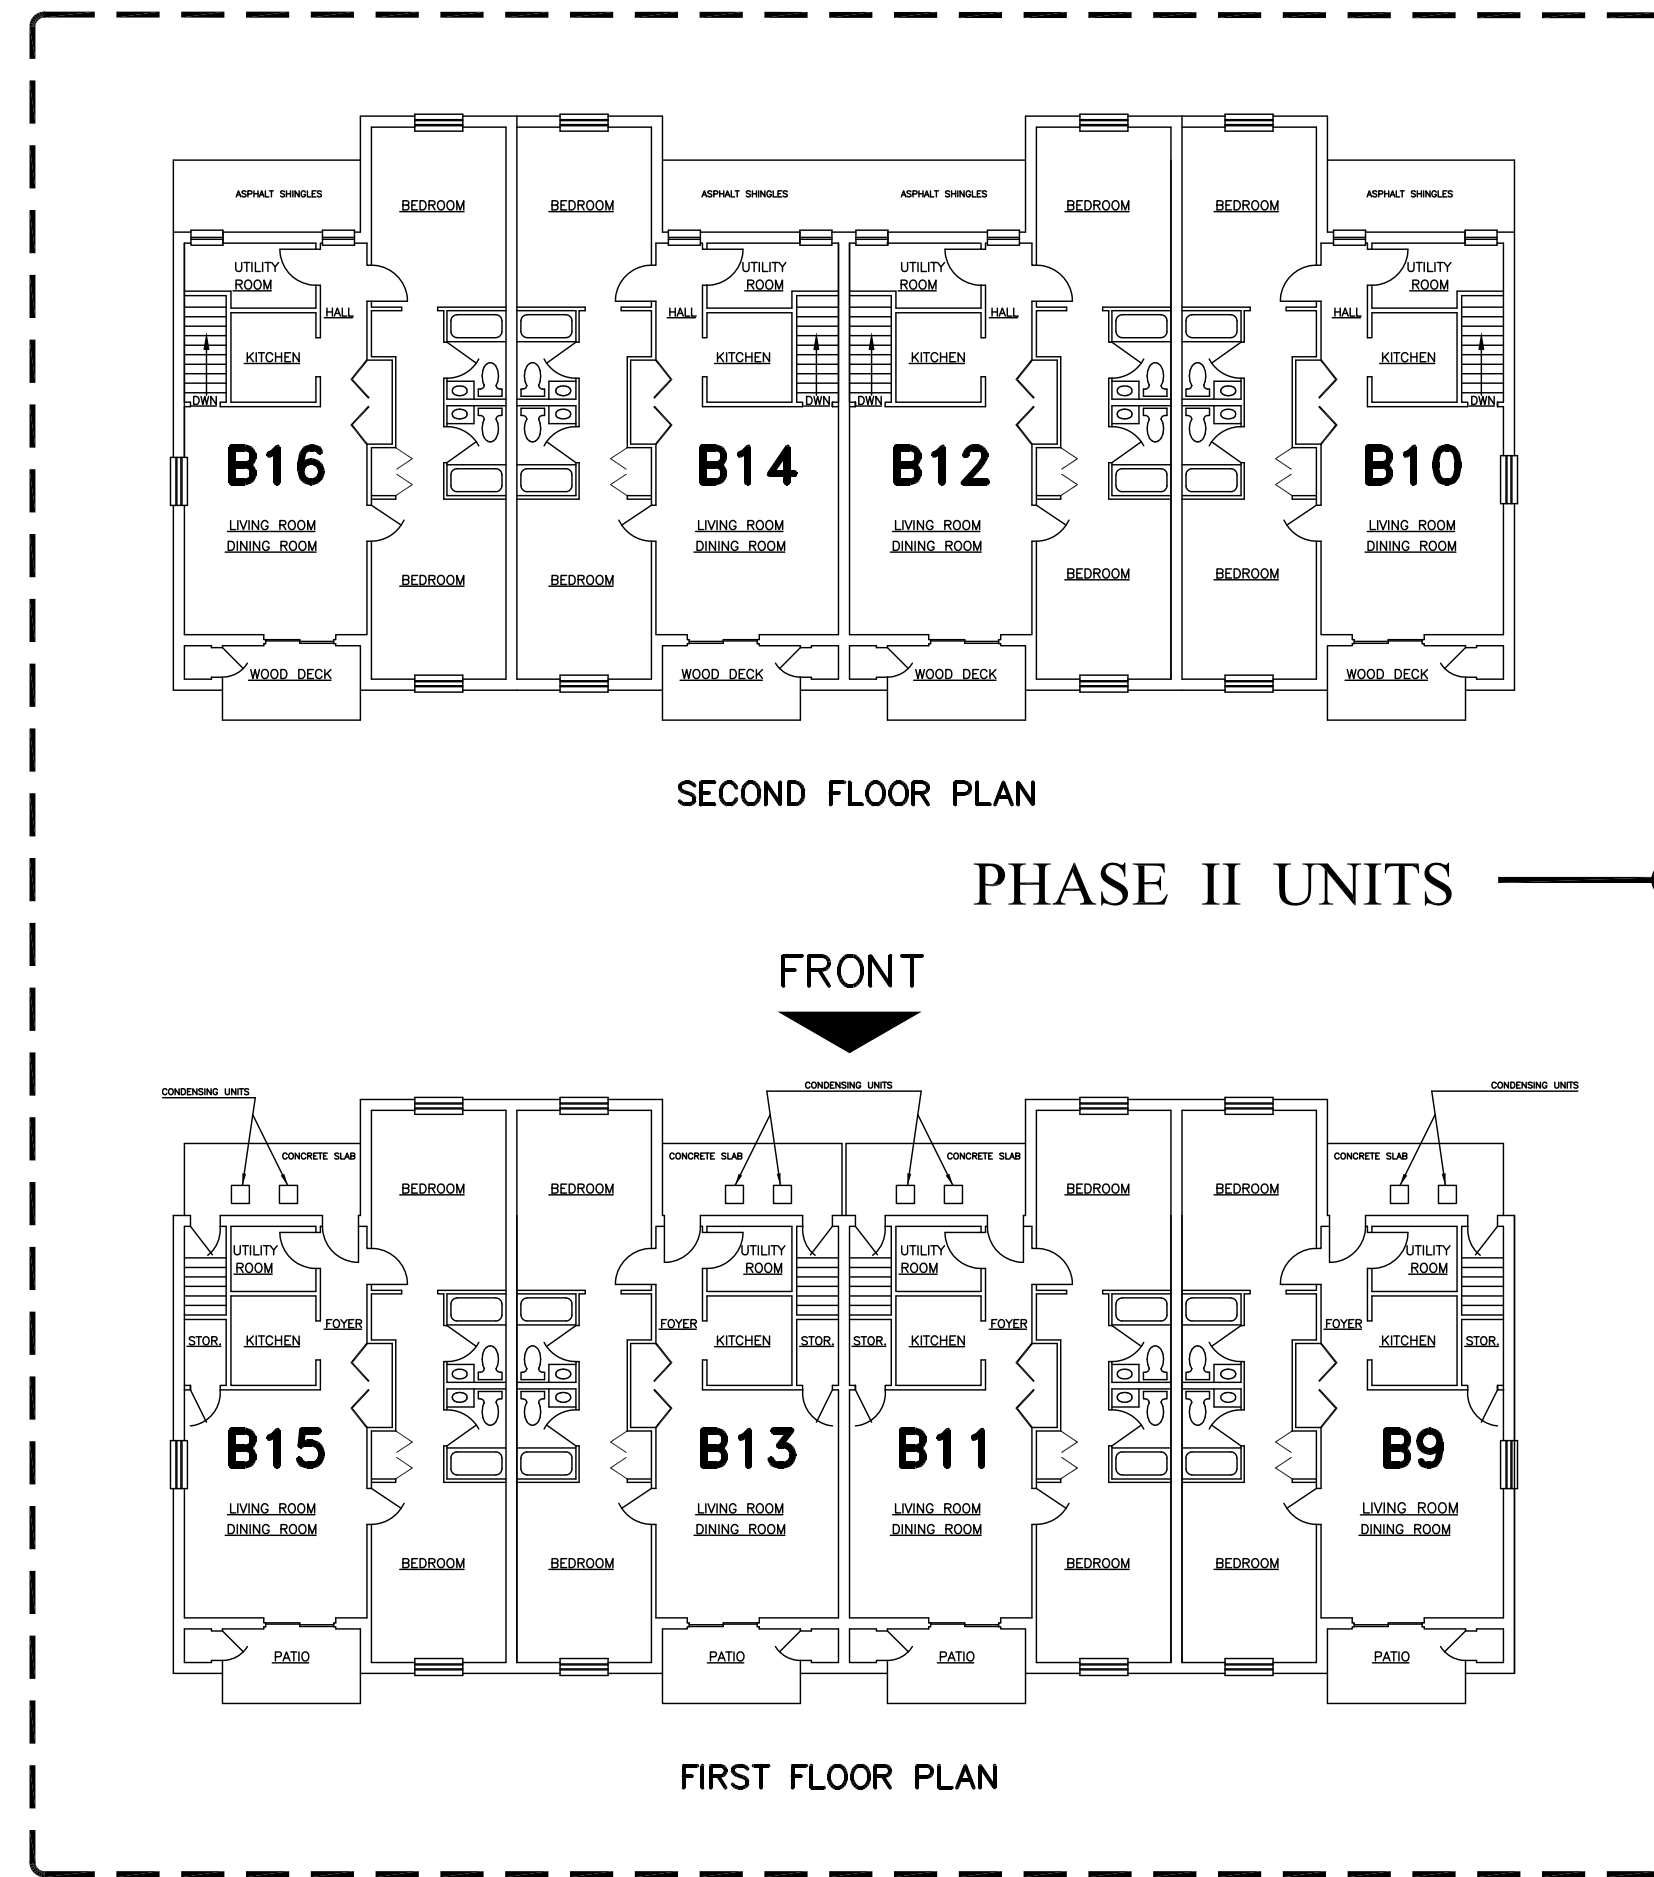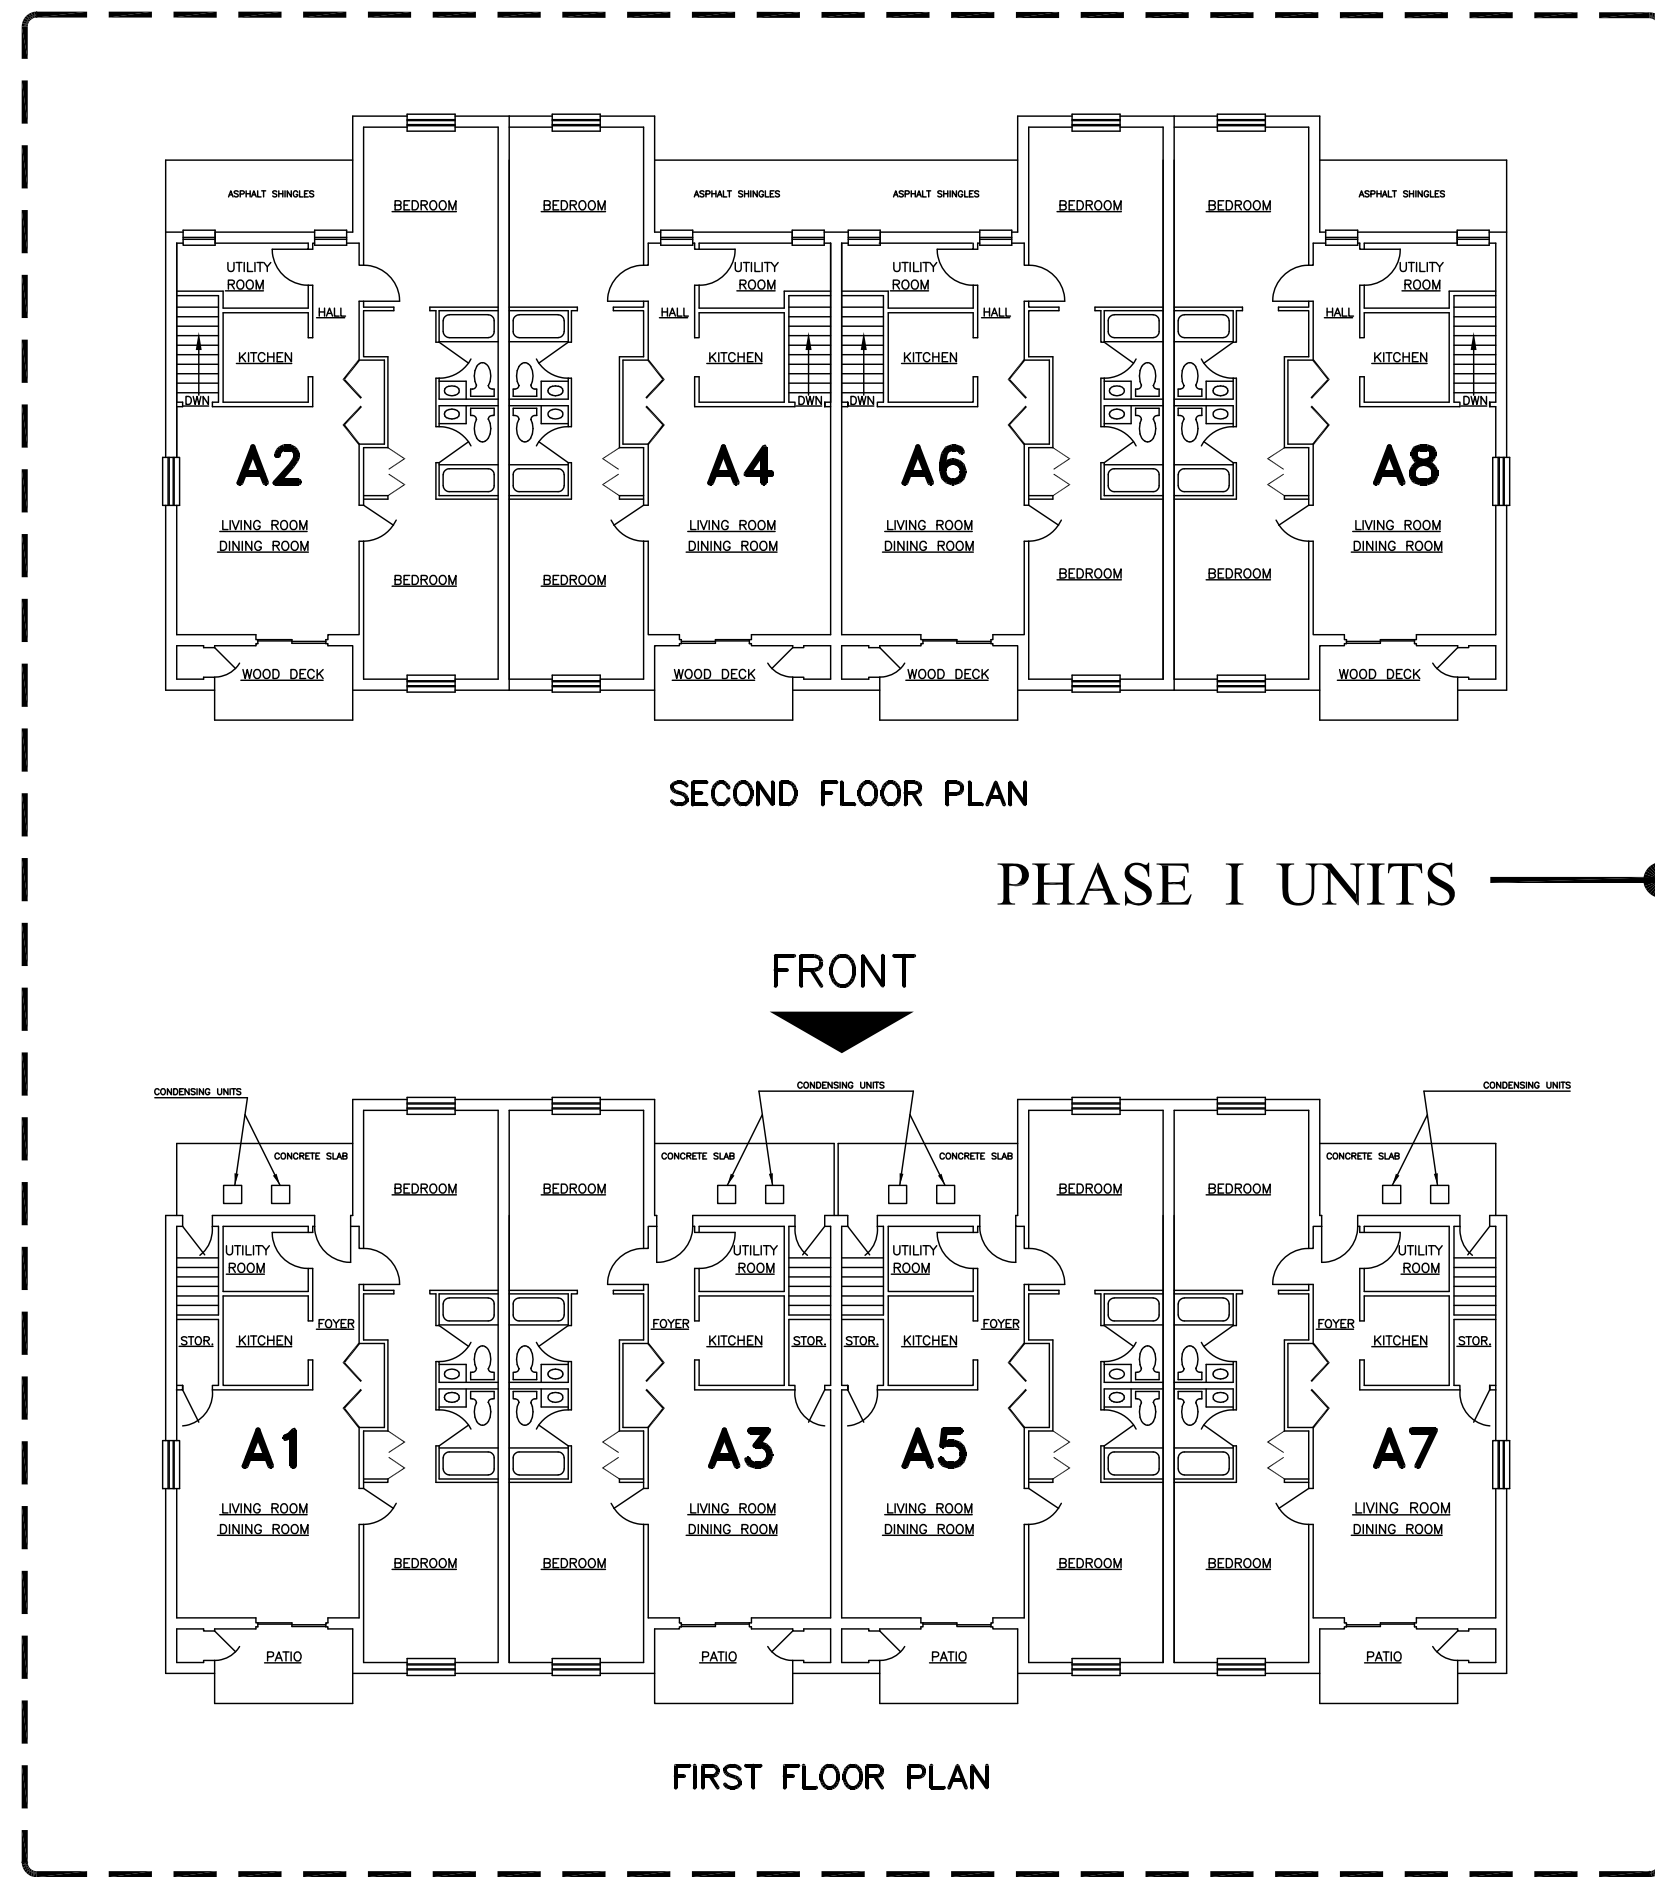

2 TOWNHOUSE BUILDING FLOOR PLANS

A1 SCALE: 1/16" = 1'-0"


1 NORTH CAMPUS RESIDENCE COMPLEX






**DEMOLITION NOTES** SEE FIRE PROTECTION, MECHANICAL AND ELECTRICAL DRAWINGS FOR ADDITIONAL DEMOLITION NOTES


- 1 DEMOLISH EXISTING CARPETING (GLUE DOWN) AND WALL BASE. INSPECT EXISTING CONCRETE SLAB (4" THICK) ON GROUND FOR SOUNDNESS AND REPAIR AREAS AS NECESSARY TO PROVIDE A SOUND SUBSTRATE FOR NEW FLOOR FINISH
- 2 DEMOLISH EXISTING CARPETING (GLUE DOWN) AND WALL BASE. INSPECT EXISTING CONCRETE FILL (APPROX. 1 5/8" THICK) FOR SOUNDNESS AND REPAIR AREAS AS NECESSARY TO PROVIDE A SOUND SUBSTRATE FOR NEW FLOOR FINISH
- 3 DEMOLISH EXISTING SHEET VINYL (GLUE DOWN) AND WALL BASE. INSPECT EXISTING CONCRETE SLAB (4" THICK) ON GROUND FOR SOUNDNESS AND REPAIR AREAS AS NECESSARY TO PROVIDE A SOUND SUBSTRATE FOR NEW FLOOR FINISH
- 4 DEMOLISH EXISTING SHEET VINYL (GLUE DOWN) AND WALL BASE. INSPECT EXISTING CONCRETE FILL (APPROX. 1 5/8" THICK) FOR SOUNDNESS AND REPAIR AREAS AS NECESSARY TO PROVIDE A SOUND SUBSTRATE FOR NEW FLOOR FINISH
- 5 DEMOLISH EXISTING CERAMIC TILE (THIN-SET) AND CERAMIC TILE WALL BASE. INSPECT EXISTING CONCRETE SLAB (4" THICK) ON GROUND FOR SOUNDNESS AND REPAIR AREAS AS NECESSARY TO PROVIDE A SOUND SUBSTRATE FOR NEW FLOOR FINISH
- 6 DEMOLISH EXISTING CERAMIC TILE (THIN-SET) AND CERAMIC TILE WALL BASE. INSPECT EXISTING CONCRETE FILL (APPROX. 1 5/8" THICK) TO REMAIN FOR SOUNDNESS AND REPAIR AREAS AS NECESSARY TO PROVIDE A SOUND SUBSTRATE FOR NEW FLOOR FINISH
- 7 DEMOLISH EXISTING CARPETING AT STAIR TREADS AND RISERS. INSPECT EXISTING STAIR WOODWORK FOR SOUNDNESS AND RESET FASTENINGS AS NECESSARY TO PROVIDE A SOUND SUBSTRATE FOR NEW FINISH
- 8 CAREFULLY DEMOLISH EXISTING CASEWORK (BASE CABINETS, COUNTERS, SPLASHES AND WALL CABINETS) SO AS TO MINIMIZE DAMAGE TO ADJACENT WALLS AND CEILINGS TO REMAIN. DEMOLISH EXISTING RANGE AND DISHWASHER. PROTECT ELECTRICAL CIRCUITS TO REMAIN. SEE ELECTRICAL AND MECHANICAL DRAWINGS
- 9 DEMOLISH EXISTING LAVATORY VANITY AND SINK AND LAVATORY MIRROR/LIGHT FIXTURE. PROTECT ELECTRICAL CIRCUITS TO REMAIN. SEE ELECTRICAL AND MECHANICAL DRAWINGS
- 10 CAREFULLY DEMOLISH EXISTING TUB AND CERAMIC TILE WALL FINISH (TO 6'-0" ABOVE FLOOR) AND WATER CLOSET. PROTECT ELECTRICAL CIRCUITS AND PLUMBING ROUGH PIPING TO REMAIN. SEE ELECTRICAL AND MECHANICAL DRAWINGS
- 11 CAREFULLY REMOVE SPRINKLER PIPING SOFFIT AND CORNER CAP AT EXISTING TUB WALL AND RELOCATE EXISTING SPRINKLER PIPING AND SOFFIT TO NEW WALL LOCATION. PROVIDE NEW PIPING PENETRATION AT SEPARATION WALL TO CONNECT TO RELOCATED PIPING IN ADJACENT UNIT.
- 12 DEMOLISH EXISTING WOOD STUD AND GYPSUM BOARD WALL
- 13 DEMOLISH CEILING AND WALL FINISHES
- 14 CAREFULLY REMOVE EXISTING DOOR, FRAME AND THRESHOLD
- 15 CUT NEW OPENING IN EXISTING EXTERIOR WALL FRAMING AND FACE BIRICK FOR NEW RANGE HOOD EXHAUST WALL CAP

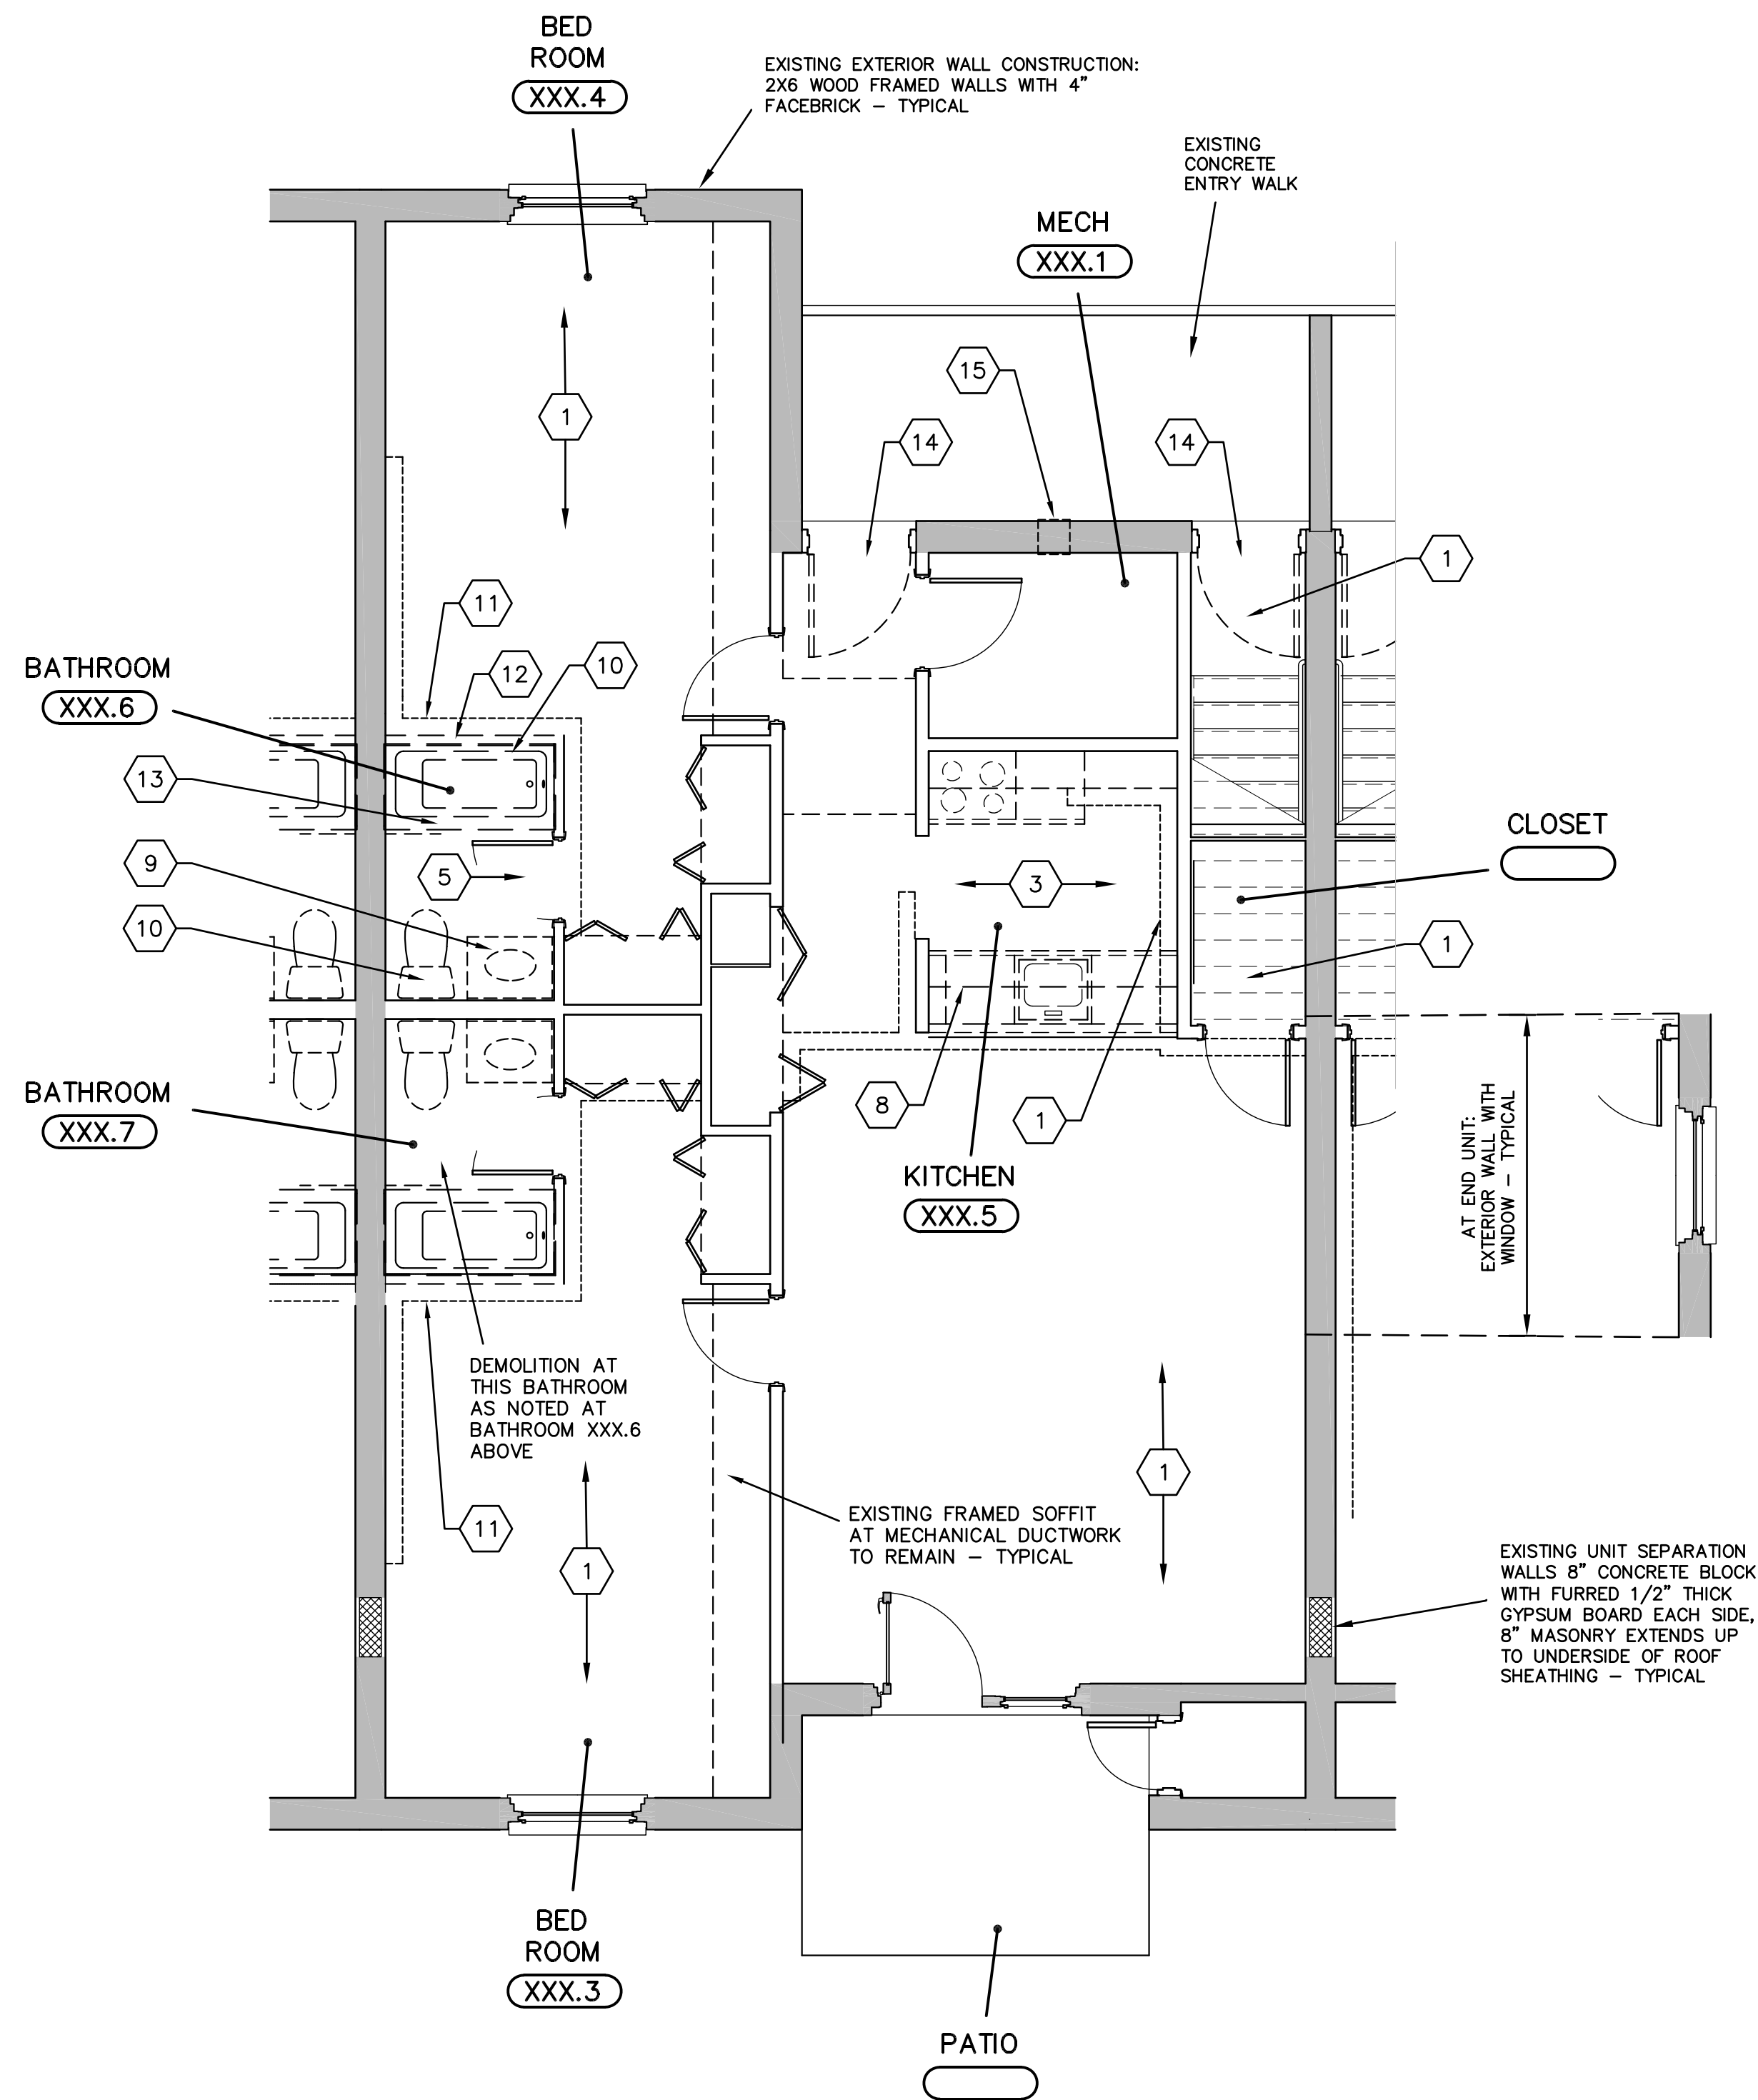

**1 PARTIAL FIRST FLOOR DEMOLITION PLAN – TYPICAL UNIT**  
 SCALE: 1/4" = 1'-0" LAYOUT AS SHOWN OR OPPOSITE HAND, SEE BUILDING PLANS FOR LAYOUTS FOR SPECIFIC UNIT NUMBERS. SEE PLUMBING, MECHANICAL AND ELECTRICAL DRAWINGS FOR ADDITIONAL DEMOLITION NOTES

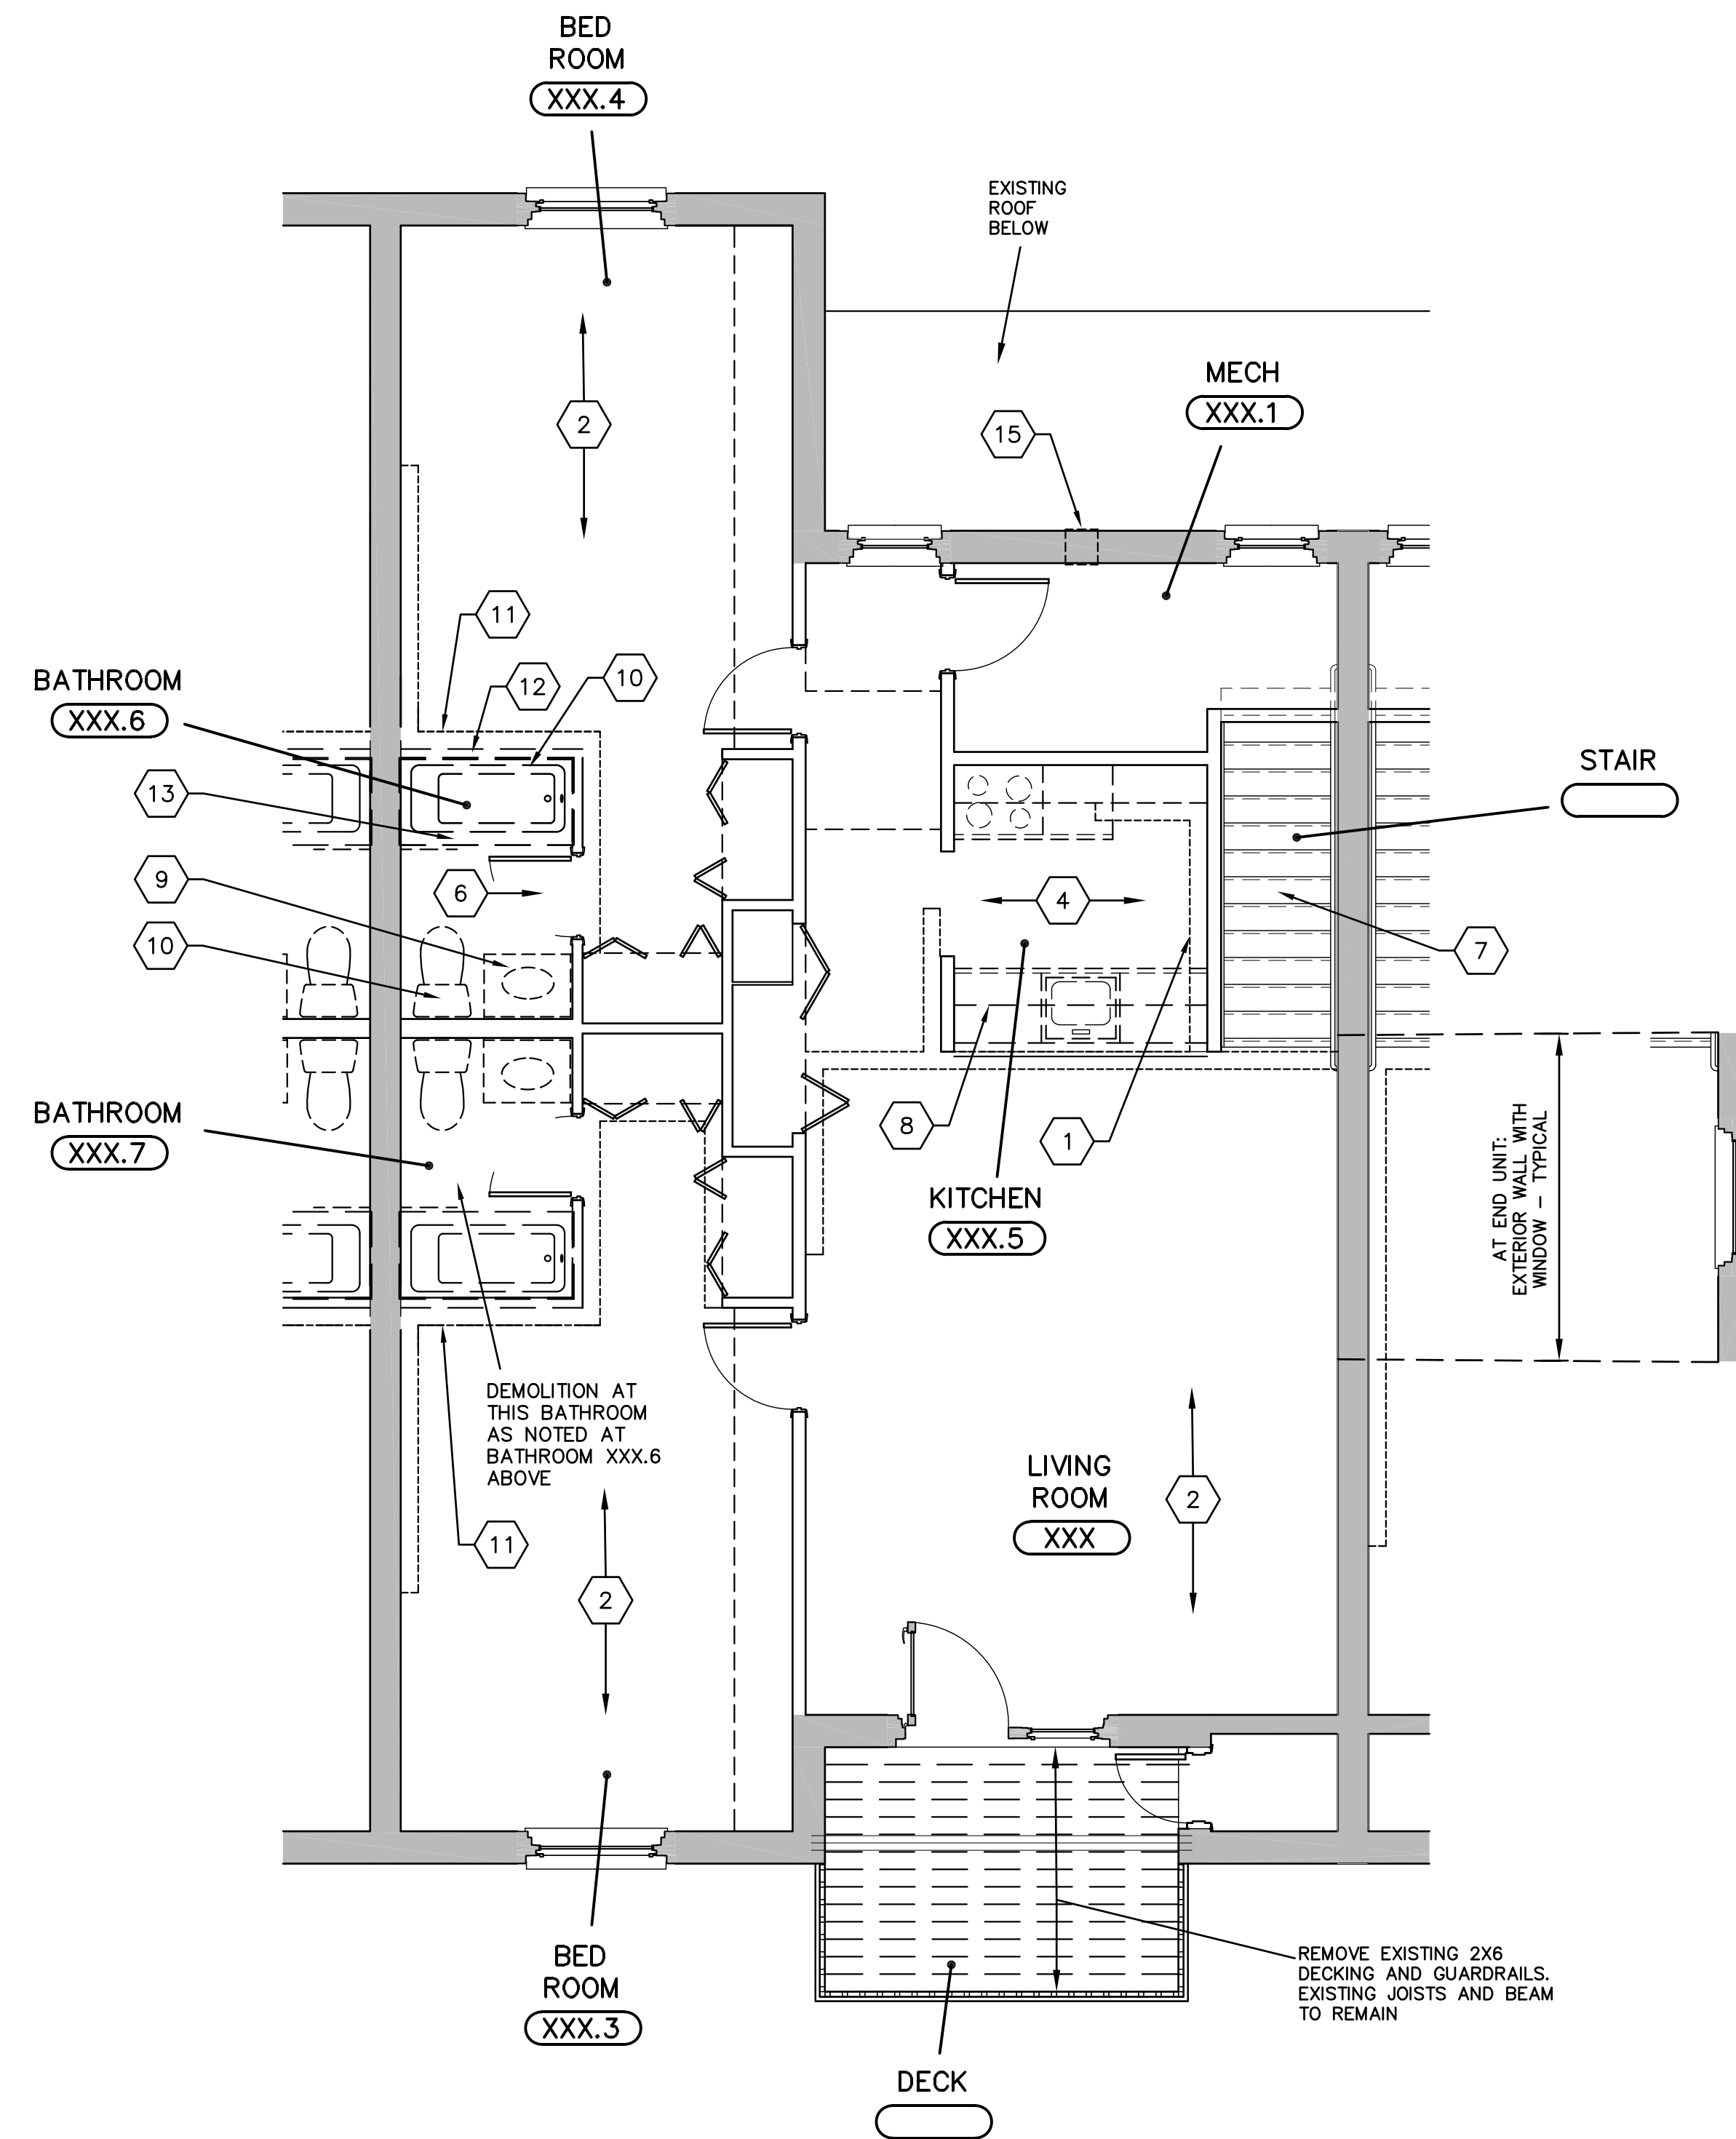

**2 PARTIAL SECOND FLOOR DEMOLITION PLAN – TYPICAL UNIT**  
 SCALE: 1/4" = 1'-0" LAYOUT AS SHOWN OR OPPOSITE HAND, SEE BUILDING PLANS FOR LAYOUTS FOR SPECIFIC UNIT NUMBERS. SEE PLUMBING, MECHANICAL AND ELECTRICAL DRAWINGS FOR ADDITIONAL DEMOLITION NOTES






**WALL CONSTRUCTION TYPE**


WALL TYPE "A": 3 1/2" DOUGLAS FIR KILN-DRIED (STUD GRADE) STUD AT 16" O.C. WITH (1) LAYER OF 1/2" MOLD AND MOISTURE RESISTANT GYPSUM BOARD TYPE X FINISH AT BATHROOM SIDE, 1/2" THICK ABUSE RESISTANT GYPSUM BOARD AT BEDROOM SIDE. INSTALL MINERAL WOOL ACOUSTIC INSULATION IN STUD SPACES ADJACENT BEDROOM WALLS.

NOTE: ALL EXISTING WALLS AND CEILINGS IN BATHROOMS TO RECEIVE NEW 1/2" THICK MOISTURE RESISTANT GYPSUM BOARD


**SYMBOL LEGEND**

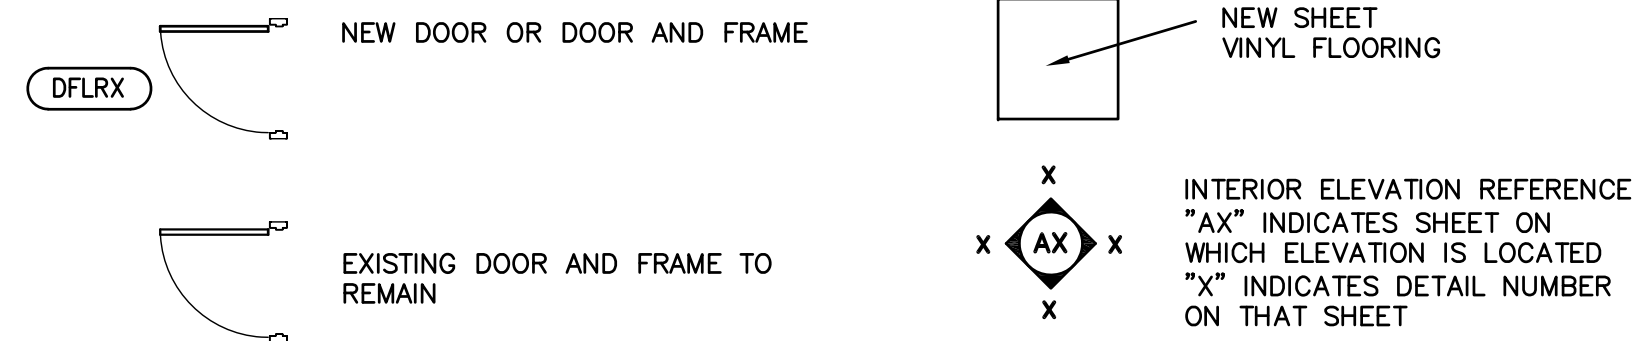


STANDARD OF RENOVATIONS QUALITY UNIT A-8 (SECOND FLOOR END UNIT WITH THE LAYOUT SHOWN BELOW) WILL BE FULLY RENOVATED, PRIOR TO THE START OF NEW WORK ON OTHER UNITS (DEMOLITION PERMITTED), AND THE ACCEPTED FINISHED UNIT WILL BE HELD AS THE STANDARD OF CONSTRUCTION QUALITY AGAINST WHICH OTHER WORK WILL BE EVALUATED AS ACCEPTABLE




PROJECT NORTH ARROW IS FOR FINISH SCHEDULE REFERENCE ONLY (ACTUAL BUILDING AND UNIT NORTH DIRECTION VARIES)

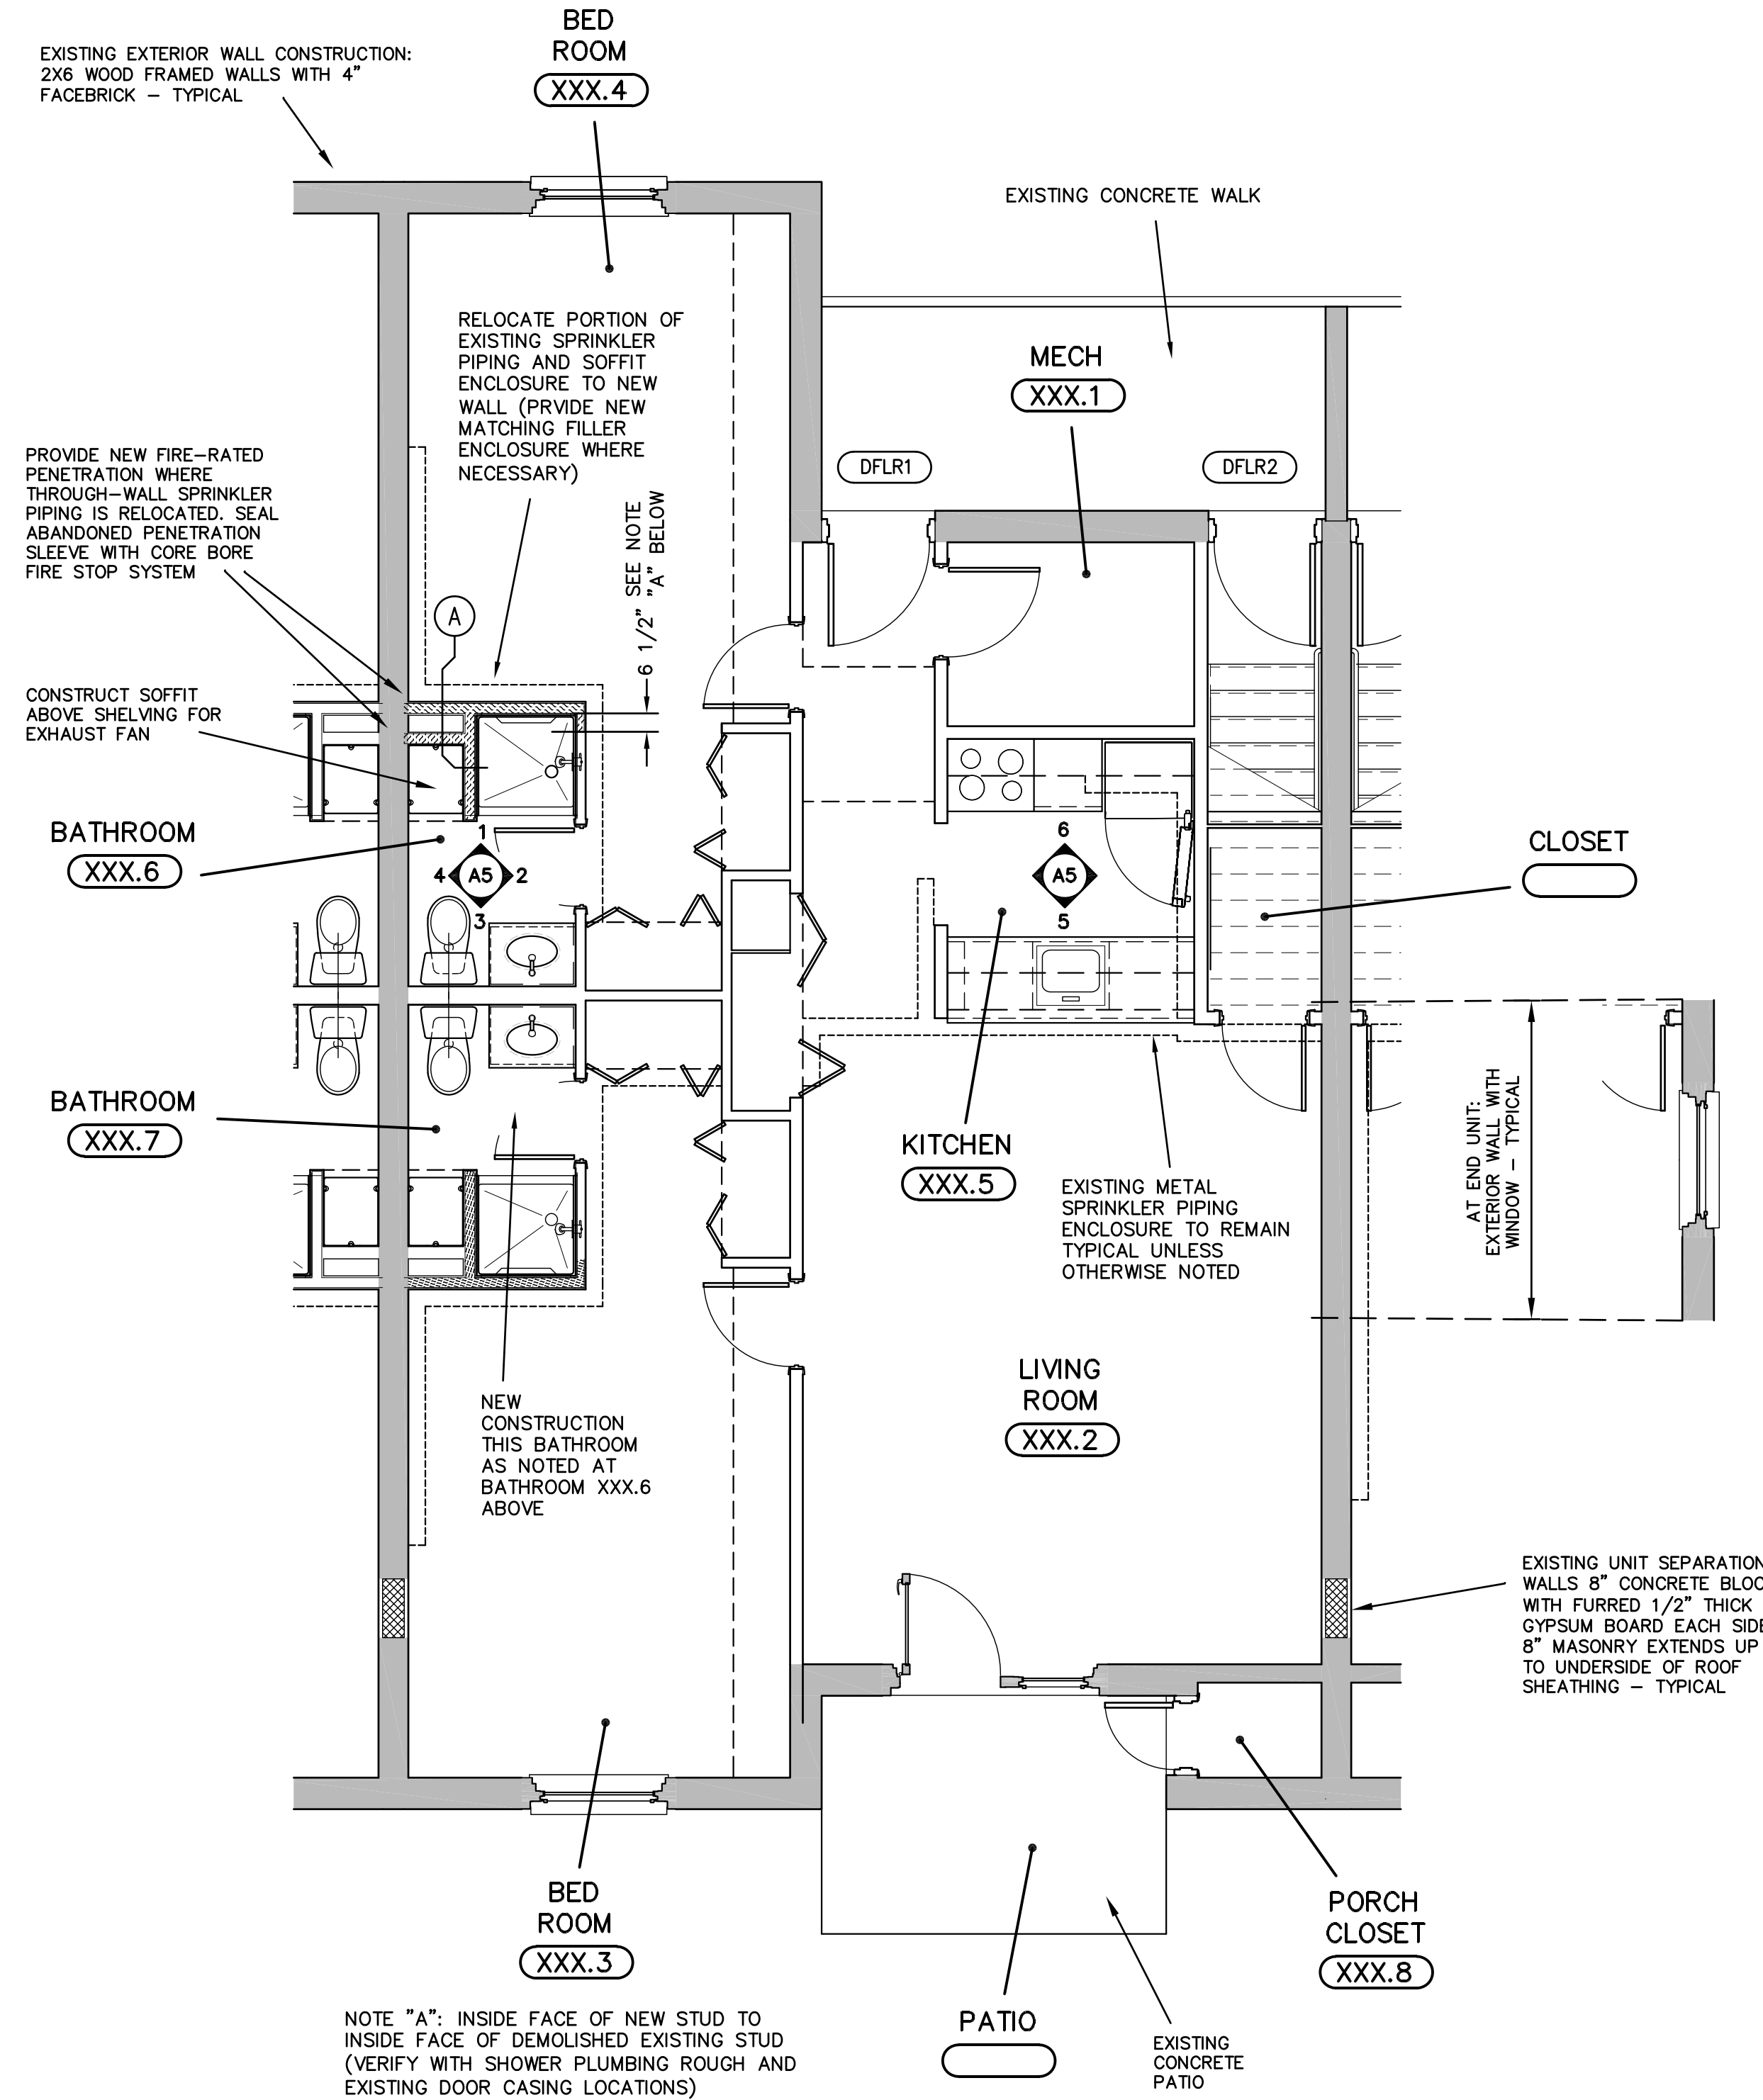

**1 PARTIAL FIRST FLOOR PLAN - TYPICAL UNIT**  
 SCALE: 1/4" = 1'-0" LAYOUT AS SHOWN OR OPPOSITE HAND, SEE OVERALL BUILDING PLANS FOR LAYOUTS FOR SPECIFIC UNIT NUMBERS

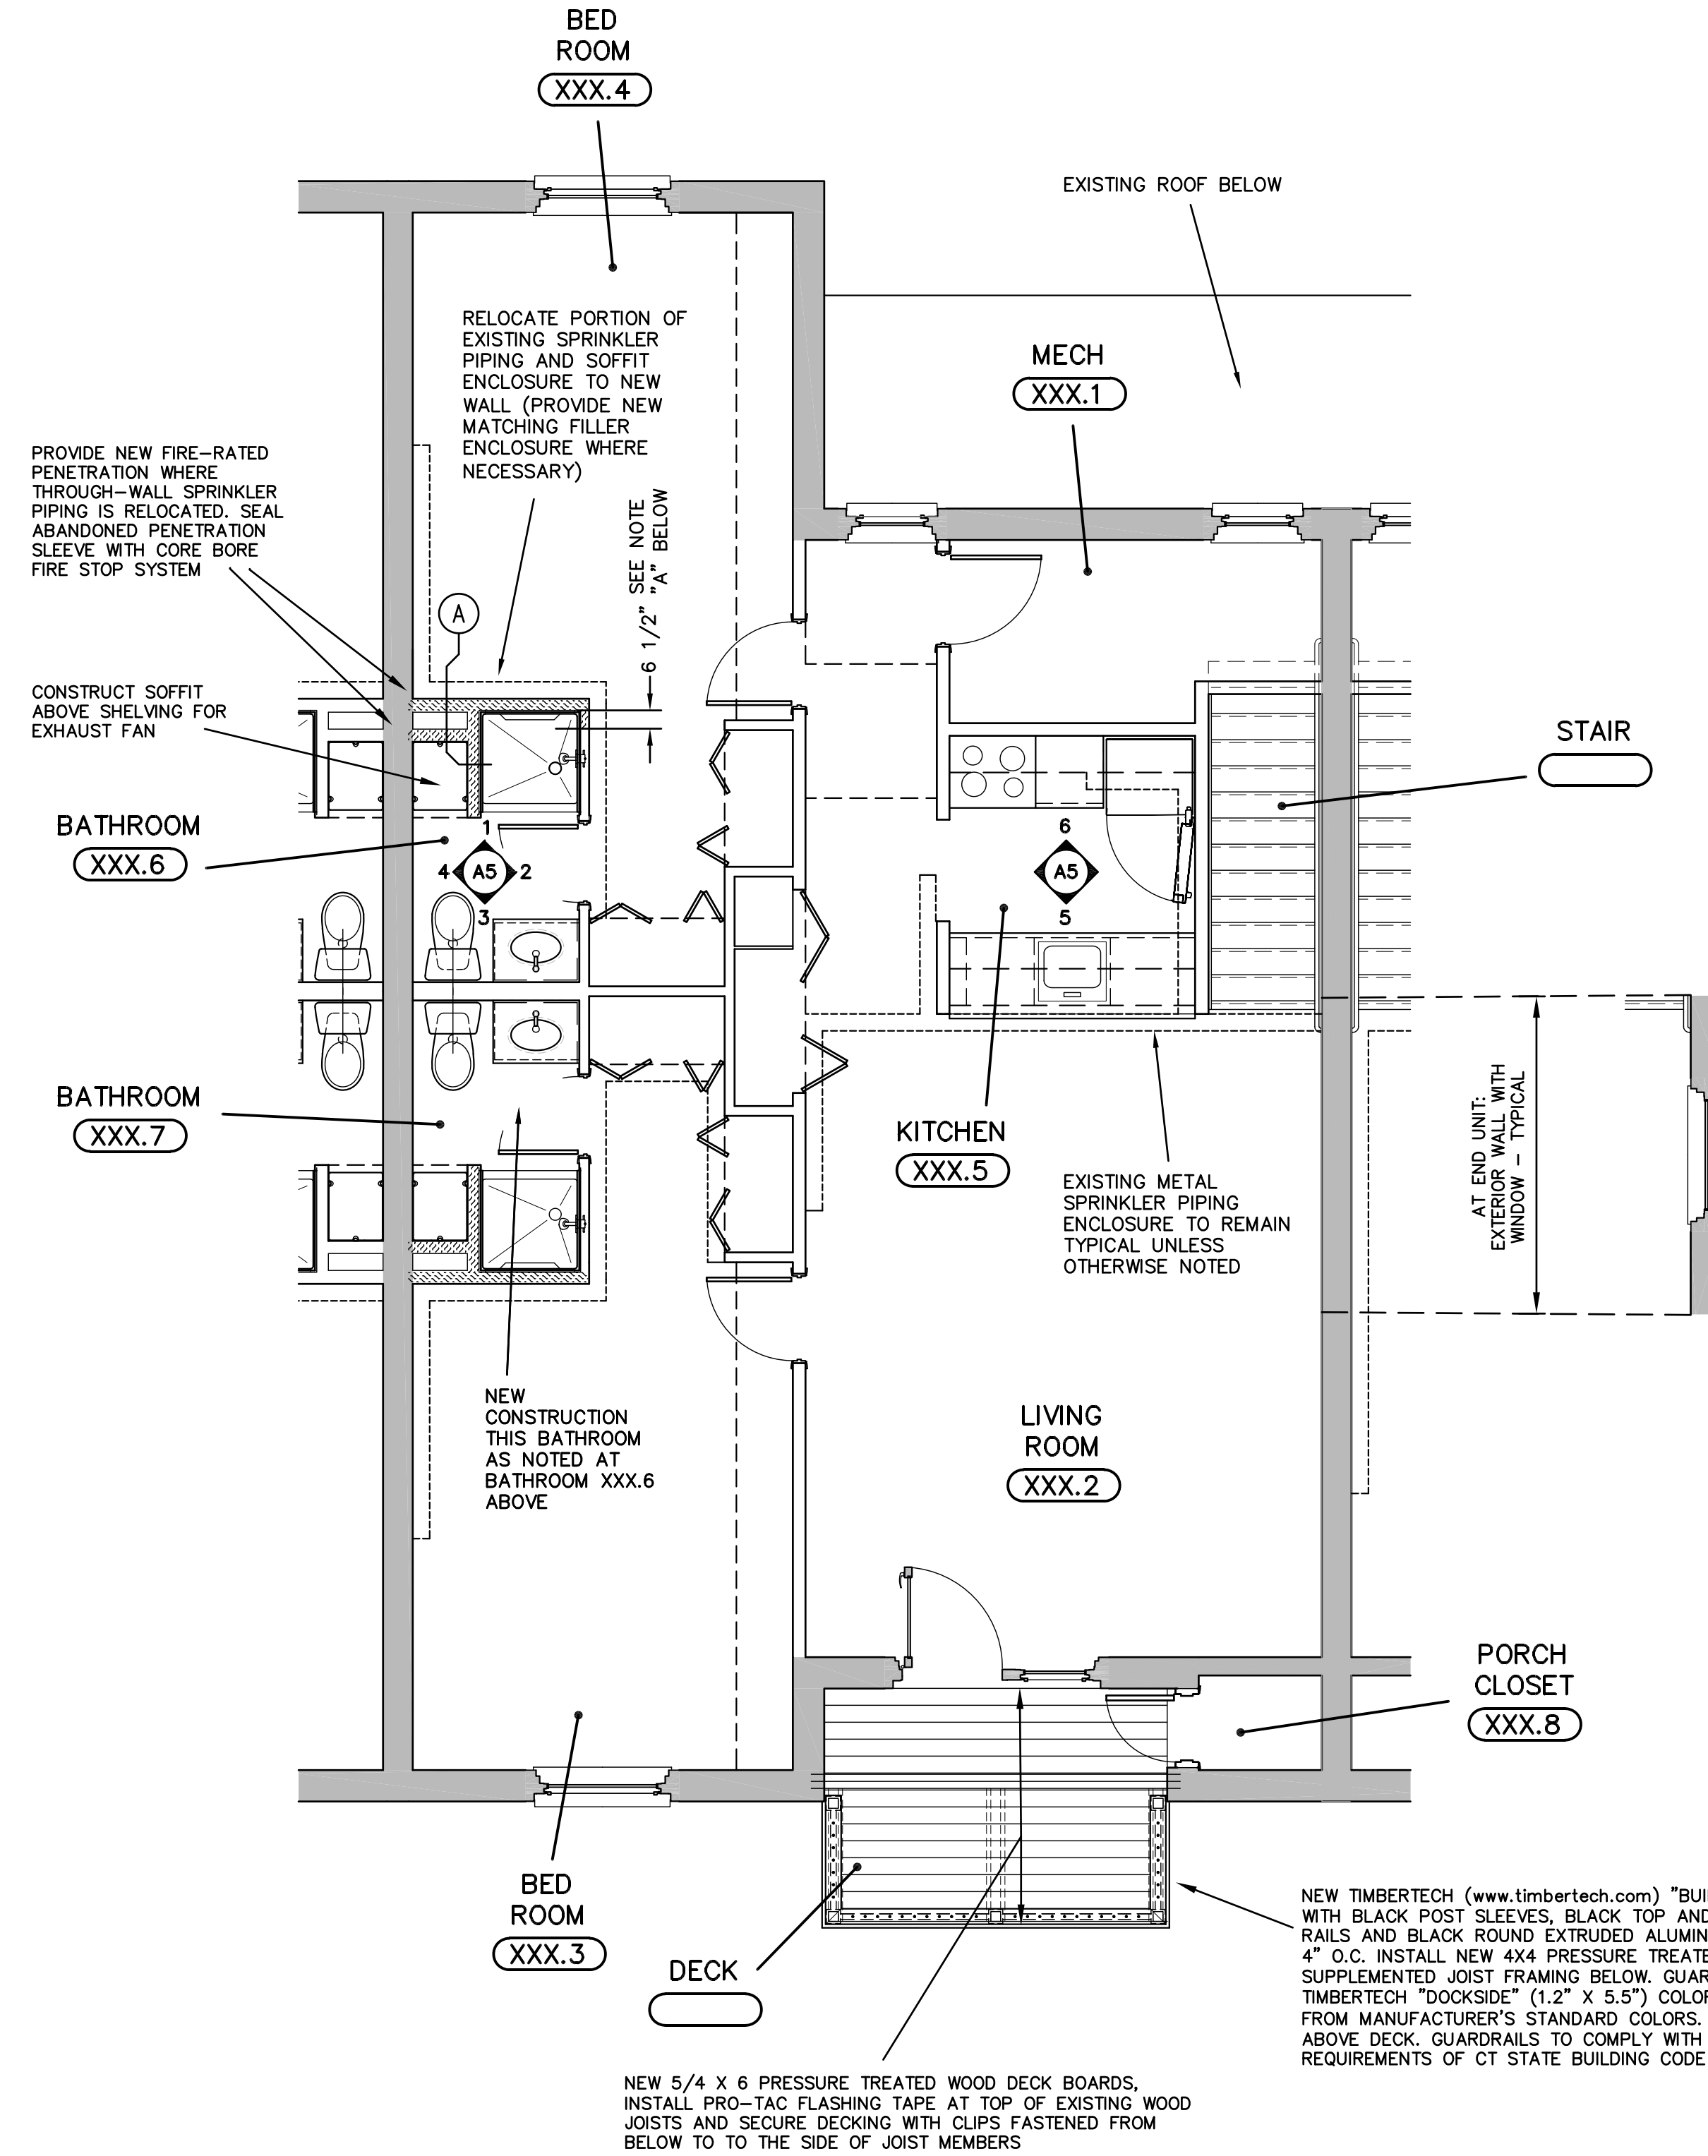

**2 PARTIAL SECOND FLOOR PLAN - TYPICAL UNIT**  
 SCALE: 1/4" = 1'-0" LAYOUT AS SHOWN OR OPPOSITE HAND, SEE OVERALL BUILDING PLANS FOR LAYOUTS FOR SPECIFIC UNIT NUMBERS





**DOOR SCHEDULE**

NOTE: REMOVE EXISTING LOCKSETS AND TRIM FROM EXISTING DOORS TO BE DEMOLISHED AND RETURN TO THE OWNER

NO.	DOOR TYPE	DOOR MATL.	SIZE (W X H)	THICK	FINISH	HARDWARE	ROOM NO.	ROOM NAME	LABEL	FRAME TYPE	FRAME MATL.	FRAME JAMB DEPTH	FRAME FINISH	JAMB DETAIL	REMARKS
DFLR1	TYPE A	METAL	3'-0" X 6'-8"	1 3/4"	NEW PAINT	1	N/A	ENTRY	NONE	1	METAL	8 3/4"	NEW PAINT	1/A4	CLOSER WITH HEAVY DUTY ARM, TEMPERED INSULATING GLASS
DFLR2	TYPE A	METAL	3'-0" X 6'-8"	1 3/4"	NEW PAINT	1	N/A	ENTRY	NONE	1	METAL	8 3/4"	NEW PAINT	1/A4	CLOSER WITH HEAVY DUTY ARM, TEMPERED INSULATING GLASS

**DOOR AND FRAME CONSTRUCTION**

**HOLLOW METAL FRAMES:**


- MANUFACTURER - BASIS OF DESIGN: CURRIES
- 16 GAUGE COLD ROLLED STEEL DOUBLE-RABBET FRAMES WITH WELDED CORNERS
- PREPARE WITH HARDWARE (AS SCHEDULED) REINFORCEMENT
- JAMB DEPTH (SEE SCHEDULE) FOR EXISTING WALL
- FIELD VERIFY DOOR HANDING.
- FRAME PROFILE TO BE MASONRY WITH COUNTERSUNK SOFFIT ANCHOR BOLTS - M
- FRAMES TO BE FULL WELD CONSTRUCTION - FW
- WELDED STEEL SPACING ANCHOR BRACKETS - WSB
- FRAMES TO HAVE WEATHERSEAL KERF AND WEATHER SEAL MATERIAL
- FRAMES TO BE FACTORY PRIME PAINTED

**METAL DOORS:**


- MANUFACTURER - BASIS OF DESIGN: CURRIES
- NEW FLUSH METAL DOORS:
- METAL DOORS TO BE MERCURY ENERGY EFFICIENT DOOR - 18 GAUGE COLD ROLLED STEEL WITH VERTICALLY STIFFENED POLYURETHANE CORE. DOOR ASSEMBLY U FACTOR - 0.38 (NFRC 102-2014) EMBOSSED PANEL DESIGN E609 (2 VISION LITE OVER 4 PANEL)
- LOCK AND HINGE EDGE TO HAVE CENTER SEAM CONTINUOUSLY WIRE WELDED - T
- DOORS TO BE REINFORCED FOR SCHEDULED HARDWARE
- VISION PANELS TO HAVE TYPE 10 POCKET FOR 5/8" THICK L062 TEMPERED INSULATING GLASS
- DOORS TO BE FACTORY PRIME PAINTED
- PROVIDE WELDED DOOR BOTTOM FILLER CAP - FILL AND FINISH SMOOTH

**NOTE: IBC 2403.1 GLASS IDENTIFICATION - SAFETY GLAZING**

IBC 2403.1 IDENTIFICATION. EACH PANE SHALL BEAR THE MANUFACTURER'S MARK DESIGNATING THE TYPE AND THICKNESS OF THE GLASS OR GLAZING MATERIAL. THE IDENTIFICATION SHALL NOT BE OMITTED UNLESS APPROVED. EACH PANE OF TEMPERED GLASS, EXCEPT TEMPERED SPANDREL GLASS, SHALL BE PERMANENTLY IDENTIFIED BY THE MANUFACTURER. THE IDENTIFICATION MARK SHALL BE ACID ETCHED, SAND BLASTED, CERAMIC FIRED, LASER ETCHED, EMBOSSED OR OF A TYPE THAT, ONCE APPLIED, CANNOT BE REMOVED WITHOUT BEING DESTROYED.

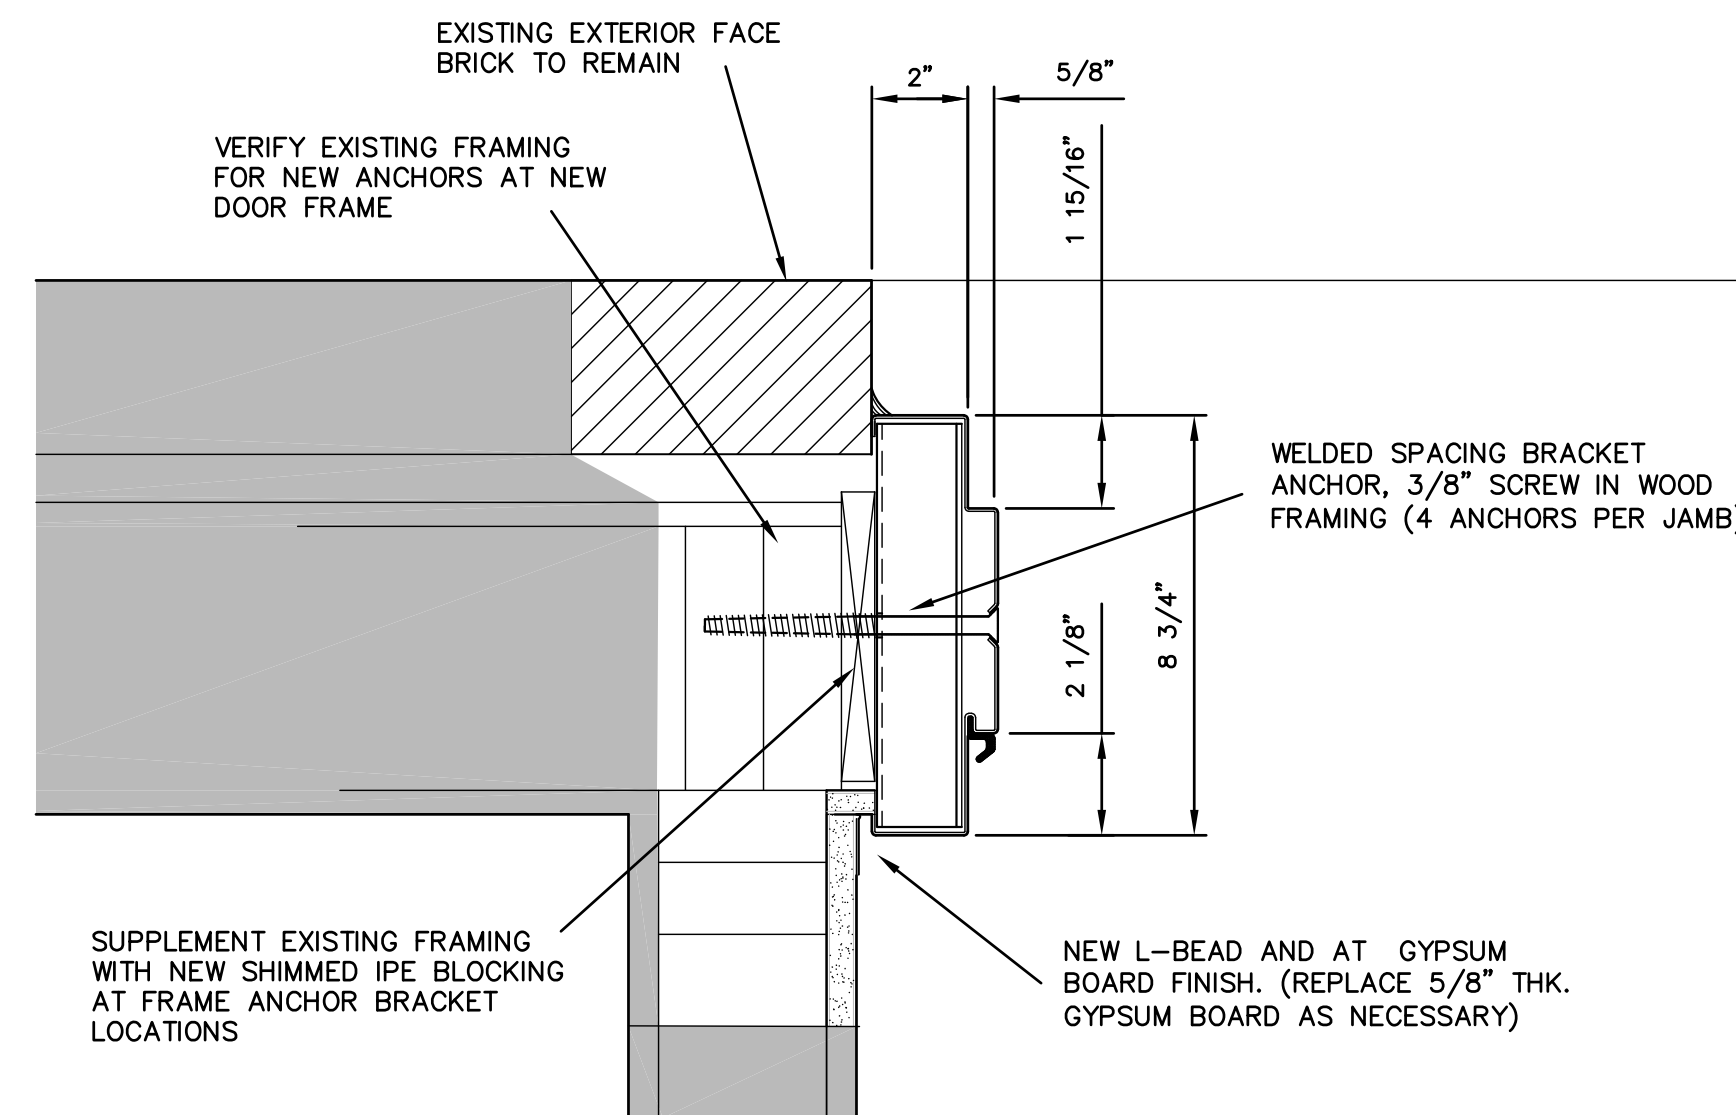


**1** DETAIL - DOOR JAMB DETAIL AT DOOR DFLR2 SHOWN (OR OPPOSITE HAND), DETAIL AT DOOR DFLR1 SIMILAR  
A4 SCALE: 3" = 1'-0"

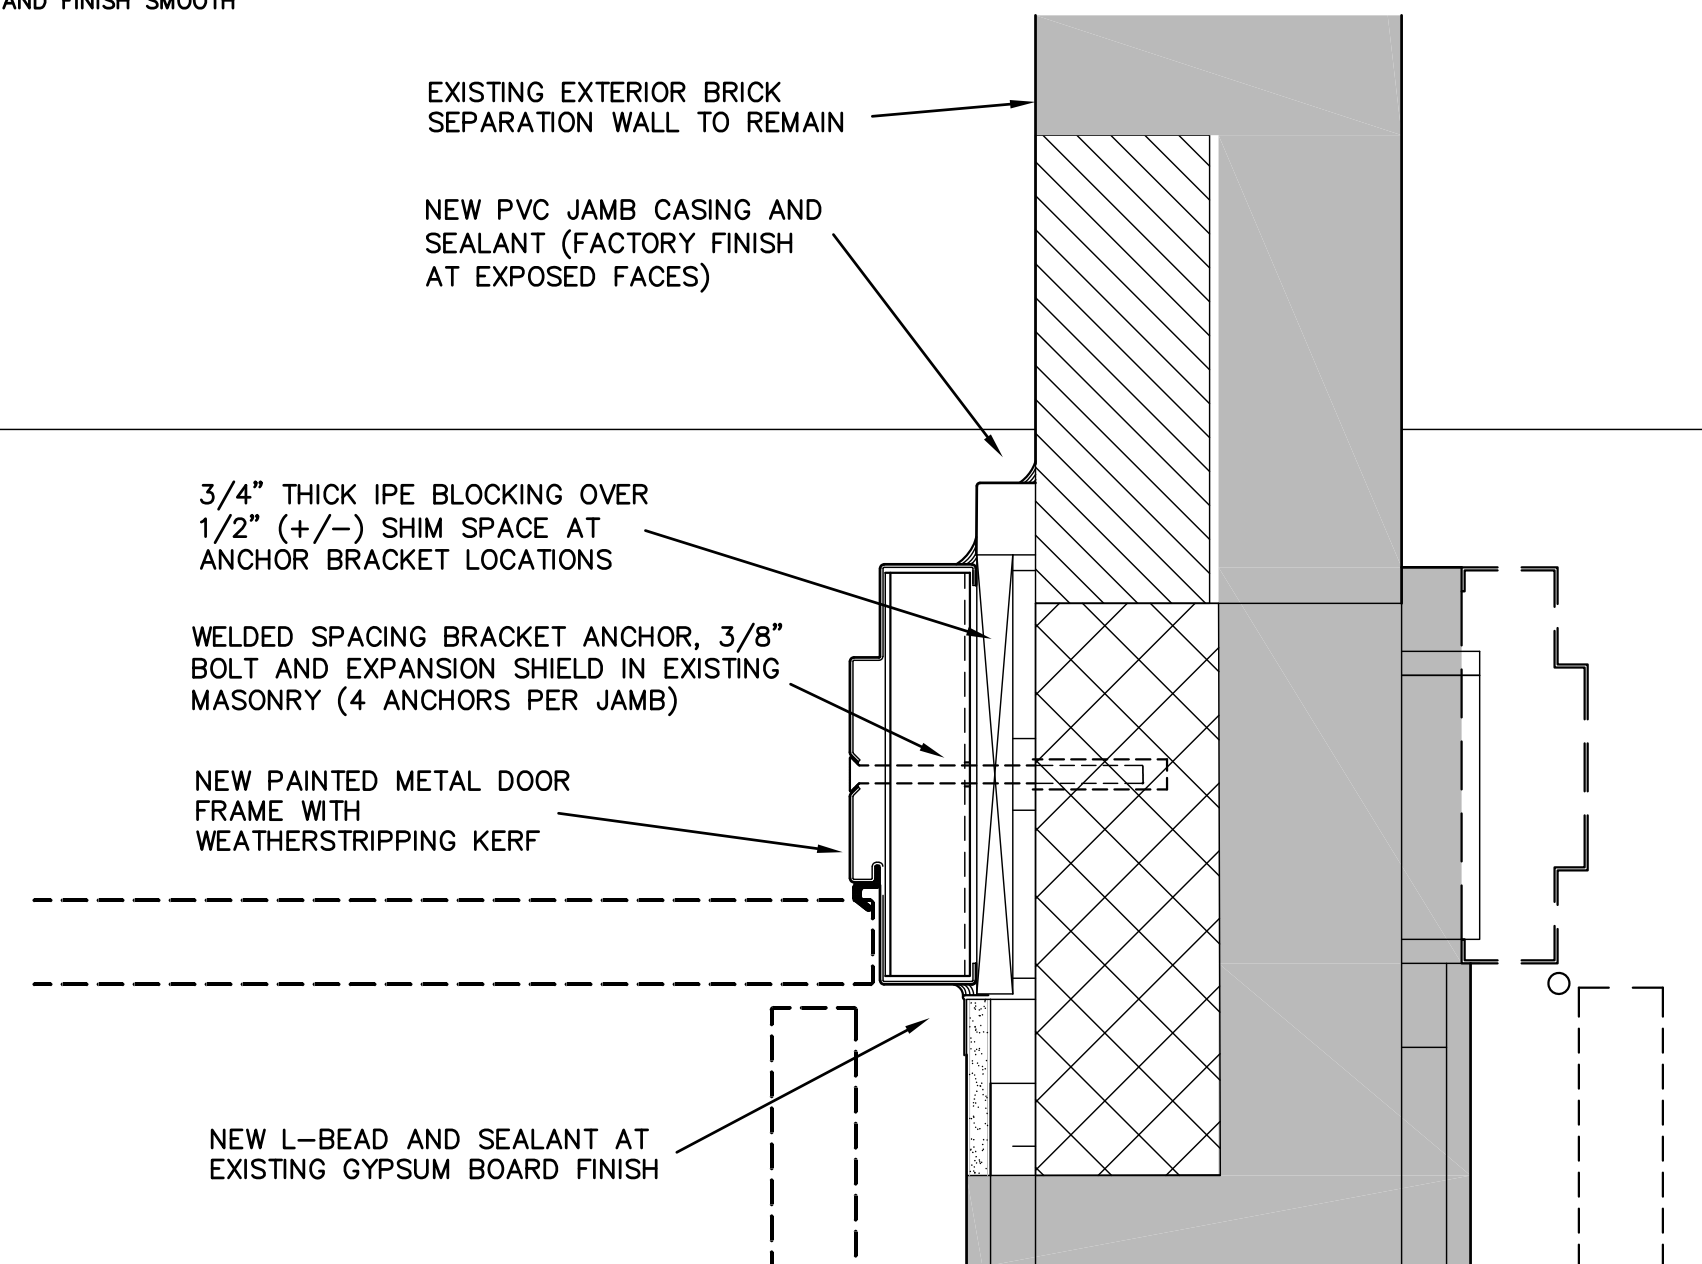

**DOOR FINISH HARDWARE SCHEDULE**

FINISH HARDWARE SET 1: (DOOR: DFLR1 DOOR: DFLR2)

3 BUTTS	TA2714 4 1/2" X 4 1/2"	US26D	MCKINNEY
1 LOCKSET	8251 LE2L 130KB	US26D	SARGENT
1 CLOSER	TB 281-010	US26D	SARGENT
1 FLOOR STOP	482	US26D	ROCKWOOD
1 KICK PLATE	K1050 8X34 4BE CSK TEK	US32D	ROCKWOOD
1 DOOR VIEWER	622	STNN	ROCKWOOD
1 THRESHOLD	249AV	MILL	PEMKO

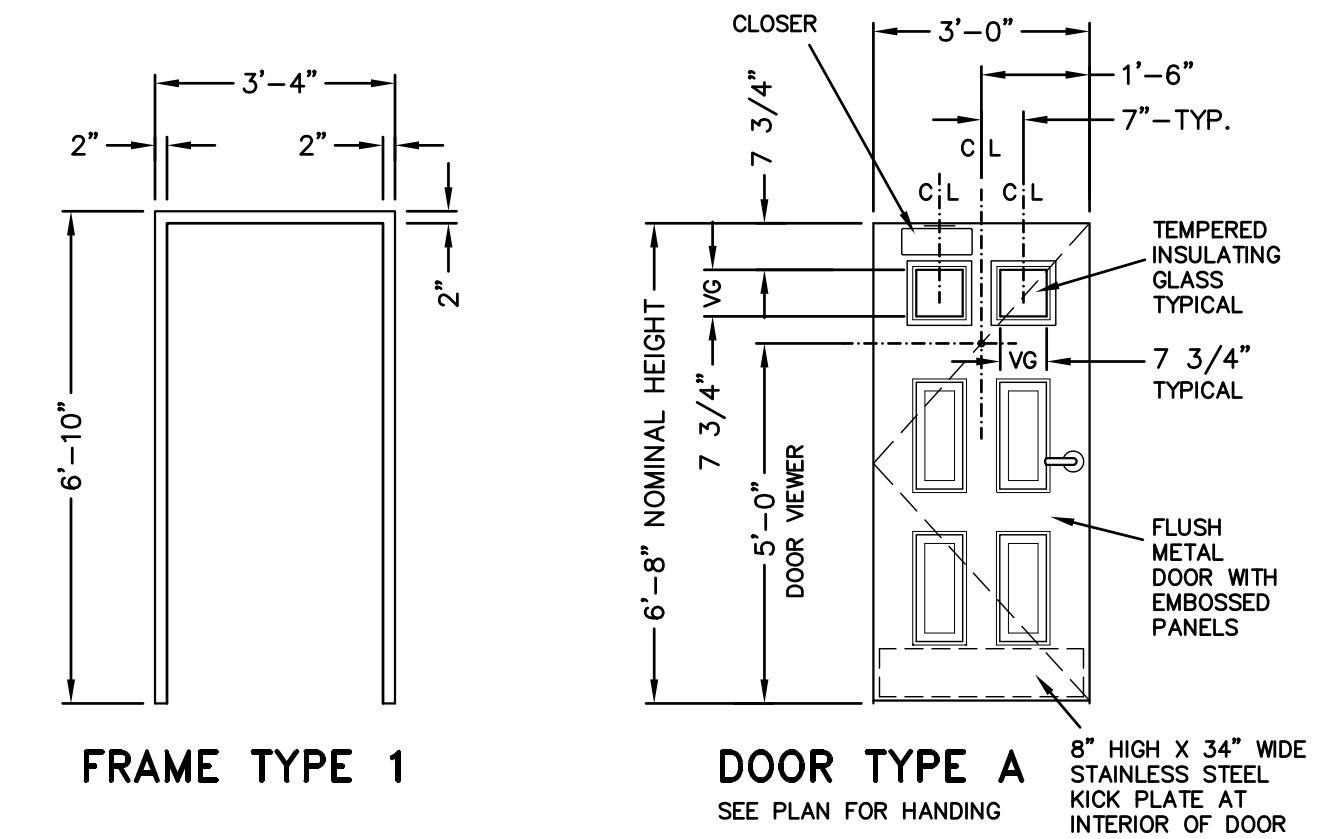

**2** DOOR AND FRAME TYPES  
A4 SCALE: 3/8" = 1'-0"

**FINISH NOTES** BASIS OF DESIGN IS NOTED FOR MATERIALS

- PAINT:
  - PT1: ALL NEW AND EXISTING GYPSUM BOARD WALL SURFACES TO RECEIVE NEW PAINT (NEW GYPSUM BOARD TO RECEIVE PRIMER PLUS (2) COATS) (SW PRO-MARK 400 INTERIOR LATEX - SHEEN: EGG-SHELL IN ALL ROOMS EXCEPT BATHROOMS AND KITCHENS, SEMI-GLOSS IN BATHROOMS, KITCHENS AND PORCH CLOSETS) COLOR TO BE SELECTED.
  - PT2: EXISTING WOOD DOORS AND FRAMES AND WOOD WINDOW SILLS: (2) COATS S-W PRO CLASSIC INTERIOR WB, ACRYLIC/ALKYD CLASSIC SEMI-GLOSS B31. COLOR TO BE SELECTED
  - PT3: NEW METAL DOORS AND FRAMES TO RECEIVE PRIMER PLUS (2) COATS OF DTM ACRYLIC SEMI-GLOSS COLOR TO BE SELECTED. COLOR TO BE SELECTED.
- NEW LUXURY VINYL TILE FLOORING:
  - MOHAWK INDUSTRIES - STYLE: "SELECT STEP II" 20 MIL WEAR LAYER, OVERALL THICKNESS 3 MM, COLOR TO BE SELECTED FROM MANUFACTURER'S STANDARD COLORS.
- NEW SHEET VINYL FLOORING:
  - MOHAWK INDUSTRIES - 6 FOOT WIDE RESILIENT FLOORING - STYLE: "CALMNESS OR EPHEMERAL" 20 MIL WEAR LAYER, OVERALL THICKNESS 2 MM, COLOR TO BE SELECTED FROM MANUFACTURER'S STANDARD COLORS.
- NEW CARPETING:
  - MOHAWK INDUSTRIES - STYLE: "FACULTY REMIX" 26 OZ. TUFTED TEXTURED MULTI-COLORED LOOP, 12 FOOT WIDE ROLLS, COLOR TO BE SELECTED FROM MANUFACTURER'S STANDARD COLORS.
- NEW 4" RUBBER BASE (COVE) TO MATCH ROPPE "PINNACLE", COLOR TO BE SELECTED FROM MANUFACTURER'S STANDARD COLORS


**FLOOR SUBSTRATE PREPARATION NOTES**

- IF THERE IS NO DAMAGED SUBFLOOR AT A SECOND FLOOR LOCATION, THE EXISTING GYP-CRETE FILL AT THE SECOND FLOOR SHALL BE REPAIRED WITH THE ARDEX PRODUCT SPECIFIED.
- BIDDER SHOULD ASSUME THAT 100% OF THE EXISTING CONCRETE SLAB AT THE FIRST FLOOR AND THE EXISTING GYP-CRETE FILLS AT THE SECOND FLOOR WILL HAVE TO BE REPAIRED.
- THE ROLL-ON MOISTURE (VAPOR BARRIER) SHALL BE APPLIED IN ALL (100%) OF THE FIRST FLOOR AREAS THAT ARE TO RECEIVE LVT OR SHEET VINYL.

**FINISH SCHEDULE**

SEE SPECIFICATIONS FOR ADDITIONAL FINISH INFORMATION NEW CARPET TO COMPLY WITH "DOC FF-1 "pill test". NOTE: ALL SPRINKLER PIPING SOFFIT ENCLOSURES TO REMAIN FACTORY FINISH


ROOM	FLOOR	BASE	N WALL	E WALL	S WALL	W WALL	CEILING	REMARKS
XXX.1 MECHANICAL	EXISTING TO REMAIN	EXISTING TO REMAIN	PAINT EXISTING GYPSUM BOARD PT1, PAINT EXISTING WINDOW SILLS PT2, (EXISTING FACTORY FINISHED WINDOWS)	PAINT EXISTING GYPSUM BOARD PT1.	PAINT EXISTING GYPSUM BOARD PT1	PAINT EXISTING GYPSUM BOARD PT1 PAINT EXISTING WOOD DOOR AND FRAME PT2	PAINT EXISTING GYPSUM BOARD PT1	PAINT EXISTING CEILING ACCESS DOORS (WHERE OCCURS) PT2
XXX.2 LIVING	NEW LUXURY VINYL TILE	NEW 4" HIGH RUBBER BASE	PAINT EXISTING GYPSUM BOARD PT1, (AT FIRST FLOOR PAINT EXISTING CLOSET DOOR AND FRAME PT2)	PAINT EXISTING GYPSUM BOARD PT1, (AT END UNITS PAINT EXISTING WINDOW SILL PT2)	PAINT EXISTING GYPSUM BOARD PT1, (EXISTING FACTORY FINISHED WINDOWS)	PAINT EXISTING GYPSUM BOARD PT1, PAINT EXISTING CLOSET DOORS AND FRAMES PT2	PAINT EXISTING GYPSUM BOARD PT1	
XXX.3 BEDROOM	NEW LUXURY VINYL TILE	NEW 4" HIGH RUBBER BASE	PAINT NEW AND EXISTING GYPSUM BOARD PT1 PAINT EXISTING WOOD DOOR AND FRAME PT2	PAINT EXISTING GYPSUM BOARD PT1 PAINT EXISTING WOOD DOORS AND FRAMES PT2	PAINT EXISTING GYPSUM BOARD PT1, PAINT EXISTING WINDOW SILL PT2, (EXISTING FACTORY FINISHED WINDOWS)	PAINT GYPSUM BOARD PT1, PAINT METAL WINDOW FRAMES PT3, NEW CASEWORK.	PAINT EXISTING GYPSUM BOARD PT1	
XXX.4 BEDROOM	NEW LUXURY VINYL TILE	NEW 4" HIGH RUBBER BASE	PAINT EXISTING GYPSUM BOARD PT1, PAINT EXISTING WINDOW SILL PT2, (EXISTING FACTORY FINISHED WINDOWS)	PAINT EXISTING GYPSUM BOARD PT1 PAINT EXISTING WOOD DOORS AND FRAMES PT2	PAINT NEW AND EXISTING GYPSUM BOARD PT1 PAINT EXISTING WOOD DOOR AND FRAME PT2	PAINT EXISTING GYPSUM BOARD PT1 PAINT EXISTING WOOD DOOR AND FRAME PT2	PAINT EXISTING GYPSUM BOARD PT1	
XXX.5 KITCHEN	NEW LUXURY VINYL TILE	NEW 4" HIGH RUBBER BASE	PAINT EXISTING GYPSUM BOARD PT1, NEW FACTORY FINISHED CASEWORK	PAINT EXISTING GYPSUM BOARD PT1	PAINT EXISTING GYPSUM BOARD PT1, NEW FACTORY FINISHED CASEWORK	PAINT EXISTING GYPSUM BOARD PT1, NEW STAINLESS STEEL SIDESPLASH AT RANGE	PAINT EXISTING GYPSUM BOARD PT1	INSTALL ARDEX LEVELING COMPOUND ON FLOOR SUBSTRATE, AT FIRST FLOOR PROVIDE MOISTURE BARRIER PRIMER AT CONCRETE SLAB
XXX.6 BATHROOM	NEW SHEET VINYL FLOORING	NEW 4" HIGH RUBBER BASE	PAINT NEW GYPSUM BOARD EXPT1, FACTORY FINISHED SHOWER	PAINT NEW GYPSUM BOARD EXPT1, PAINT DOOR AND FRAME PT2	PAINT NEW GYPSUM BOARD EXPT1, NEW FACTORY FINISHED CASEWORK	PAINT NEW GYPSUM BOARD EXPT1	PAINT NEW GYPSUM BOARD PT1	PAINT NEW CEILING ACCESS DOOR AT FIRST FLOOR PT2. INSTALL ARDEX LEVELING COMPOUND ON FLOOR SUBSTRATE, AT FIRST FLOOR PROVIDE MOISTURE BARRIER PRIMER AT CONCRETE SLAB
XXX.7 BATHROOM	NEW SHEET VINYL FLOORING	NEW 4" HIGH RUBBER BASE	PAINT NEW GYPSUM BOARD EXPT1, NEW FACTORY FINISHED CASEWORK	PAINT NEW GYPSUM BOARD EXPT1, PAINT DOOR AND FRAME PT2	PAINT NEW GYPSUM BOARD EXPT1, FACTORY FINISHED SHOWER	PAINT NEW GYPSUM BOARD EXPT1	PAINT NEW GYPSUM BOARD PT1	PAINT NEW CEILING ACCESS DOOR AT FIRST FLOOR PT2. INSTALL ARDEX LEVELING COMPOUND ON FLOOR SUBSTRATE, AT FIRST FLOOR PROVIDE MOISTURE BARRIER PRIMER AT CONCRETE SLAB
XXX.8 PORCH CLOSET	EXISTING TO REMAIN	EXISTING TO REMAIN	PAINT EXISTING GYPSUM BOARD PT1	PAINT EXISTING GYPSUM BOARD PT1	PAINT EXISTING GYPSUM BOARD PT1	PAINT GYPSUM BOARD PT1, PAINT EXISTING METAL DOOR AND FRAME PT3 (INTERIOR AND EXTERIOR)	PAINT EXISTING GYPSUM BOARD PT1	
CLOSETS	NEW LUXURY VINYL TILE	NEW 4" HIGH RUBBER BASE	PAINT EXISTING GYPSUM BOARD PT1, PAINT DOORS, FRAMES AND EXISTING RODS AND SHELVING PT2	PAINT EXISTING GYPSUM BOARD PT1, PAINT DOORS, FRAMES AND EXISTING RODS AND SHELVING PT2	PAINT EXISTING GYPSUM BOARD PT1, PAINT DOORS, FRAMES AND EXISTING RODS AND SHELVING PT2	PAINT EXISTING GYPSUM BOARD PT1, PAINT DOORS, FRAMES AND EXISTING RODS AND SHELVING PT2	PAINT EXISTING GYPSUM BOARD PT1	
STAIR-ENTRY	NEW CARPETING	NEW 4" HIGH RUBBER BASE AT LANDING	PAINT NEW AND EXISTING GYPSUM BOARD PT1, PAINT METAL DOOR AND FRAME PT3	PAINT EXISTING GYPSUM BOARD PT1, PAINT EXISTING DOOR AND FRAME PT2 (AS OCCURS)	N/A	PAINT EXISTING GYPSUM BOARD PT1, PAINT EXISTING DOOR AND FRAME PT2 (AS OCCURS)	PAINT EXISTING GYPSUM BOARD PT1	






**BATHROOM ACCESSORIES**


- (A) TOILET PAPER DISPENSER: BRADLEY MODEL 505 - SURFACE MOUNTED DIECAST ZINC WITH COPPER AND NICKEL POLISHED CHROME PLATED FINISH. 5" DIAMETER PAPER ROLL SIZE STANDARD CORE SIZE. PUSH BUTTON RELEASE OF SUPPORT ARMS FOR REFILLING
- (B) HEAVY DUTY TOWEL BAR: GAMCO MODEL TB-3 - 18" LONG WITH 18 GAUGE TYPE 304 STAINLESS STEEL 1" DIAMETER TUBE BAR. SATIN CHROME SOLID BRASS POSTS WITH EXPOSED STAINLESS STEEL SCREW FASTENING
- (C) HEAVY DUTY TOWEL BAR: GAMCO MODEL TB-3 - 24" LONG WITH 18 GAUGE TYPE 304 STAINLESS STEEL 1" DIAMETER TUBE BAR. SATIN CHROME SOLID BRASS POSTS WITH EXPOSED STAINLESS STEEL SCREW FASTENING
- (D) NEW DOOR STOP - ROCKWOOD 432W CONCAVE RUBBER DOOR STOP, COLOR WHITE, SELF-ADHESIVE. MOUNT AT BOTTOM OF STRIKE STILE OF DOOR TO MEET SHOWER CURB
- (E) NEW WALL MOUNTED MIRROR: BOBRICK B-1658-1830, 18" WIDE X 30" HIGH MIRROR (TYPE 430 STAINLESS STEEL CHANNEL FRAME WITH 1/4" TEMPERED GLASS) WITH CONCEALED SCREW LOCKING MOUNTING.
- (F) SHOWER CURTAIN ROD: SHOWER RODS AND SHOWER CURTAINS WILL PROVIDED BY OWNER AND INSTALLED BY GENERAL CONTRACTOR

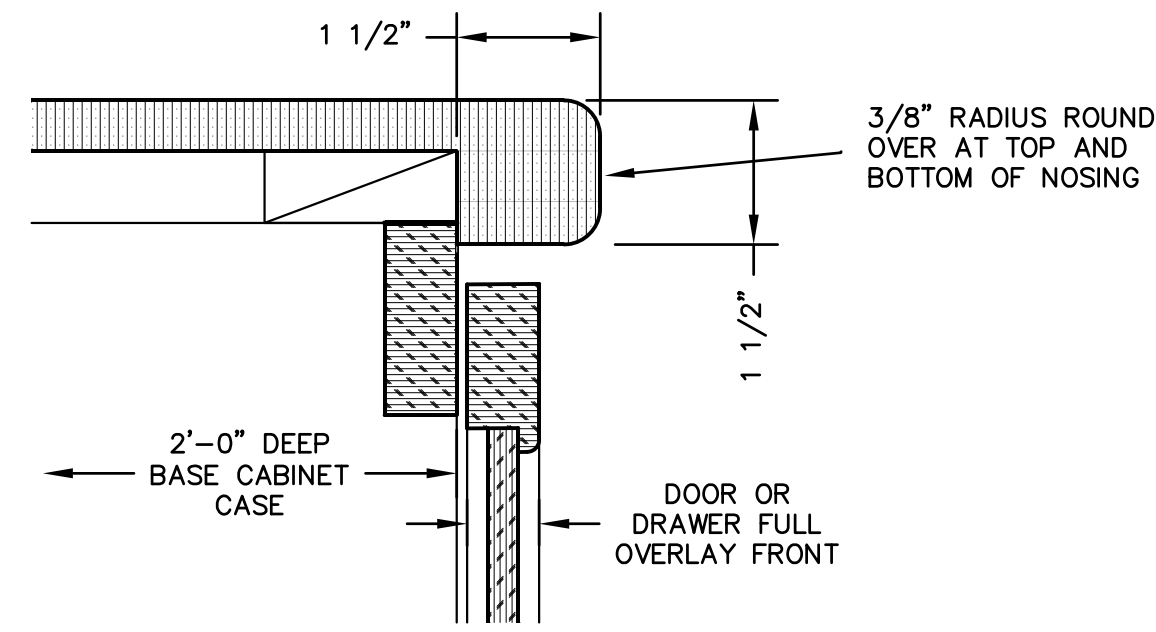

**7 COUNTERTOP NOSING AT CASEWORK**  
A5 SCALE: 3" = 1'-0"

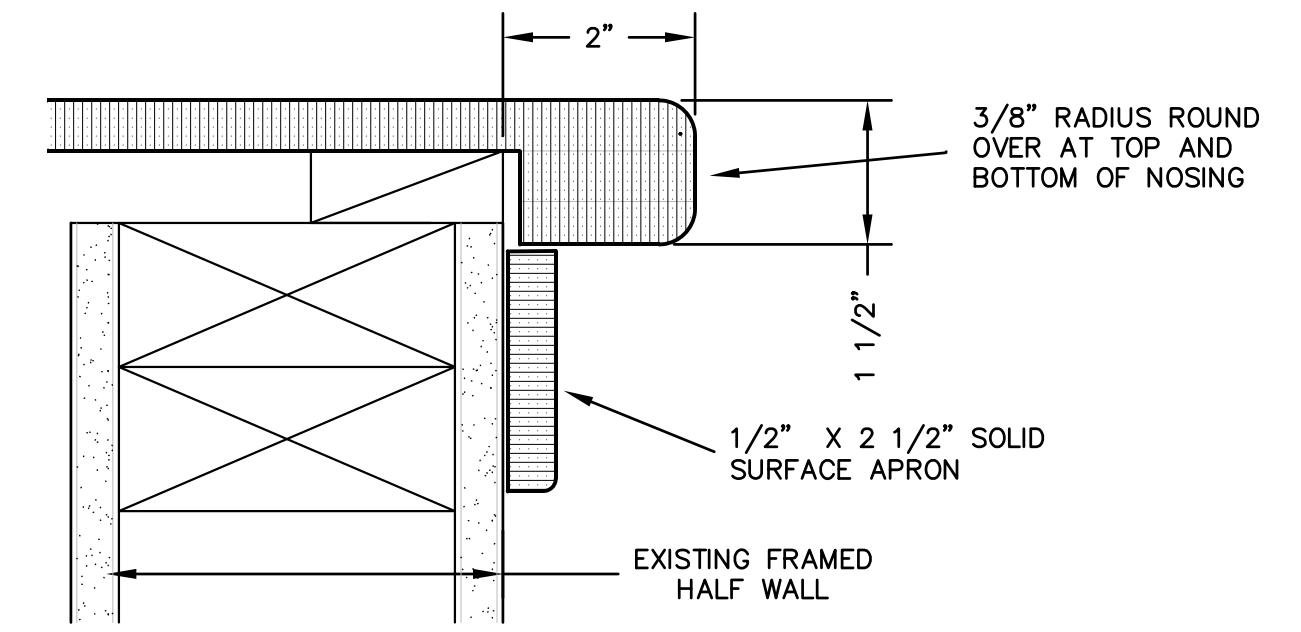


**8 COUNTERTOP NOSING AT HALF WALL**  
A5 SCALE: 3" = 1'-0"

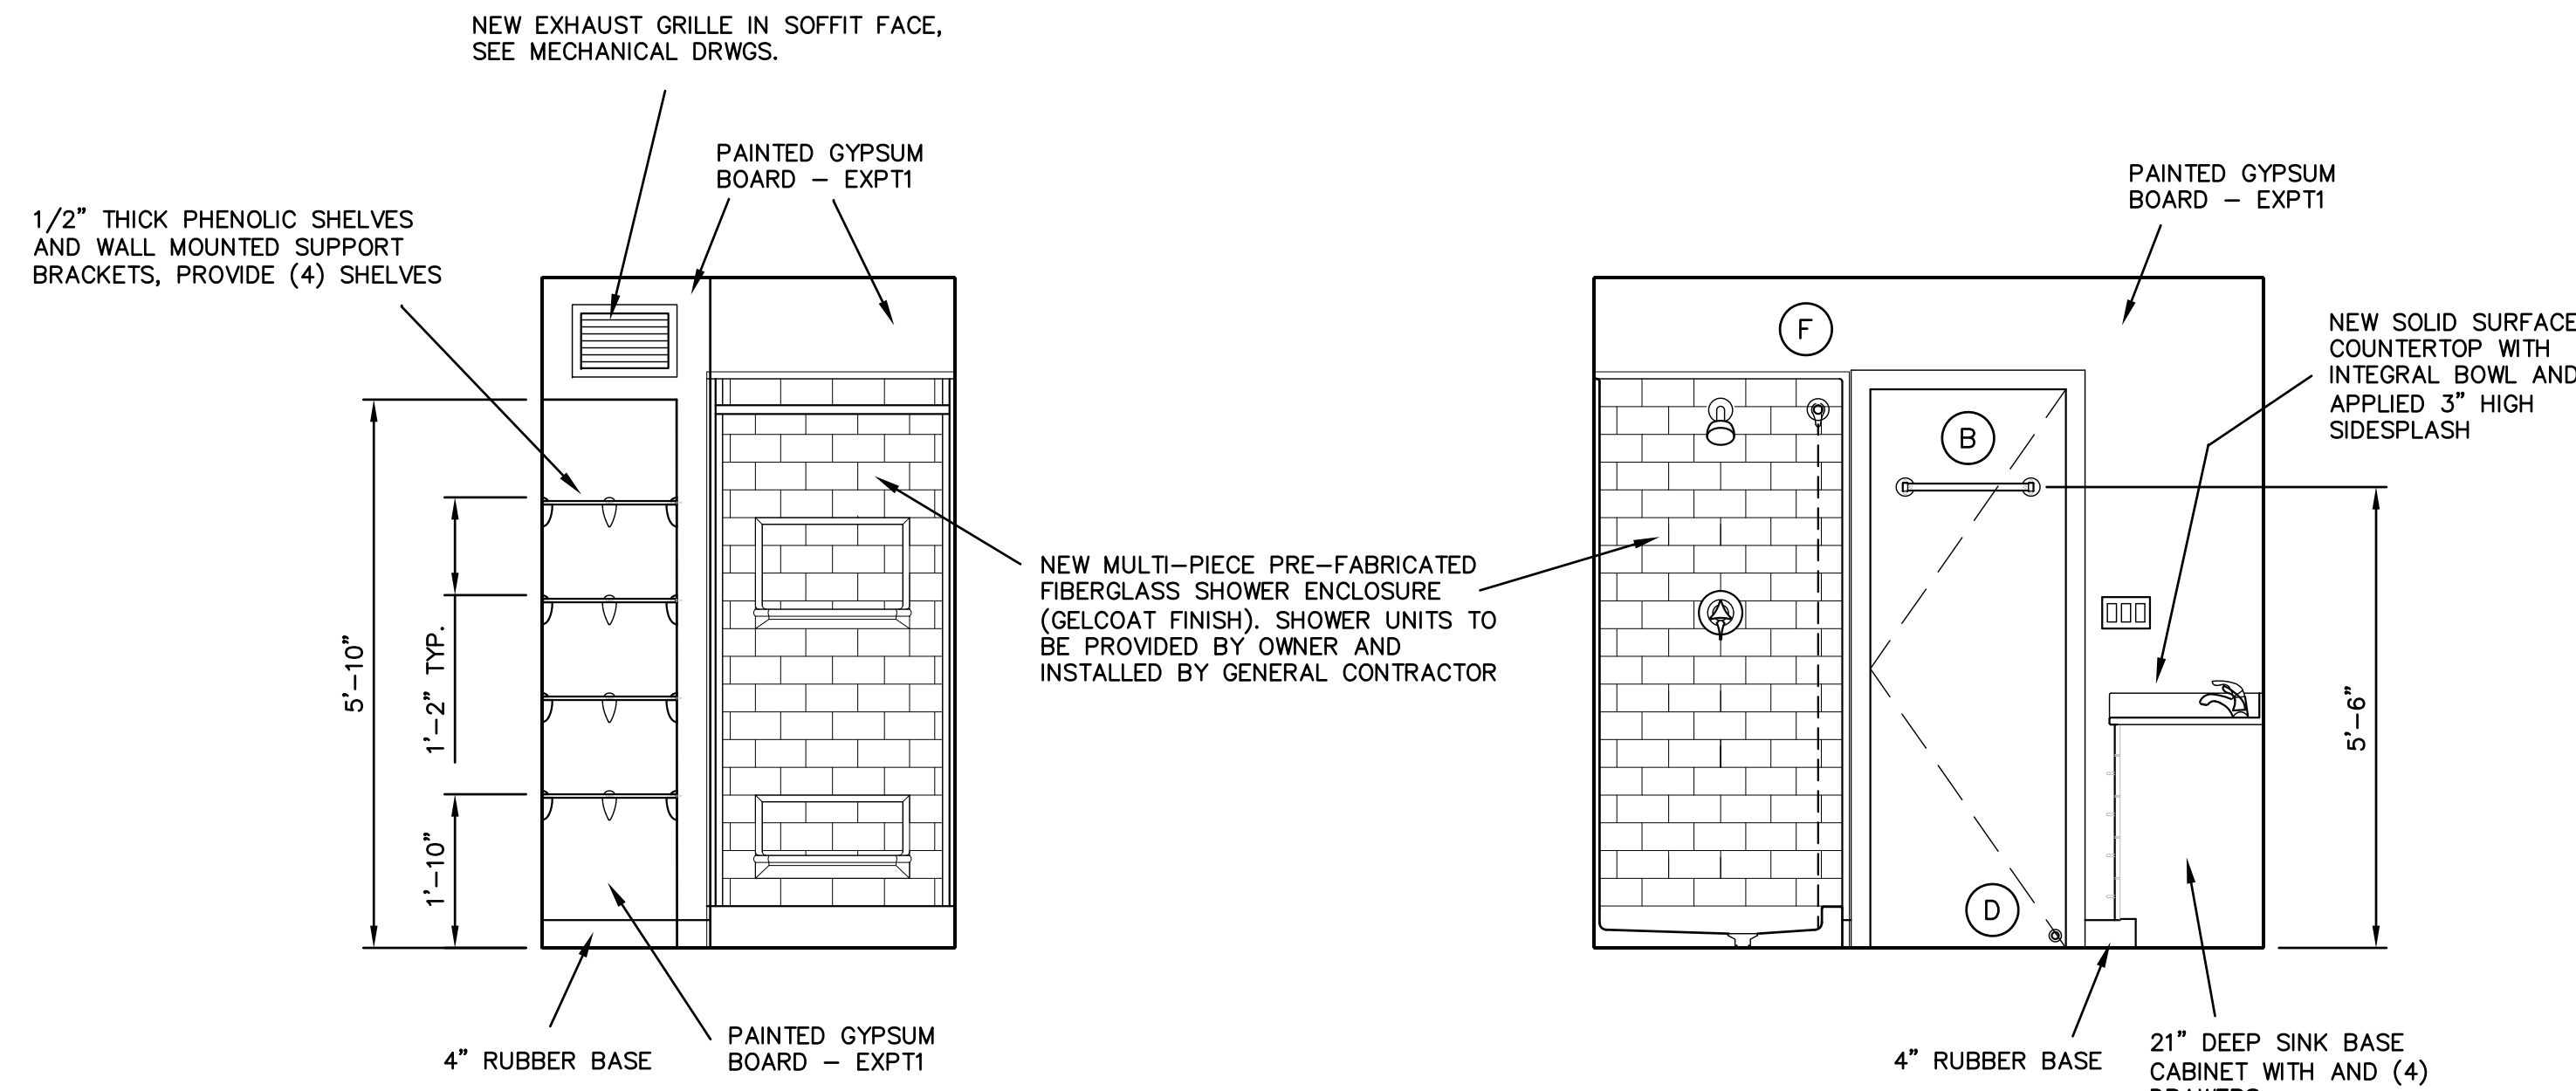


**1 ELEVATION 1 BATHROOM**  
A5 SCALE: 1/2" = 1'-0"

**2 ELEVATION 2 BATHROOM**  
A5 SCALE: 1/2" = 1'-0"

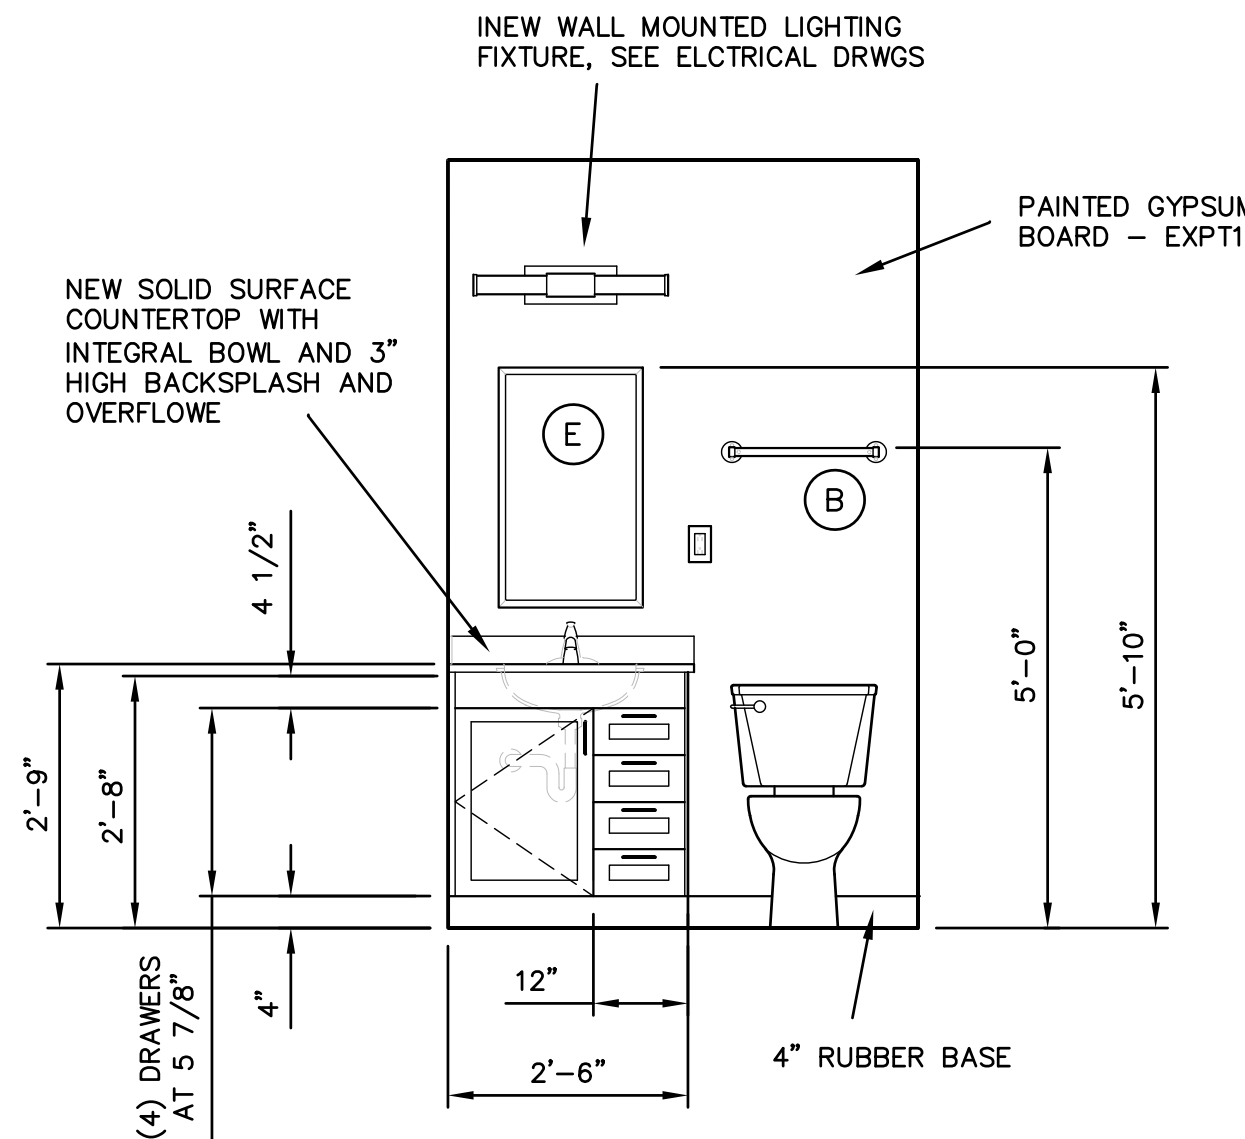

**3 ELEVATION 3 BATHROOM**  
A5 SCALE: 1/2" = 1'-0"

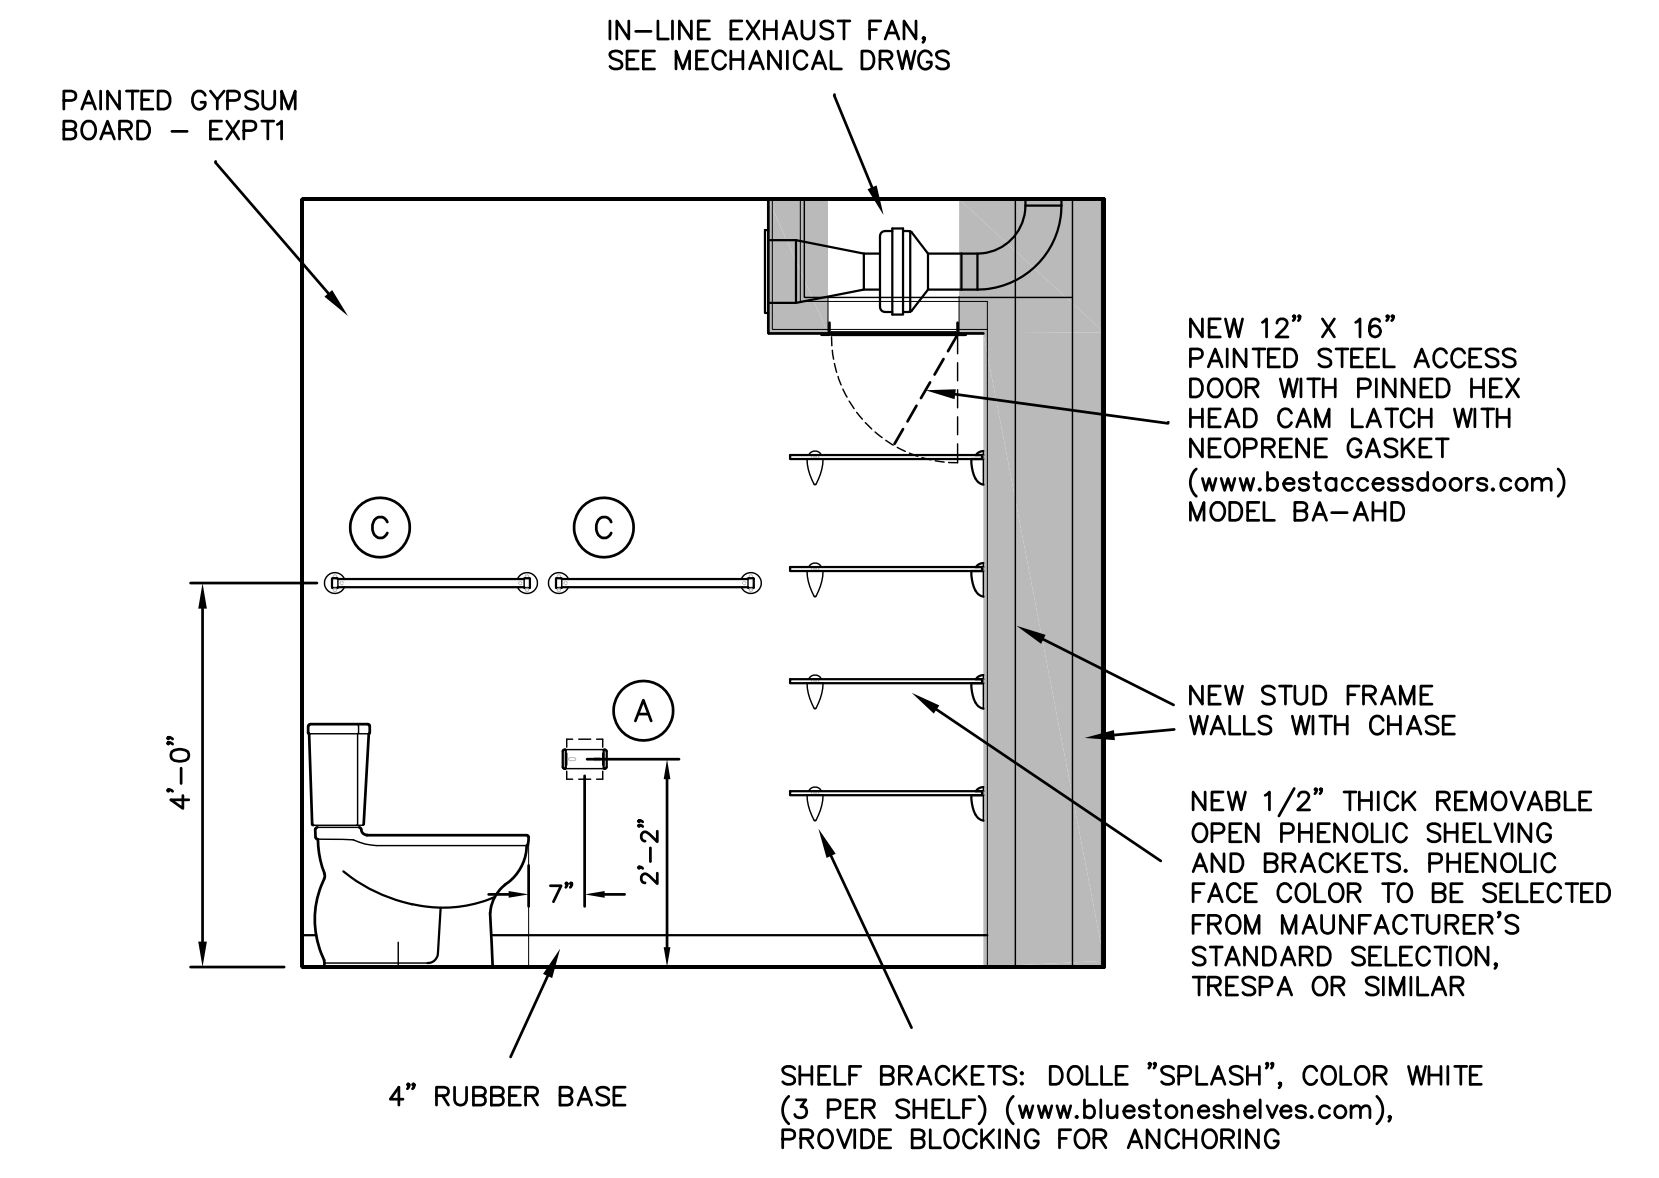

**4 ELEVATION 4 BATHROOM**  
A5 SCALE: 1/2" = 1'-0"

**KITCHEN AND LAVATORY CASEWORK CONSTRUCTION:**

ALL CONSTRUCTION TO MEET HUD SEVERE USE STANDARDS

(NOTE: USE OF PARTICLE BOARD, FLAKE BOARD, OR HARDBOARD IN THE CONSTRUCTION OF CABINETS AND COUNTERTOPS SHALL NOT BE ACCEPTED)

CONSTRUCTION STYLE: HARDWOOD STILE AND RAIL DOORS AND DRAWER FRONTS FLUSH OVERLAY ON FACE FRAME AS FOLLOWS:

- 1) 3/4" THICK KILN DRIED HARDWOOD FACE FRAMES
- 2) 3/4" THICK HARDWOOD STILE AND RAIL DRAWER AND DOOR FRONTS WITH INSET VENEER (BOTH SIDES) 3/8" PLYWOOD PANEL
- 3) 3/4" THICK PLYWOOD CORE SIDE PANELS
- 4) 1/2" THICK PLYWOOD BOTTOM AND UNEXPOSED BACK PANELS
- 5) DRAWERS TO HAVE 3/8" THICK MINIMUM VENEER PLYWOOD BOTTOMS DADOED AND GLUED INTO ALL FOUR SIDES OF DRAWER BOX
- 6) EPOXY COATED STEEL DRAWER GUIDES, 100 LB. MIN. CAPACITY, TWO SIDE-MOUNTED SLIDES PER DRAWER
- 7) WALL CABINET HANGING RAILS SHALL RUN CONTINUOUSLY ALONG TOP AND BOTTOM OF CABINET AND BE A MINIMUM OF 3/4" X 3" NOMINAL SOLID WOOD

**WALL AND BASE CABINETS:**


- 1) 3/4" THICK FACE FRAMES WITH 1 1/2" WIDE STILES AND 1 3/4" WIDE RAILS AND 2" WIDE CENTRAL VERTICAL AT PAIR DOORS. MEMBERS GLUED AND DOWELED. FACE FACE MEMBERS TO DADOED TO RECEIVE SIDES BOTTOMS AND TOPS
- 2) 3" DEEP TOE KICK
- 3) BASE CABINETS INSTALLED ON CONCRETE SLABS TO BE SHIMMED WITH PHENOLIC OR OTHER HIGH DENSITY NON WATER ABSORBENT MATERIAL (NO UNTREATED WOOD MATERIALS SHOULD COME IN CONTACT WITH CONCRETE SLABS)
- 4) SHELVES TO BE 1/2" HARDWOOD VENEER WITH PLYWOOD CORE WITH EDGE BANDING AT (4) SIDES
- 5) CONCEALED HINGES TO BE HIGH QUALITY SELF CLOSING AS MANUFACTURED BY BLUM OR EQUAL
- 6) ALL SURFACES OF WALL CABINET BOTTOM CONSTRUCTION TO BE FINISHED WITH PAINTED ALKYD FACTORY FINISH
- 7) PAINTED FINISHED FILLERS SHALL BE SCRIBED TO FIT EXISTING CONDITIONS. PROVIDE BOTTOM FILLERS AT WALL CABINETS
- 8) DOOR AND DRAWER PULLS TO BE 4" CHROME PLATED WIRE PULLS
- 9) EXPOSED PAINT COLOR TO BE SELECTED FROM MANUFACTURER'S STANDARD SELECTIONS
- 10) ALL CABINETS SURFACES TO RECEIVE OPAQUE ALKYD PAINT FINISH
- 11) VERIFY THAT SUFFICIENT EXISTING WALL BLOCKING EXISTS FOR MOUNTING AND PROVIDE ADDITIONAL BLOCKING AS NECESSARY
- 12) PROVIDE CUT-OUTS AT CABINET BACKS FOR ACCESS TO PLUMBING PIPING AND ELECTRICAL DEVICE(S) MOUNTED IN BASE CABINETS
- 13) PROVIDE FINISHED BACK PANELS WHERE CABINETS ARE INSTALLED TOWARDS LIVING ROOM

**KITCHEN COUNTERTOPS:**


- 1) COUNTERTOPS AND BACK AND SIDESPLASHES TO BE POLYMER SOLID SURFACING WITH 1 1/2" HIGH SQUARE (EASED) NOSING (1 1/2" PROJECTION BEYOND FACE FRAME OF BASE CABINET)
- 2) SOLID SURFACING TO BE SELECTED FROM MANUFACTURER'S STANDARD SELECTIONS
- 3) COORDINATE COUNTERTOP PREPARATION FOR UNDERMOUNT STAINLESS STEEL SINK AND CORING FOR FAUCET
- 4) WHERE COUNTERTOP EXTENDS OVER HALF-WALL AT LIVING ROOM PROVIDE 2" NOSING EXTENSION BEYOND WALL FACE AND INSTALL 1/2" THICK X 2 1/2" HIGH SOLID POLYMER APRON BELOW NOSING. PROVIDE 2" HORNS AT EACH END OF NOSING EXTENSION SCRIBED TO WALL. SEE DETAIL ABOVE

**LAVATORY COUNTERTOPS:**


- 1) COUNTERTOP AND BACKSPLASH TO BE POLYMER SOLID SURFACING WITH 1" HIGH SQUARE (EASED) NOSING WITH AN INTEGRAL SINK BOWL (WITH OVERFLOW) AND 4" CENTERSET CORING FOR FAUCET
- 2) SOLID SURFACING TO BE SELECTED FROM MANUFACTURER'S STANDARD SELECTIONS
- 3) PROVIDE MATCHING SIDESPLASH ACCESSORY
- 4) SIZE: 31" WIDE X 22" DEEP

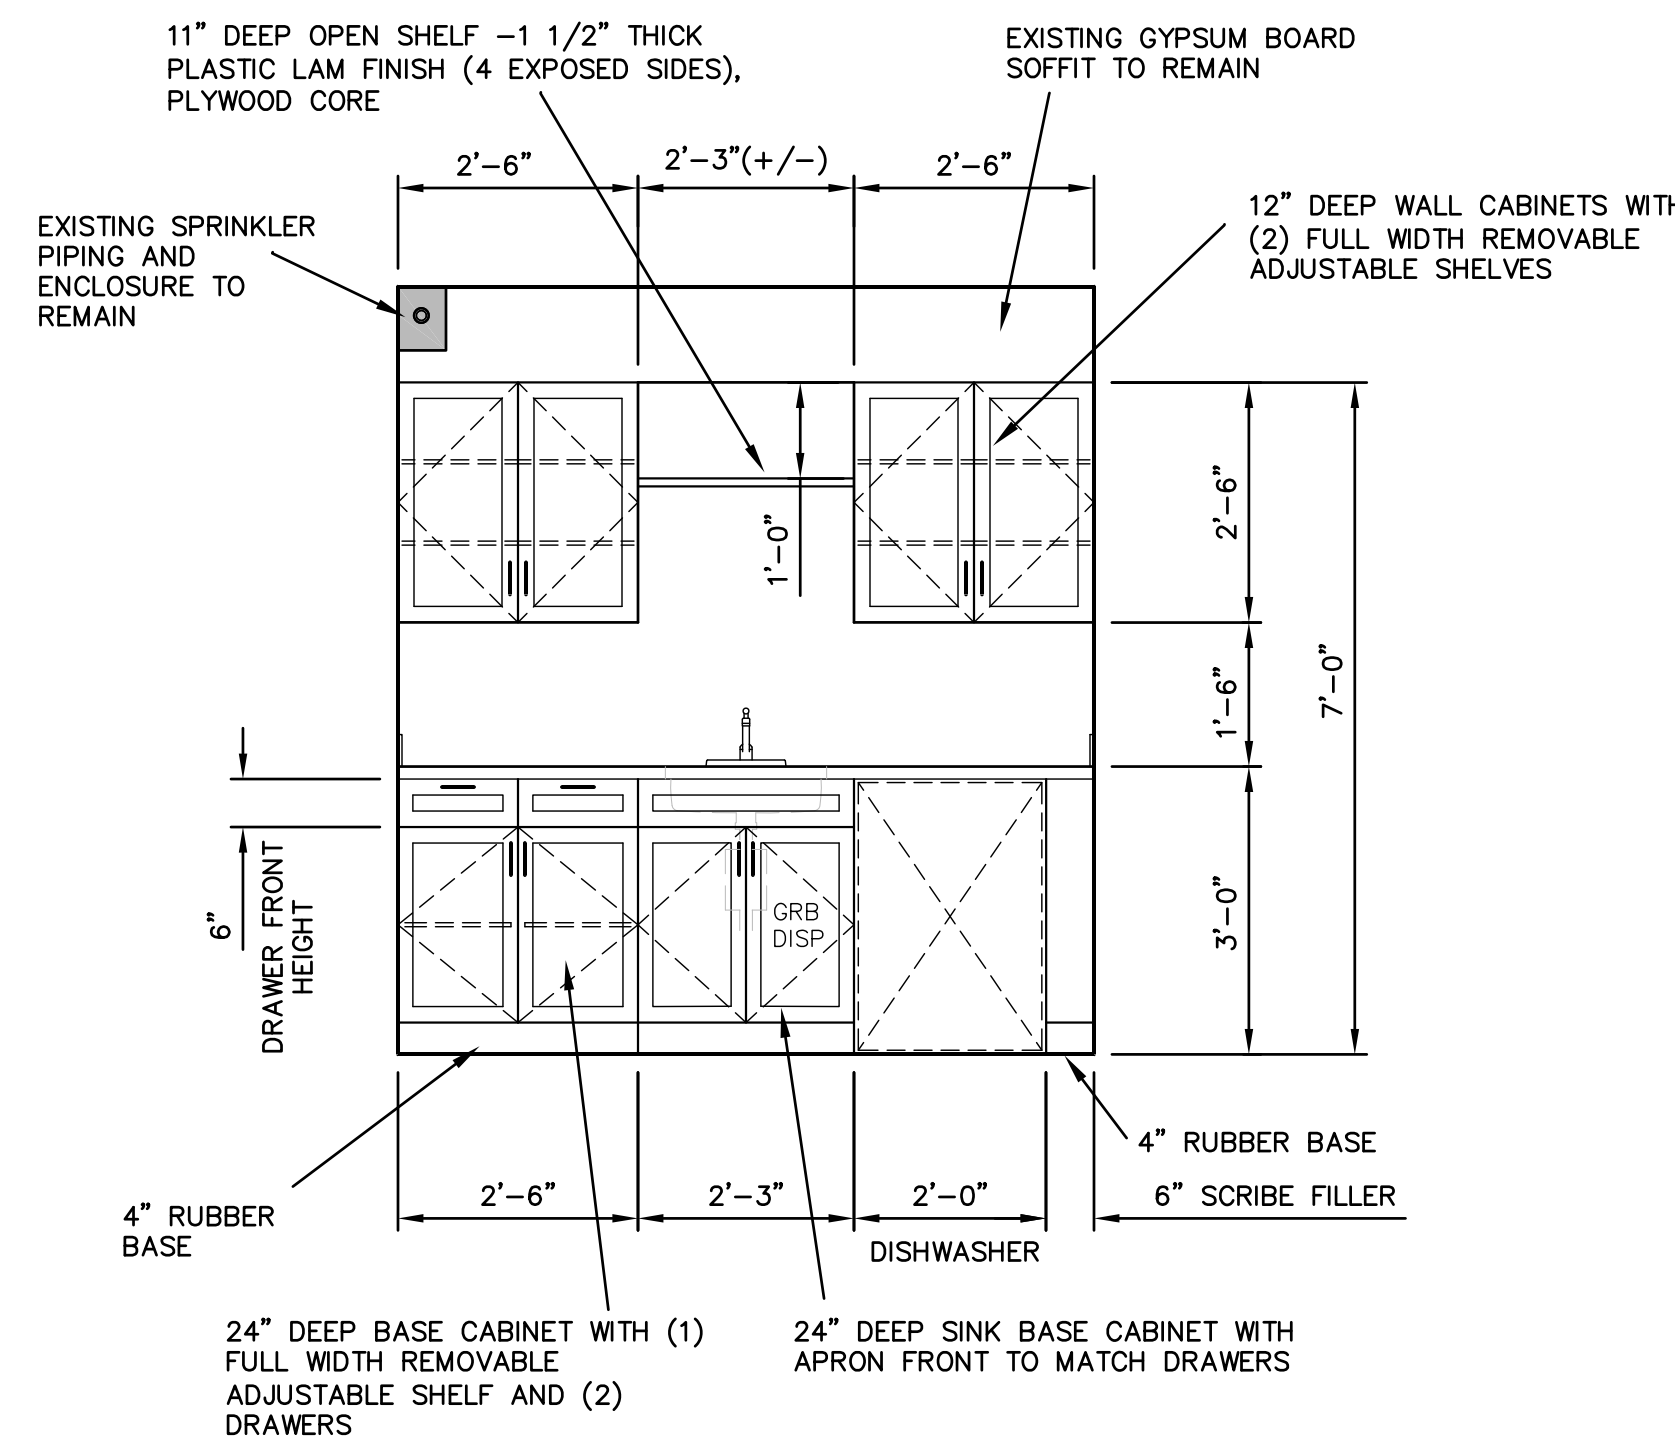








**5 ELEVATION 5 KITCHEN CASEWORK**  
A5 SCALE: 1/2" = 1'-0"

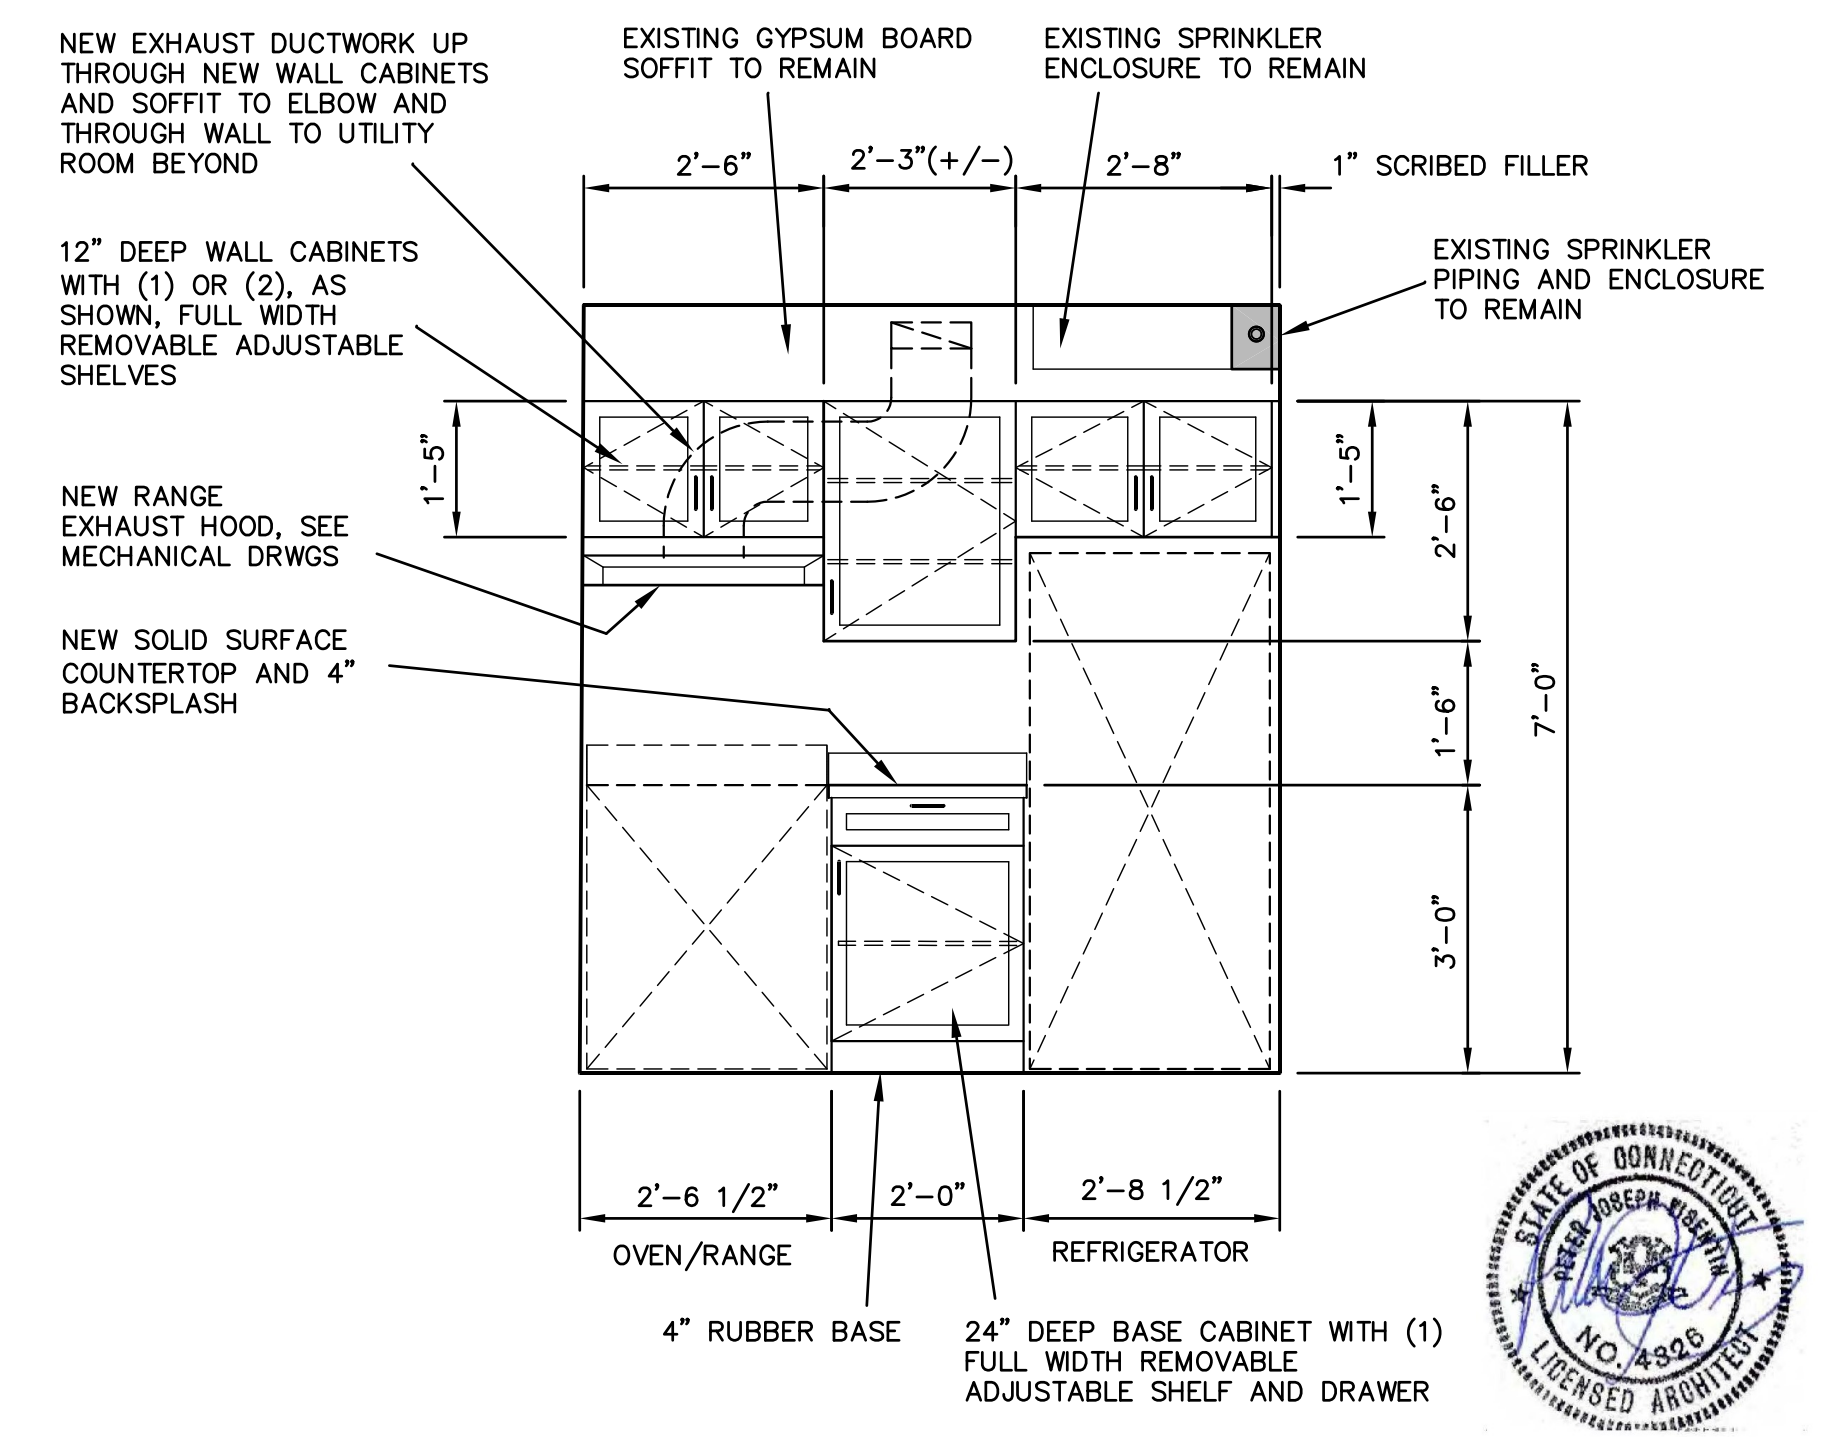

**6 ELEVATION 6 KITCHEN CASEWORK**  
A5 SCALE: 1/2" = 1'-0"





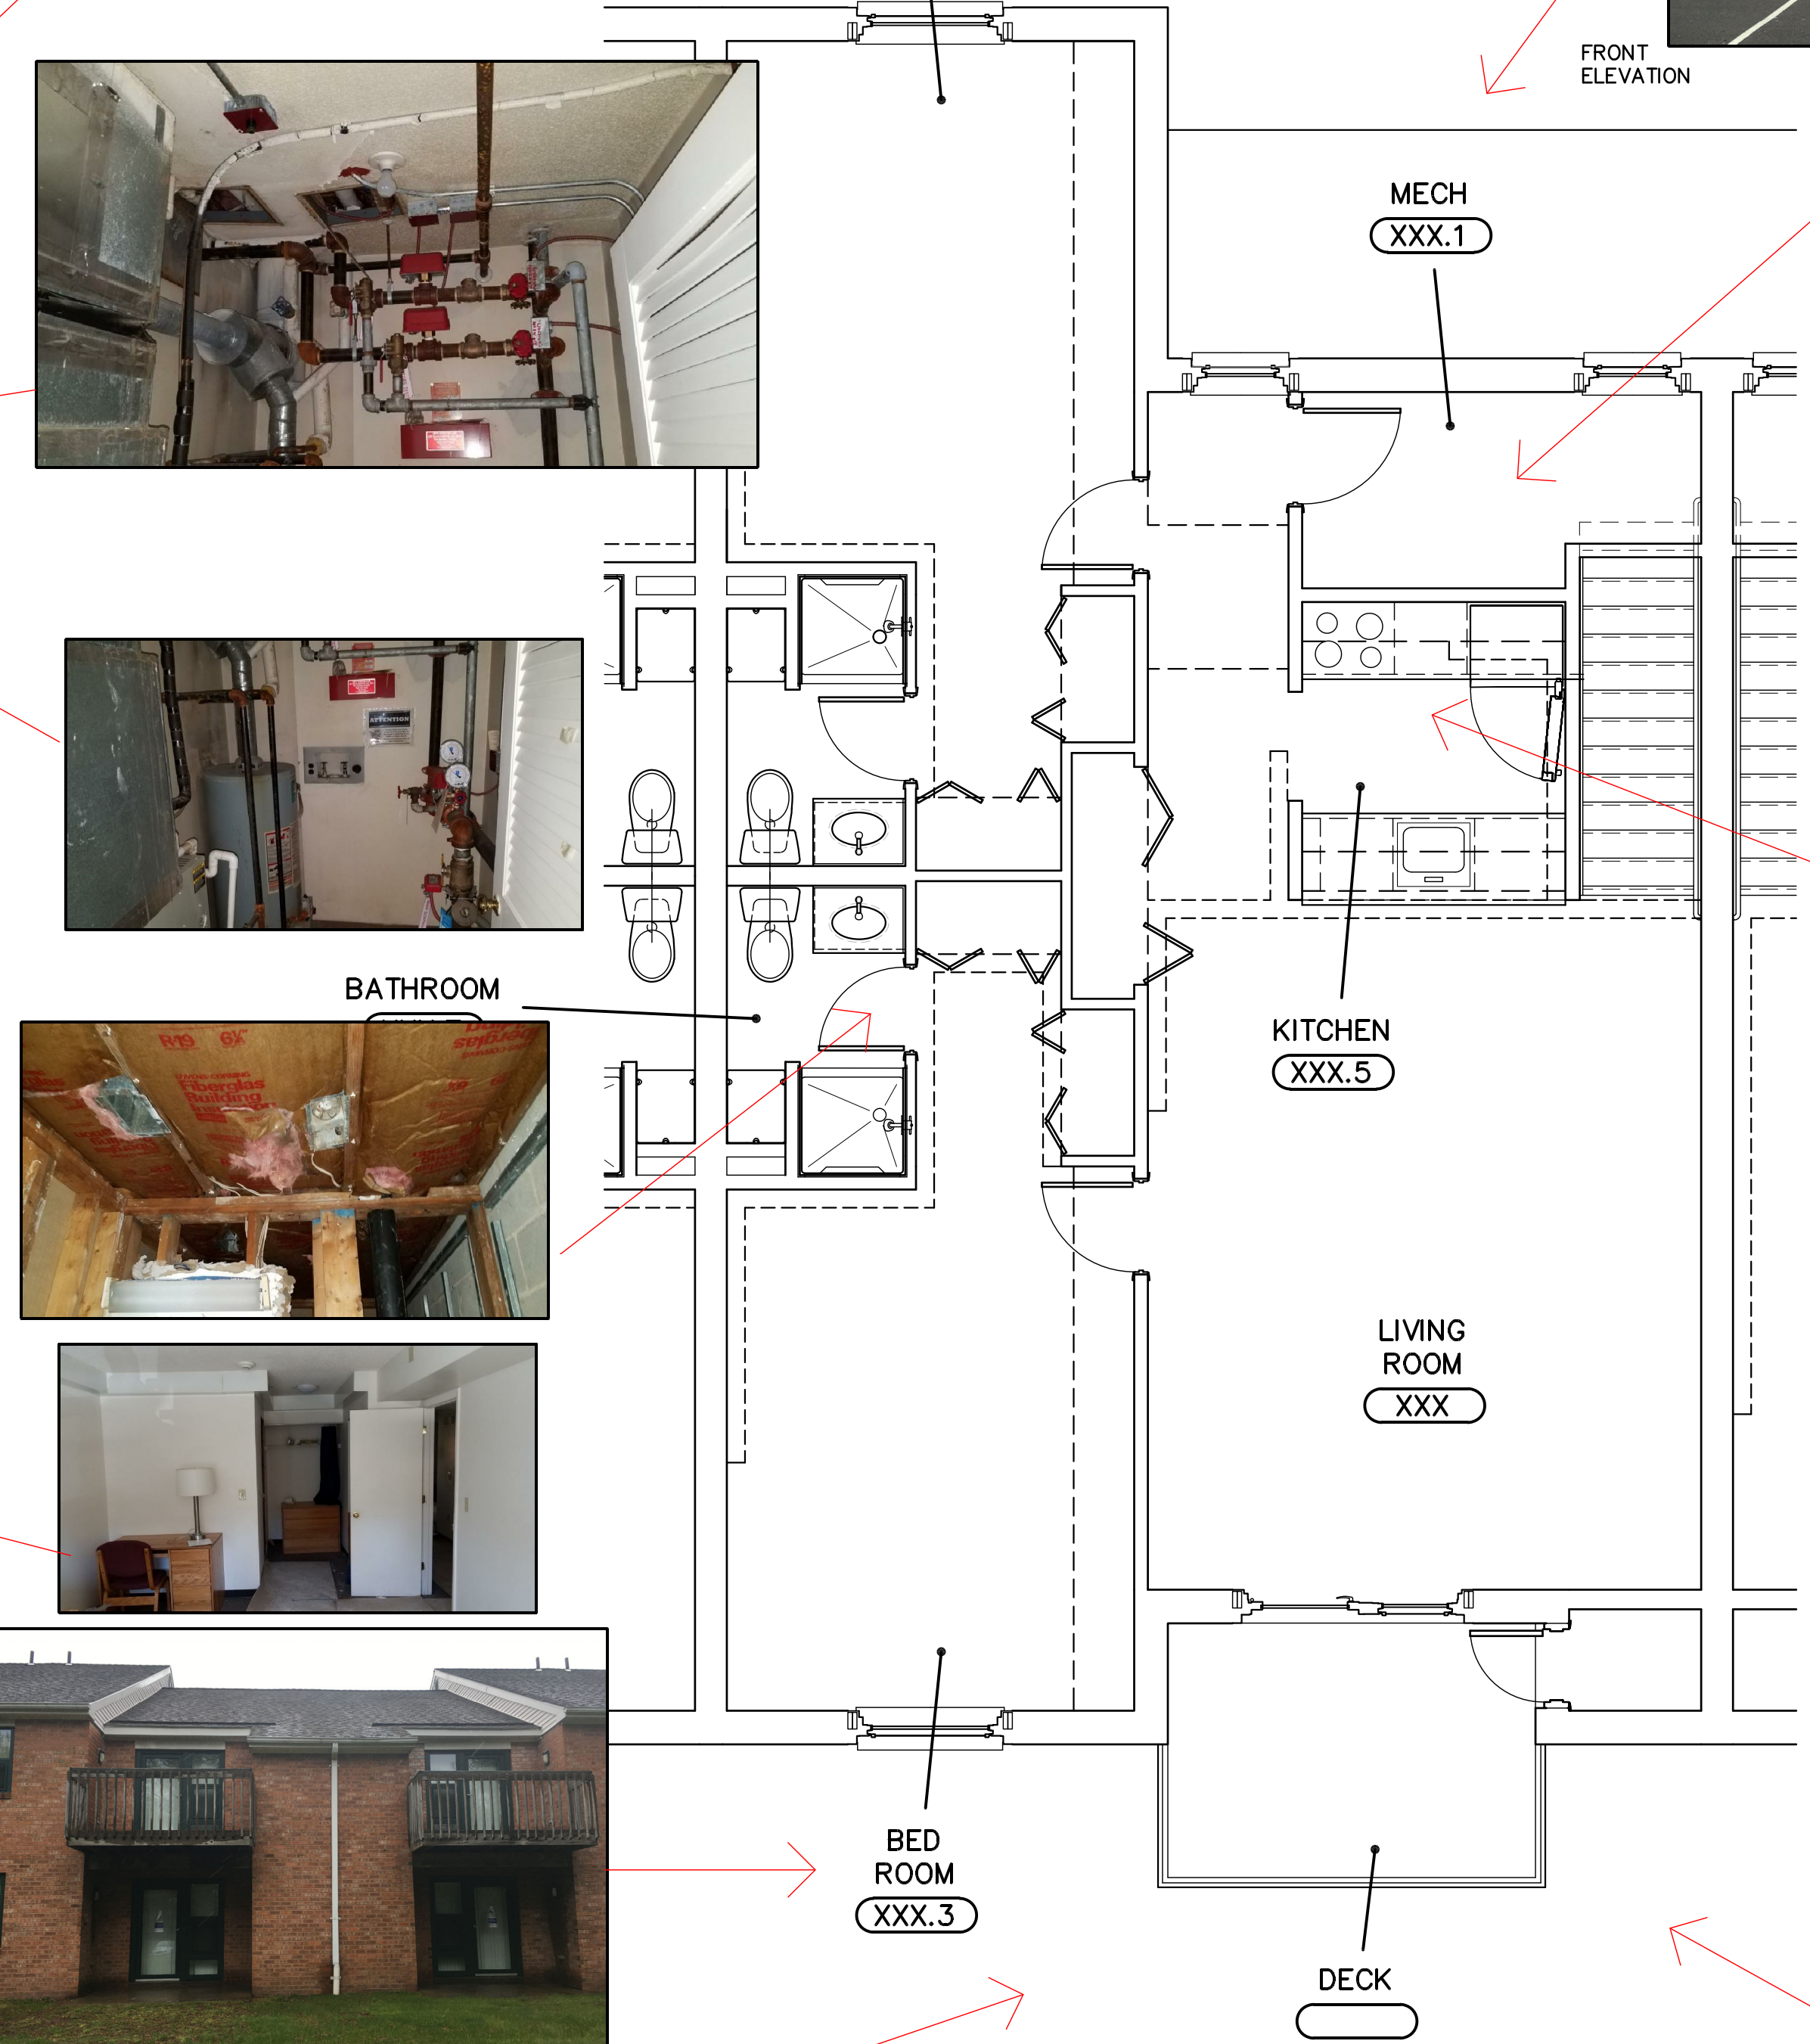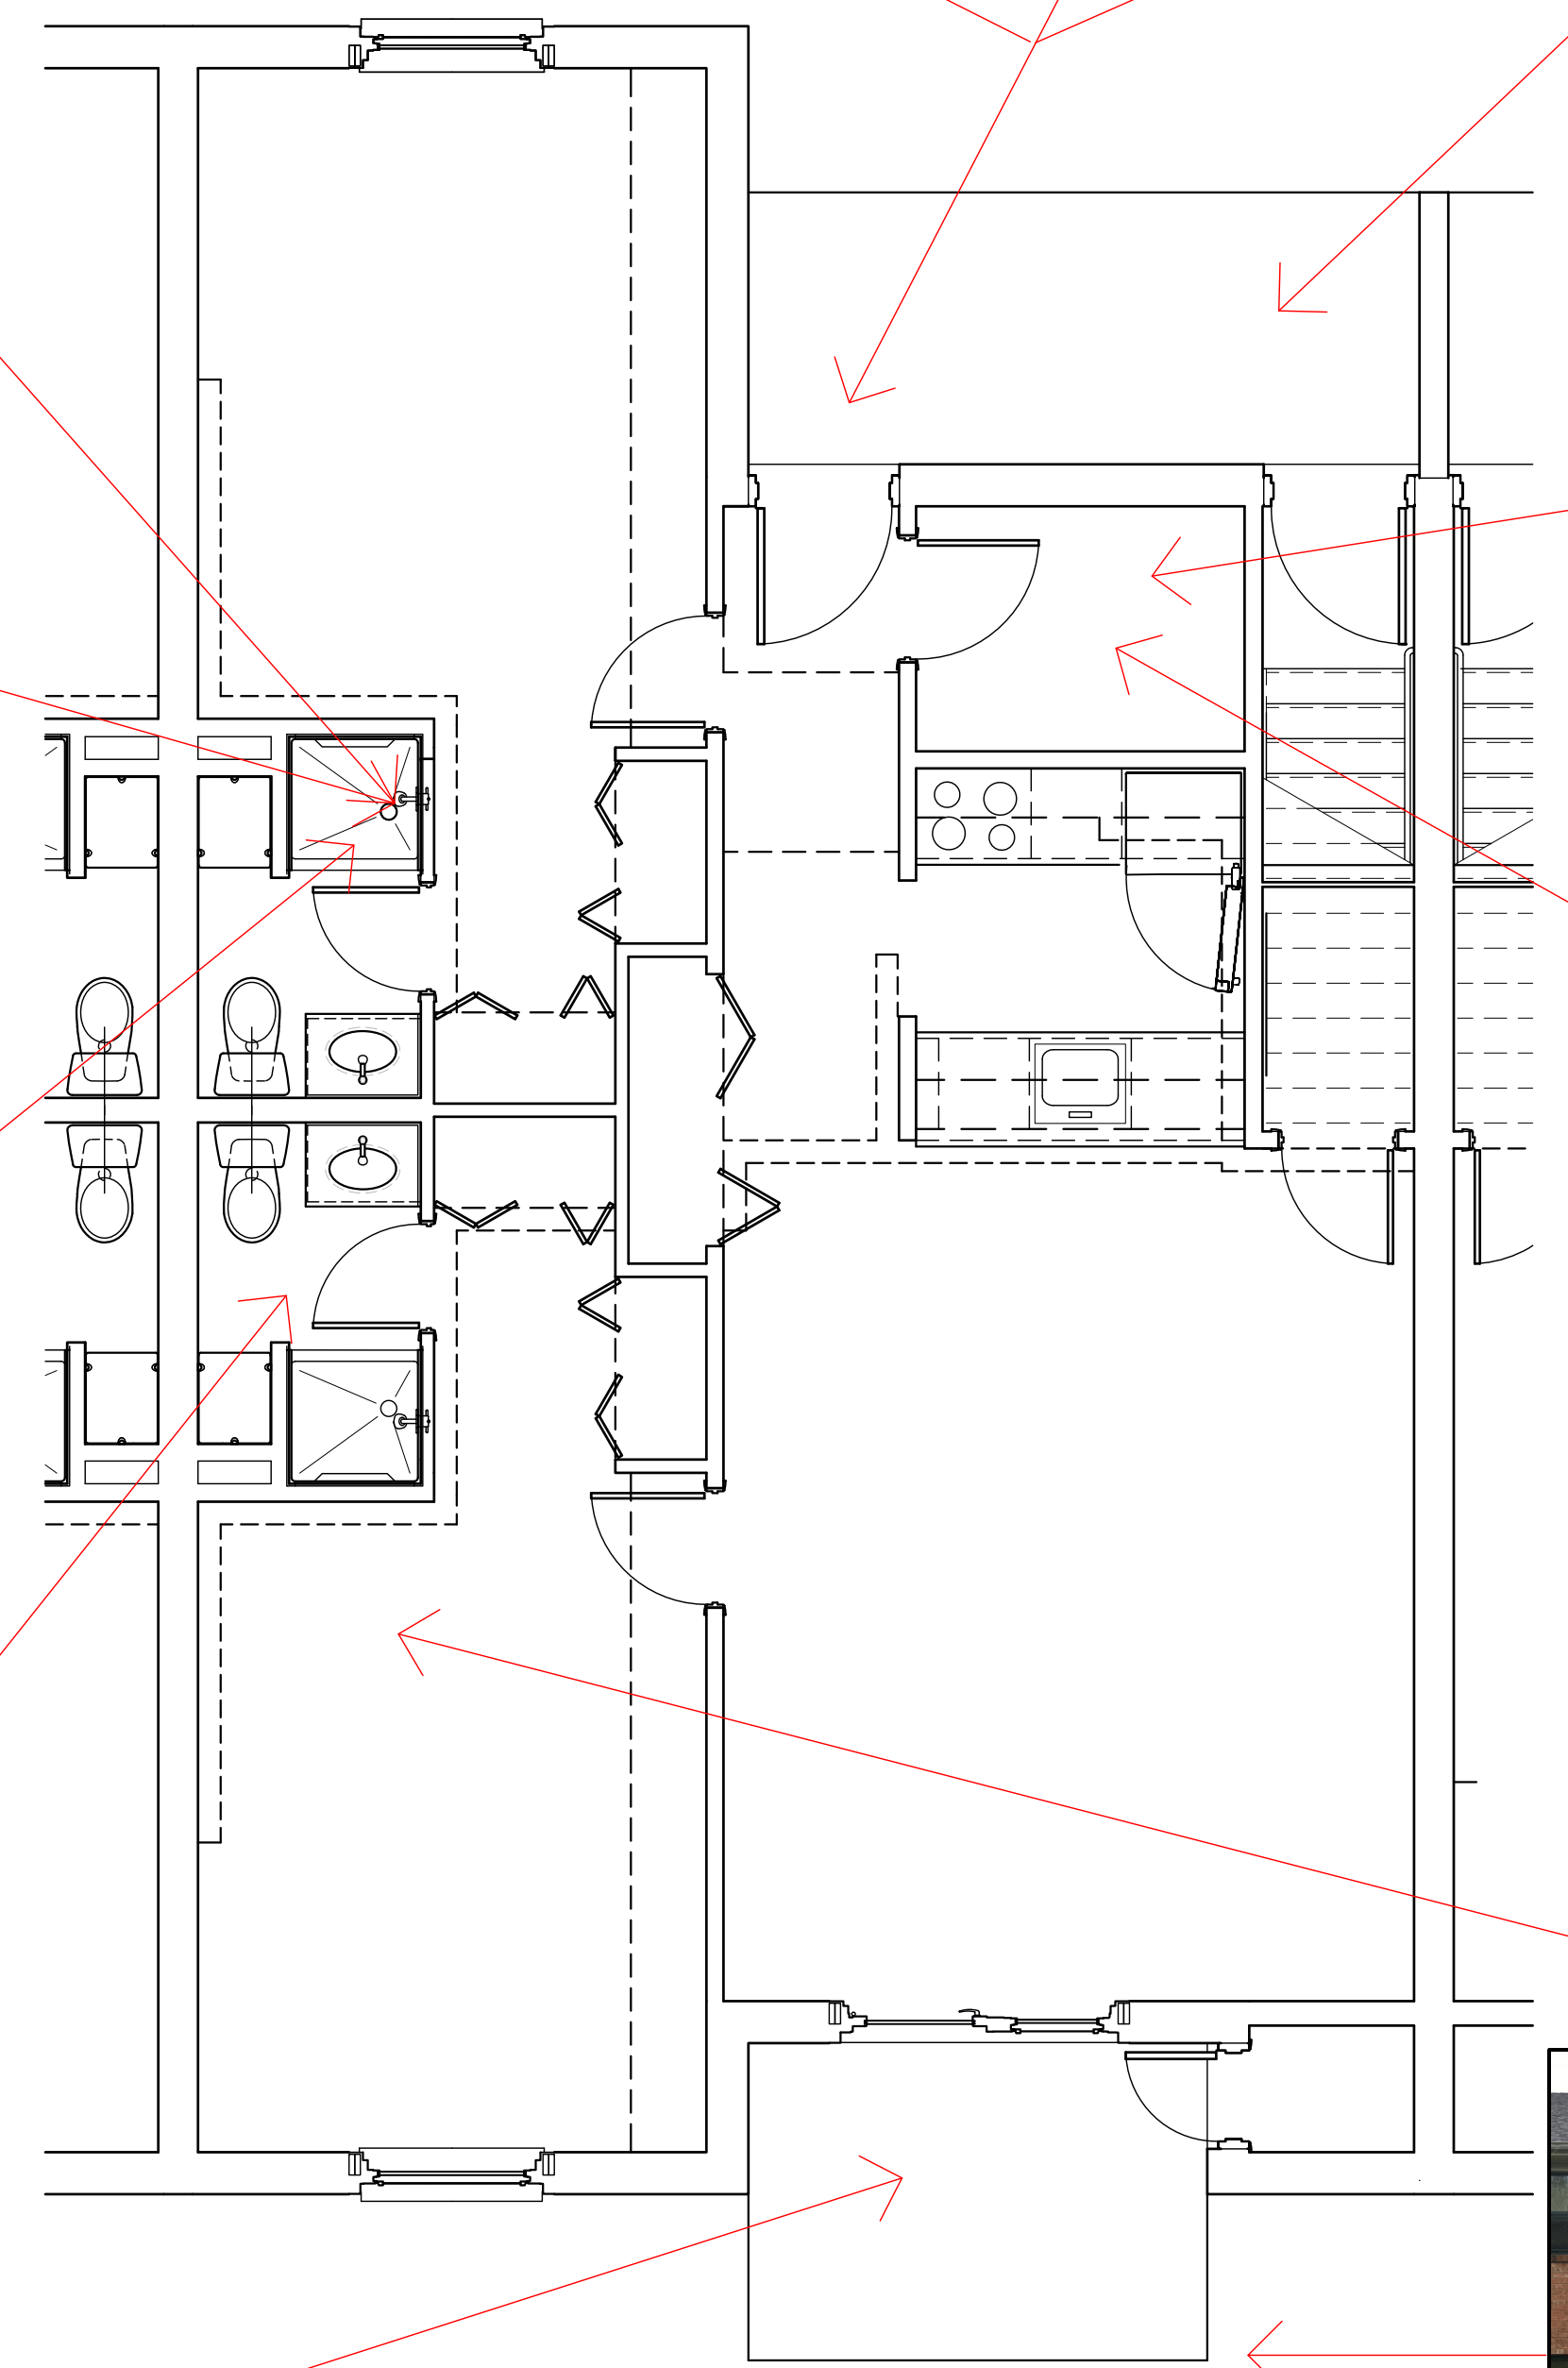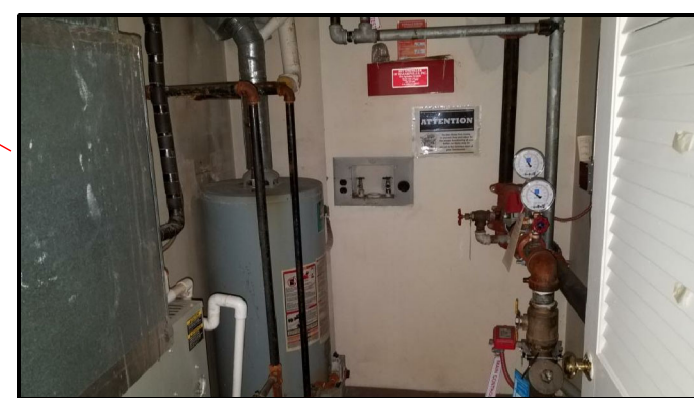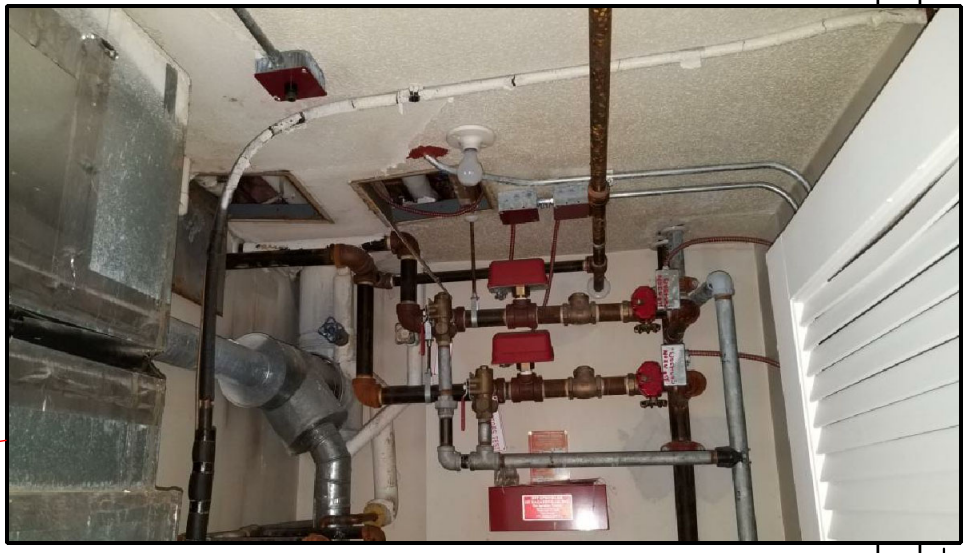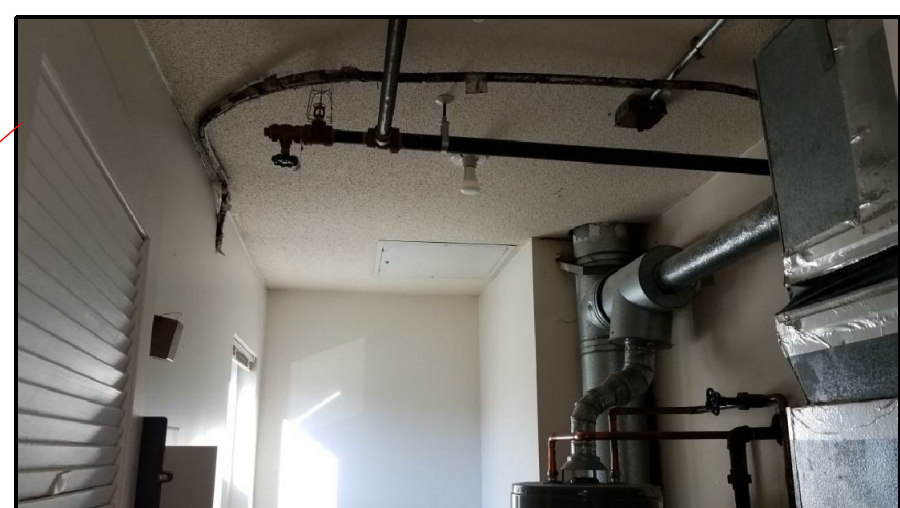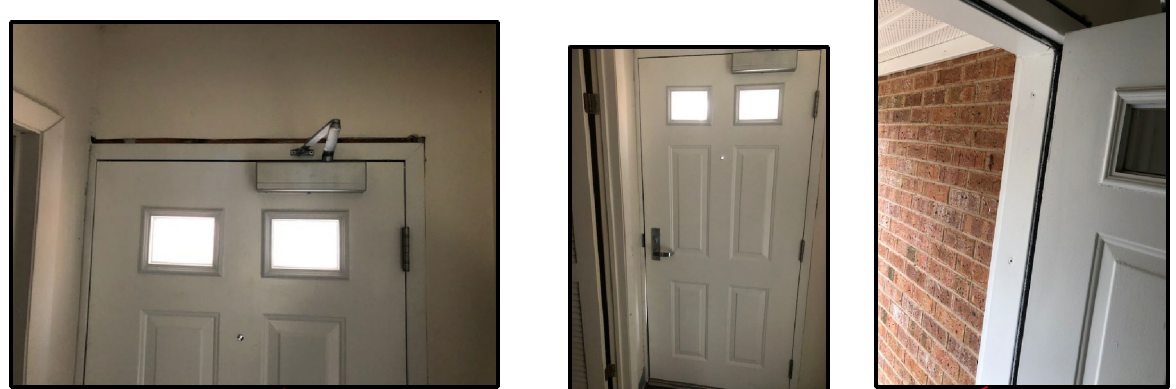
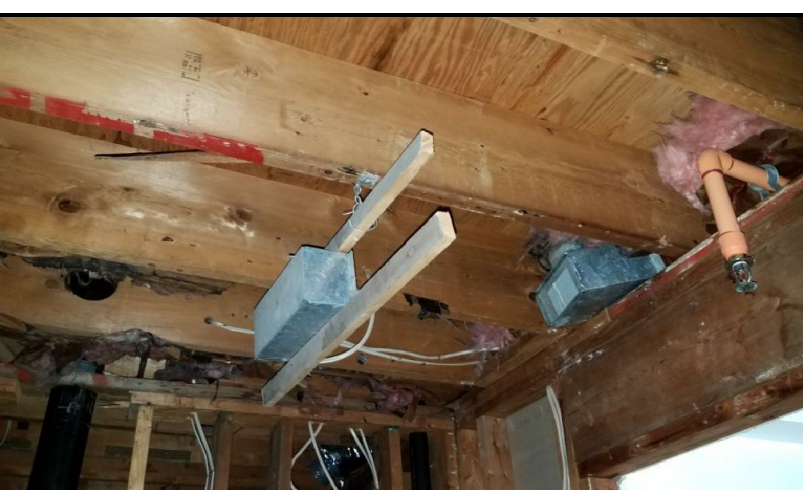


**1** PARTIAL FIRST FLOOR PLAN - TYPICAL UNIT  
**A6** SCALE: 1/4" = 1'-0" LAYOUT AS SHOWN OR OPPOSITE HAND, SEE BUILDING PLANS FOR LAYOUTS FOR SPECIFIC UNIT NUMBERS


**2** PARTIAL SECOND FLOOR PLAN - TYPICAL UNIT  
**A6** SCALE: 1/4" = 1'-0" LAYOUT AS SHOWN OR OPPOSITE HAND, SEE BUILDING PLANS FOR LAYOUTS FOR SPECIFIC UNIT NUMBERS





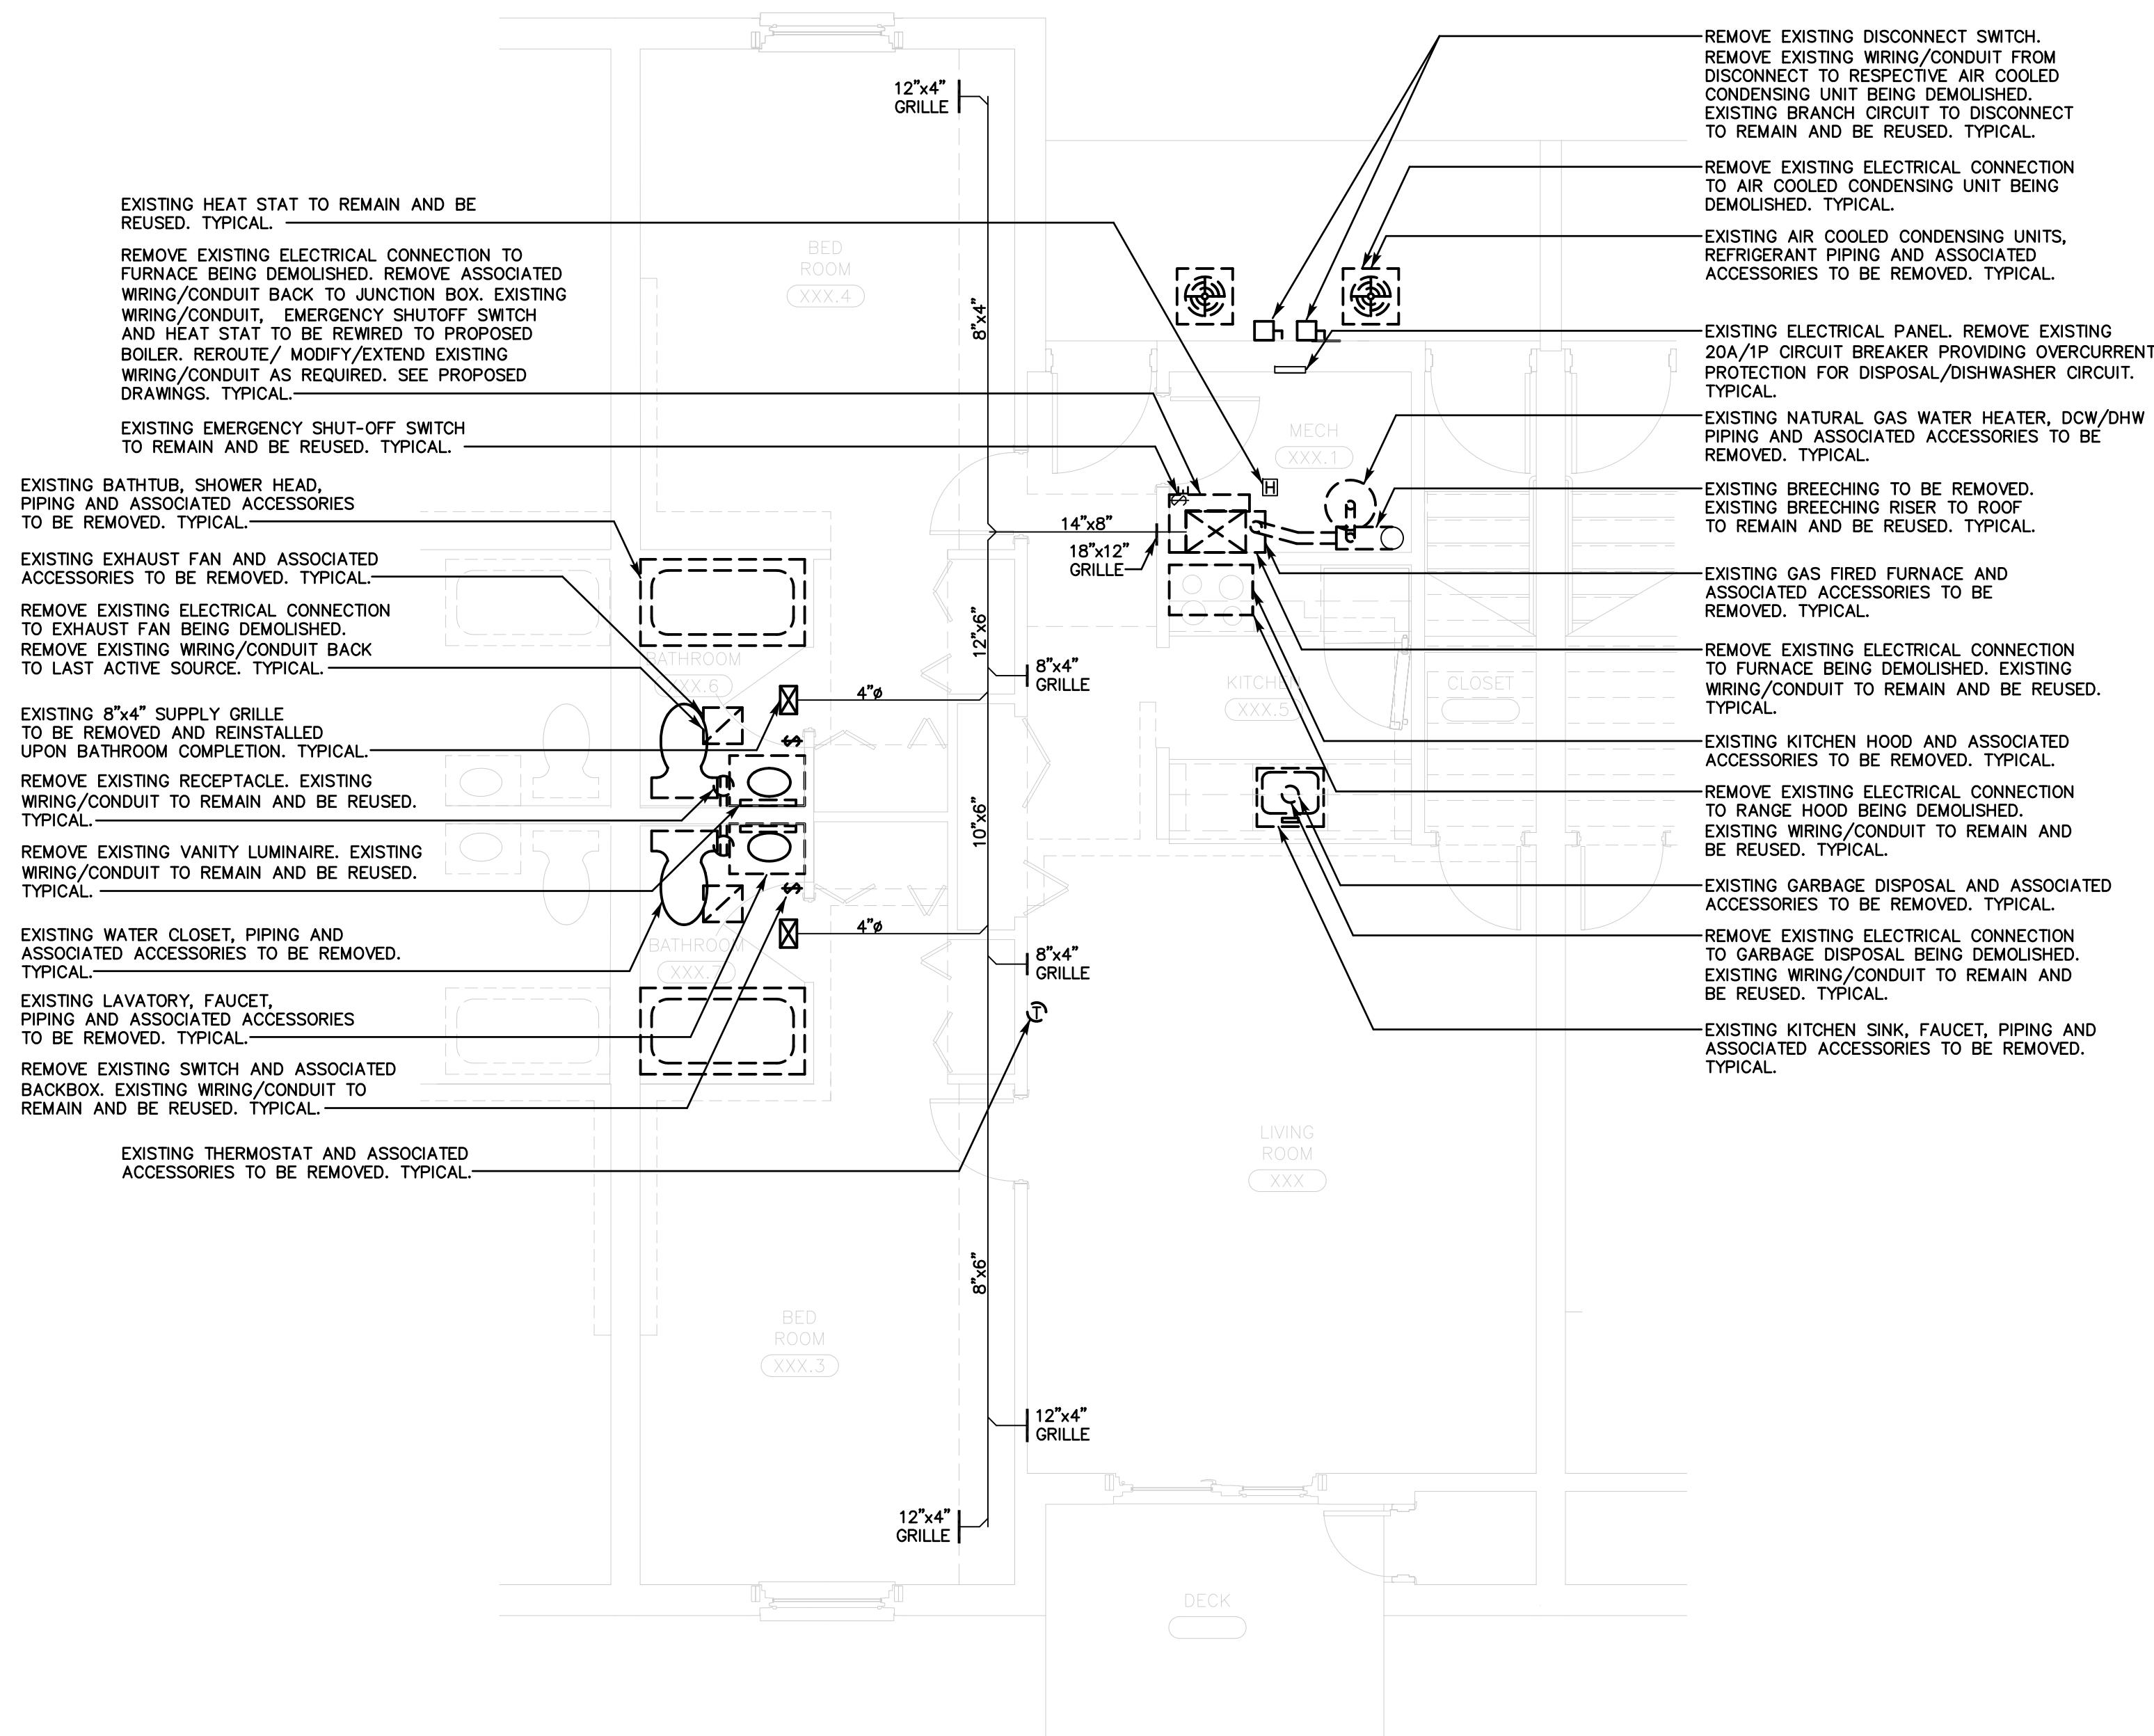



**1** PARTIAL FIRST FLOOR PLUMBING/MECHANICAL/ELECTRICAL DEMOLITION PLAN - TYPICAL UNIT  
 SCALE: 1/4" = 1'-0" LAYOUT AS SHOWN OR OPPOSITE HAND, SEE BUILDING PLANS FOR LAYOUTS FOR SPECIFIC UNIT NUMBERS

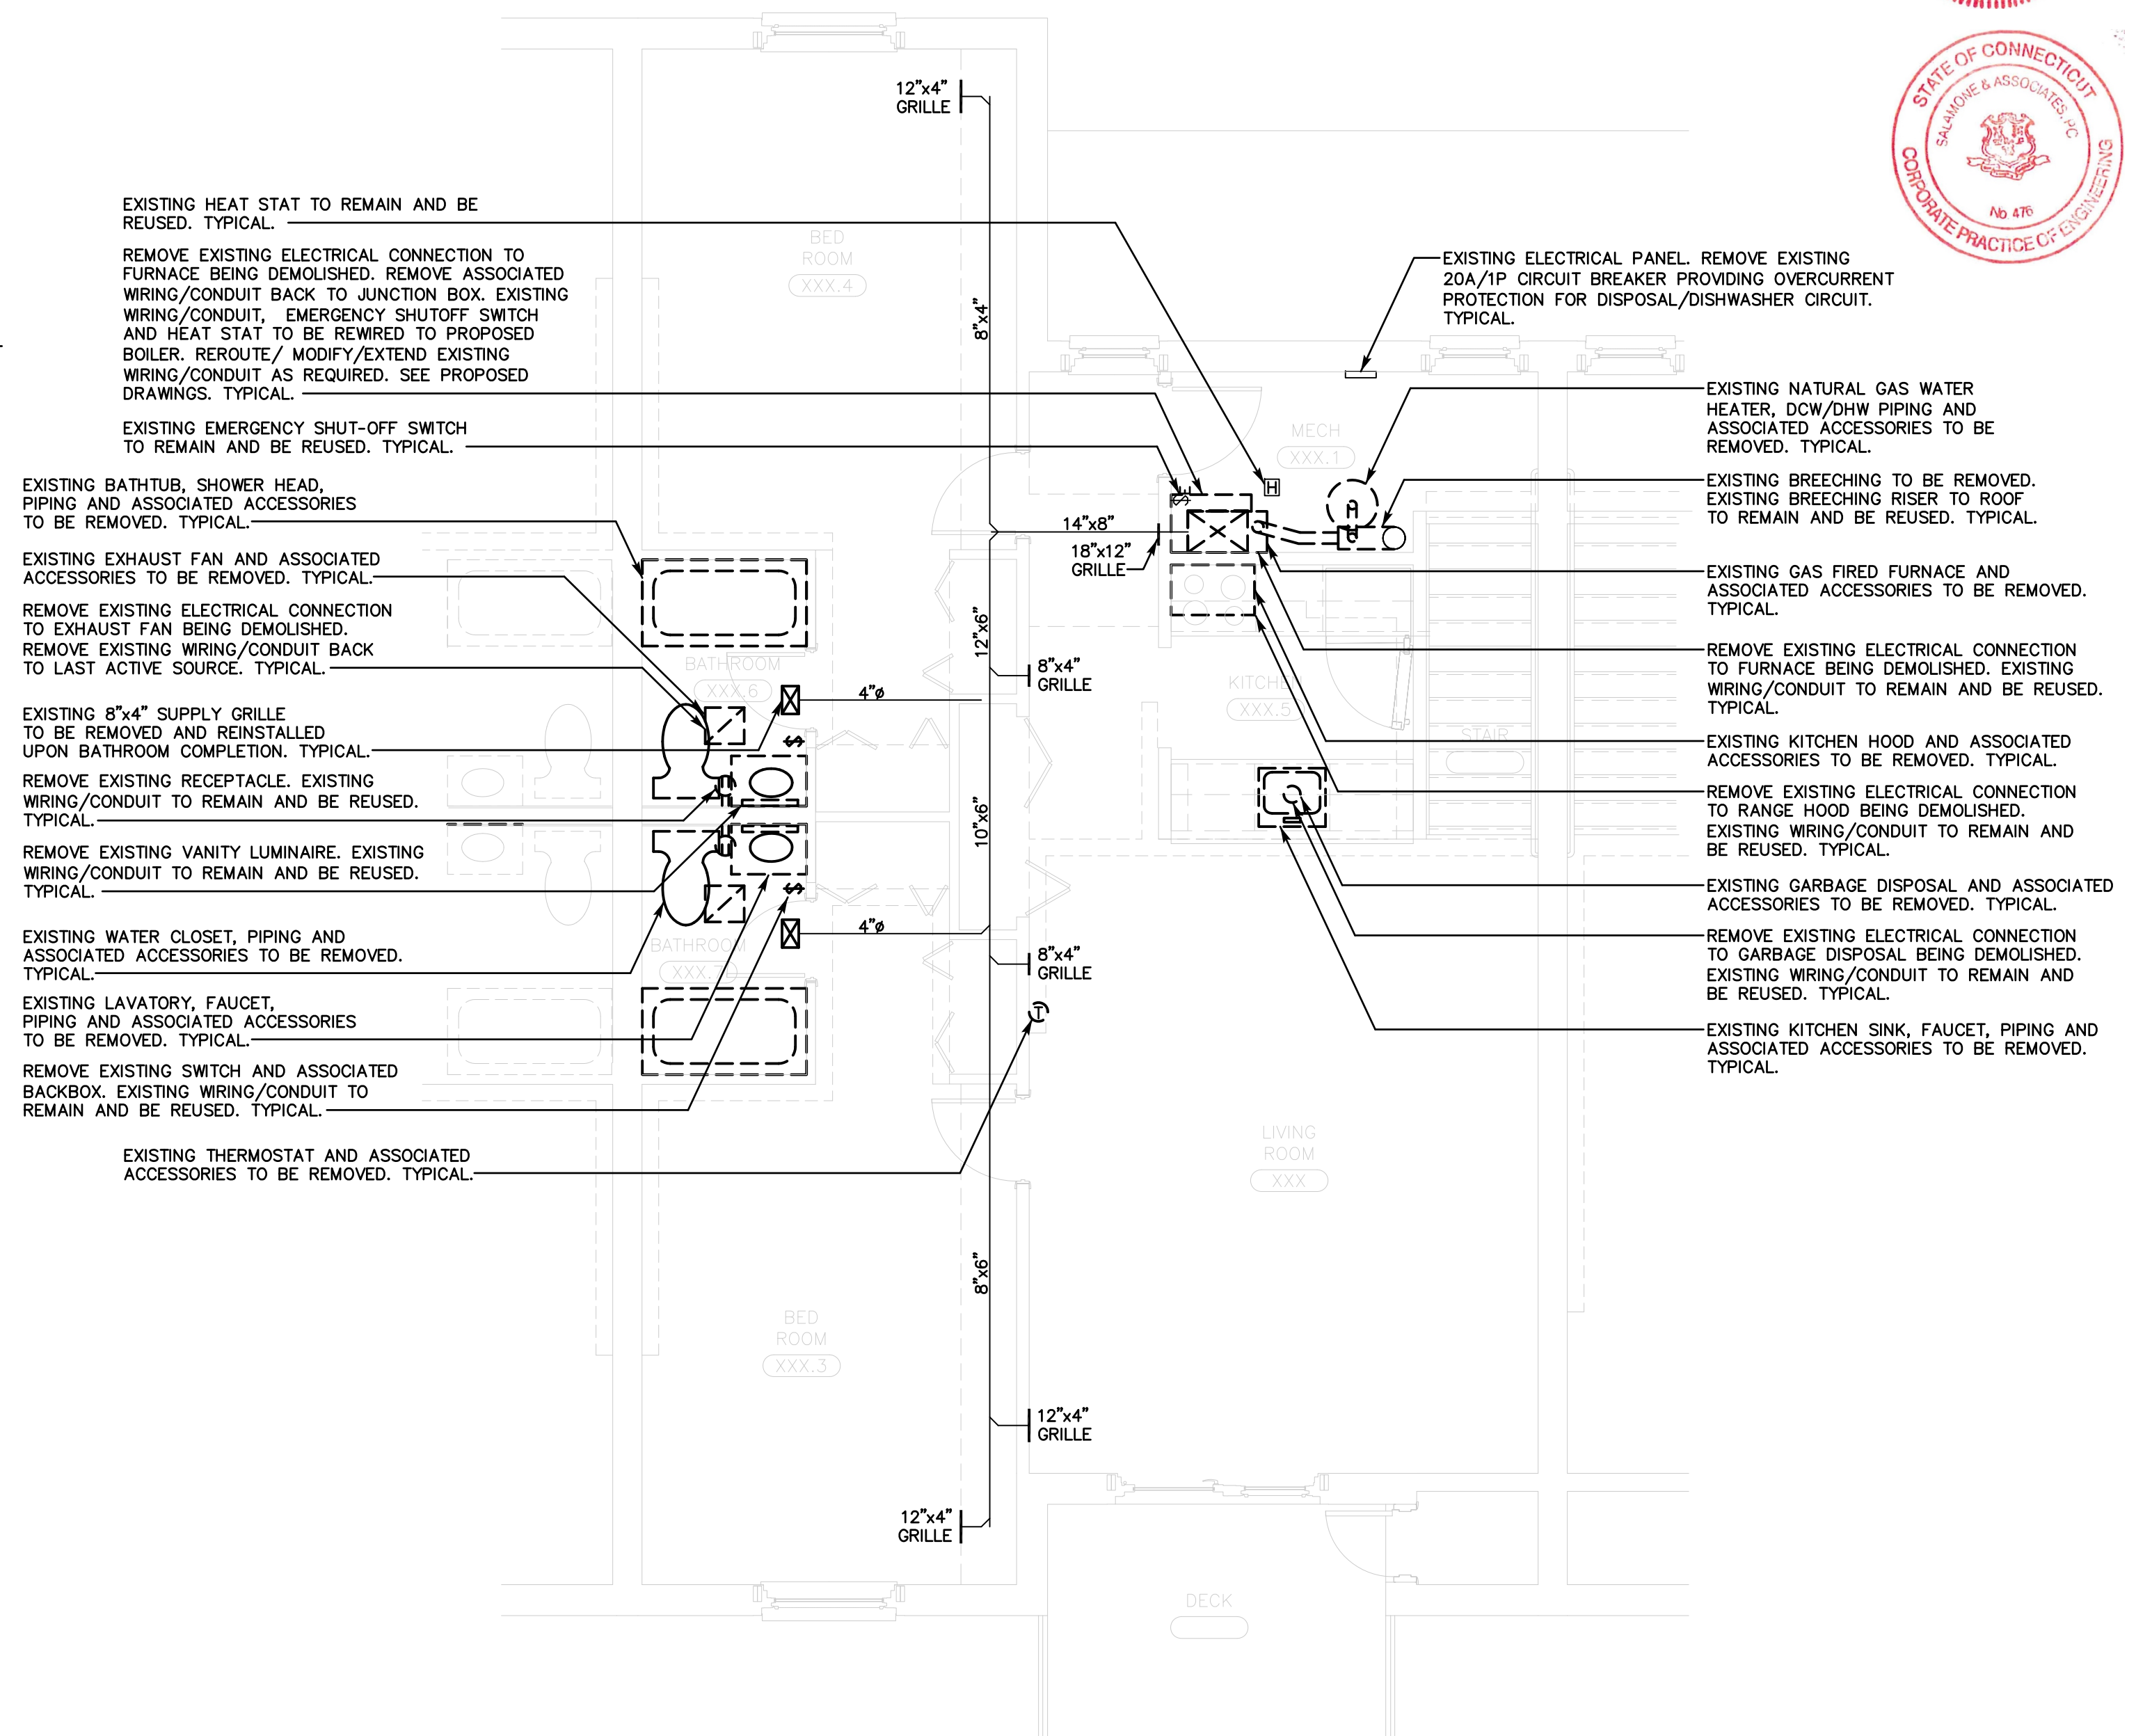


**2** PARTIAL SECOND FLOOR PLUMBING/MECHANICAL/ELECTRICAL DEMOLITION PLAN - TYPICAL UNIT  
 SCALE: 1/4" = 1'-0" LAYOUT AS SHOWN OR OPPOSITE HAND, SEE BUILDING PLANS FOR LAYOUTS FOR SPECIFIC UNIT NUMBERS



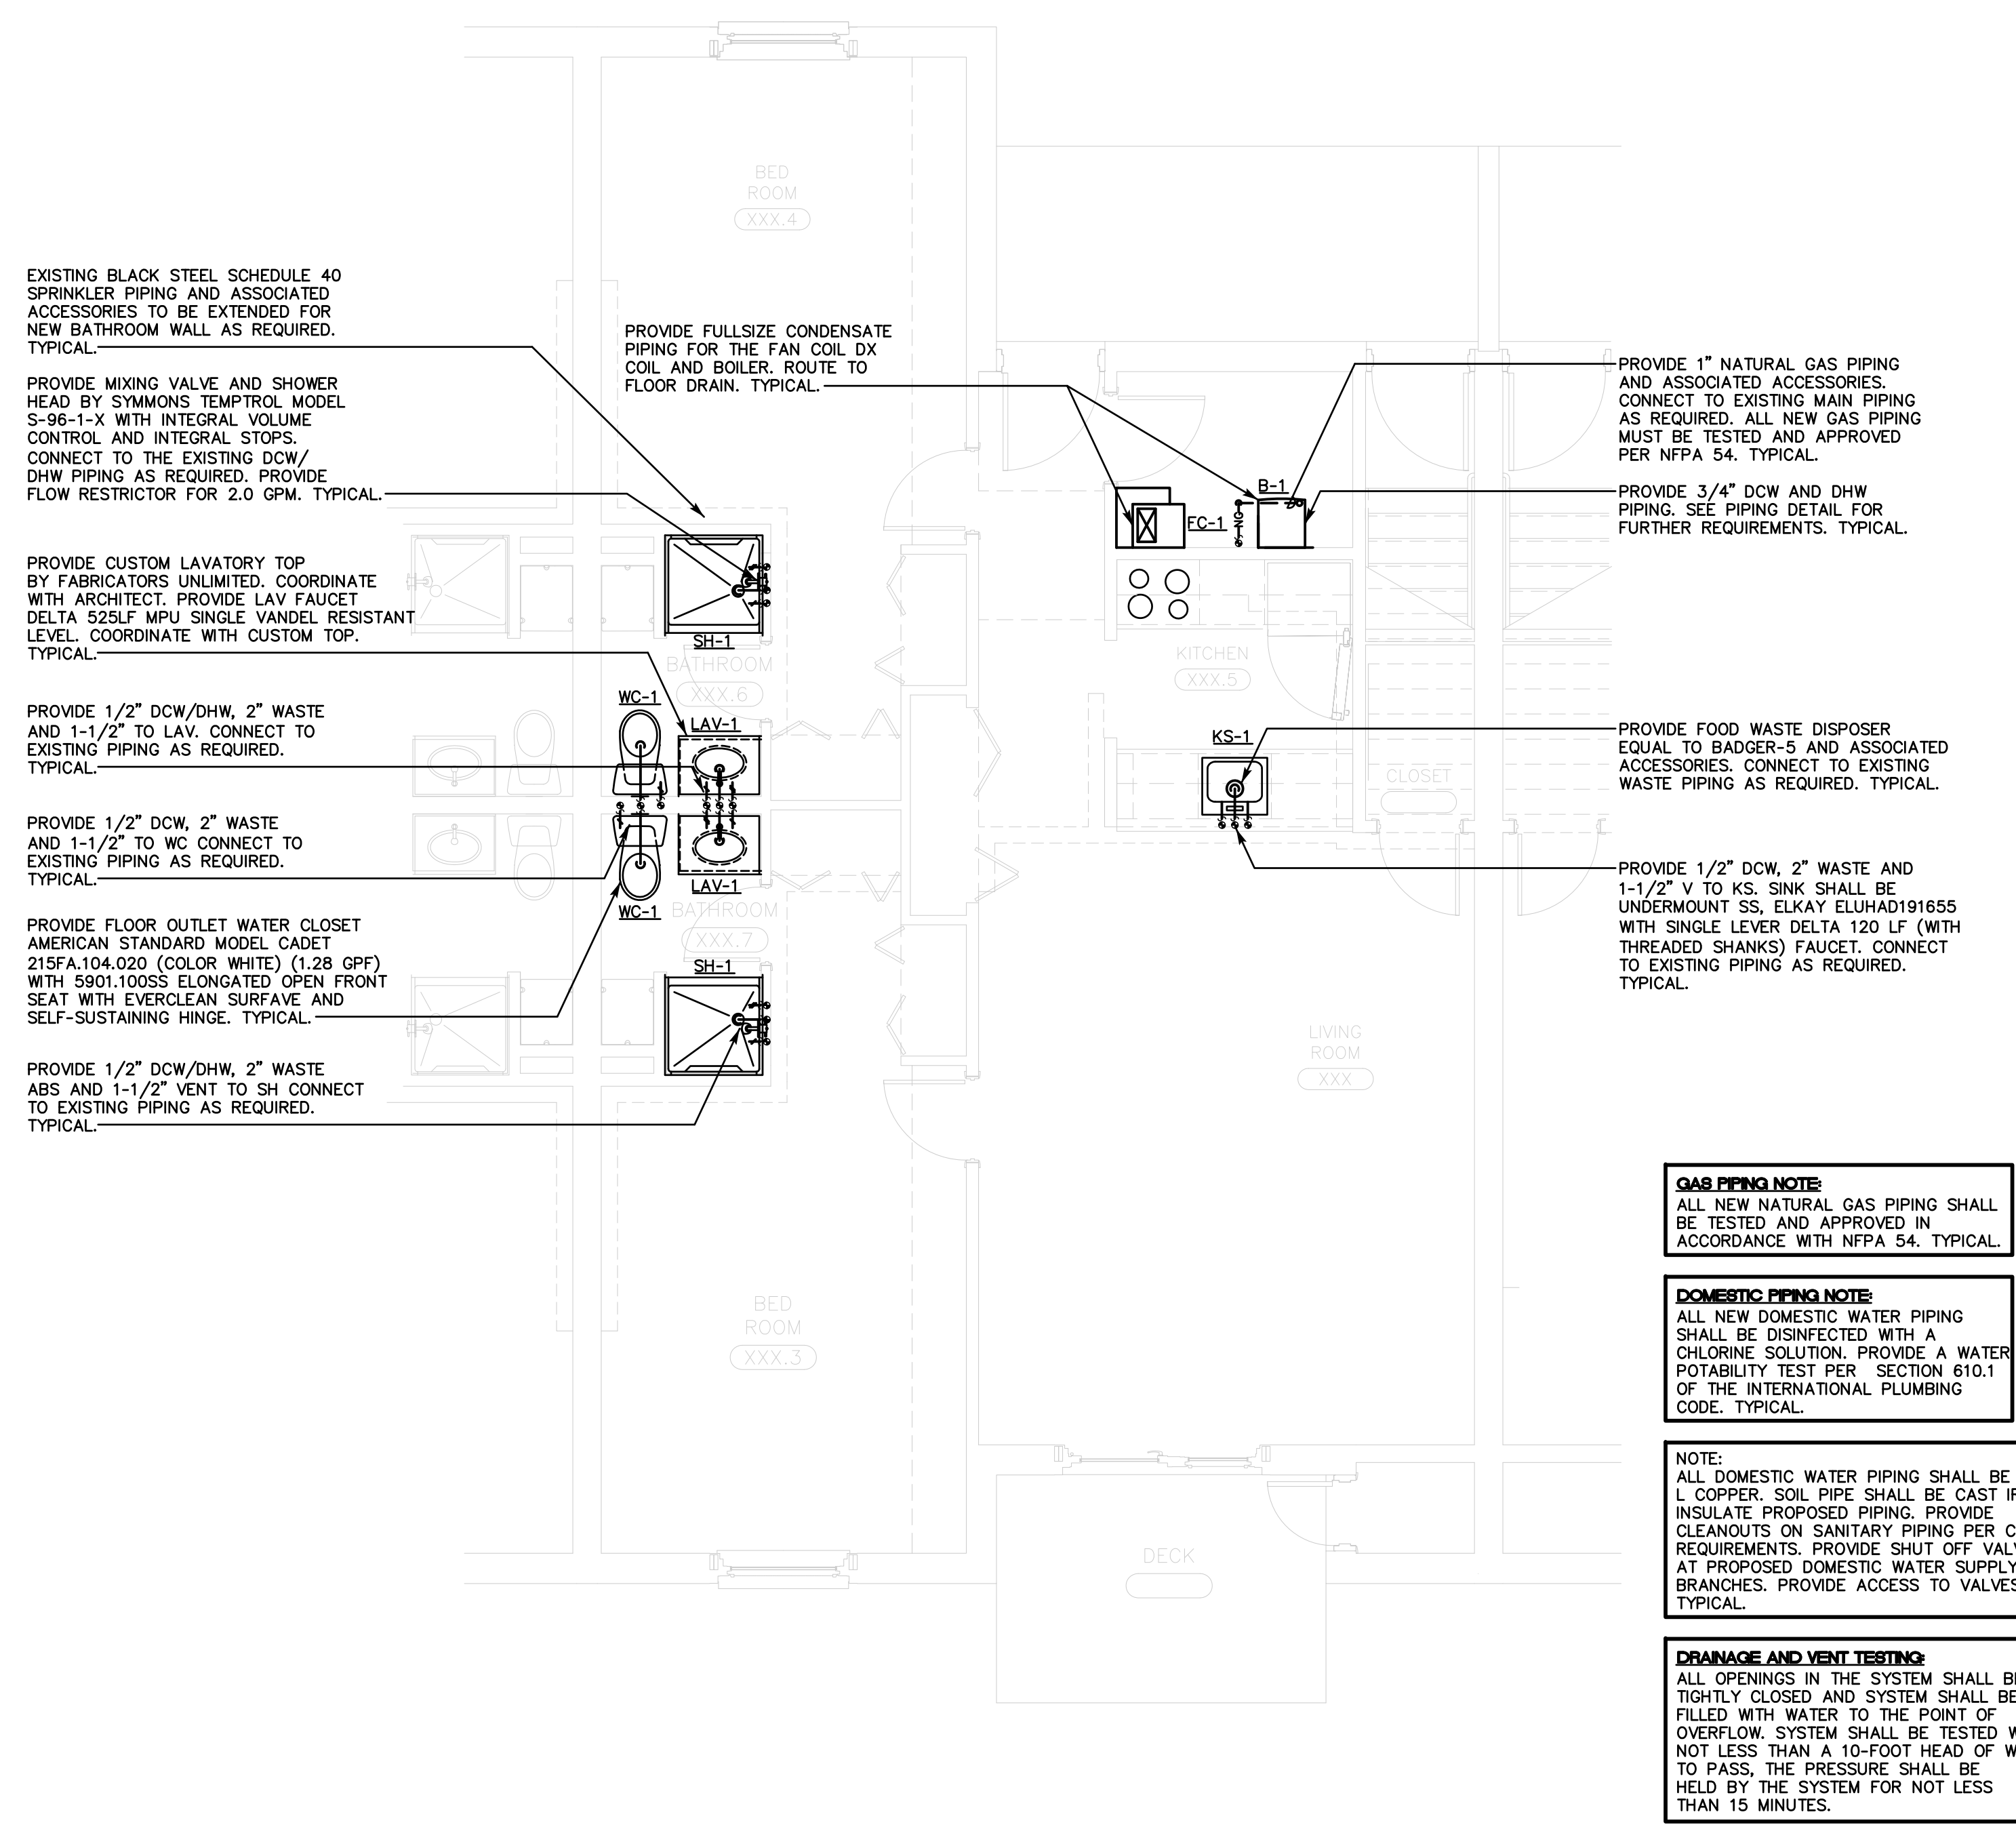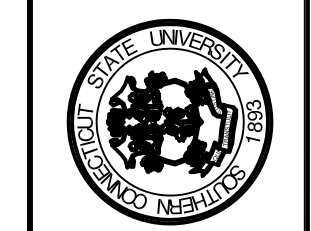

**1 PARTIAL FIRST FLOOR PLUMBING/FIRE PROTECTION PLAN - TYPICAL UNIT**

PPF1 SCALE: 1/4" = 1'-0" LAYOUT AS SHOWN OR OPPOSITE HAND, SEE BUILDING PLANS FOR LAYOUTS FOR SPECIFIC UNIT NUMBERS

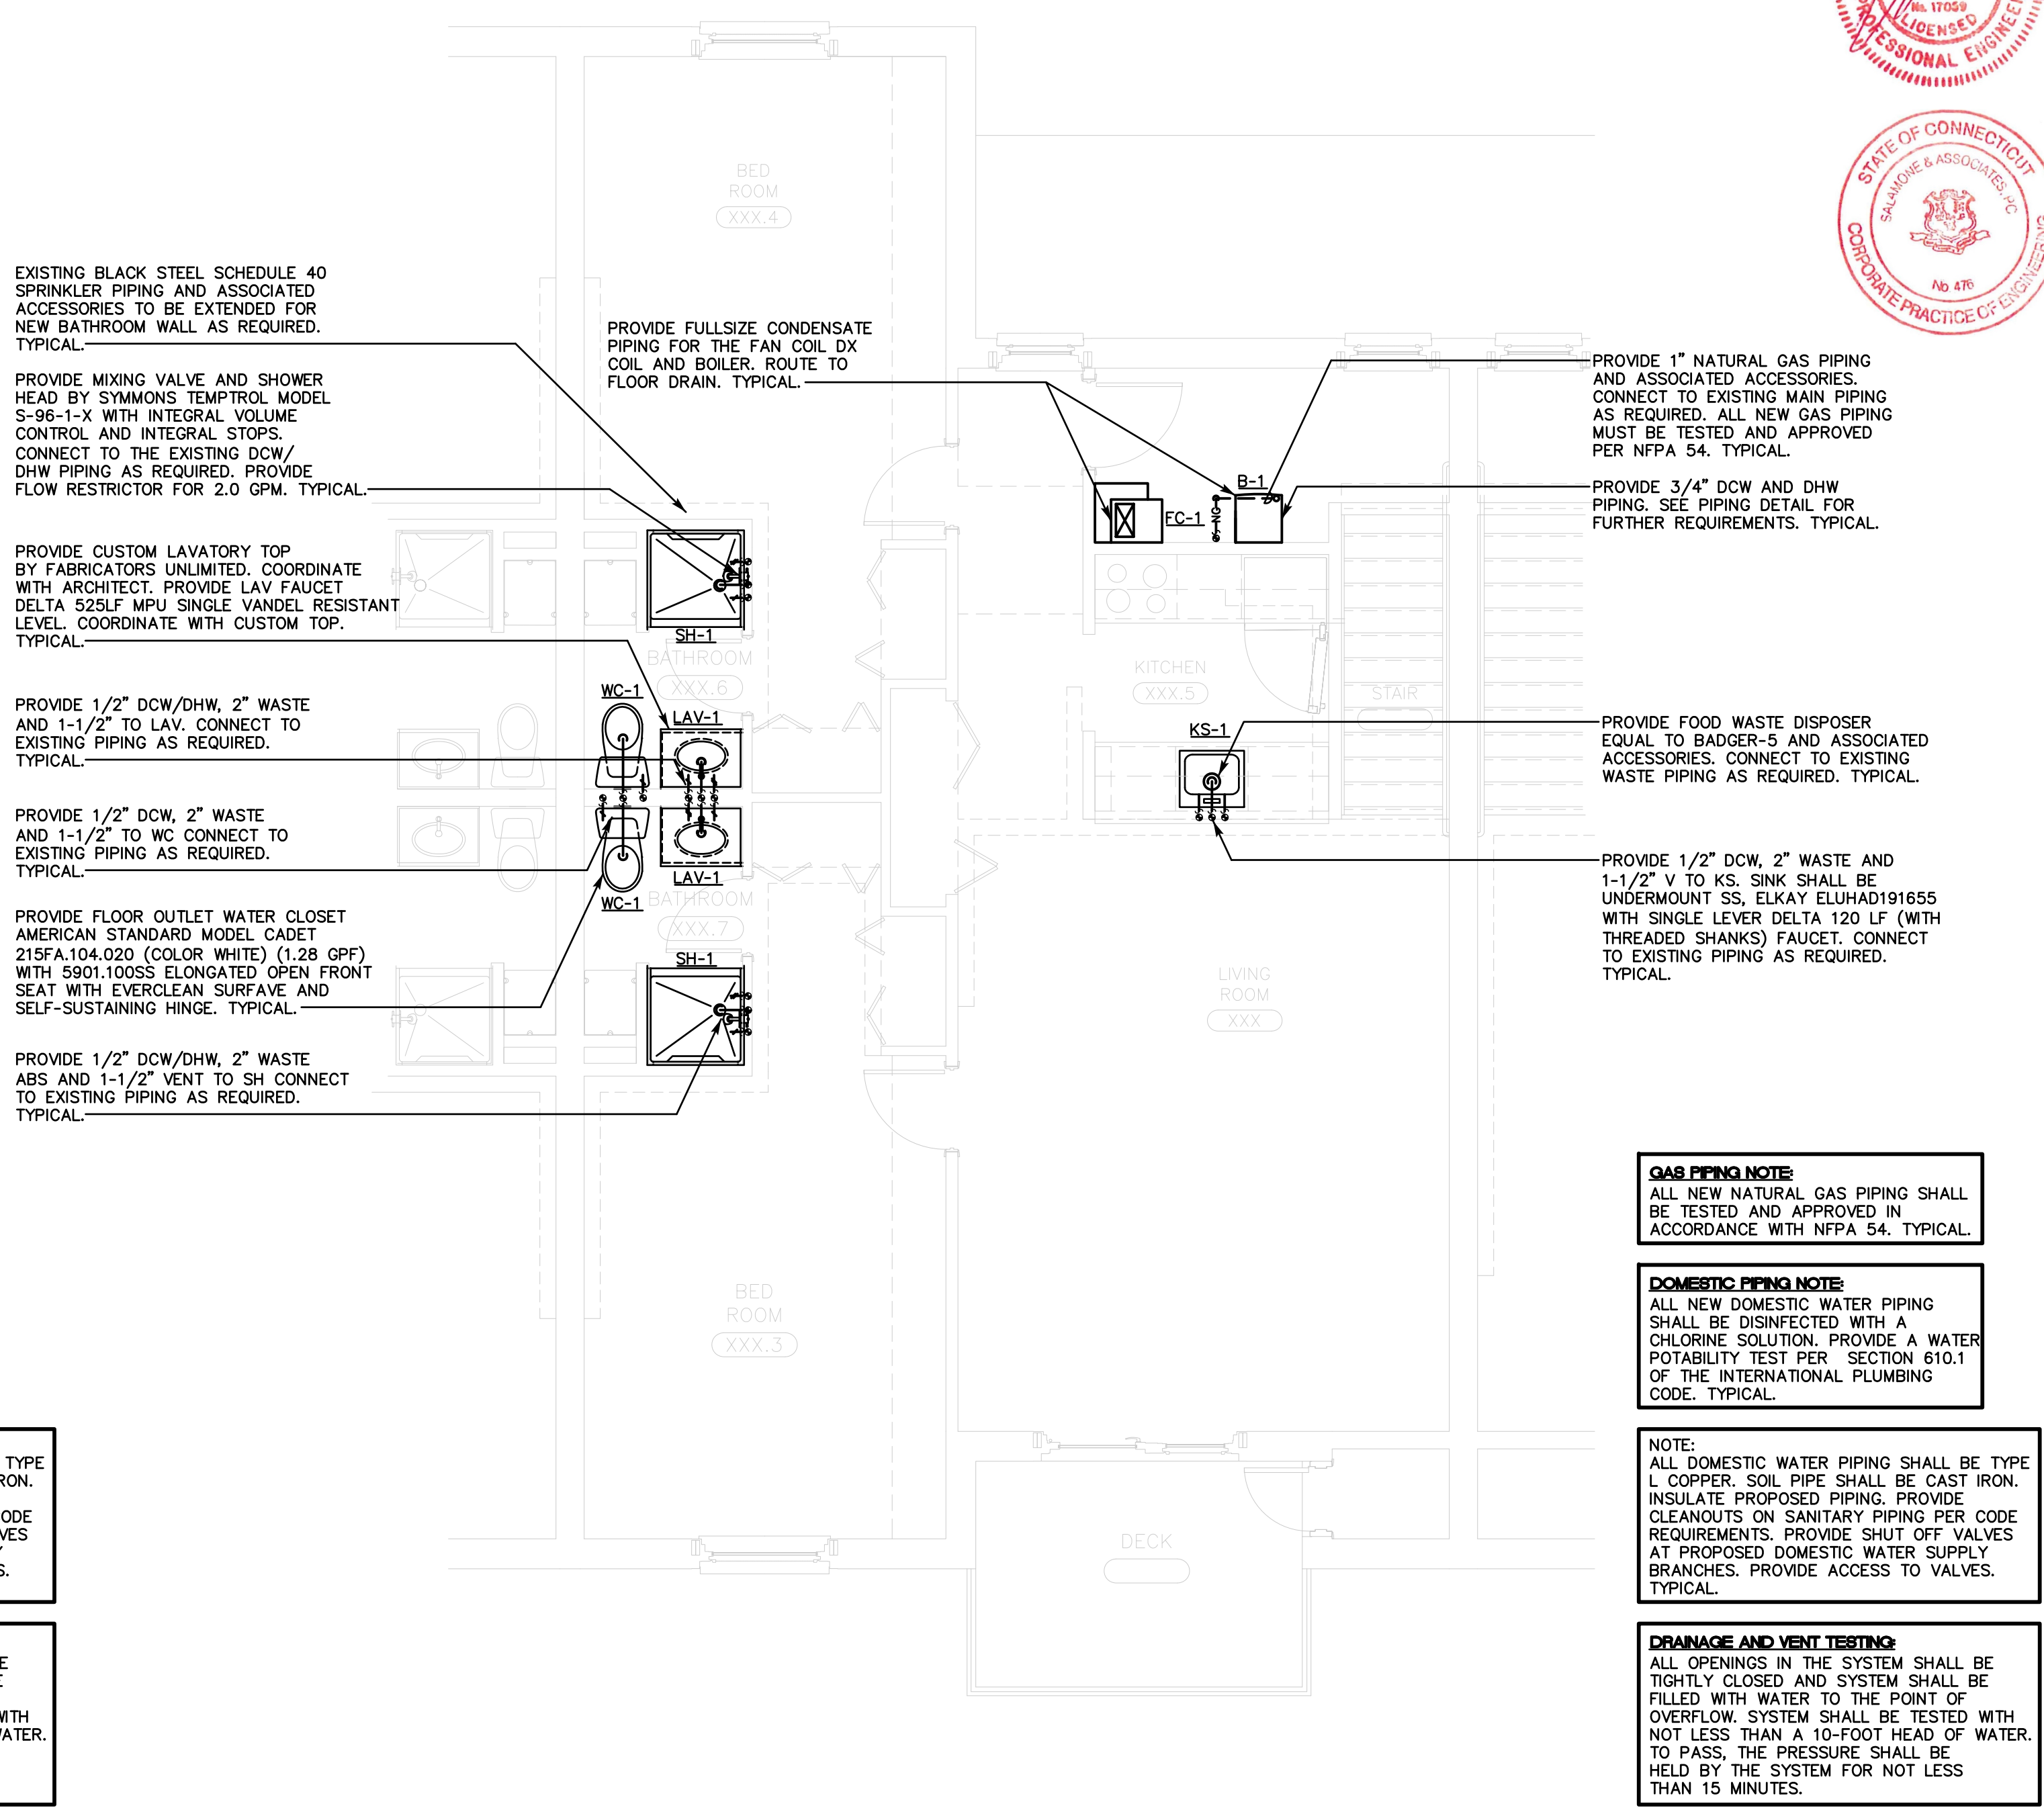

**2 PARTIAL SECOND FLOOR PLUMBING/FIRE PROTECTION PLAN - TYPICAL UNIT**

PPF1 SCALE: 1/4" = 1'-0" LAYOUT AS SHOWN OR OPPOSITE HAND, SEE BUILDING PLANS FOR LAYOUTS FOR SPECIFIC UNIT NUMBERS




PLUMBING SYMBOL LIST	
	BALL VALVE
	CAP
	PIPE ELBOW, TURNED UP
	PIPE ELBOW, TURNED DOWN
	DOMESTIC COLD WATER SUPPLY PIPING
	DOMESTIC HOT WATER SUPPLY PIPING
	SANITARY VENT PIPING
	PIPING TO BE PROVIDED
	CLEAN OUT

PLUMBING ABBREVIATIONS	
C.O.	CLEANOUT
DCW	DOMESTIC COLD WATER SUPPLY
DHW	DOMESTIC HOT WATER SUPPLY
DN	DOWN
F.C.O.	FLOOR CLEANOUT
FD	FLOOR DRAIN
FS	FLOOR SINK
ID	INDIRECT WASTE
LAV	LAVATORY
NTS	NOT TO SCALE
SAN	SANITARY
SK	SINK
TYP	TYPICAL
VTR	SANITARY VENT THROUGH ROOF
WC	WATER CLOSET


EXPANSION TANK SCHEDULE	
NO.	ET-2
LOCATION	MECH ROOM
SERVICE	DOMESTIC WATER
TYPE	BLADDER
CAPACITY (GALLONS)	2
ACCEPTANCE	0.9
MODEL	PT-5
MANUFACTURER	BELL AND GOSSETT
<b>NOTE:</b>	
1. INSTALL PER MANUFACTURERS INSTALLATION INSTRUCTIONS.	

**GENERAL NOTES**

- PROVIDE FIXTURE SHUT-OFF VALVES AND P-TRAPS FOR ALL FIXTURES PROVIDED. PROVIDE SANITARY, WASTE AND DOMESTIC WATER PIPING AS REQUIRED FOR ALL FIXTURES PROVIDED.
- REFER TO AND CAREFULLY CHECK ARCHITECTURAL, ELECTRICAL AND MECHANICAL DRAWINGS AND DETAILS, NOTING LOCATIONS WHERE WALLS, PARTITIONS, CEILINGS AND OTHER SURFACES ARE FURRED, LOCATION OF PIPE SLEEVES, LOCATIONS OF PIPE SHAFTS AND CONFLICTS WITH WORK OF OTHER TRADES AND ARRANGE WORK ACCORDINGLY. FURNISH ALL OFFSETS, FITTINGS, VALVES, DRAINS, ETC. REQUIRED TO MEET SUCH CONDITIONS.
- DUE TO SCALE OF DRAWINGS, ALL REQUIRED OFFSETS, FITTINGS, VALVES, DRAINS, ETC. MAY NOT BE INDICATED.
- CONTRACTOR SHALL OBTAIN AND PAY FOR ALL REQUIRED PERMITS AND ARRANGE FOR ALL REQUIRED INSPECTIONS IN ACCORDANCE WITH STATE AND LOCAL GOVERNING CODES.
- THE TERM "PROVIDE" SHALL MEAN "TO FURNISH, INSTALL AND CONNECT COMPLETELY."
- ALL WORK SHALL BE DONE WITH LICENSED WORKMEN IN ACCORDANCE WITH STATE AND LOCAL GOVERNING AUTHORITIES.
- CONTRACTOR SHALL MAKE ADEQUATE PROVISIONS FOR PIPE SLOPE AND ANCHORAGE.
- BEFORE CUTTING OR DRILLING INTO BUILDING ELEMENTS, INSPECT AND LAYOUT WORK TO AVOID DAMAGING STRUCTURAL ELEMENTS AND BUILDING UTILITIES.
- ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE LATEST ADOPTED:
  - CT BUILDING CODE
  - NFPA 13
  - INTERNATIONAL PLUMBING CODE
  - ASTM & ANSI STANDARDS.
- CONTRACTOR SHALL BE RESPONSIBLE FOR REPAIR AND PAYMENT FOR ANY/ALL UTILITIES DAMAGED DURING CONSTRUCTION.
- CONTRACTOR TO CONFIRM PIPE LOCATIONS, ELEVATIONS, AND SIZES BEFORE ANY WORK IS STARTED. IF ANY DISCREPANCIES ARE FOUND NOTIFY ENGINEER BEFORE PROCEEDING WITH WORK.
- PROVIDE SEISMIC DESIGN CATEGORY B BRACING OF ALL PLUMBING PIPES PER THE STATE OF CONNECTICUT BUILDING CODE.
- FOLLOW MANUFACTURER'S INSTRUCTIONS AND RECOMMENDATIONS FOR INSTALLATION OF PROVIDED EQUIPMENT.
- ALL PIPES THAT PENETRATE WALLS, FLOORS AND CEILINGS IN FINISHED AREAS SHALL RECEIVE CHROME PLATED METAL ESCUTCHEONS.
- ALL SHOP DRAWINGS OF INDIVIDUAL COMPONENTS ARE TO BE SUBMITTED AS A COMPLETE PACKAGE.
- ALL SHOP DRAWINGS OF RELATED COMPONENTS SHALL BE SUBMITTED AS A COMPLETE PACKAGE.
- ALL WORK IN INTERIOR FINISHED SPACES IS TO BE CONCEALED BEHIND WALLS, ABOVE CEILINGS, OR UNDER THE FLOOR. PROVIDE ALL NECESSARY CUTTING, PATCHING, REPAINTING AND/OR REPLACEMENT OF FINISHES AS REQUIRED TO PERFORM WORK.
- WRITTEN REQUESTS FOR PLANNED SHUTDOWN OR INTERRUPTION OF BUILDING SERVICES, SYSTEMS OR EQUIPMENT SHALL BE MADE IN WRITING 72 HOURS PRIOR TO START OF THE REQUESTED SHUTDOWN PERIOD.
- SUPPORT PIPING ABOVE SUSPENDED CEILING, FROM CONSTRUCTION ABOVE, AS CLOSE AS POSSIBLE TO BOTTOM OF SLABS, BEAMS, MAINTAINING MAXIMUM HEADROOM AT ALL TIMES.
- PROVIDE CLEANOUTS PER INTERNATIONAL PLUMBING CODE.




**SOUTHERN CONNECTICUT STATE UNIVERSITY**  
 FACILITIES PLANNING DEPARTMENT  
 615 FITCH STREET, HAMDEN, CT. 06514 TEL. 203-382-6055



**SALAMONE & ASSOCIATES, P.C.**  
 REGISTERED PROFESSIONAL ENGINEERS  
 118 South Main Street, Suite 200  
 Hamden, CT 06514  
 Phone: (203) 382-6055 Fax: (203) 382-6055


**NORTH CAMPUS TOWNHOUSES BATHROOM REPLACEMENT 2020**

CADD. NO. PROJECT NO. SCSU-2020-04  
 SHEET DATE: MAY, 27 2020  
 DRAWING TITLE: PLUMBING/FIRE PROTECTION SCHEDULES, NOTES, SYMBOLS AND ABBREVIATIONS  
**PFP2**

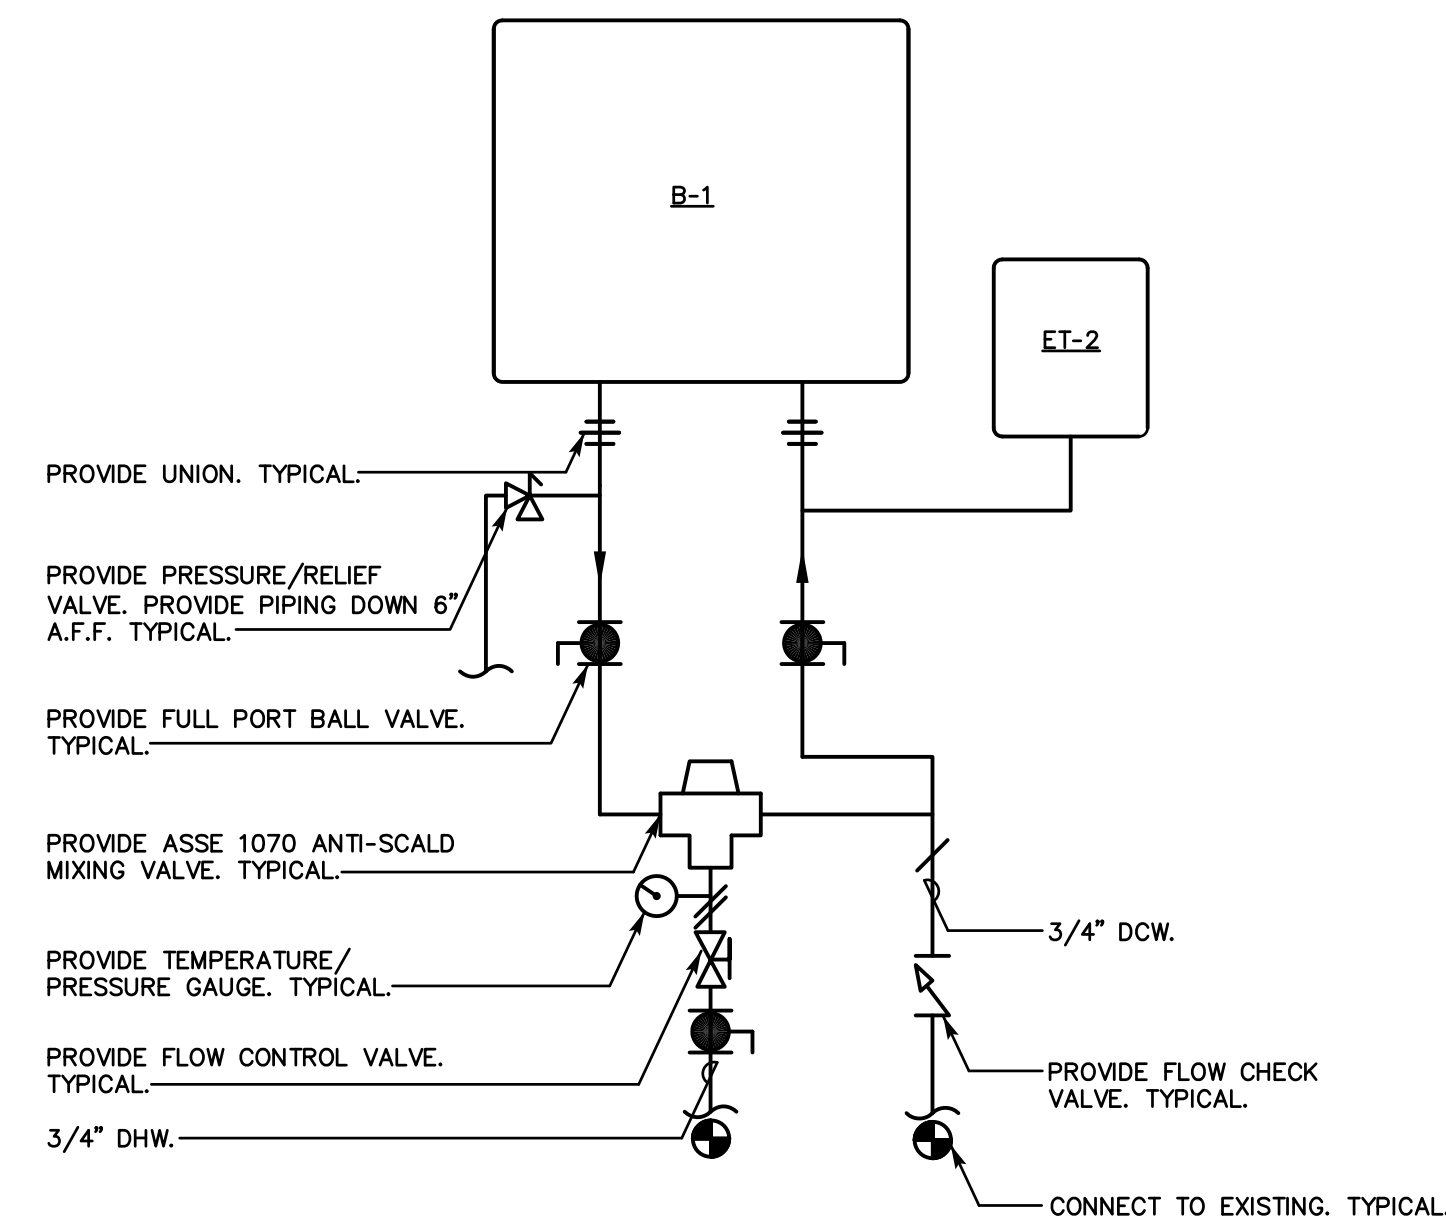

**TYPICAL DOMESTIC WATER PIPING DETAIL**  
 SCALE: NTS





SALAMONE & ASSOCIATES, P.C.  
REGISTERED PROFESSIONAL ENGINEERS  
118 South Main Street, Suite 200  
Hamden, CT 06517  
Phone: (203) 382-6055 Fax: (203) 382-6056





NORTH CAMPUS TOWNHOUSES  
BATHROOM REPLACEMENT 2020

CADD. NO. PROJECT NO. SCSU-2020-04

SHEET DATE: MAY, 27 2020

DRAWING TITLE: PARTIAL FIRST AND SECOND FLOOR MECHANICAL PLANS

M1

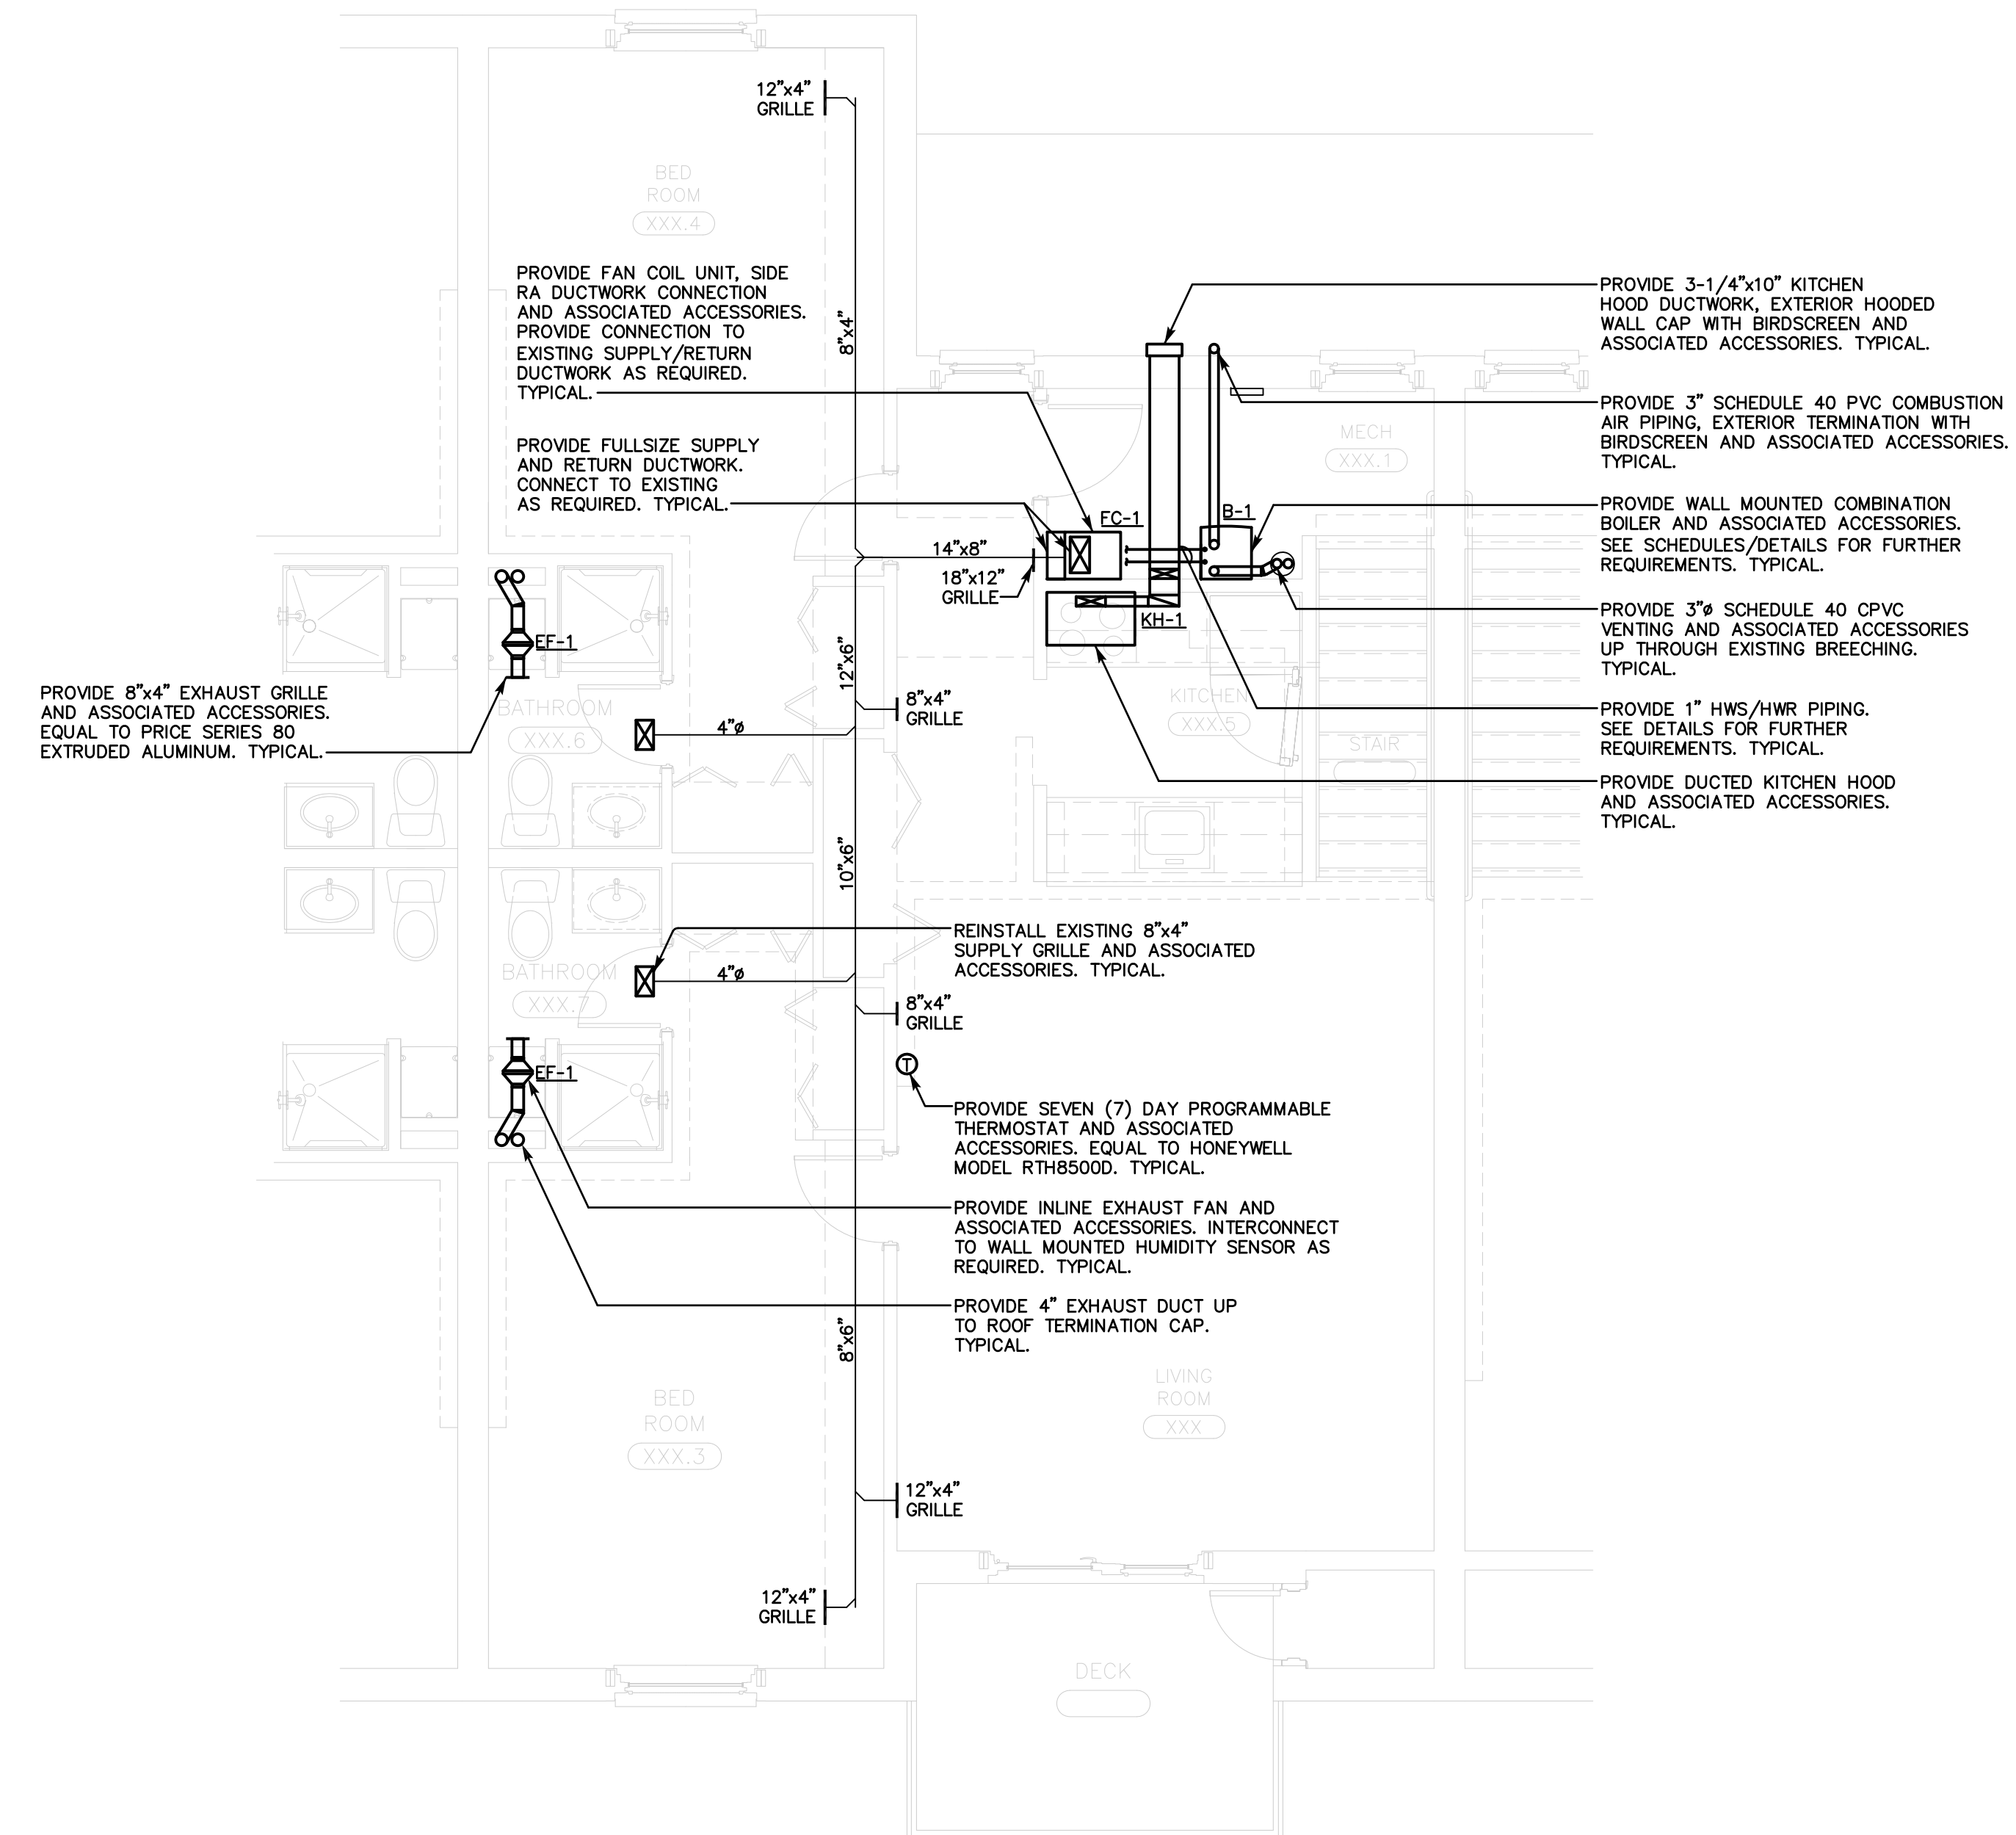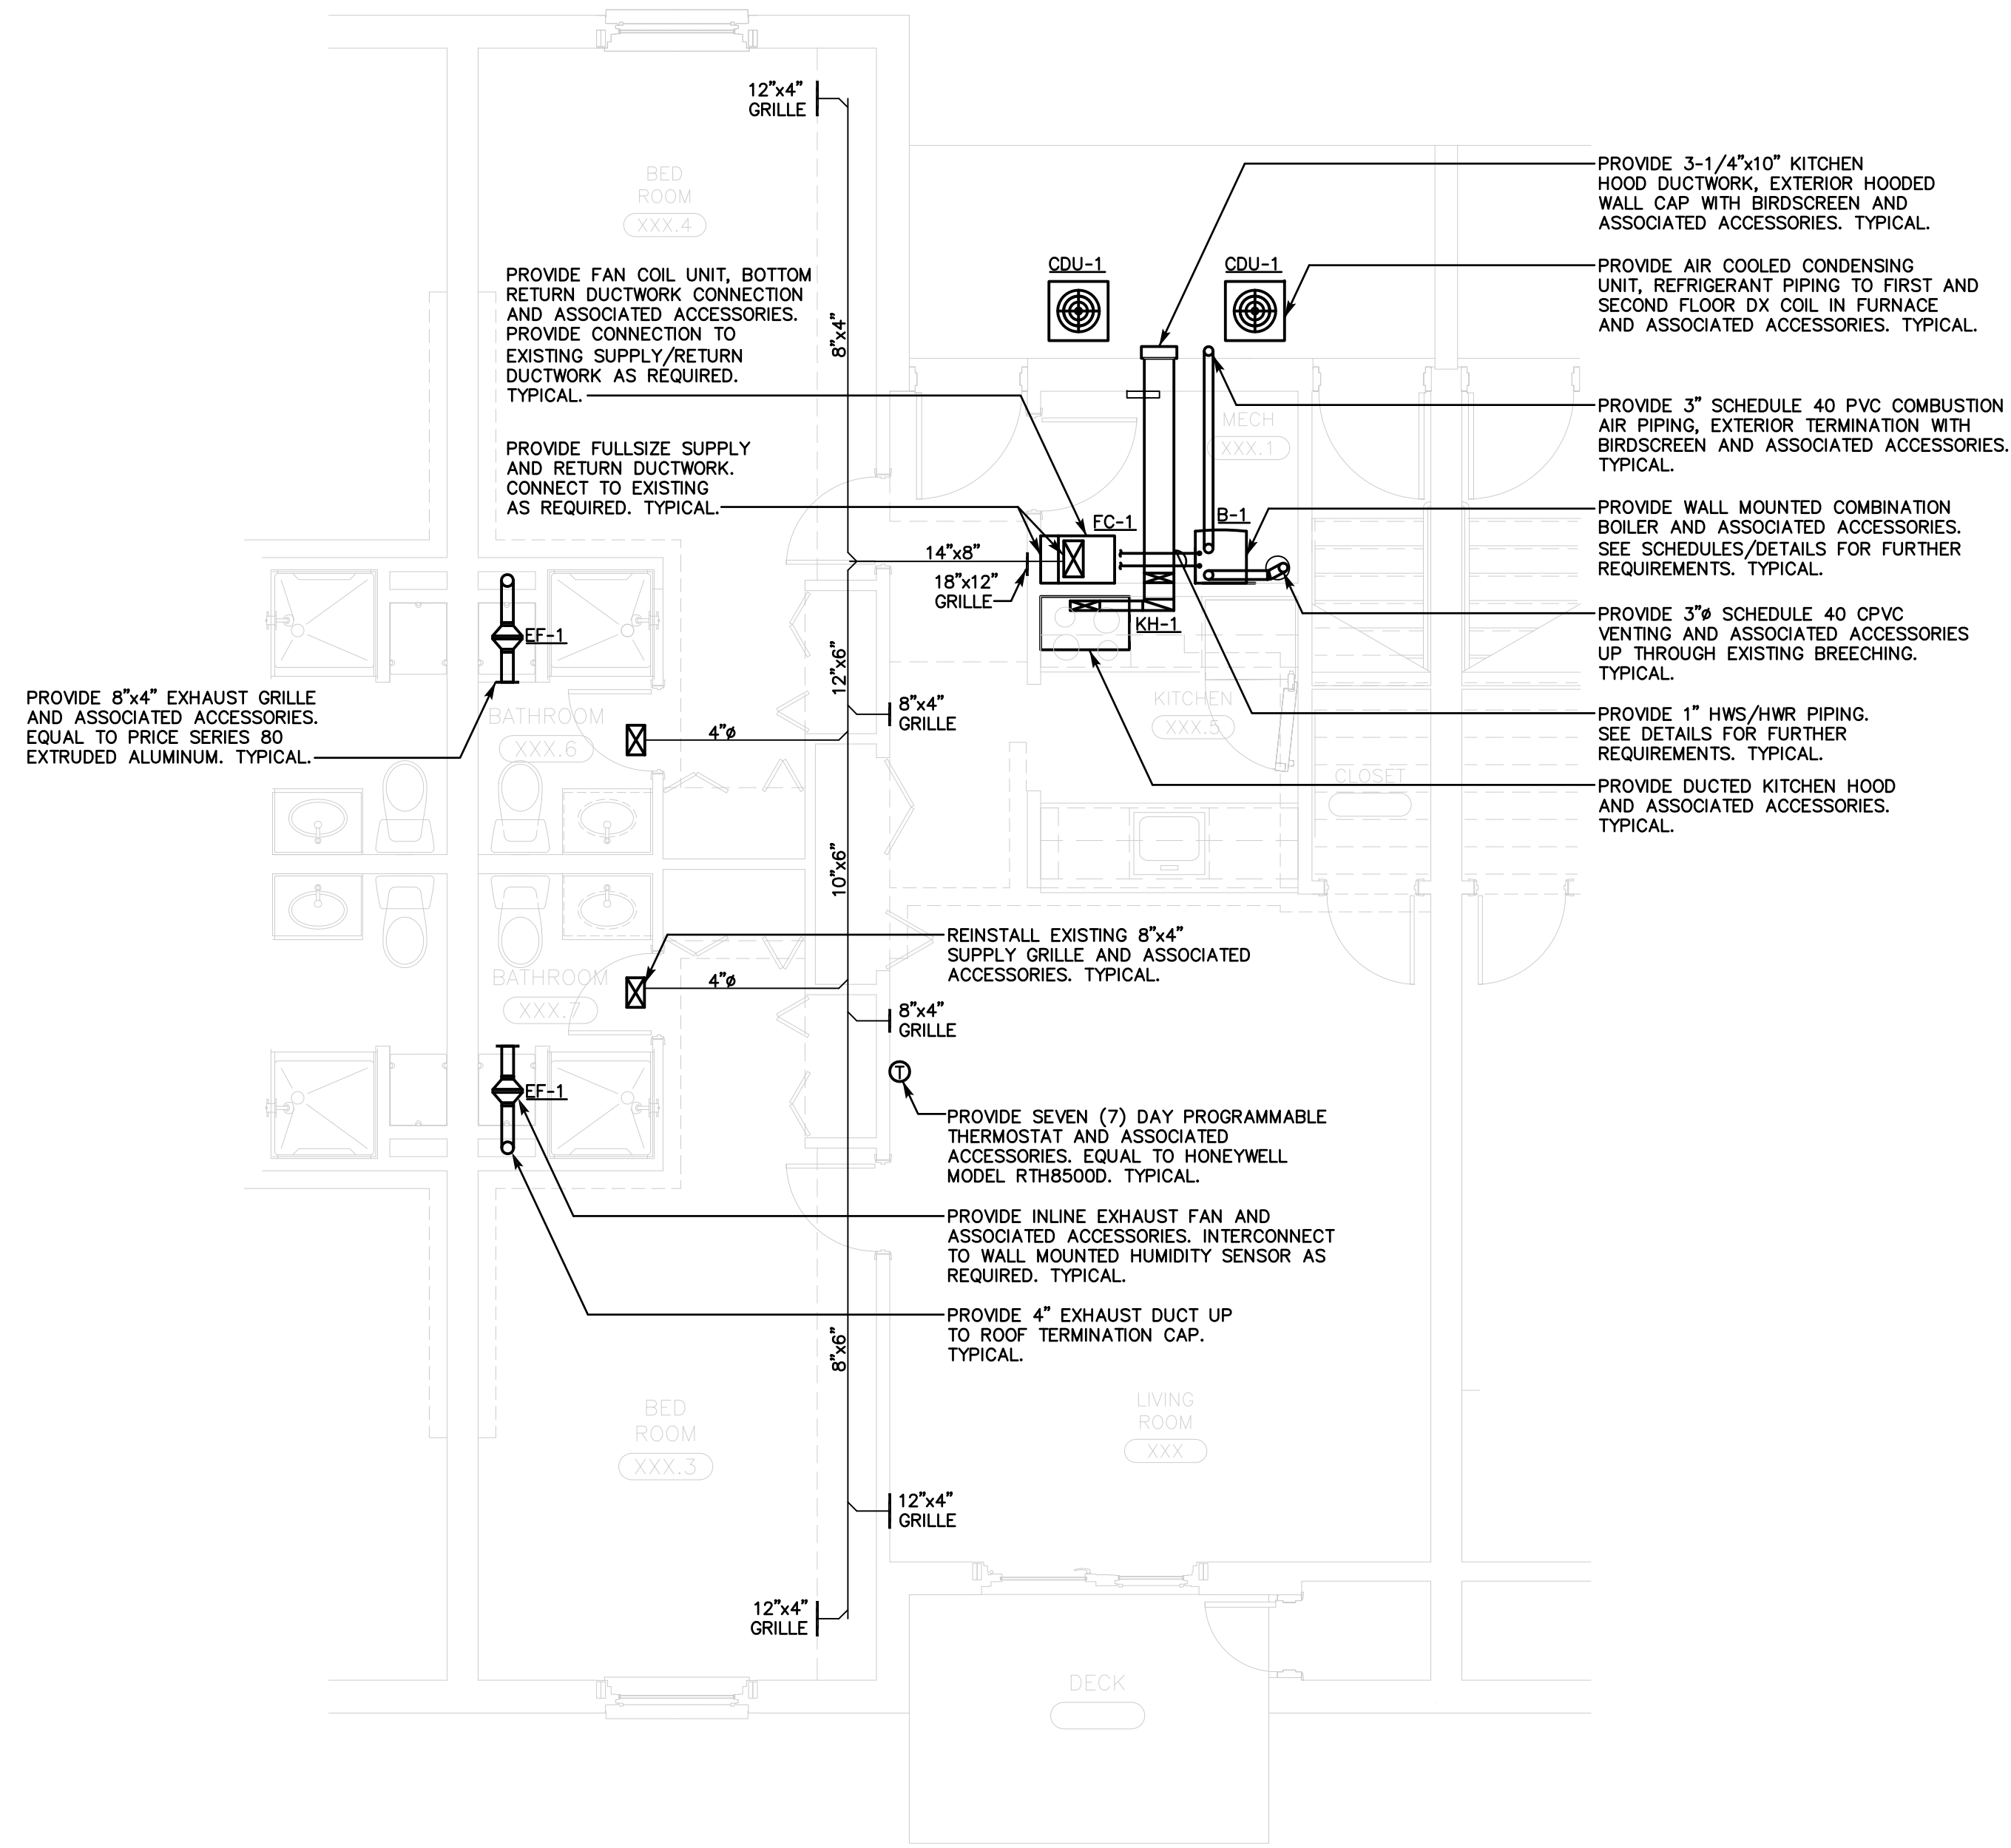


ADD ALTERNATE #1 DUCT CLEANING.  
ALL EXISTING DUCTWORK, SUPPLY/RETURN GRILLES  
SHALL BE CLEANED IN ACCORDANCE WITH NADCA  
STANDARDS.

ADD ALTERNATE #1 DUCT CLEANING.  
ALL EXISTING DUCTWORK, SUPPLY/RETURN GRILLES  
SHALL BE CLEANED IN ACCORDANCE WITH NADCA  
STANDARDS.

**1** PARTIAL FIRST FLOOR MECHANICAL PLAN - TYPICAL UNIT  
M1 SCALE: 1/4" = 1'-0" LAYOUT AS SHOWN OR OPPOSITE HAND, SEE BUILDING PLANS FOR LAYOUTS FOR SPECIFIC UNIT NUMBERS

**2** PARTIAL SECOND FLOOR MECHANICAL PLAN - TYPICAL UNIT  
M1 SCALE: 1/4" = 1'-0" LAYOUT AS SHOWN OR OPPOSITE HAND, SEE BUILDING PLANS FOR LAYOUTS FOR SPECIFIC UNIT NUMBERS



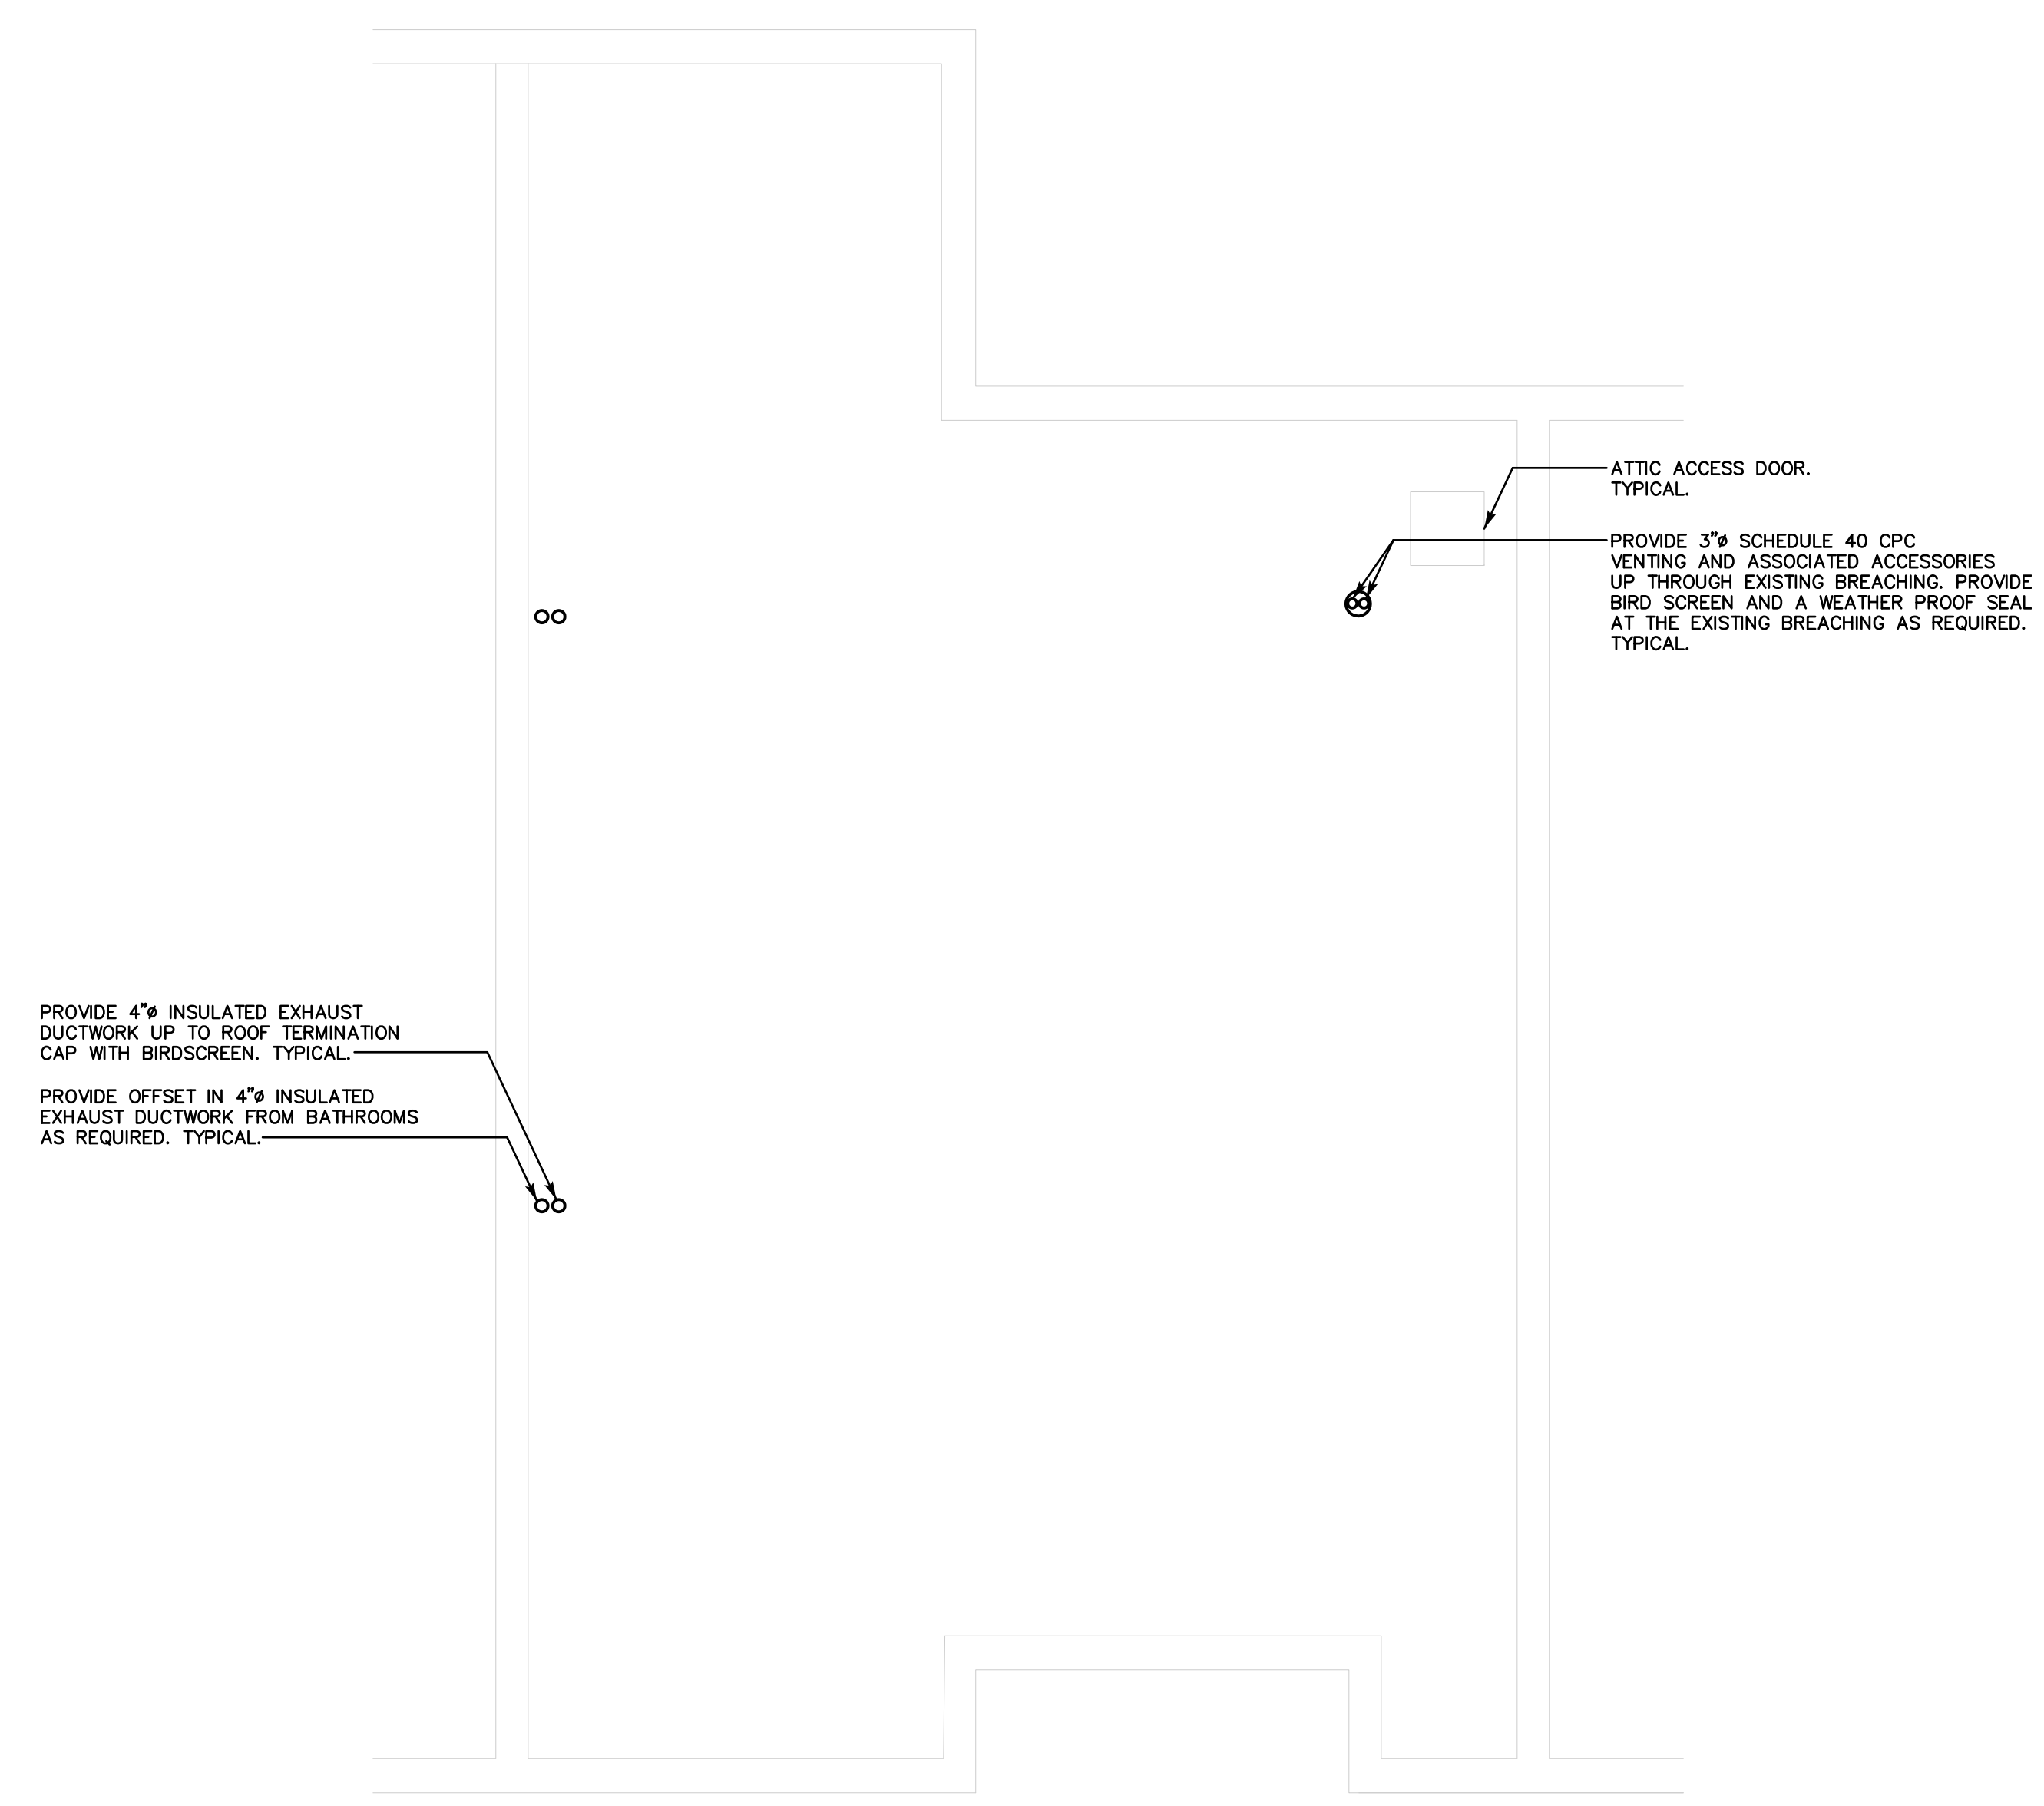

**1** PARTIAL ATTIC MECHANICAL PLAN - TYPICAL UNIT  
**M2** SCALE: 1/4" = 1'-0" LAYOUT AS SHOWN OR OPPOSITE HAND, SEE BUILDING PLANS FOR LAYOUTS FOR SPECIFIC UNIT NUMBERS



**SALOMONE & ASSOCIATES, P.C.**  
 REGISTERED PROFESSIONAL ENGINEERS  
 110 South Main Street, Suite 200  
 Hamden, CT 06514  
 Phone: (203) 341-0000 Fax: (203) 341-0700


**NORTH CAMPUS TOWNHOUSES  
 BATHROOM REPLACEMENT 2020**

PROJECT NO. SCSU-2020-04  
 DATE: MAY, 27 2020  
 DRAWING TITLE: PARTIAL ATTIC MECHANICAL PLAN

CADD. NO. SHEET  
**M2**

**SOUTHERN CONNECTICUT  
 STATE UNIVERSITY**  
 FACILITIES PLANNING DEPARTMENT  
 615 FITCH STREET, HAMDEN, CT. 06514 TEL. 203-382-6055



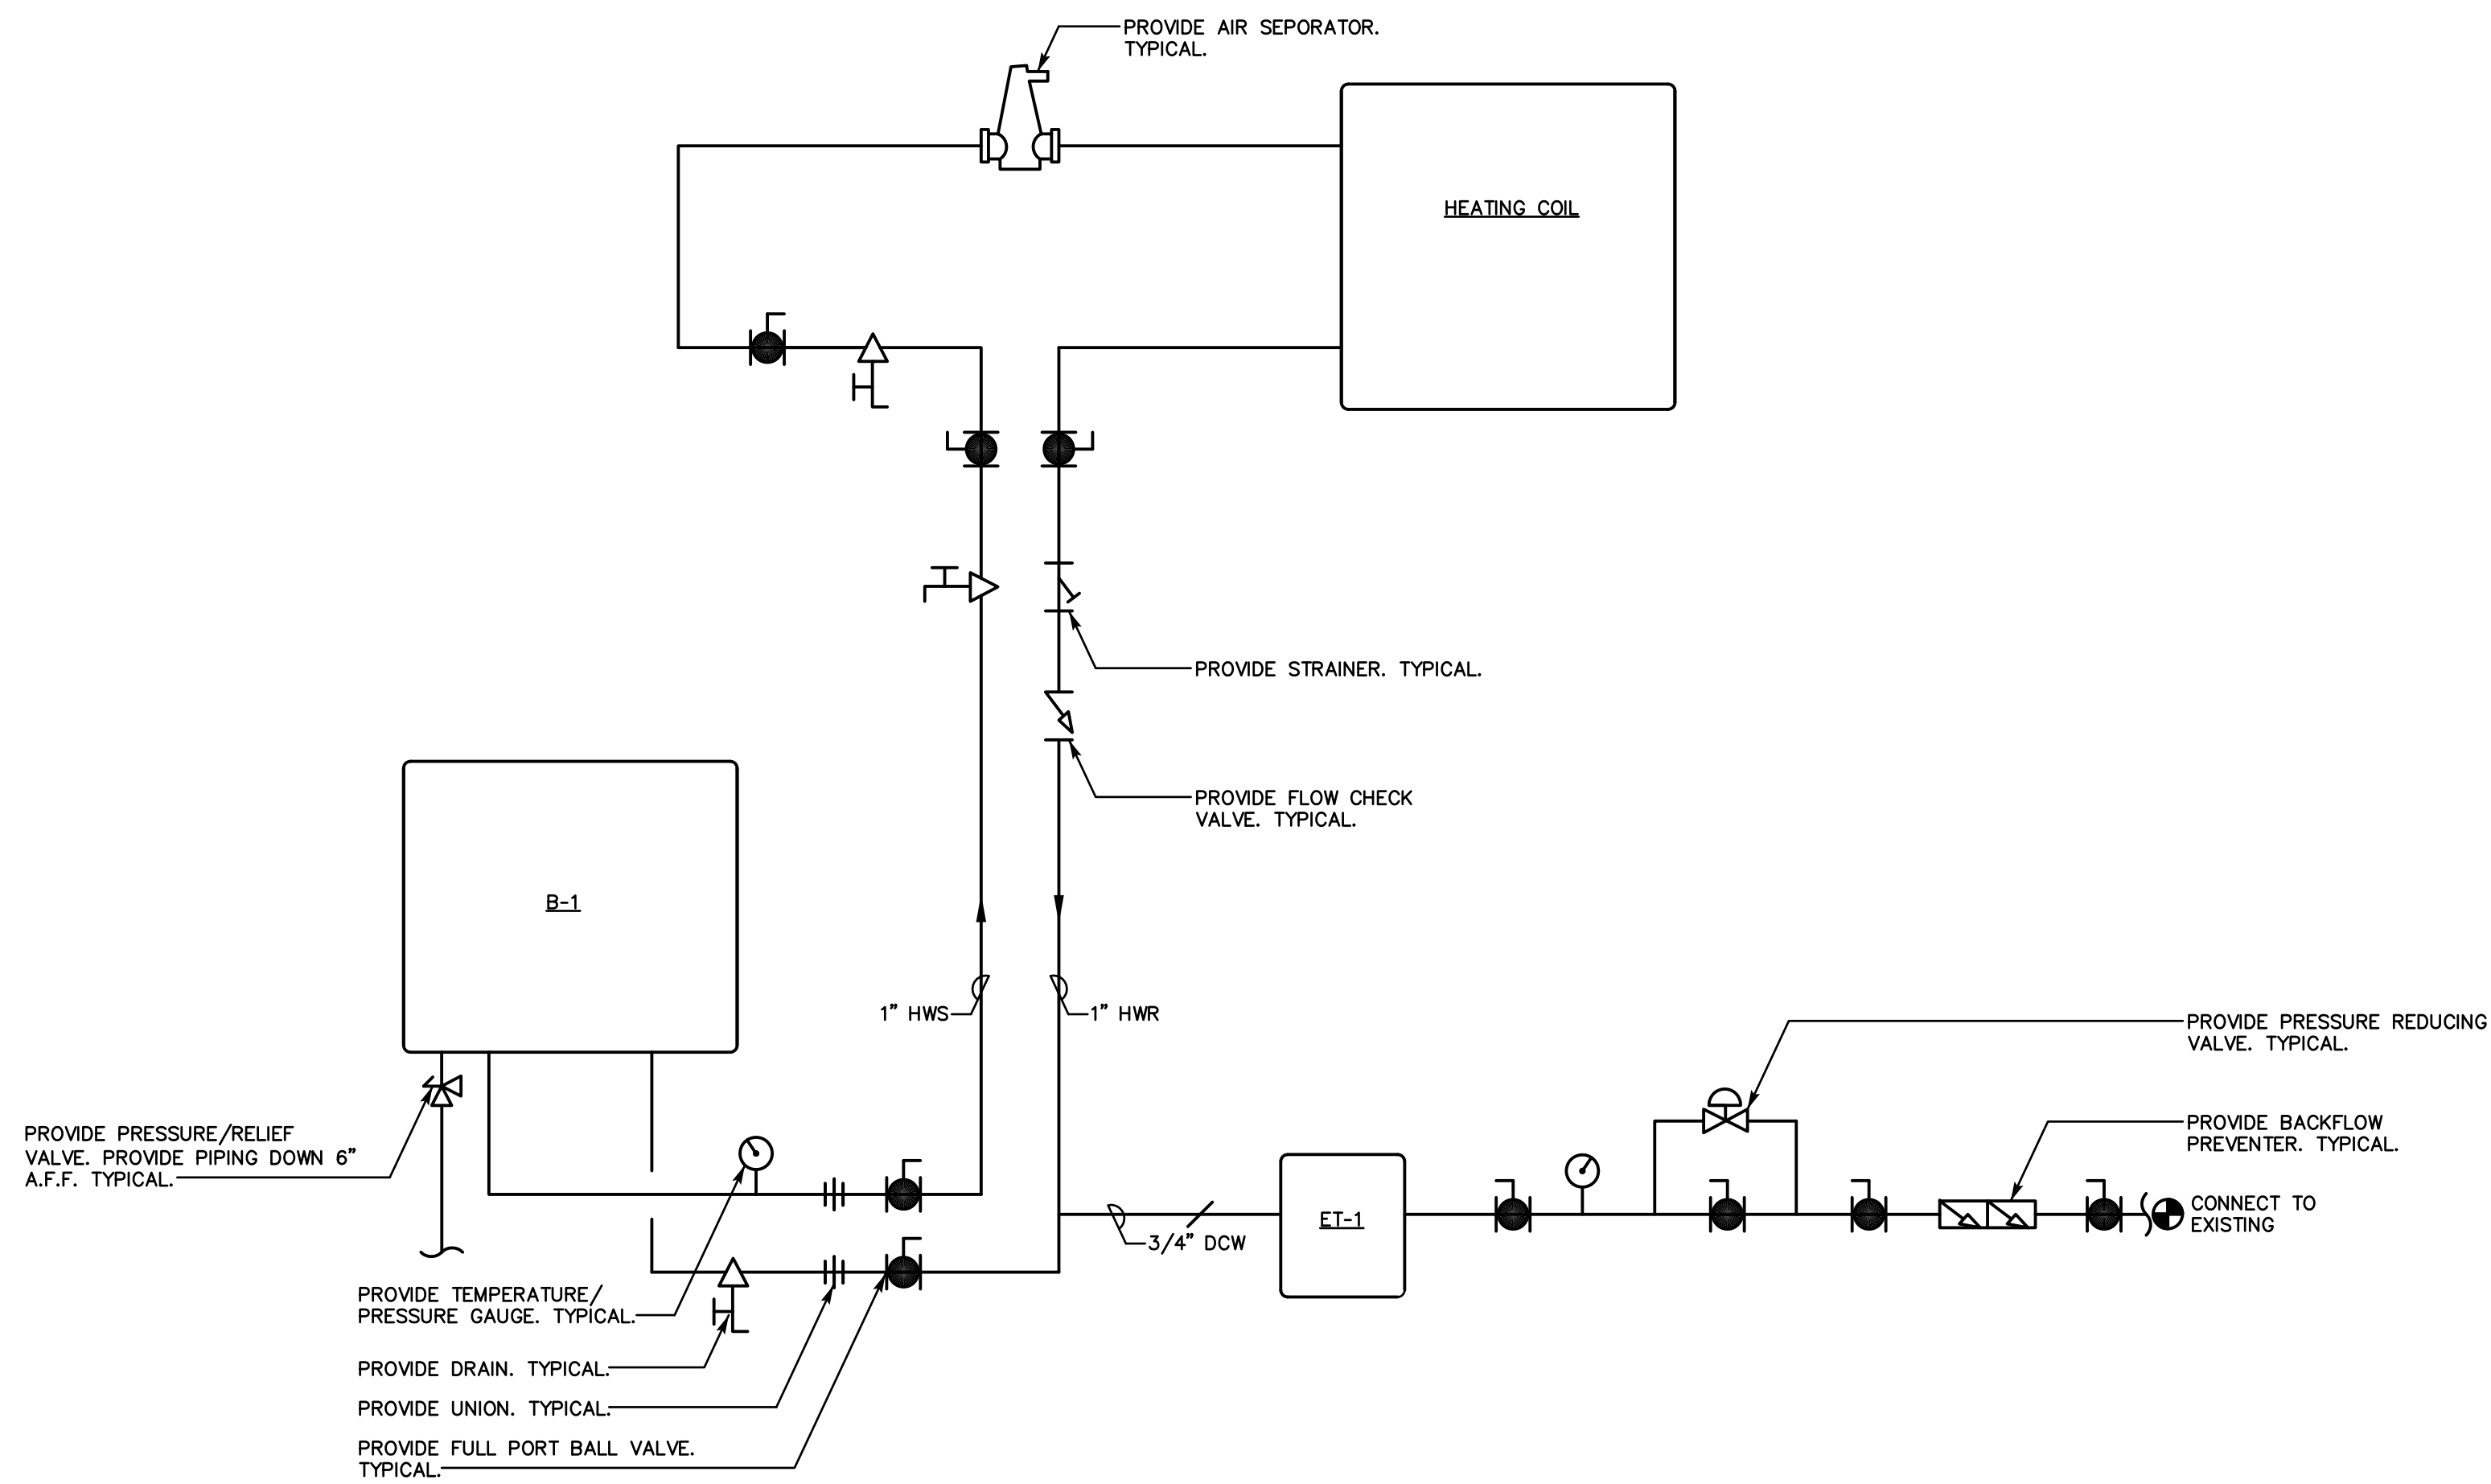

**TYPICAL HOT WATER PIPING DETAIL**  
SCALE: NTS

COMBINATION BOILER SCHEDULE	
BOILER NO.	B-1
LOCATION	MECH ROOM
TYPE	GAS-FIRED, CONDENSING COMBINATION
HEATING INPUT (BTU/HR)	150,000
HEATING OUTPUT (BTU/HR)	139,000
AFUE	95%
BUILT IN CIRCULATOR PUMP	YES
ELECT. CHARAC. (V/PH/Hz)	115/1/60
DESIGN BASED MODEL	NKB150N
DESIGN BASED MANUFACTURER	LOCHINVAR
<b>NOTE:</b>	
1. INSTALL PER MANUFACTURERS INSTALLATION INSTRUCTIONS AND ALL APPLICABLE CODES.	
2. PROVIDE LOW WATER CUT OFF, CONDENSATE NEUTRALIZER KIT AND OUTDOOR AIR SENSOR.	
3. PROVIDE CONNECTION TO PROPOSED THERMOSTAT AS REQUIRED. TYPICAL.	

EXPANSION TANK SCHEDULE	
TANK NO.	ET-1
LOCATION	MECH ROOM
TYPE	BLADDER
CAPACITY (GALLONS)	2.0
ACCEPTANCE	1.0
MODEL	HFT-15
MANUFACTURER	BELL AND GOSSETT
<b>NOTE:</b>	
1. INSTALL PER MANUFACTURERS INSTALLATION INSTRUCTIONS AND ALL APPLICABLE CODES.	

FAN COIL UNIT SCHEDULE	
FURNACE NO.	FC-1
LOCATION	MECH ROOM
TYPE	HOT WATER/DX COIL
AIR FLOW (CFM)	590
HEATING INPUT (BTU/HR)	60,000
HEATING OUTPUT (BTU/HR)	48,000
GPM	6.0
COOLING CAPACITY (BTU/HR)	17,900
COOLING EDB (°F)	80.00
COOLING EWB (°F)	67.00
COOLING LDB (°F)	59.90
COOLING LWB (°F)	57.20
ELECT. CHARAC. (V/PH/Hz)	115/1/60
DESIGN BASED MODEL	GAM580A24M21
DESIGN BASED MANUFACTURER	TRANE
<b>NOTES:</b>	
1. INSTALL PER MANUFACTURERS INSTALLATION INSTRUCTIONS AND ALL APPLICABLE CODES.	
2. PROVIDE DX COOLING COIL MODEL 4PXABU24BS3 AND ASSOCIATED ACCESSORIES.	
3. PROVIDE FIELD INSTALLED PLENUM STAND UNDERNEATH THE FAN COIL UNIT FOR RETURN DUCT CONNECTION. TYPICAL.	
4. PROVIDE CONNECTION TO PROPOSED THERMOSTAT AS REQUIRED. TYPICAL.	


CONDENSING UNIT SCHEDULE	
UNIT NO.	CDU-1
SERVICE	F-1 DX COOLING COIL
COOLING TOTAL BTU/HR	18,300
REFRIGERANT	R410A
ELECT. CHAR. (V/PH/Hz)	208-230/1/60
DESIGN BASED MODEL	4TR401B
DESIGN BASED MANUFACTURER	TRANE
<b>NOTES:</b>	
1. INSTALL PER MANUFACTURERS INSTALLATION INSTRUCTIONS AND ALL APPLICABLE CODES.	
2. PROVIDE CONNECTION TO PROPOSED THERMOSTAT AS REQUIRED. TYPICAL.	

EXHAUST FAN SCHEDULE	
EXHAUST FAN NO.	EF-1
SERVICE	BATHROOM
LOCATION	INLINE
AIR FLOW (CFM)	110
EXT. STATIC PRESS. (IWG)	0.20
MOTOR (WATTS)	46.0
ELECT. CHARAC. (V/PH/Hz)	115/1/60
DESIGN BASED MODEL	ILF120
DESIGN BASED MANUFACTURER	NUTONE
<b>NOTES:</b>	
1. INSTALL PER MANUFACTURERS INSTALLATION INSTRUCTIONS AND ALL APPLICABLE CODES.	
2. PROVIDE WALL MOUNTED HUMIDITY SENSOR EQUAL TO NUTONE MODEL 82W. INTERCONNECT TO EF-1 AS REQUIRED. TYPICAL.	




KITCHEN HOOD SCHEDULE	
HOOD NO.	KH-1
SERVICE	BATHROOM
LOCATION	OVER RANGE
AIR FLOW (CFM)	160 (TWO SPEED)
MOTOR (AMPS)	2.0
ELECT. CHARAC. (V/PH/Hz)	115/1/60
DESIGN BASED MODEL	403001
DESIGN BASED MANUFACTURER	BROAN
<b>NOTE:</b>	
1. INSTALL PER MANUFACTURERS INSTALLATION INSTRUCTIONS AND ALL APPLICABLE CODES.	

ABBREVIATIONS	
AD	ACCESS DOOR
AFF	ABOVE FINISHED FLOOR
AMP	AMPERE
BAS	BUILDING AUTOMATION SYSTEM
BDD	BACK DRAFT DAMPER
BHP	BRAKE HORSE POWER
BTU	BRITISH THERMAL UNIT
BTUH	BRITISH THERMAL UNIT/HOUR
CENTRIF	CENTRIFUGAL
CFM	CUBIC FEET PER MINUTE
COND	CONDENSATE
ESP	EXTERNAL STATIC PRESSURE
FD	FIRE DAMPER
FFF	FROM FINISHED FLOOR
PFM	FEET PER MINUTE
FFS	FEET PER SECOND
FT	FEET
GPM	GALLONS PER MINUTE
HP	HORSEPOWER
HT	HEIGHT
ID	INSIDE DIAMETER
IN	INCHES
L	LENGTH
LWT	LEAVING WATER TEMPERATURE
MAX	MAXIMUM
MBH	THOUSAND BTU/HOUR
MIN	MINIMUM
NTS	NOT TO SCALE
OSD	OPPOSED BLADE DAMPER
PSIA	POUNDS PER SQUARE INCH ABSOLUTE
PSIG	POUNDS PER SQUARE INCH GAUGE
RPM	REVOLUTIONS PER MINUTE
SENS	SENSOR
S	SMOKE DETECTOR
SP	STATIC PRESSURE
TEMP	TEMPERATURE
TONS	TONS OF REFRIGERATION


- | GENERAL NOTES |  |
|---------------|--|
| 1.            | DRAWINGS ARE DIAGRAMMATIC. THEY INDICATE THE GENERAL ARRANGEMENT OF SYSTEMS AND WORK INCLUDED IN THE CONTRACT. DRAWINGS ARE NOT TO BE SCALED. ORIGINAL ARCHITECTURAL SCHEDULES AND DETAILS SHALL BE EXAMINED FOR EXACT LOCATION OF FIXTURES AND EQUIPMENT. WHERE THEY ARE NOT DEFINITELY LOCATED, THE INFORMATION SHALL BE OBTAINED FROM THE OWNER OR AUTHORIZED REPRESENTATIVE.   |
| 2.            | UNLESS OTHERWISE INDICATED, PROVIDE COMPLETE AND OPERATIONAL MECHANICAL SYSTEMS INCLUDING ALL NECESSARY MATERIAL, LABOR, AND EQUIPMENT.  |
| 3.            | UNLESS OTHERWISE INDICATED, PROVIDE CONTROL WIRING FOR ALL MECHANICAL SYSTEM EQUIPMENT. INSTALL PER N.E.C.   |
| 4.            | ALL EQUIPMENT AND MATERIAL SHALL BE LABELED AND LISTED AND INSTALLED IN ACCORDANCE WITH THEIR LISTING.   |
| 5.            | THE CONTRACTOR SHALL OBTAIN ALL REQUIRED PERMITS AND ARRANGE FOR ALL REQUIRED INSPECTIONS IN ACCORDANCE WITH STATE AND LOCAL GOVERNING AUTHORITIES.  |
| 6.            | ALL WORK SHALL BE DONE WITH LICENSED WORKMEN IN ACCORDANCE WITH STATE AND LOCAL GOVERNING AUTHORITIES.   |
| 7.            | THE TERM "INDICATED" SHALL MEAN "AS SHOWN ON CONTRACT DOCUMENTS (SPECIFICATIONS, DRAWINGS, AND RELATED ATTACHMENTS)."  |
| 8.            | THE TERM "PROVIDE" SHALL MEAN "TO FURNISH, INSTALL, AND CONNECT COMPLETELY."   |
| 9.            | SUBMIT FOR REVIEW, DETAILED SHOP DRAWINGS OF ALL EQUIPMENT AND MATERIAL REQUIRED TO COMPLETE THE WORK. NO MATERIAL OR EQUIPMENT MAY BE DELIVERED TO THE JOBSITE OR INSTALLED UNTIL ACCEPTED SHOP DRAWINGS FOR THE PARTICULAR MATERIAL OR EQUIPMENT HAS BEEN APPROVED BY THE OWNER OR HIS AUTHORIZED REPRESENTATIVE. WHERE THE CONTRACTOR PROPOSES TO USE AN ITEM OF EQUIPMENT OTHER THAN THAT SPECIFIED OR DETAILED ON THE DRAWINGS, WHICH REQUIRES ANY REDESIGN OF THE STRUCTURE, PARTITIONS, FOUNDATIONS, PIPING, WIRING, OR ANY OTHER PART OF THE MECHANICAL, ELECTRICAL, OR ARCHITECTURAL LAYOUT, ALL SUCH REDESIGN AND ALL NEW DRAWINGS, AND DETAILING REQUIRED, THEREFORE, SHALL BE PREPARED AT THE CONTRACTOR'S EXPENSE, AND IS SUBJECT TO THE REVIEW AND APPROVAL OF THE OWNER OR HIS AUTHORIZED REPRESENTATIVE. OWNER RESERVES THE RIGHT TO HAVE THE ARCHITECT OR ENGINEER OF HIS CHOICE PREPARE ANY REDESIGN WORK. |
| 10.           | MECHANICAL PLANS AND DETAILS DO NOT SHOW ALL INTERFERENCES AND CONDITIONS, VISIBLE AND/OR HIDDEN, THAT MAY EXIST; THUS, REQUIRING THE CONTRACTOR TO INSPECT AND SURVEY THE SPACE BEFORE PERFORMING THE WORK.   |
| 11.           | CONTRACTOR SHALL COORDINATE ELECTRICAL REQUIREMENTS OF MECHANICAL EQUIPMENT WITH DIVISION 16.  |
| 12.           | TURN OVER TO THE OWNER ALL MANUFACTURER'S WARRANTIES FOR EQUIPMENT AND MATERIALS PROVIDED.   |
| 13.           | THE CONTRACTOR MAY SUBSTITUTE EQUIPMENT OF ANOTHER MANUFACTURER IF IT IS OF EQUAL QUALITY AND RATING, SUBJECT TO OWNER'S AND ENGINEER'S REVIEW AND ACCEPTANCE. WHERE CONTRACTOR SUBSTITUTES EQUIPMENT PROVIDING A DIFFERENT SYSTEM CONFIGURATION, HE SHALL BE RESPONSIBLE FOR PROVIDING INSTALLATION SHOP DRAWINGS AND ALL RELATED ACCESSORY EQUIPMENT FOR A COMPLETE SYSTEM INSTALLATION.   |
| 14.           | BEFORE SELECTING MATERIAL AND EQUIPMENT AND PROCEEDING WITH WORK, INSPECT AREAS WHERE MATERIAL AND EQUIPMENT ARE TO BE INSTALLED TO INSURE SUITABILITY, AND CHECK NEEDED SPACE FOR PLACEMENT AND CLEARANCES.   |
| 15.           | BEFORE CUTTING OR DRILLING INTO BUILDING ELEMENTS, INSPECT AND LAYOUT WORK TO AVOID DAMAGING STRUCTURAL ELEMENTS AND BUILDING UTILITIES.   |
| 16.           | ALL WORK SHALL BE DONE IN ACCORDANCE WITH (THE LATEST ADOPTED):<br>A. CONNECTICUT BUILDING CODE AND SUPPLEMENTS<br>B. INTERNATIONAL PLUMBING CODE<br>C. INTERNATIONAL MECHANICAL CODE<br>D. INTERNATIONAL ENERGY CONSERVATION CODE<br>E. ANSI STANDARDS  |
| 17.           | LOCATE ALL EQUIPMENT WHICH REQUIRES SERVICING IN FULLY ACCESSIBLE POSITIONS. IF REQUIRED FOR BETTER ACCESSIBILITY, FURNISH ACCESS DOORS FOR THE PURPOSE. MINOR DEVIATIONS FROM DRAWINGS MAYBE MADE TO ALLOW FOR BETTER ACCESSIBILITY. ANY CHANGE SHALL BE SUBMITTED TO THE OWNER OR HIS AUTHORIZED REPRESENTATIVE FOR REVIEW.  |
| 18.           | ASCERTAIN FROM EXAMINATION OF THE DRAWINGS, ANY SPECIAL TEMPORARY OPENINGS IN THE BUILDING REQUIRED FOR THE ADMISSION OF APPARATUS PROVIDED UNDER THIS DIVISION. NOTIFY THE OWNER ACCORDINGLY. IN THE EVENT OF FAILURE TO GIVE SUFFICIENT NOTICE TO THE CONTRACTOR IN TIME TO ARRANGE FOR OPENINGS DURING CONSTRUCTION, ASSUME ALL COSTS OF PROVIDING SUCH OPENINGS THEREAFTER. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL ASSEMBLY AND DISASSEMBLY OF EQUIPMENT AS REQUIRED TO PLACE EQUIPMENT IN ITS FINAL LOCATION.  |
| 19.           | UNLESS OTHERWISE INDICATED, PROVIDE 14 GAUGE GALVANIZED PIPE SLEEVES TWO (2) SIZES LARGER THAN THE PIPE OR INSULATION WHERE SUCH ASSEMBLIES PENETRATE WALLS, PARTITIONS, FLOORS, OR STRUCTURAL MEMBERS.  |
| 20.           | ALL VOIDS BETWEEN PIPE SLEEVES AND PIPES SHALL BE FILLED WITH A FIRE TESTED AND APPROVED ELASTOMERIC CAULKING MATERIAL.  |
| 21.           | UNLESS OTHERWISE INDICATED, SUPPORT PIPES WITH HANGER SPACING IN ACCORDANCE WITH THE INTERNATIONAL MECHANICAL CODE.  |
| 22.           | CONTRACTOR SHALL MAKE ADEQUATE PROVISIONS FOR PIPE EXPANSION, CONTRACTION, SLOPE, AND ANCHORAGE.   |
| 23.           | ALL DUCTWORK SHALL BE INSTALLED IN ACCORDANCE WITH SMACNA STANDARDS.   |
| 24.           | PROVIDE PIPE/DUCT INSULATION PER THE CURRENT IECC REQUIREMENTS.  |
| 25.           | PROVIDE EQUIPMENT/PIPING/DUCTWORK LABELING, COMPLY WITH ANSI A13.1 FOR LETTERING SIZE, LENGTH OF COLOR FIELD, COLORS, AND VIEWING ANGLES OF DEVICES.   |
| 26.           | GALVANIZED SHEET STEEL: LOCK-FORMING QUALITY, ASTM A 527, COATING DESIGNATION G 90. PROVIDE MILL PHOSPHATIZED FINISH FOR EXPOSED SURFACES OF DUCTS EXPOSED TO VIEW.  |

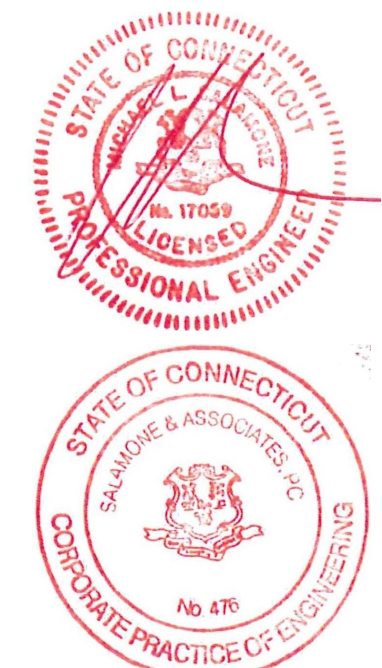



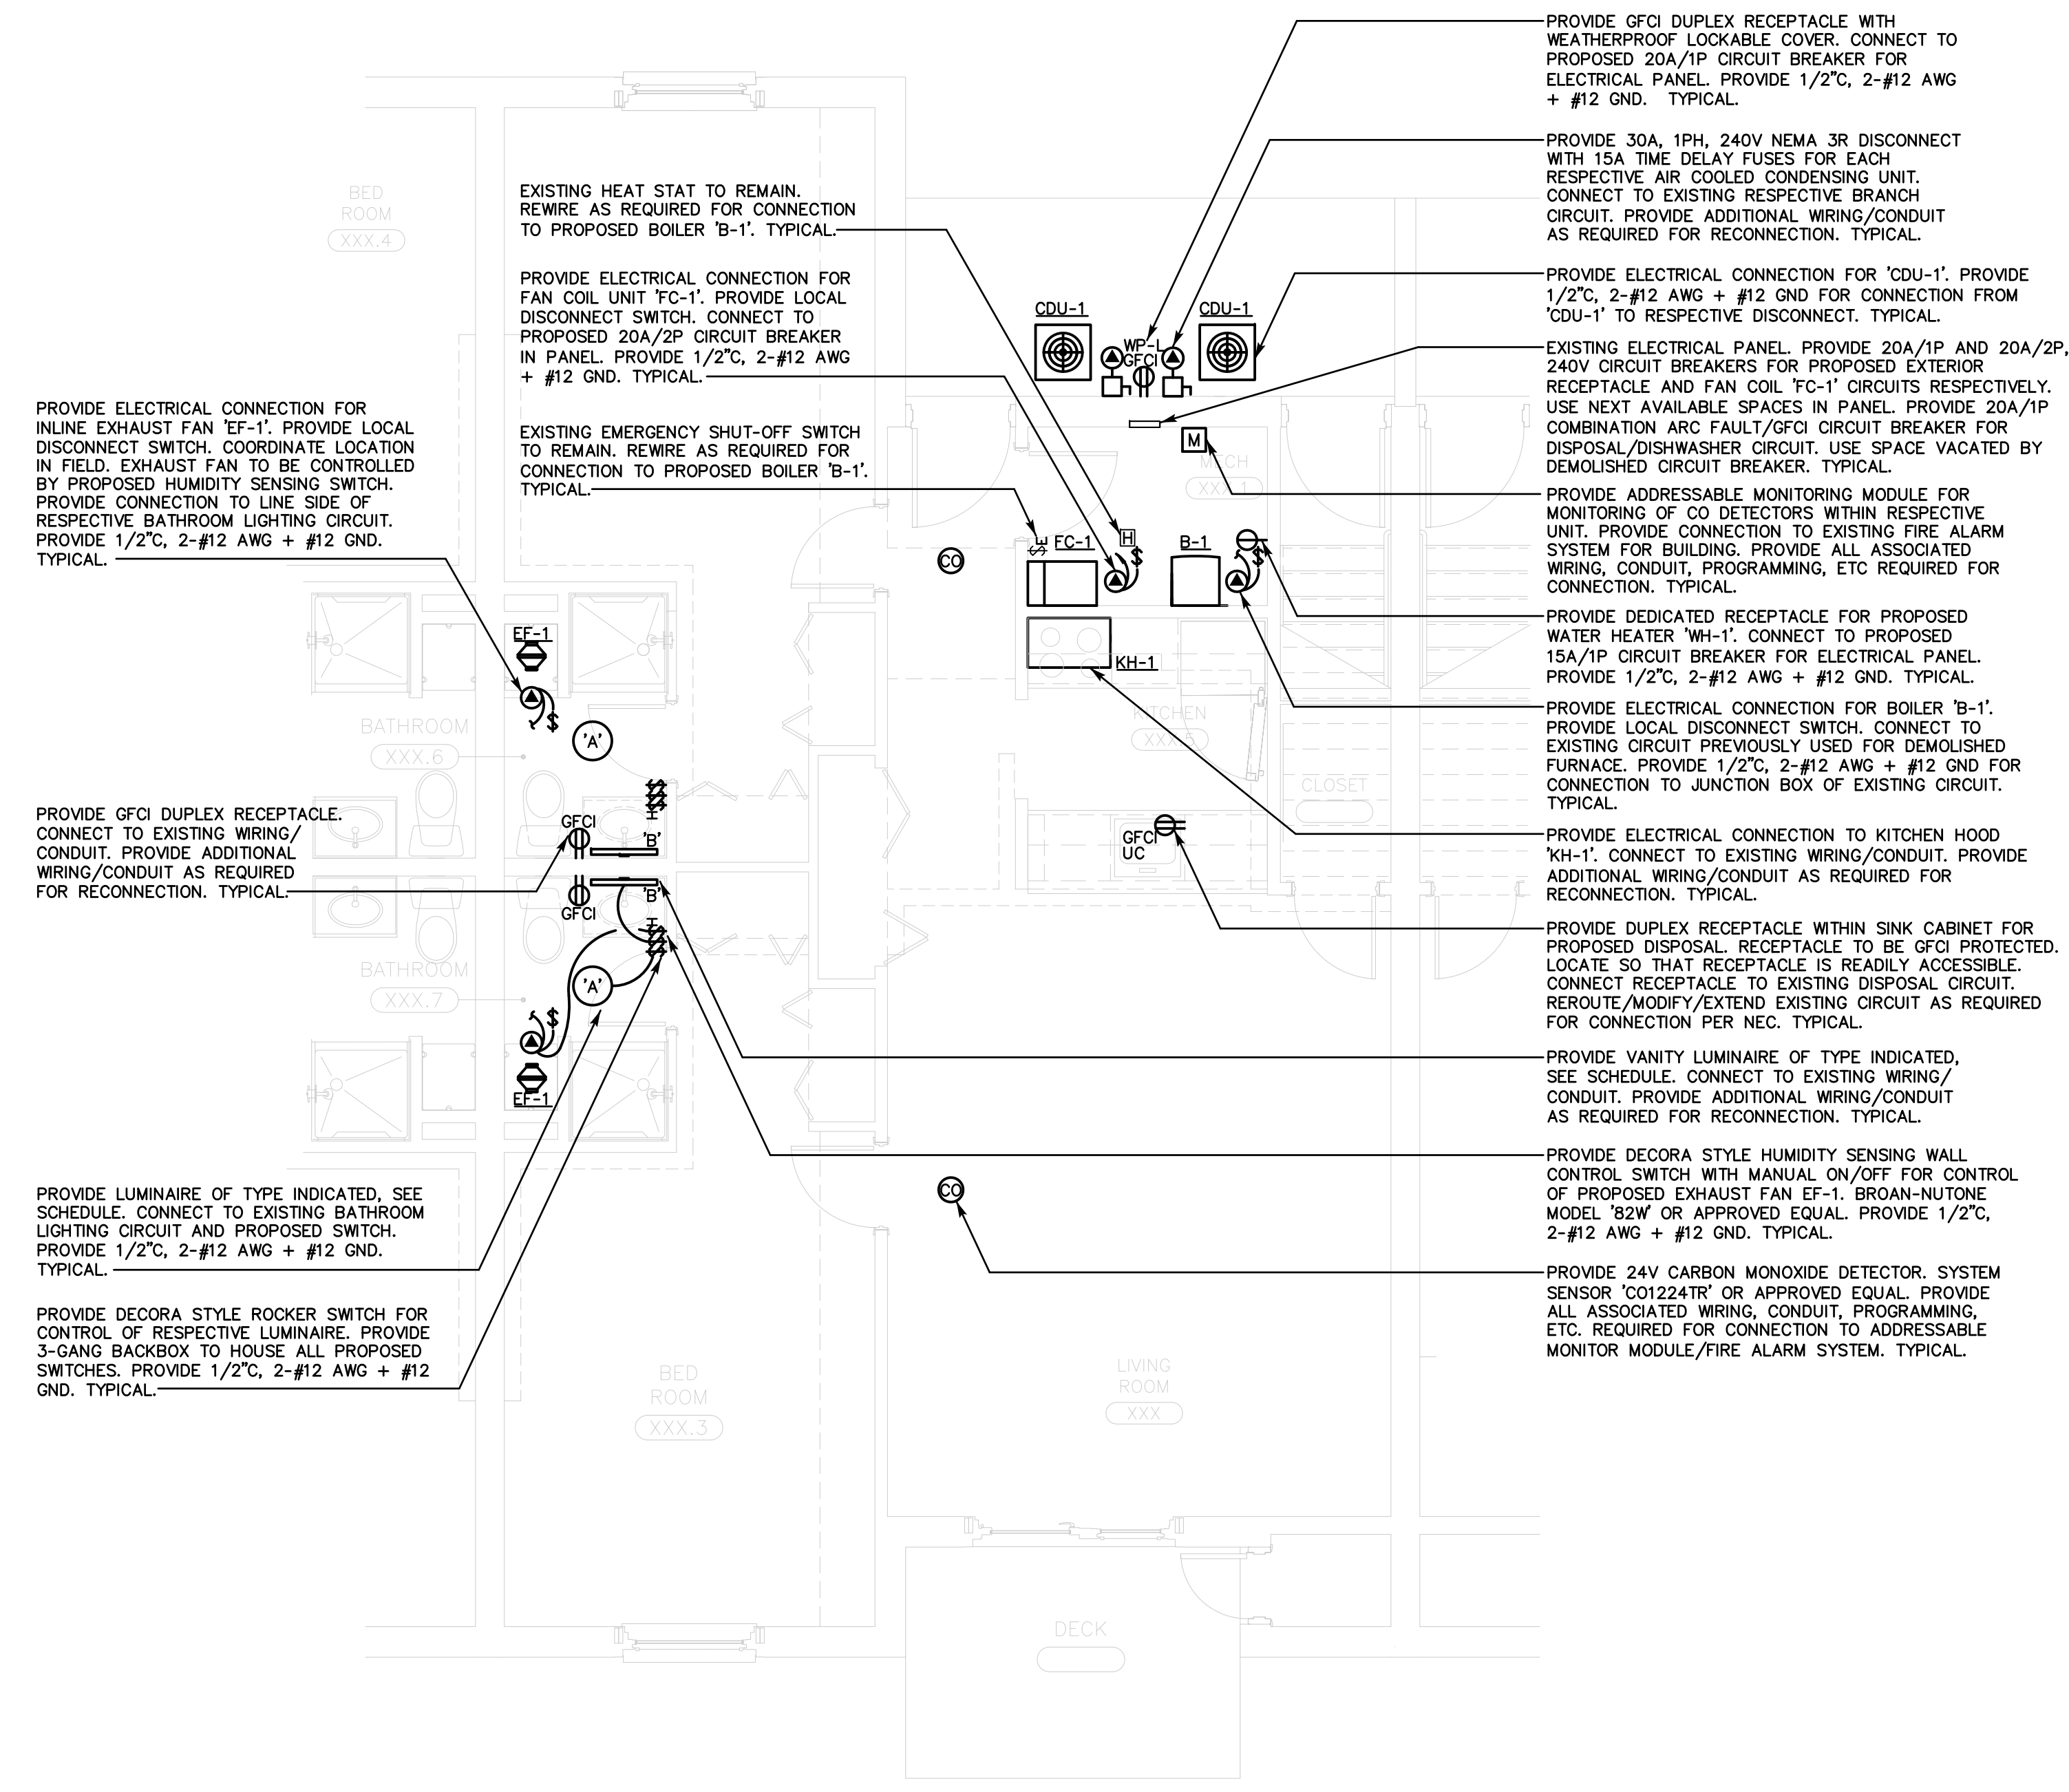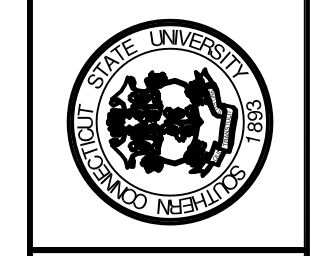

**1 PARTIAL FIRST FLOOR ELECTRICAL PLAN - TYPICAL UNIT**  
 SCALE: 1/4" = 1'-0" LAYOUT AS SHOWN OR OPPOSITE HAND, SEE BUILDING PLANS FOR LAYOUTS FOR SPECIFIC UNIT NUMBERS

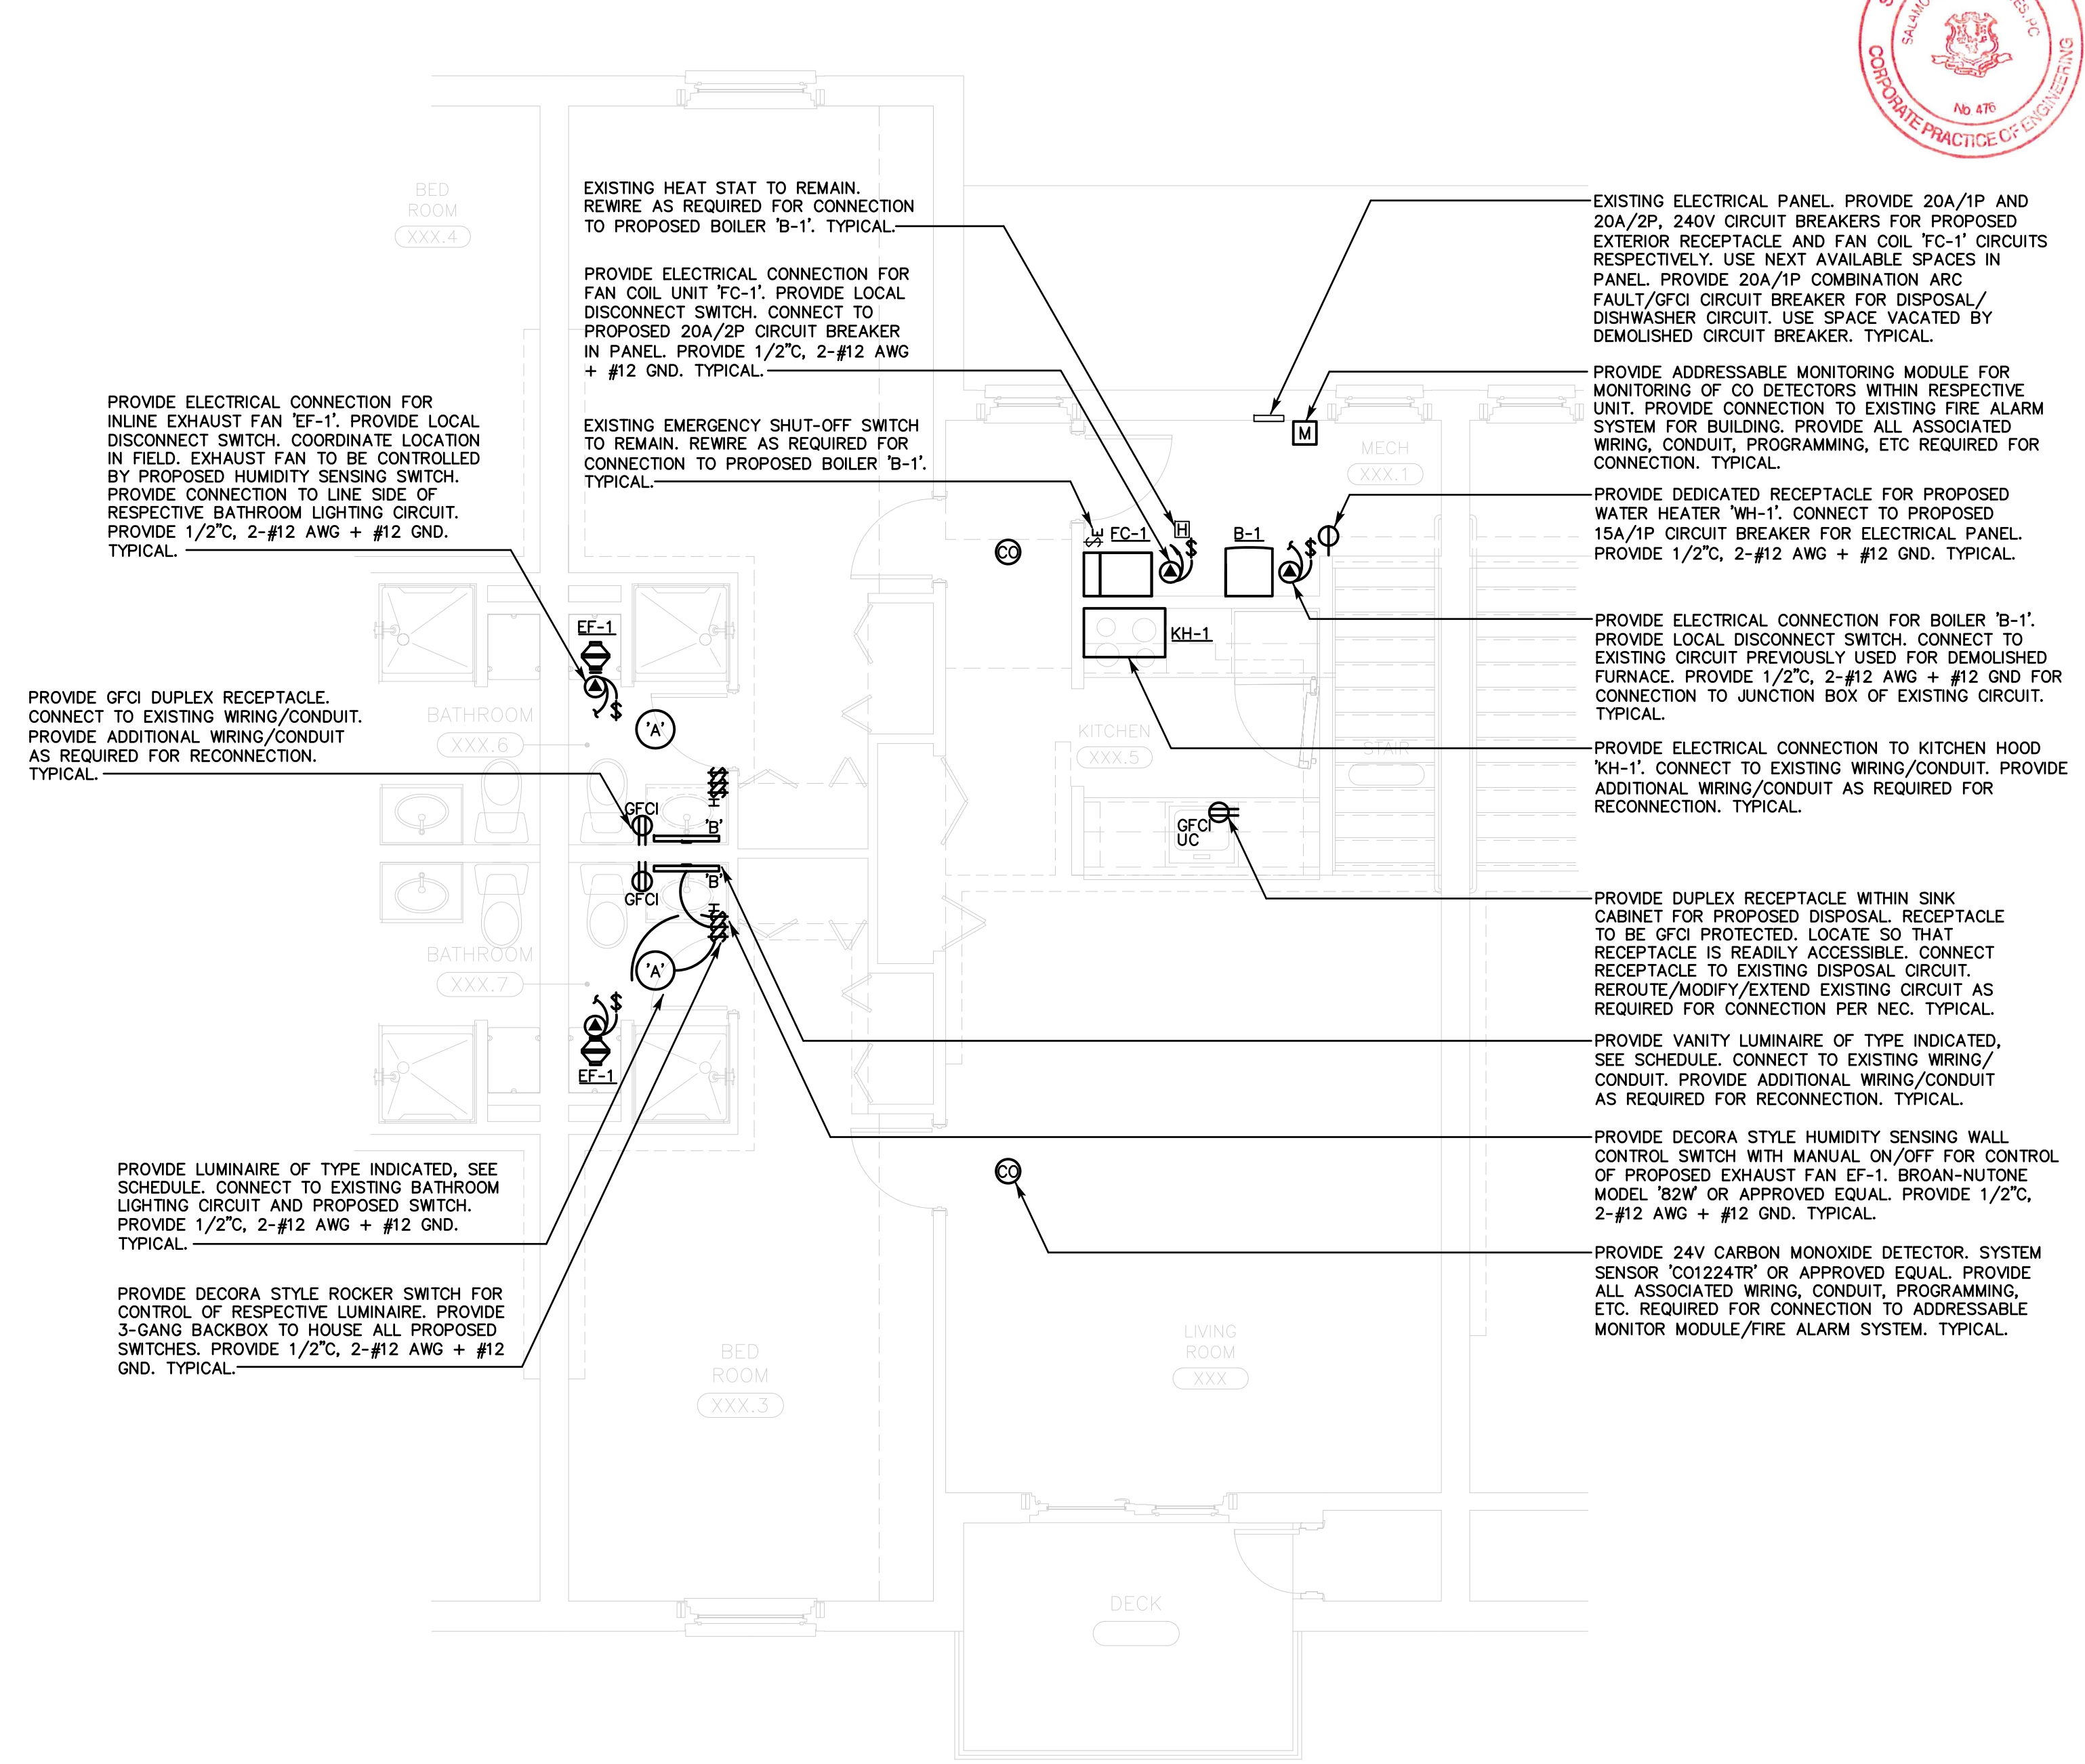

**2 PARTIAL SECOND FLOOR ELECTRICAL PLAN - TYPICAL UNIT**  
 SCALE: 1/4" = 1'-0" LAYOUT AS SHOWN OR OPPOSITE HAND, SEE BUILDING PLANS FOR LAYOUTS FOR SPECIFIC UNIT NUMBERS




LUMINAIRE SCHEDULE					
LTC. CODE	DESCRIPTIONS	VOLTS	CATALOG NO. / MANUFACTURER	MOUNTING	LAMPING
A	14"W X 2.5"H SURFACE MOUNTED, HIGH EFFICIENCY LED LUMINAIRE. NOMINAL 1100 LUMEN OUTPUT, 3000K COLOR TEMP. 80CRI. HIGH TRANSMISSION WHITE ACRYLIC DIFFUSER. COLD ROLLED STEEL HOUSING. SATIN FINISH. 5 YEAR WARRANTY. UL LISTED DAMP LOCATIONS.	120	DC336D-3000K-62  SUNPARK	SURFACE/ CEILING	LED
B	24" HIGH EFFICIENCY LED VANITY LUMINAIRE. NOMINAL 2110 LUMEN OUTPUT, 3000K COLOR TEMP. 80CRI. HIGH TRANSMISSION WHITE ACRYLIC DIFFUSER. COLD ROLLED STEEL HOUSING. SATIN FINISH. 5 YEAR WARRANTY. UL LISTED DAMP LOCATIONS.	120	FL5524D-3000K-B-62  SUNPARK	WALL/ VANITY	LED

ELECTRICAL SYMBOL LIST	
	DUPLEX RECEPTACLE GFCI - GROUND FAULT CIRCUIT INTERRUPTER IG - ISOLATED GROUND WP - WEATHERPROOF L - LOCKABLE COVER
	SWITCH (NONE) - SINGLE POLE 2 - TWO POLE 3 - THREE WAY 4 - FOUR WAY D - DIMMER TOL - THERMAL OVERLOAD PROTECTION DEVICE VS - VACANCY SENSOR
	SPECIAL PURPOSE CONNECTION
	DISCONNECT SWITCH
	BRANCH CIRCUIT HOMERUN (ARROWS INDICATE CIRCUIT NUMBERS)

ELECTRICAL ABBREVIATIONS	
A	AMPERES
A.F.F.	ABOVE FINISHED FLOOR
AWG	AMERICAN WIRE GAUGE
C	CONDUIT
CIR	CIRCUIT
G	GROUNDING
NEC	NATIONAL ELECTRIC CODE
NEMA	NATIONAL ELECTRICAL MANUFACTURERS ASS.
P	POLE
UL	UNDERWRITER'S LABORATORY
V	VOLTS
VA	VOLT-AMPERES
W	WATTS
#	WIRE SIZE IN AWG, OR MCM WHEN INDICATED

- ### ELECTRICAL GENERAL NOTES
- PROVIDE A COMPLETE AND OPERATIONAL ELECTRICAL SYSTEM INCLUDING ALL NECESSARY MATERIAL, LABOR AND EQUIPMENT.
  - ELECTRICAL PLANS AND DETAILS AND ONE LINE DIAGRAMS SHOW THE GENERAL LOCATION AND ARRANGEMENT OF THE ELECTRICAL SYSTEM. THEY ARE DIAGRAMMATIC AND DO NOT SHOW ALL CONDUIT BODIES, CONNECTORS, BENDS, FITTINGS, HANGERS AND ADDITIONAL PULL AND JUNCTION BOXES.
  - ALL EQUIPMENT AND MATERIAL SHALL BE LABELED, LISTED AND INSTALLED IN ACCORDANCE WITH THEIR LISTING.
  - THE CONTRACTOR SHALL OBTAIN ALL REQUIRED PERMITS AND ARRANGE FOR ALL REQUIRED INSPECTIONS IN ACCORDANCE WITH STATE AND LOCAL GOVERNING AUTHORITIES.
  - ALL WORK SHALL BE DONE WITH LICENSED WORKMEN IN ACCORDANCE WITH STATE AND LOCAL GOVERNING AUTHORITIES.
  - THE DEFINITION OF ELECTRICAL TERMS USED SHALL BE AS DEFINED IN THE 2017 CURRENT EDITION OF THE NATIONAL ELECTRICAL CODE (NEC).
  - THE TERM "INDICATED" SHALL MEAN "AS SHOWN ON CONTRACT DOCUMENTS (SPECIFICATIONS, DRAWINGS AND RELATED ATTACHMENTS)".
  - THE TERM "PROVIDE" SHALL MEAN "TO FURNISH, INSTALL AND CONNECT COMPLETELY".
  - THE TERM "SIZE" SHALL MEAN ONE OR MORE OF THE FOLLOWING: "LENGTH, CURRENT AND VOLTAGE RATING, NUMBER OF POLES, NEMA SIZE AND OTHER SIMILAR ELECTRICAL CHARACTERISTICS".
  - THE TERM "SPACE" ON PANELBOARD AND SWITCHBOARD SCHEDULES SHALL MEAN "PROVIDE SPACE TO INSTALL THE NUMBER OF POLES AND SIZE OF THE PROTECTIVE DEVICE INDICATED WITH ALL NECESSARY BUS AND FITTINGS TO INSTALL THE DEVICE AT SOME FUTURE DATE".
  - ELECTRICAL PLANS AND DETAILS DO NOT SHOW ALL INTERFERENCES AND CONDITIONS, VISIBLE AND/OR HIDDEN, THAT MAY EXIST; THUS REQUIRING THE CONTRACTOR TO INSPECT AND SURVEY THE SPACE BEFORE PERFORMING THE WORK.
  - COORDINATE ELECTRICAL WORK WITH OWNER.
  - COORDINATE ELECTRICAL WORK WITH OTHER DIVISIONS OF THIS PROJECT.
  - TURN OVER TO THE OWNER ALL MANUFACTURERS WARRANTIES FOR EQUIPMENT AND MATERIAL PROVIDED.
  - UNLESS OTHERWISE INDICATED, ALL ELECTRICAL EQUIPMENT HAS BEEN BASED ON GENERAL ELECTRIC PRODUCTS.
  - THE CONTRACTOR MAY SUBSTITUTE EQUIPMENT OF ANOTHER MANUFACTURER IF IT IS OF EQUAL QUALITY AND RATING, SUBJECT TO OWNER'S AND ENGINEER'S REVIEW AND ACCEPTANCE.
  - UNLESS OTHERWISE INDICATED, ALL ENCLOSURES FOR EQUIPMENT PROVIDED SHALL BE NEMA TYPE 1.
  - UNLESS OTHERWISE INDICATED, ALL CONDUCTORS TO BE COPPER THHN/THWN-2.
  - UNLESS OTHERWISE INDICATED, ALL OUTLET AND SWITCH BOXES TO BE CAST IRON WITH THREADED HUBS.
  - IN INTERIOR PROTECTED LOCATIONS, OUTLET AND SWITCH BOXES MAY BE STEEL.
  - UNLESS OTHERWISE INDICATED, PROVIDE HEAVY-DUTY GRADE, 20 AMPERE DECORA STYLE RECEPTACLES AND SWITCHES AND ASSOCIATED WALL PLATES. DEVICE AND WALL PLATES COLOR SHALL BE WHITE. PLATES FOR SURFACE MOUNTED INTERIOR BOXES IN UNFINISHED AREAS SHALL BE STAMPED STEEL. PLATES EXPOSED TO WEATHER OR WATER TO BE GASKETED, WEATHERPROOF TYPE.
  - BEFORE SELECTING MATERIAL AND EQUIPMENT, AND PROCEEDING WITH WORK, INSPECT AREAS WHERE MATERIAL AND EQUIPMENT ARE TO BE INSTALLED TO INSURE SUITABILITY, AND CHECK NEEDED SPACE FOR PLACEMENT, CLEARANCES AND INTERCONNECTIONS.
  - BEFORE CUTTING OR DRILLING INTO BUILDING ELEMENTS, INSPECT AND LAYOUT WORK TO AVOID DAMAGING STRUCTURAL ELEMENTS AND BUILDING UTILITIES.
  - ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE 2017 NATIONAL ELECTRIC CODE (NEC) ANSI/NFPA 70 WITH STATE OF CONNECTICUT AMENDMENTS.
  - THE MEASUREMENT FROM ABOVE FINISHED FLOOR (AFF) SHALL BE TAKEN FROM THE FINISHED FLOOR SURFACE TO THE TOP OF WALL RECEPTACLES AND SWITCH BOXES; TO THE CENTER LINE OF WALL LIGHTING OUTLET BOXES, TO THE TOP OF WALL MOUNTED EQUIPMENT ENCLOSURES, TO THE CENTER LINE OF THE TOP MOST SWITCH HANDLE, OR TO THE LOWEST SURFACE OF CEILING LIGHTING FIXTURES OTHER CEILING MOUNTED EQUIPMENT.
  - UNLESS OTHERWISE INDICATED, ALL CONDUCTORS ARE NO. 12 AWG.
  - CONDUIT SIZE FOR INDICATED CONDUCTORS SHALL BE BASED ON CHAPTER 9 OF NEC.
  - UTILIZE LIQUIDTIGHT FLEXIBLE METAL CONDUIT FOR CONNECT TO EQUIPMENT LOCATED OUTDOORS OR IN DAMP LOCATIONS. MAXIMUM LENGTH OF SIX (6) FEET.
  - ALL WIRING AND CONDUIT SHALL BE CONCEALED BEHIND FINISHED SURFACES.
  - UTILIZE FLEXIBLE METAL CONDUIT OR MC CABLE IN INTERIOR DRY LOCATIONS.
  - PROVIDED ACCEPTABLE TO AUTHORITY HAVING JURISDICTION, CONTRACTOR MAY MAY UTILIZE NONMETALLIC-SHEATHED CABLE IN CONCEALED INTERIOR SPACES ONLY.
  - THE CONTRACTOR MAY GROUP BRANCH CIRCUIT HOME RUN CONDUCTORS IN A SINGLE RACEWAY IN ACCORDANCE WITH NEC.
  - ALL BLANK COVER PLATES TO BE STAINLESS STEEL IN UNFINISHED AREAS ONLY.
  - REFER TO ARCHITECTURAL DRAWINGS FOR SWITCHES, RECEPTACLES AND TELE/DATA OUTLET BOXES FOR MOUNTING HEIGHTS.



SOUTHERN CONNECTICUT STATE UNIVERSITY  
FACILITIES PLANNING DEPARTMENT  
615 FITCH STREET, HAMDEN, CT. 06514 TEL. 203-392-6055



SALAMONE & ASSOCIATES, P.C.  
REGISTERED PROFESSIONAL ENGINEERS  
111 South Main Street, Suite 200  
Hamden, CT 06517  
Phone: (203) 341-0000 Fax: (203) 341-0700



NORTH CAMPUS TOWNHOUSES  
BATHROOM REPLACEMENT 2020


PROJECT NO. SCSU-2020-04

DATE: MAY, 27 2020


DRAWING TITLE: ELECTRICAL SCHEDULES, DETAILS, SYMBOLS, NOTES AND ABBREVIATIONS

CADD. NO. SHEET

E2

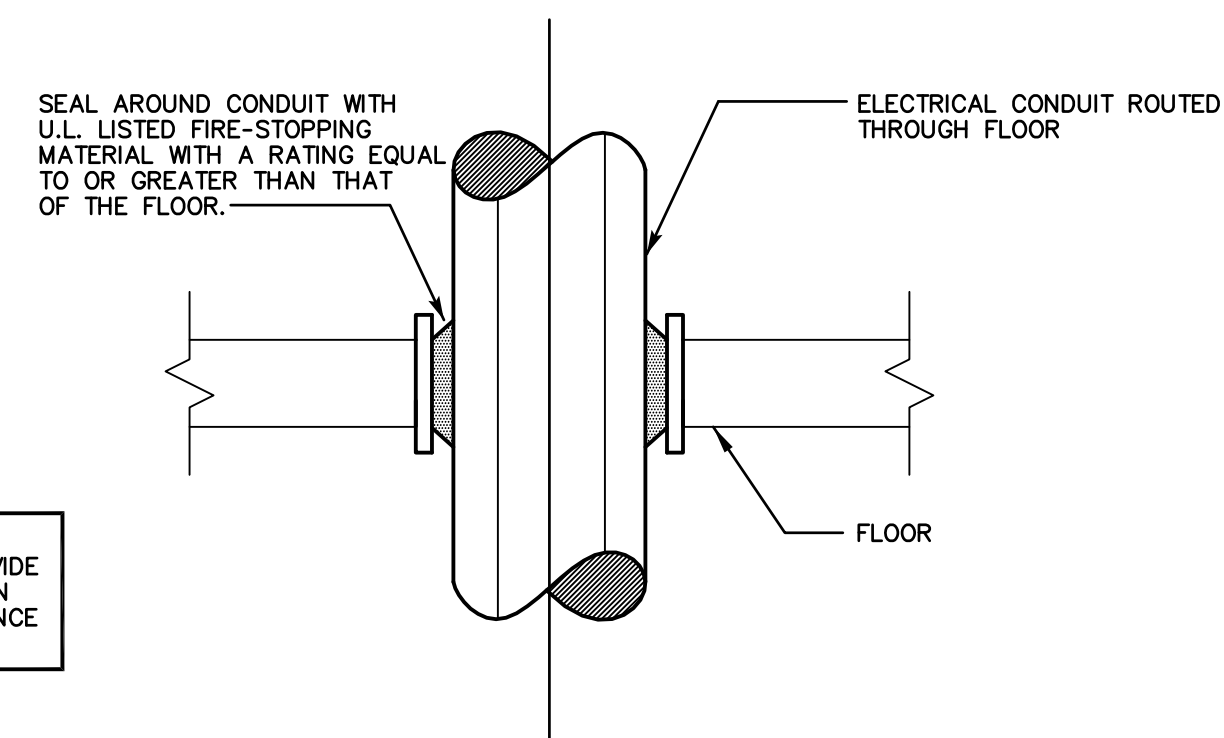

**TYPICAL CONDUIT FLOOR PENETRATION  
DETAIL (UL XHEZ C-AJ-1008)**  
SCALE: N.T.S.

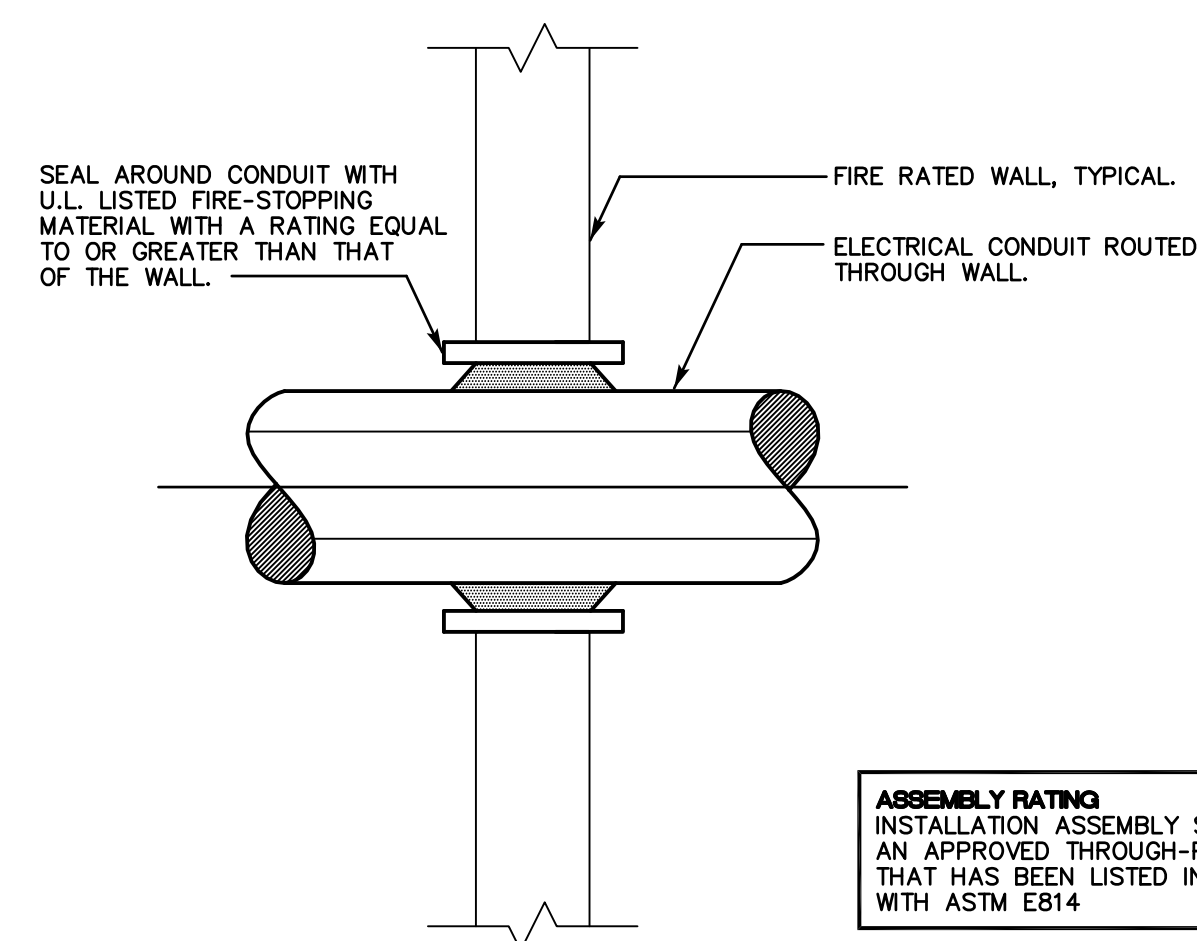

**TYPICAL CONDUIT WALL PENETRATION  
DETAIL (UL XHEZ C-AJ-1008)**  
SCALE: N.T.S.

**ASSEMBLY RATING**  
INSTALLATION ASSEMBLY SHALL PROVIDE AN APPROVED THROUGH-PENETRATION THAT HAS BEEN LISTED IN ACCORDANCE WITH ASTM E814

**ASSEMBLY RATING**  
INSTALLATION ASSEMBLY SHALL PROVIDE AN APPROVED THROUGH-PENETRATION THAT HAS BEEN LISTED IN ACCORDANCE WITH ASTM E814